


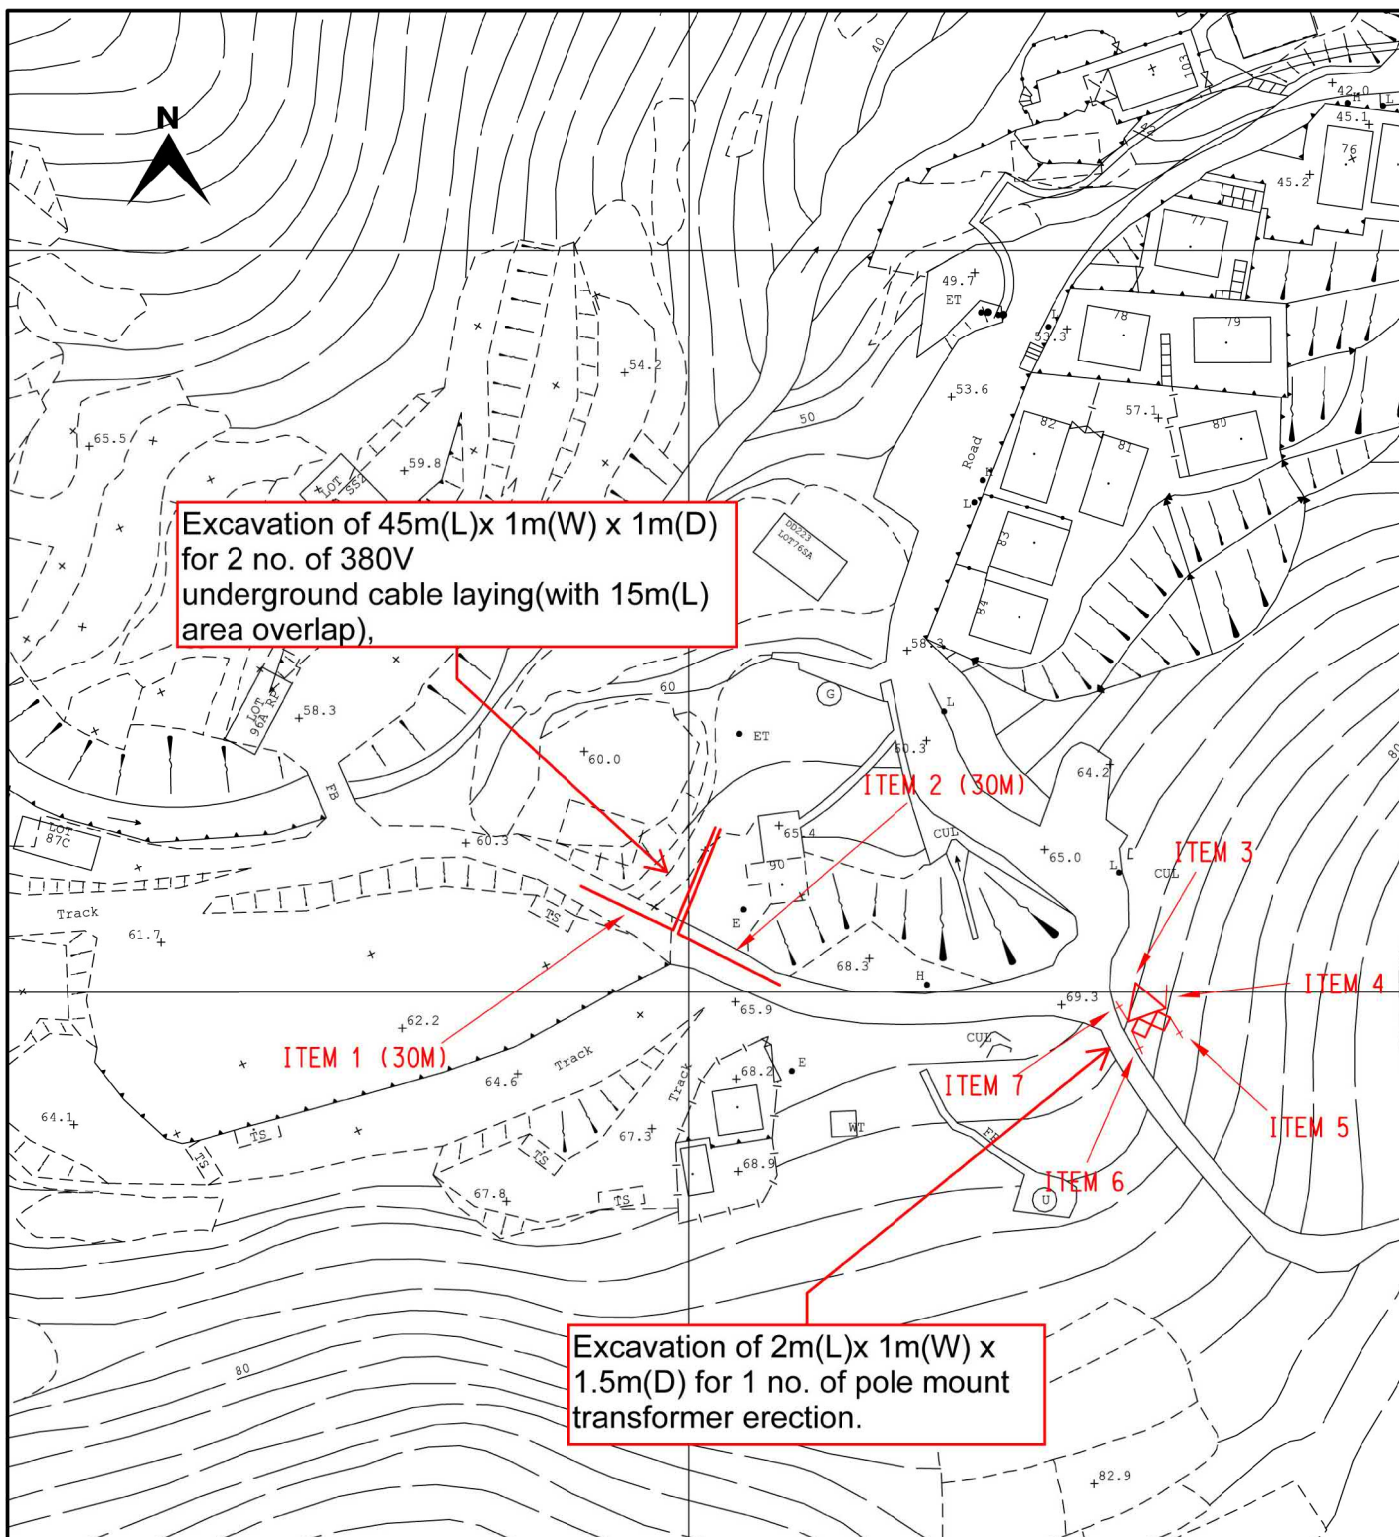

CLP 中電

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX
- EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- EXISTING POLE MOUNTED TRANSFORMER
- PROPOSED POLE MOUNTED TRANSFORMER
- PROPOSED STAY / STAY POLE
- PROPOSED 5.0M(L) x 2.39M(W) x 3.0M(H) PACKAGE SUBSTATION

TITLE : 11kV & LV CABLE LAYING, POLE ERECTION
NEAR HOUSE NO.90
MOK TSE CHE
SAI KUNG

MAP NO : 11NE05C

DRAWN : H.Y. WONG

E/O NO :

CHECKED : JIMMY ZHU

REGION : WE

C.C. : SK

DATE : 18-05-2018

PROJECT REF. : SK2017-0357

SCALE :


PLAN REF. : WESK2017-0357-02

Map data reproduced with permission of the Director of Lands. (C) Hong Kong

(資料來源 : 由申請人提供的位置圖)
(Source : Location Plan supplied by the Applicant)

參考編號
REFERENCE No.
A/SK-HC/303

繪圖
DRAWING
A-1

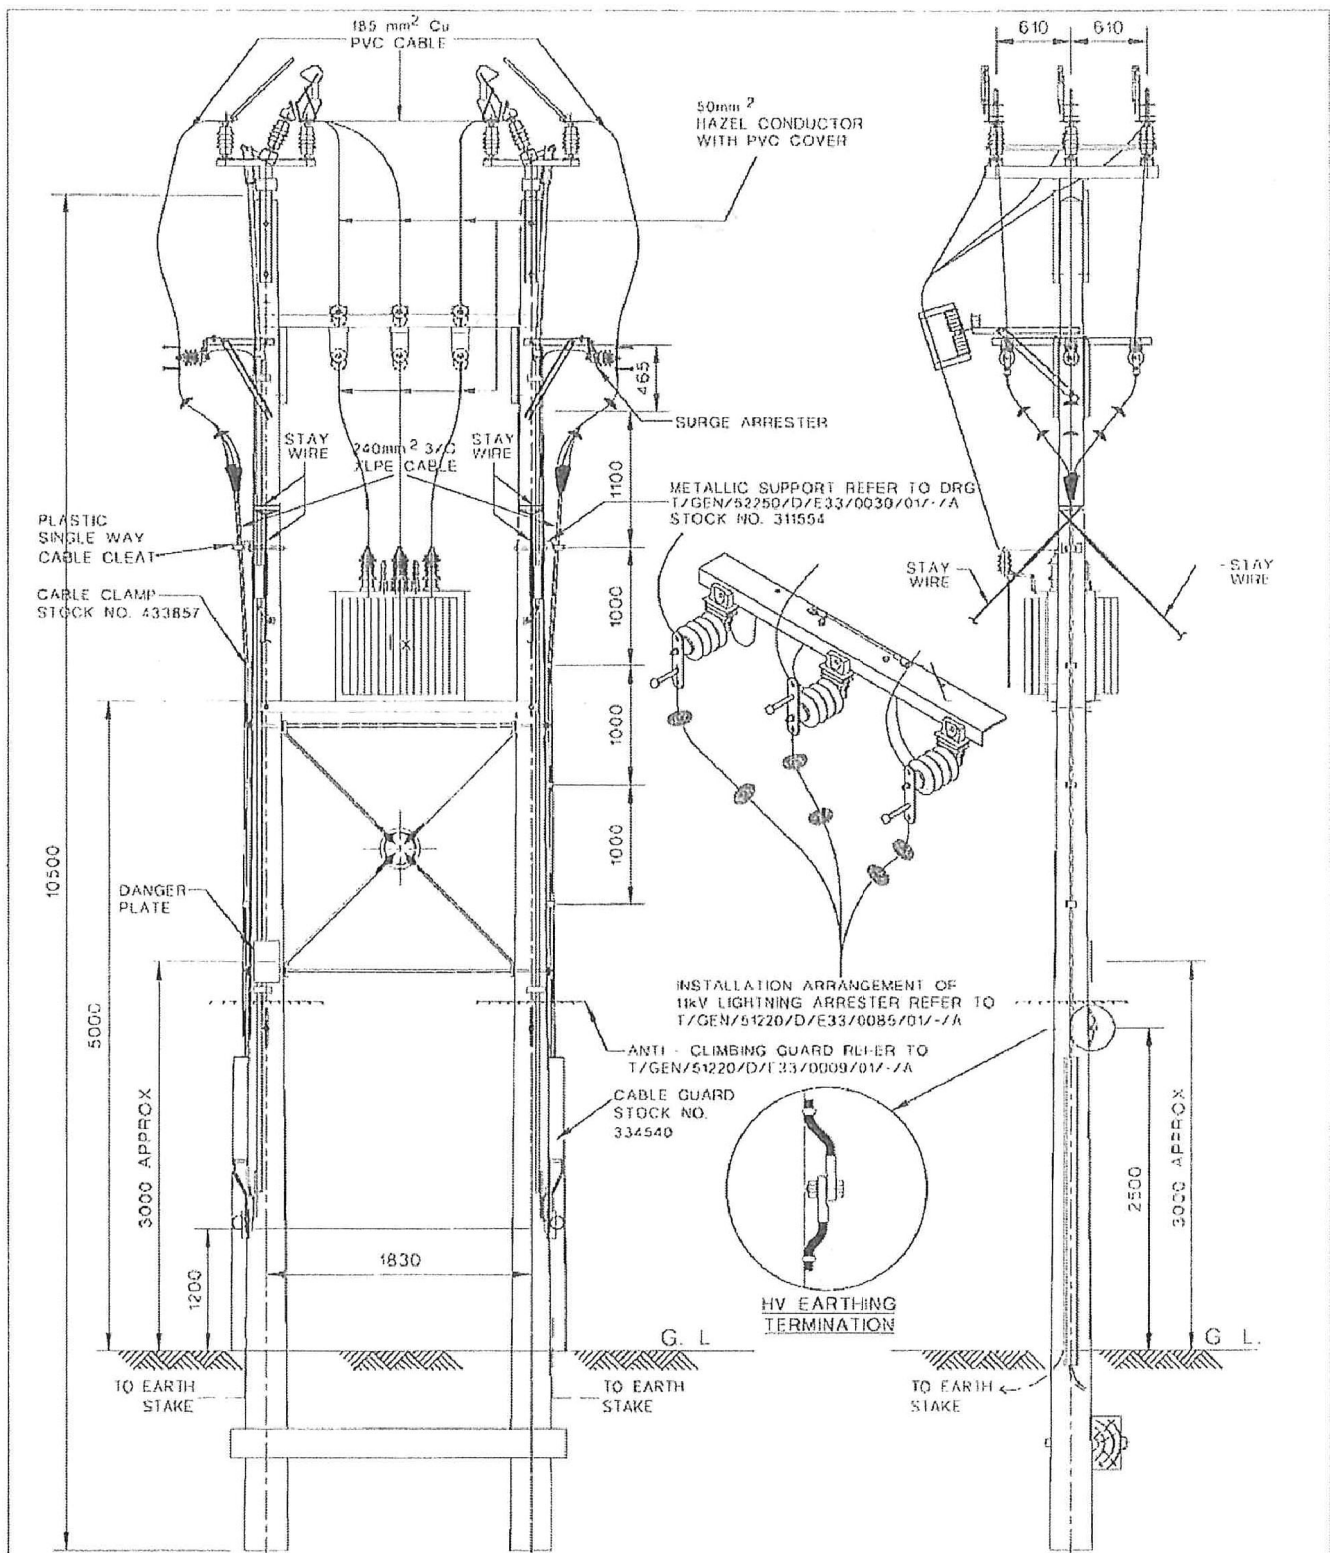

NOTES:

1. THIS CONFIGURATION WAS A REPIA OF EXISTING INSTALLATIONS PRIOR TO YEAR 2000 AS REQUESTED BY OC-OIL
2. PLEASE REFER TO THE MEMO REF : M/06510/02-06/JC/JC DATED 24/6/02 AND STRUCTURAL ENGINEER'S REPORT (MEINHARDT) ON 21/5/2002.
3. FOR OPERATION ON EQUIPMENT PLEASE REFER TO RELEVANT DSM CHAPTER.
4. FOR DETAILS OF INDIVIDUAL CONSTRUCTION PLEASE REFER TO RELEVANT STANDARD DRAWING.
5. ALL DIMENSIONS ARE IN mm.

CLP 中電

DRAWN: S.C.TO DATE: 5-5-2000
 CHECKED: C.Y.IP / F.CHOY APPROVED: K.S.YEUNG
 SCALE: NTS SHEET(S) IN SET: 1

ASSET MANAGEMENT


REVS	26202	21303									
	A	B	C	D	E	F	G	H	J	K	L
INITIAL	HCC	HCC									
TITLE											
TYPICAL LAYOUT FOR DOUBLE POLES INSTALLATION WITH TWO ISOLATORS AND FUSED TRANSFORMER FED BY CABLES											
PROJECT NO.						CONTRACT NO.					
DRG. NO. T GEN 51220 D E 33 0084 01 B A											

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

(資料來源：由申請人提供的布局設計圖)
 (Source : Layout Plan supplied by the Applicant)

參考編號
 REFERENCE No.
 A/SK-HC/303


繪圖
 DRAWING
 A-2

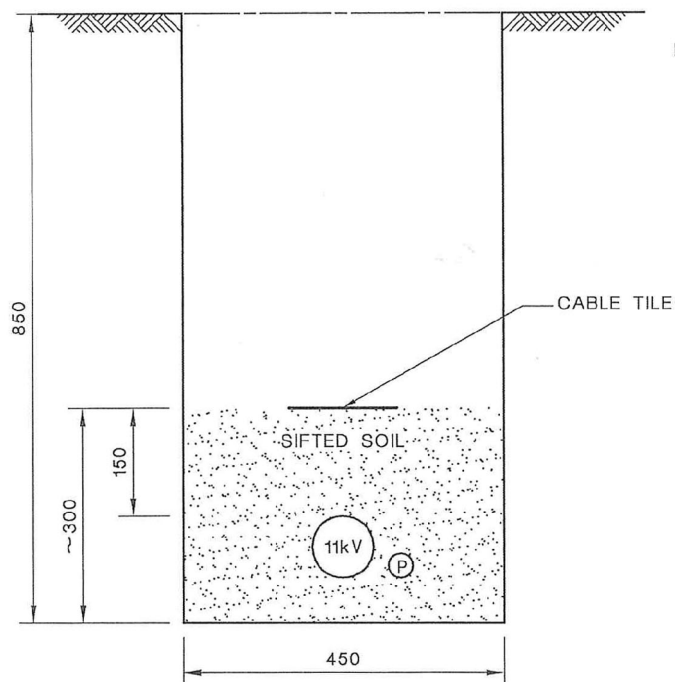

NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES TO BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm

EXISTING ARRANGEMENT OF 11kV CABLE TRENCH

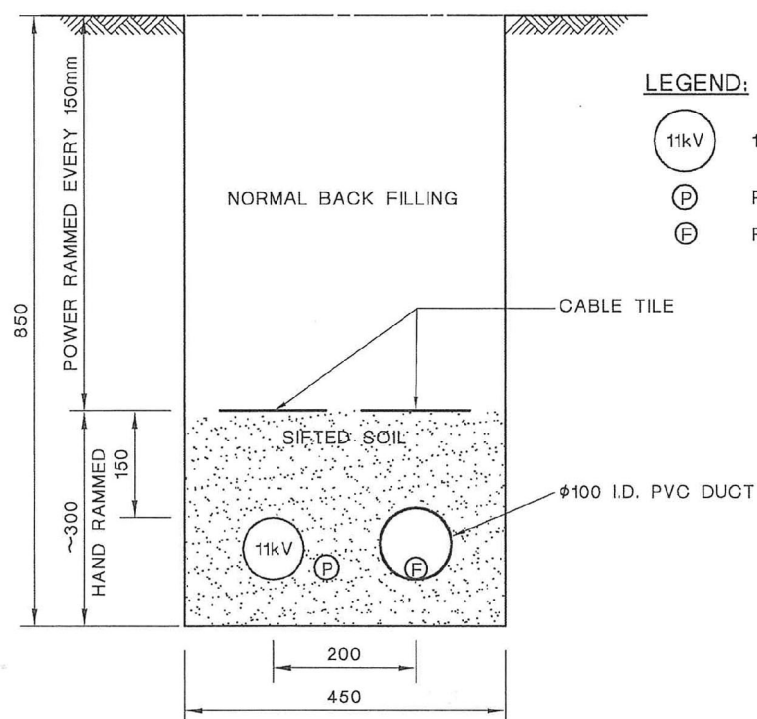

LEGEND:

- 11kV 11kV 3/C XLPE POWER CABLE
- P PILOT CABLE
- F FIBRE OPTIC CABLE

11kV CABLE TRENCH WITH FIBRE OPTIC CABLE IN PVC DUCT


D	GENERAL REVISION	C	NOTE ADDED	A	NO AMENDMENT AFTER REVIEW										
CLP 中電				REVS.	15.8.03	4.4.07	18.6.07	28.6.11							
					A	B	C	D	E	F	G	H	J	K	L
				INITIAL	C.F.YAM	Y.K.MAN	W.B.LEE	Y.K.MAN							
				TITLE : TYPICAL 11kV CABLE TRENCH WITH PILOT AND FIBRE OPTIC CABLES - TYPE II											
DRAWN: K. F. CHEUNG		DATE: 11-4-2000													
CHECKED: C. Y. IP		APPROVED: W. B. LEE													
SCALE:		SHEET(S) IN SET: 1		PROJECT NO.						CONTRACT NO.					
A S S E T M A N A G E M E N T				DRG. NO. T G E N 1 0 5 2 0 D E 3 3 0 0 0 6 0 1 D A											

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER


(資料來源 : 由申請人提供的剖視圖)
(Source : Section Plan supplied by the Applicant)

參考編號
REFERENCE No.
A/SK-HC/303

繪圖
DRAWING
A-3

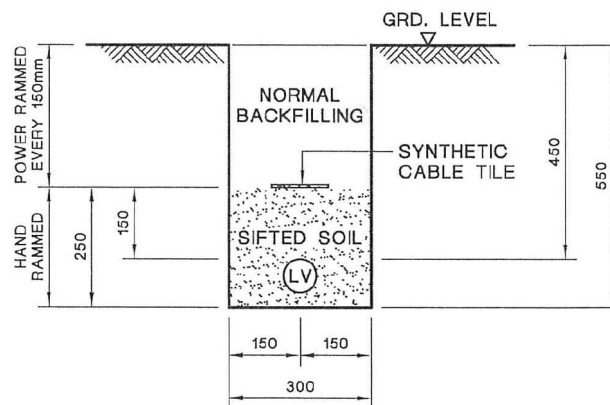

TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

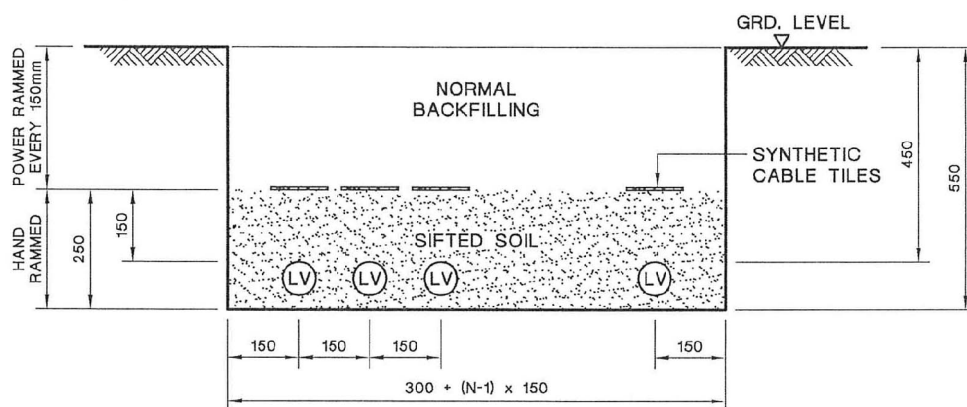

TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES

LEGEND :

- (LV) LV CABLE
N NUMBER OF CABLE CIRCUITS

NOTES:


1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.


C GENERAL REVISION		B GENERAL REVISION		A SYNTHETIC CABLE TILE SPECIFIED									
		REVS.	16-2-04	18-6-07	28-6-07								
			A	B	C	D	E	F	G	H	J	K	L
		INITIAL	C.Y.IP	W.B.LEE	Y.K.MAN								
		TITLE :											
		TYPICAL LV CABLE TRENCH											
DRAWN: S.C.T.		DATE: 15 Aug., 2003											
CHECKED: K. K. LEUNG		APPROVED: W. B. LEE											
SCALE:		SHEET(S) IN SET: 1											
		PROJECT NO.						CONTRACT NO.					
ASSET MANAGEMENT		DRG. NO. T GEN 25500 DE 33 0002 01 C A											

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

(資料來源：由申請人提供的剖視圖)
(Source : Section Plan supplied by the Applicant)

參考編號 REFERENCE No. A/SK-HC/303	繪圖 DRAWING A-4
--------------------------------------	----------------------

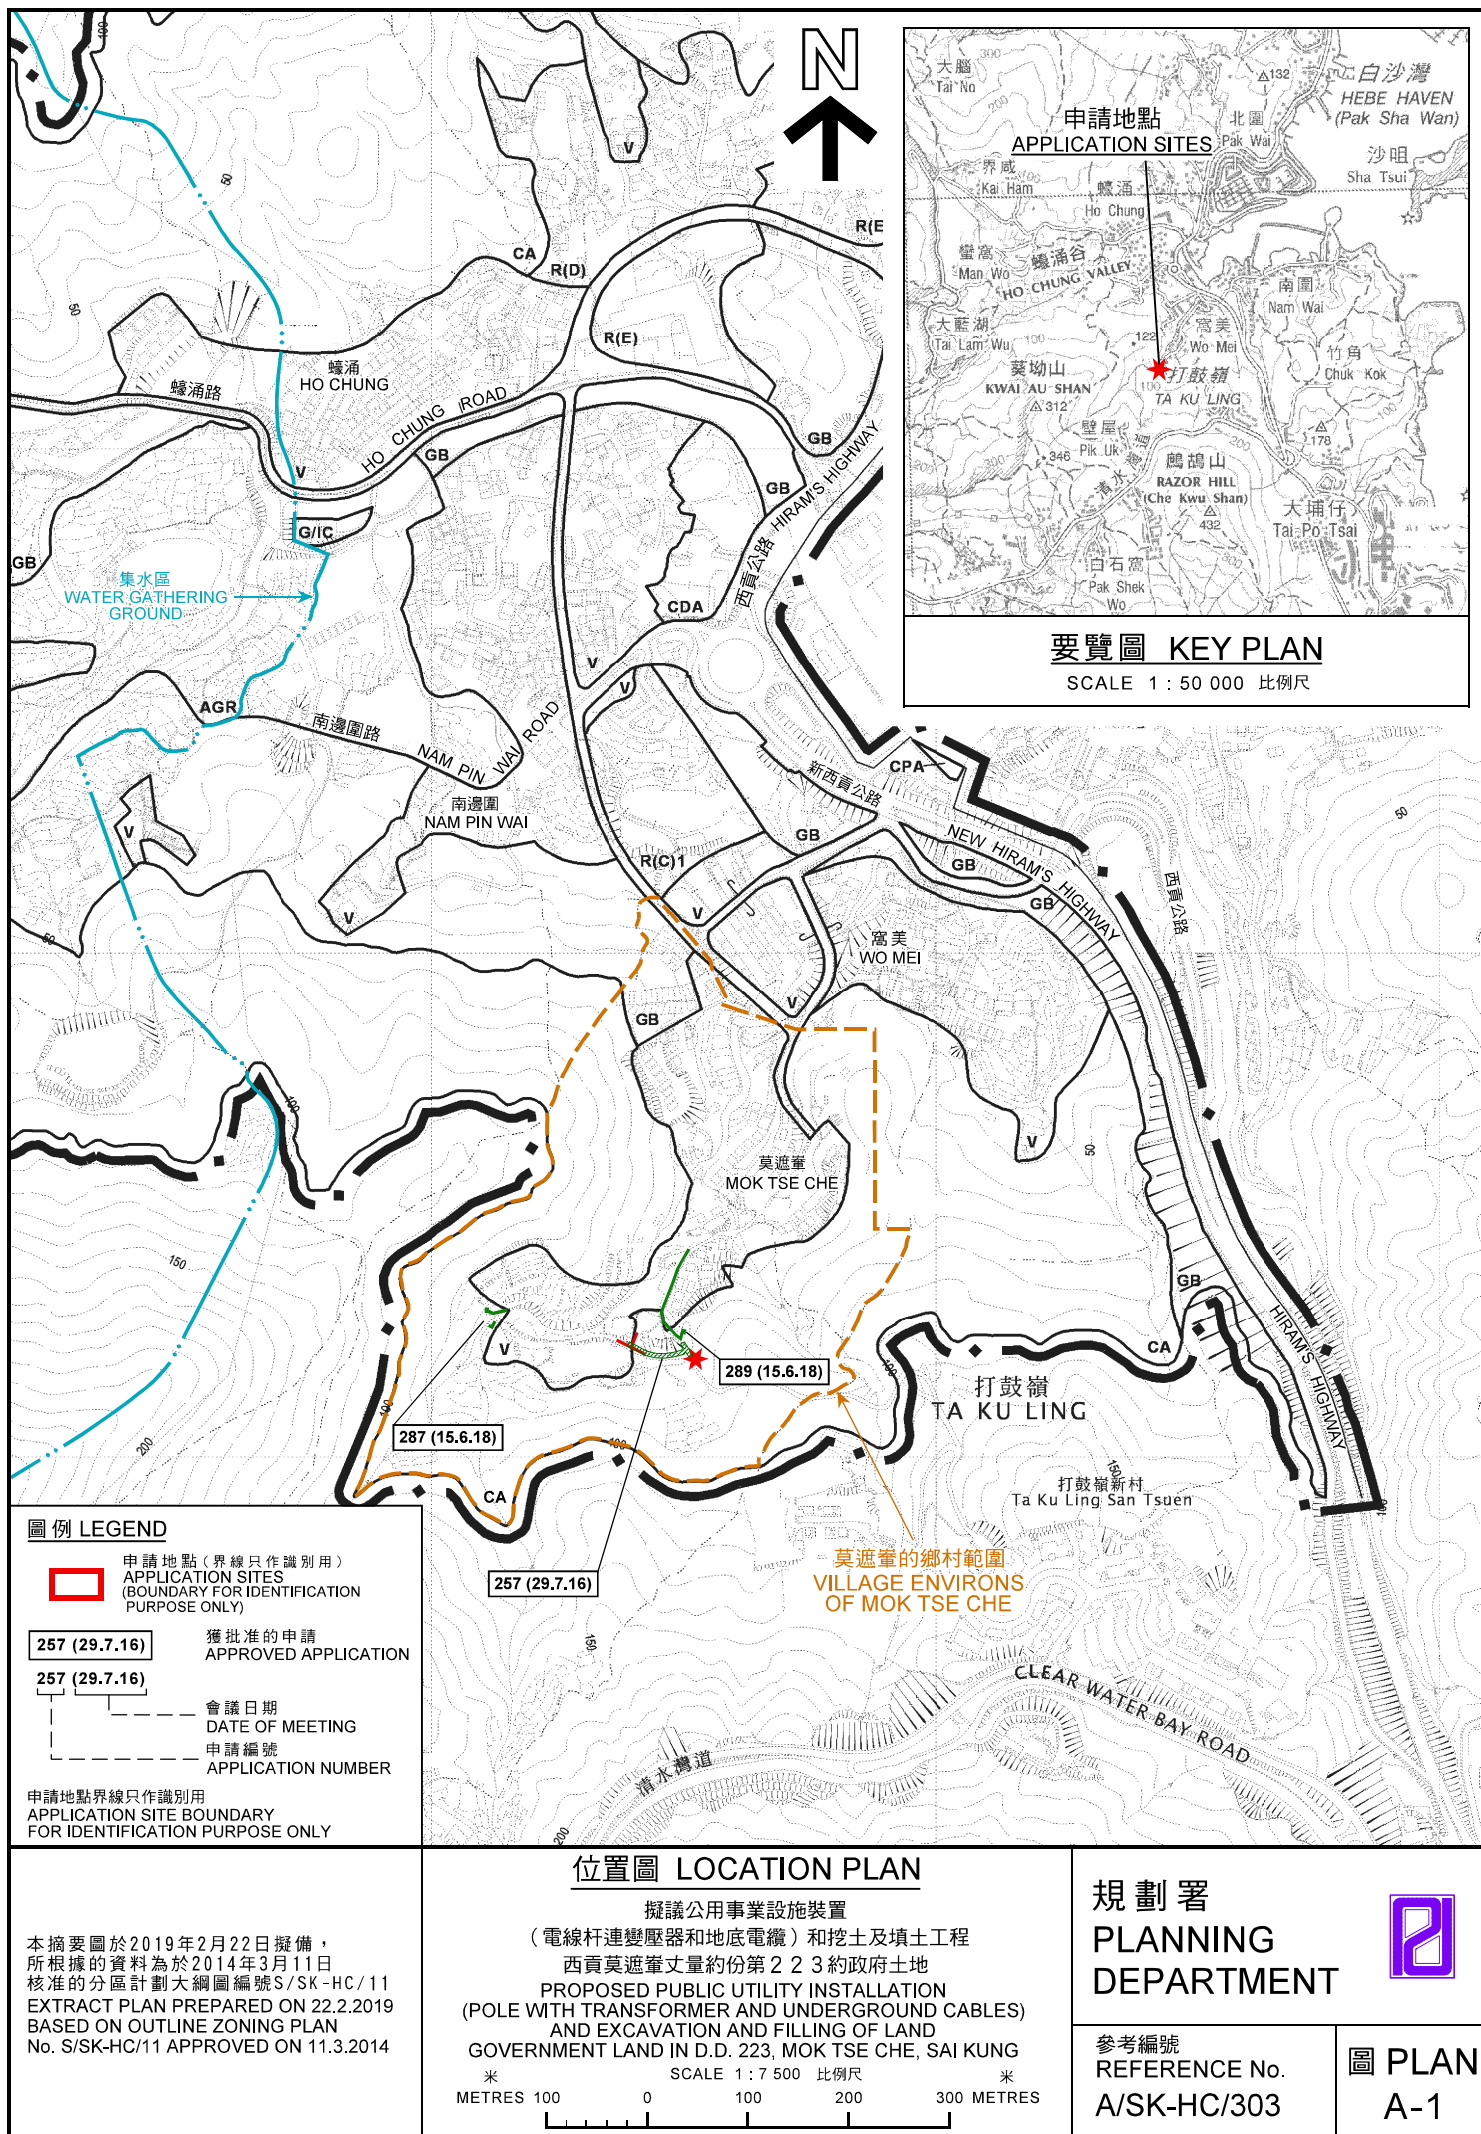

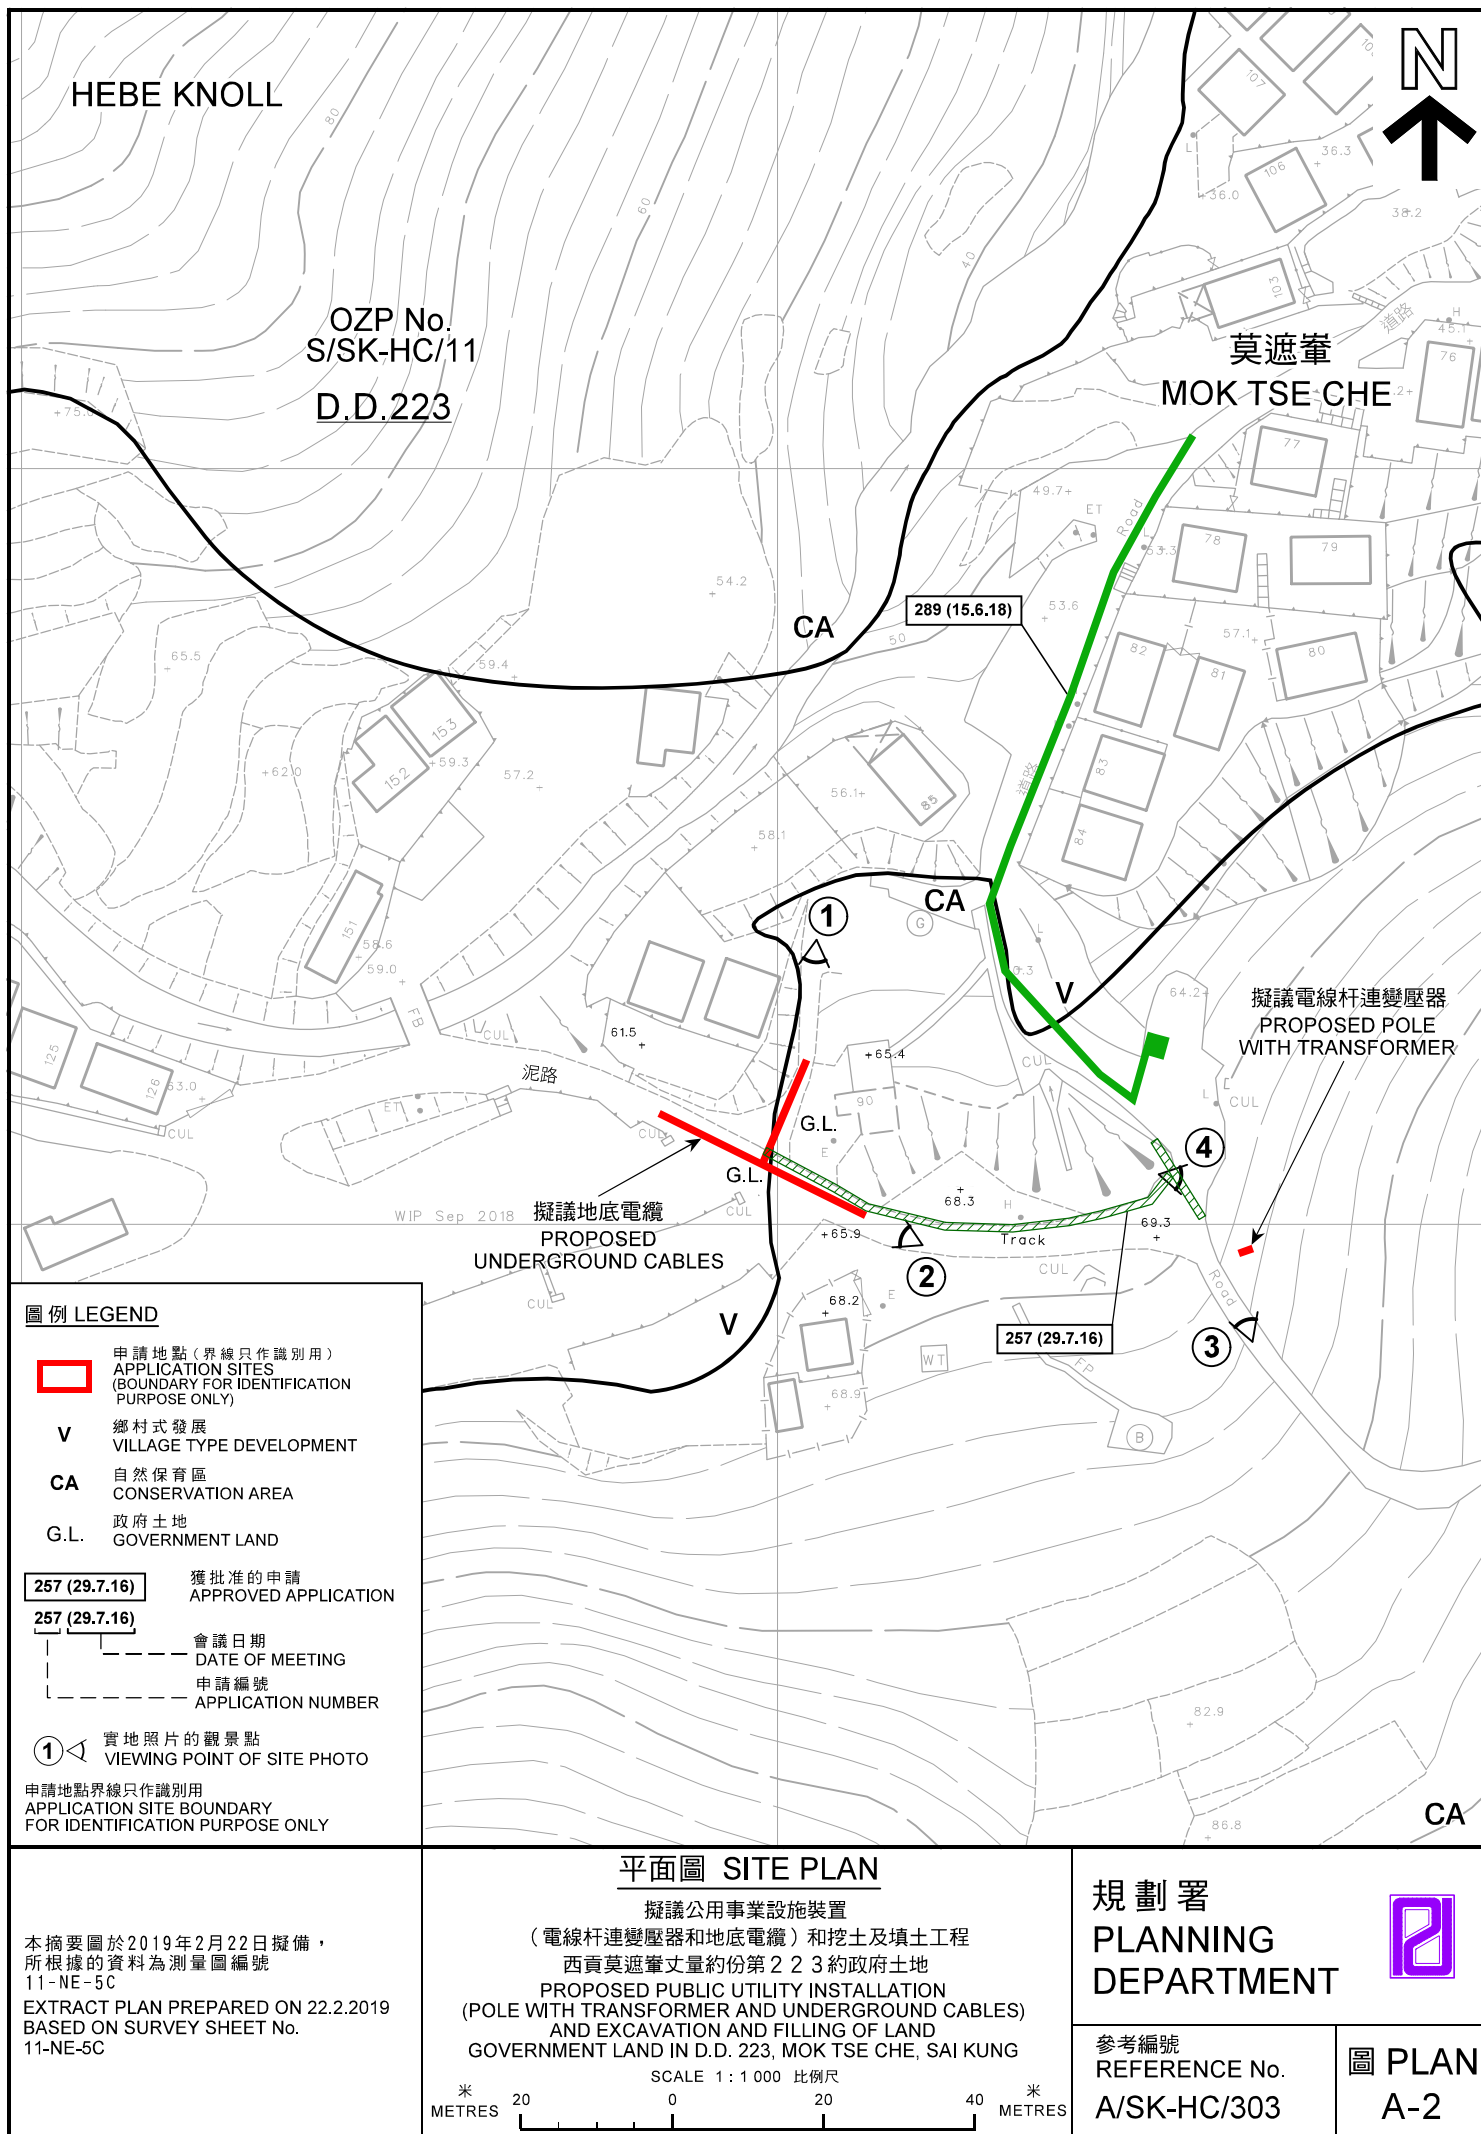



圖例 LEGEND

申請地點 (界線只作識別用)
APPLICATION SITES
(BOUNDARY FOR IDENTIFICATION
PURPOSE ONLY)

本摘要圖於2019年2月22日擬備，
所根據的資料為地政總署
於2018年9月11日拍得的
航攝照片編號E044748C

EXTRACT PLAN PREPARED ON 22.2.2019
BASED ON AERIAL PHOTO No. E044748C
TAKEN ON 11.9.2018
BY LANDS DEPARTMENT

航攝照片 AERIAL PHOTO

擬議公用事業設施裝置
(電線杆連變壓器和地底電纜) 和挖土及填土工程
西貢莫遮峯丈量約份第223約政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(POLE WITH TRANSFORMER AND UNDERGROUND CABLES)
AND EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 223, MOK TSE CHE, SAI KUNG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-HC/303

圖 PLAN
A-3

1



2



申請地點界線只作識別用
APPLICATION SITE BOUNDARY
FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTO

擬議公用事業設施裝置
(電線杆連變壓器和地底電纜) 和挖土及填土工程
西貢莫遮嶺丈量約份第223約政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(POLE WITH TRANSFORMER AND UNDERGROUND CABLES)
AND EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 223, MOK TSE CHE, SAI KUNG

規劃署
PLANNING
DEPARTMENT




參考編號
REFERENCE No.
A/SK-HC/303

圖 PLAN
A-4a

本圖於2019年2月22日擬備，所根據的
資料為攝於2019年2月1日的實地照片
PLAN PREPARED ON 22.2.2019 BASED ON
SITE PHOTOS TAKEN ON 1.2.2019

3

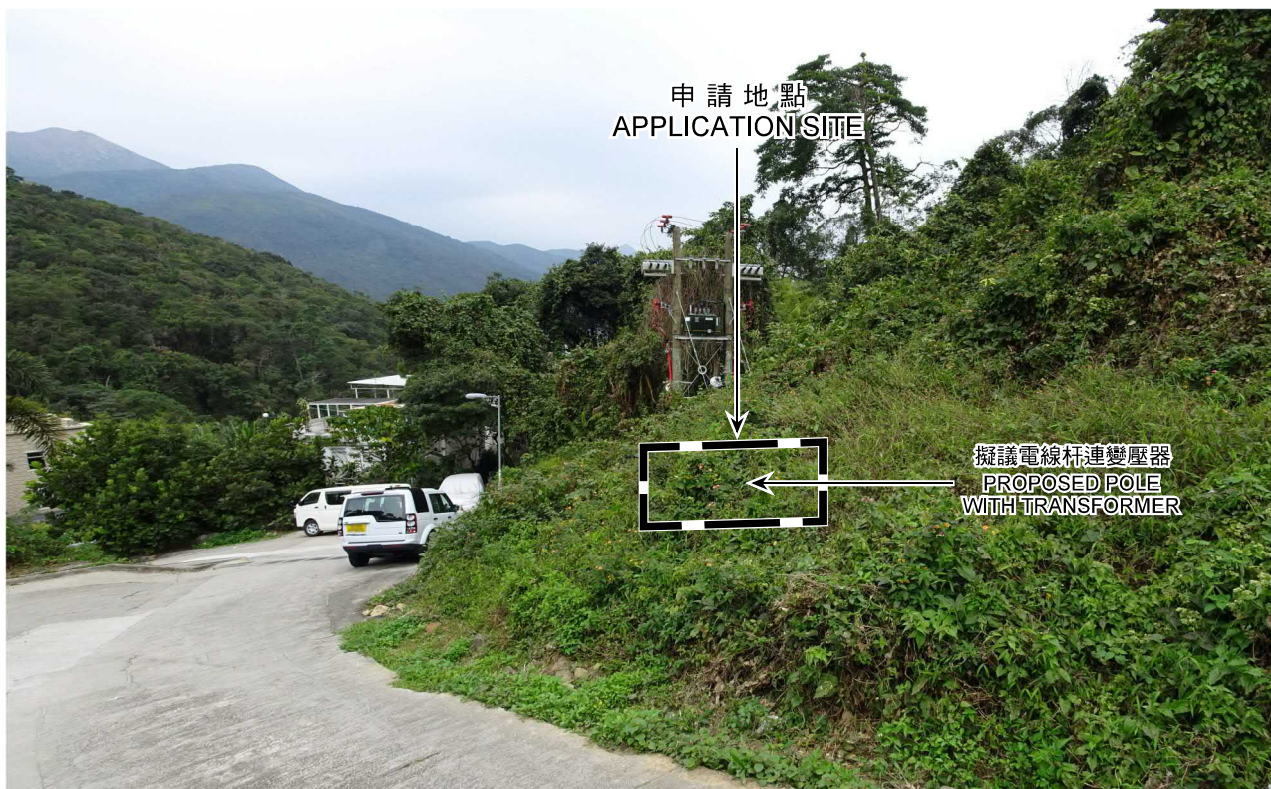

4



申請地點界線只作識別用
APPLICATION SITE BOUNDARY
FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTO

擬議公用事業設施裝置
(電線杆連變壓器和地底電纜) 和挖土及填土工程
西貢莫遮嶺丈量約份第223約政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(POLE WITH TRANSFORMER AND UNDERGROUND CABLES)
AND EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 223, MOK TSE CHE, SAI KUNG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-HC/303

圖 PLAN
A-4b

本圖於2019年2月22日擬備，所根據的
資料為攝於2019年2月1日的實地照片
PLAN PREPARED ON 22.2.2019 BASED ON
SITE PHOTOS TAKEN ON 1.2.2019