




LEGEND :

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOFF BOX
- x EXCAVATION FOR JOINTING / REPAIRING / INSPECTING CABLE
- PROPOSED 3.6M(L) x 3.32M(W) x 2.7M(H) HV PILLAR

- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11KV, L.V., O.H.L. OF STEEL / WOODEN POLE
- OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE THINNING / CUTTING
- ⬆ EXISTING POLE MOUNTED TRANSFORMER
- ⬆ PROPOSED POLE MOUNTED TRANSFORMER
- + PROPOSED STAY / STAY POLE

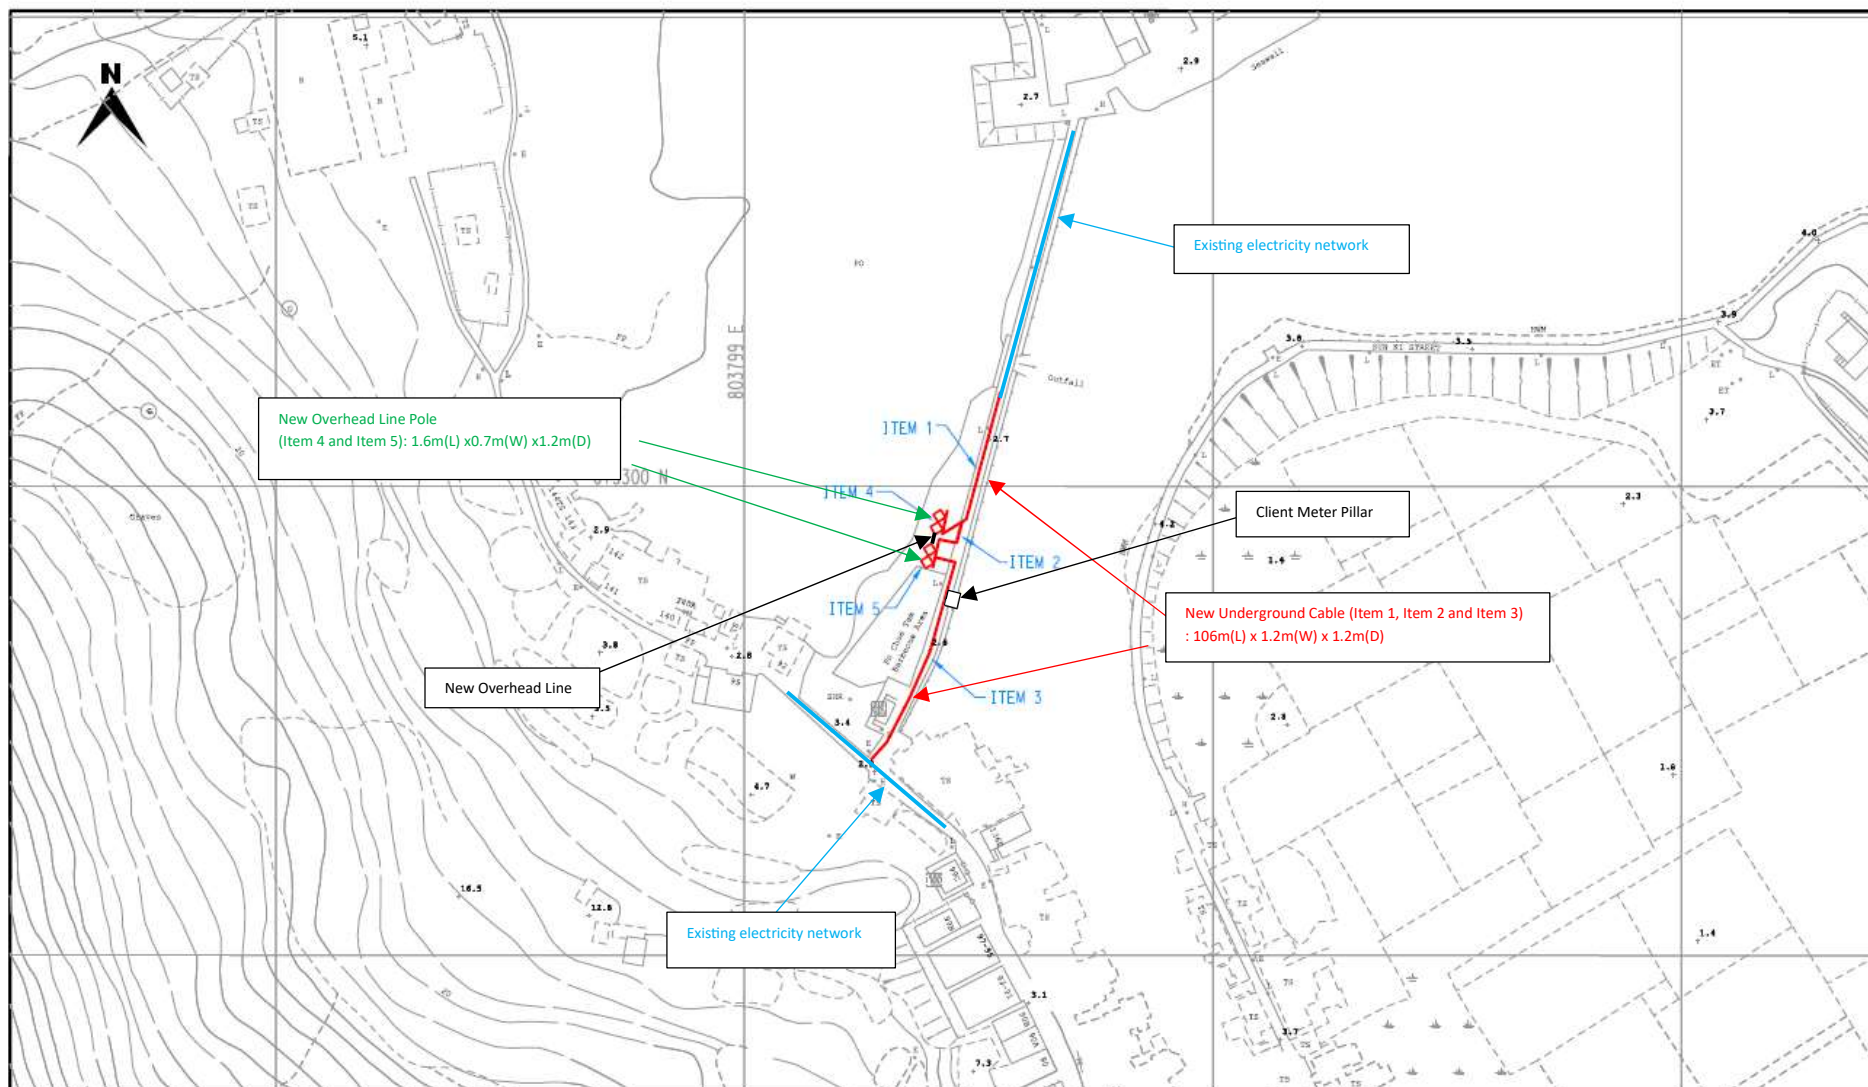

SCALE 1:1000 @A3

DATE :06-02-2025

REGION :WE

O.C. :LT

DRAWN :NY CHO1

CHECKED : SC LAM

E/O NO :

TITLE :POLE ERECTION & 11KV & LV CABLE LAYING
AT PO CHUE TAM FOOTBRIDGE
NEAR KAT HING BACK STREET.
TAI O

MAP NO : 09SW23A, 09SW23B, 09SW18D, 09SW18C

PROJECT REF. : LT2024-0539

Summary

Map data reproduced with permission of the Director of Lands. (C) Hong Kong
Information Classification: PROPRIETARY