













	Exit Sign
	Hose reel
	Gate valve
	Non return valve
	Flexible connector
	Fixed fire pump
	Ball float valve
	Level controller
	Manual fire alarm call point
	Fire alarm bell
	5 kg CO2 f.e.
	Water type f.e.
	Fire control panel
	Essential power supply

Enclosed Structure	Floor Area (sq. m)
Existing Temporary Structure (Block -1)	169.5
Existing Temporary Structure (Block -2)	169.5
Temporary Storage of Goods	7.8
Existing One Storey Container Converted Site Office	14.4
Canopy A (Not Enclosed, Shown for Completeness)	6.0 (approx.)
Canopy B (Not Enclosed, Shown for Completeness)	4.8 (approx.)
Canopy C (Not Enclosed, Shown for Completeness)	40.8 (approx.)

FIRE SERVICES NOTES:

- One actuating point and one audio warning device to be located at each hose reel point. this actuating point should include facilities for fire pump start and audio warning device initiation.
- Emergency electrical generator will be provided.
- Emergency lighting in accordance with BS 5266 part 1:2011 and BS EN1838:1999 to be provided throughout the entire development of buildings and all exit routes leading to open yard.
- All exits to be clearly indicated by illuminated "EXIT" sign in both English and Chinese characters of not less than 180mm high with 15mm side strokes. All exit signs shall follow FSD circular letter no. 5/2008.
- A main fire annunciation panel to be provided to receive all fire alarm signals.
- A fire detection and alarm system to be provided in accordance with the BS 5839-1 : 2002 + A2 : 2008 - Fire Detection and Fire Alarm System for Building and FSD circular letter no. 1/2009.
- Hose Reel System.
 - HR system to be provided in accordance with cop and latest FSD requirement.
 - A 2000L F.S. water tank as shown on plan shall be provided to supply the installation. Two HR pump (duty/standby) with jockey pump will be provided.
- Fire extinguisher to be provided of the type and capacity at positions indicated on plans.
- When a ventilation/air conditioning control system to a building is provided, it shall stop mechanically induced air movement within a designated fire compartment.
- Any intended storage or use of dangerous goods as defined in Chapter 295 of the laws of Hong Kong should be notified to the Director of Fire Services Department.

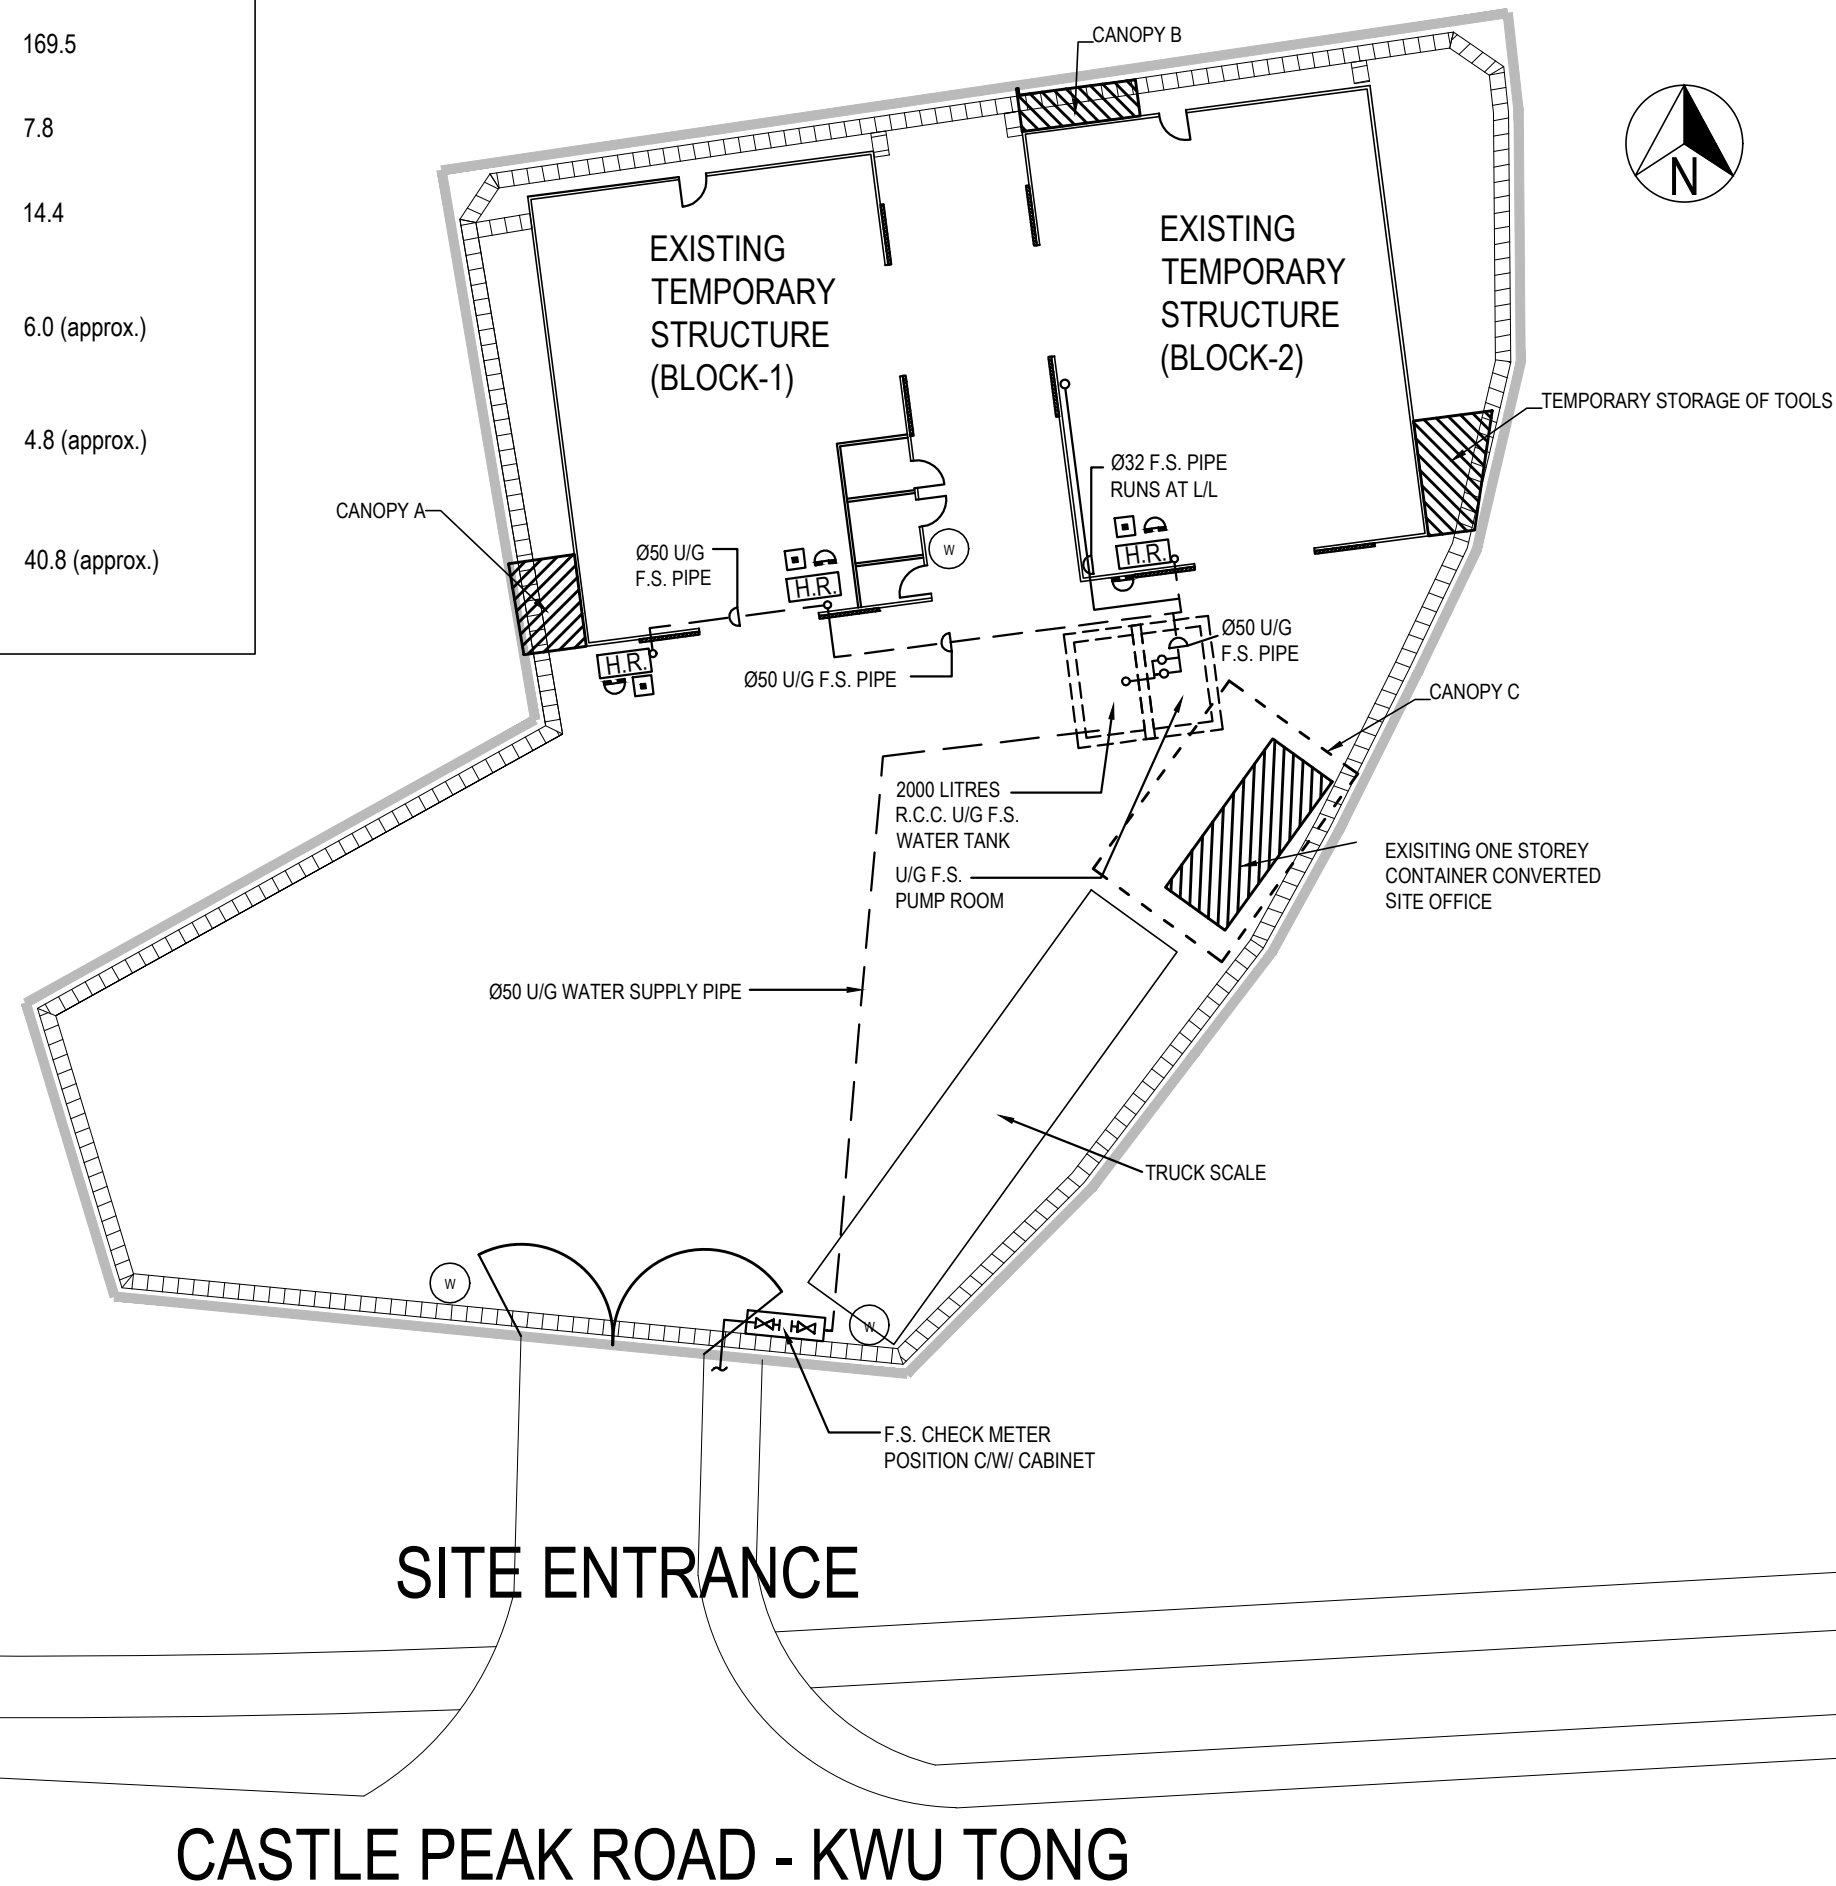

B.D. REF.	
F.S.D. REF.	
U.S.D. REF.	