
N

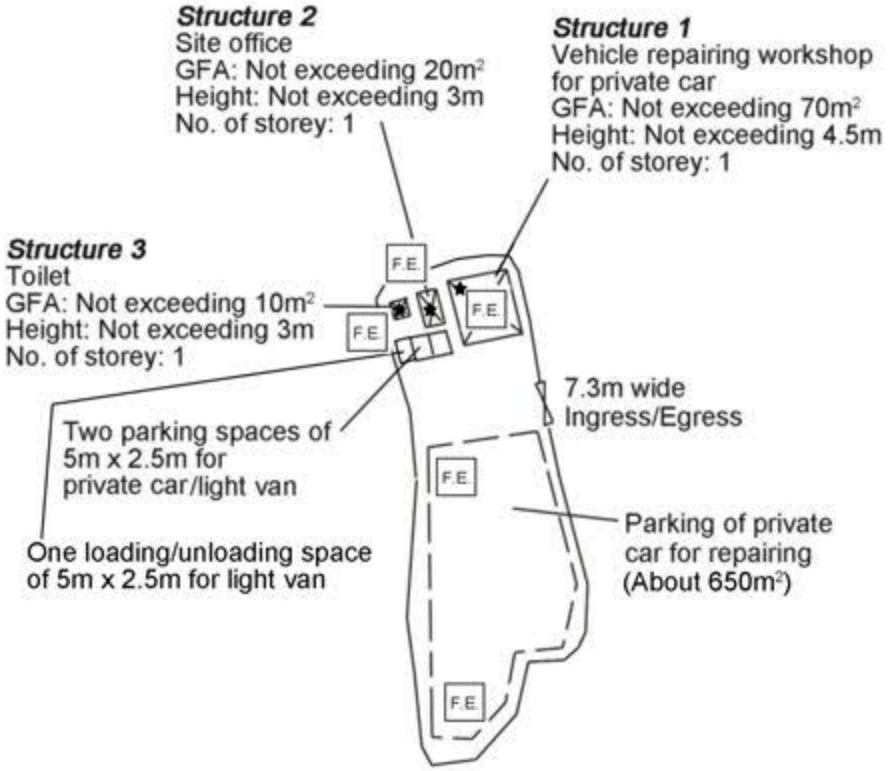

F.S.NOTES:

1 THE STAND-ALONE FIRE DETECTOR SHALL BE PROVIDED IN ACCORDANCE WITH THE "STAND-ALONE FIRE DETECTOR GENERAL GUIDELINES ON PURCHASE, INSTALLATION & MAINTENANCE [SEP 2021]"

2 PORTABLE FIRE FIGHTING APPLIANCES SHALL BE PROVIDED AT POSITIONS AS INDICATED ON LAYOUT PLAN. IN ACCORDING TO CODES OF PRACTICE FOR MINIMUM FIRE SERVICES INSTALLATIONS AND EQUIPMENT.

3 When two or more stand-alone fire detectors are installed in an enclosed structure, all stand-alone fire detectors shall be interconnected such that when one of the detectors is triggered, all connected stand-alone detectors shall sound an alarm simultaneously.

Project 項目名稱:	Drawing Title 圖目:	Remarks 備註:
Proposed Temporary Vehicle Repair Workshop for Private Car for a Period of 3 Years at Lot 143 (Part) in D.D. 52 & Adjoining Government Land, Sheung Shui, New Territories	Proposed Fire Service Installations Plan	F.E. 5kg carbon dioxide fire extinguisher ★ Stand alone battery type smoke detector
	Drawing No. 圖號: Figure 10	Scale 比例: 1:1000