



# 布局圖

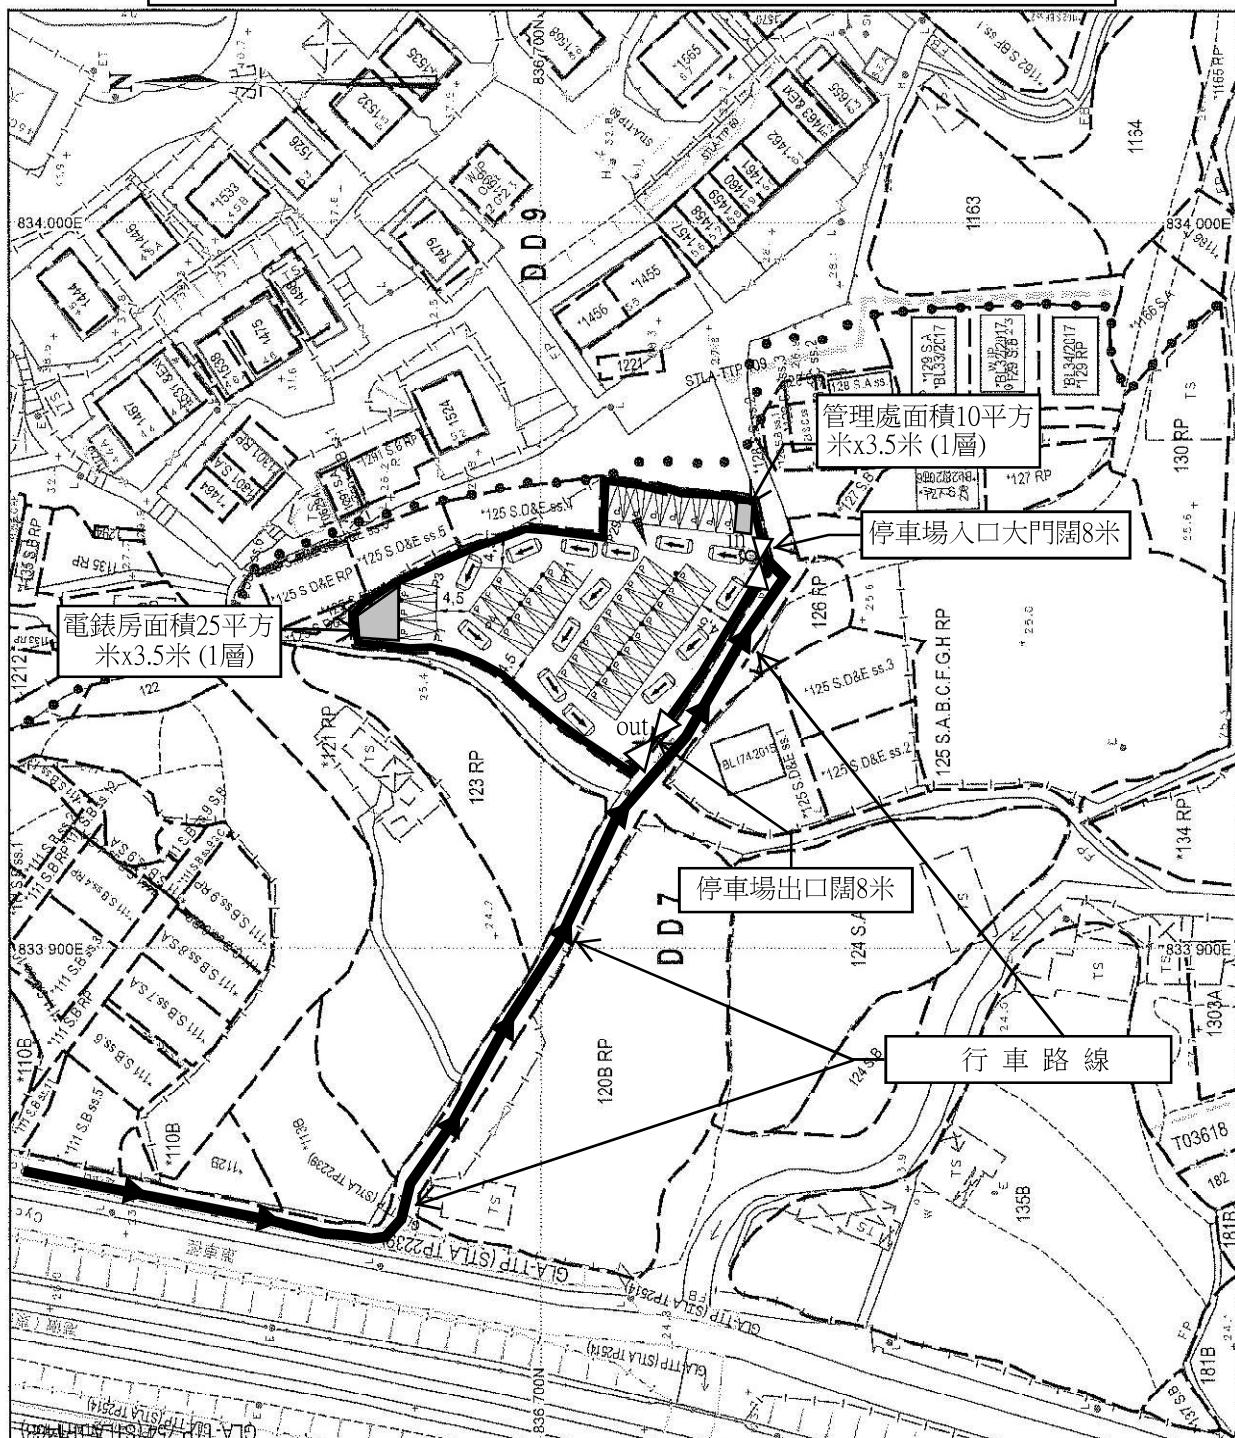

## 申請地點位置圖

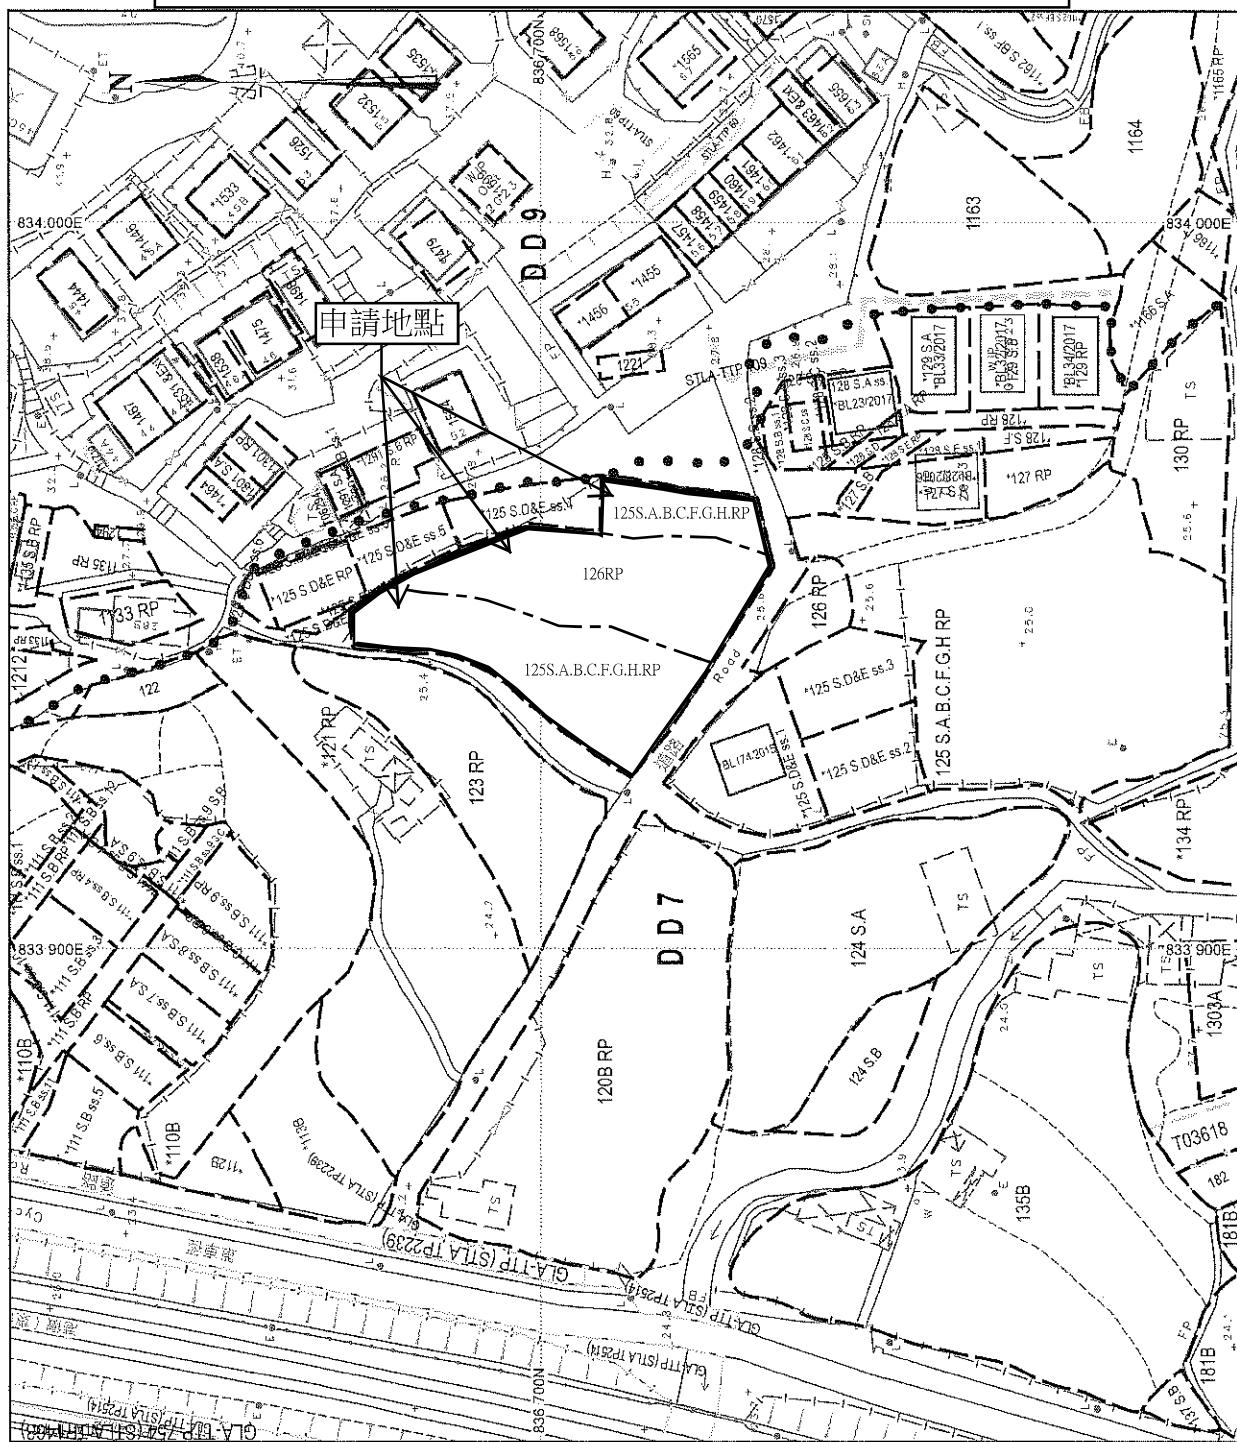

地政總署測繪處


Survey and Mapping Office, Lands Department

比例尺 SCALE 1:1000

米 metres 10 0 10 20 30 40 50 metres



# 雨水排放建議圖

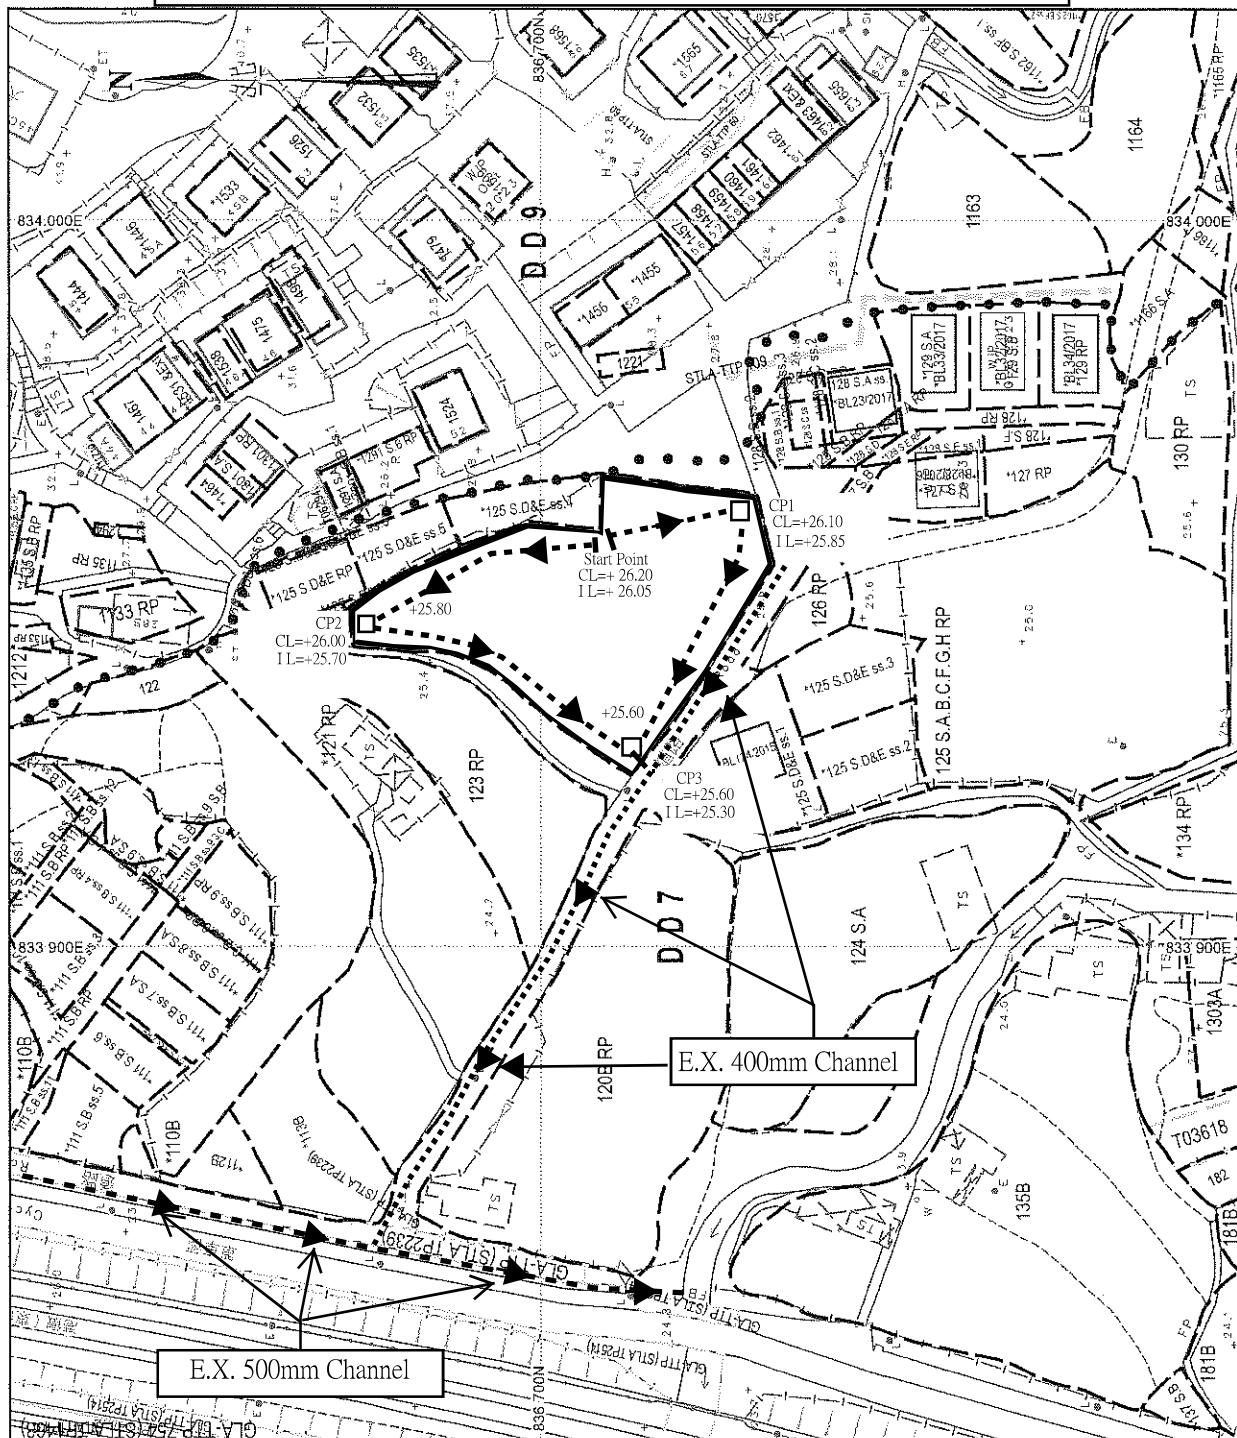

地政總署測繪處

Survey and Mapping Office, Lands Department

比例尺 SCALE 1:1000

米 metres 10 0 10 20 30 40 50 metres



Calculation for channels:

Catchment Area of site

Site Catchment Area =  $1124 \text{ m}^2 = 0.0001124 \text{ Km}^2$

Peak runoff in  $\text{m}^3/\text{s} = 0.278 \times 0.95 \times 250 \text{ mm/hr} \times 0.0001124 \text{ km}^2 = 0.07421 \text{ m}^3/\text{s}$   
 $= 4452 \text{ liter/min}$

Proposed 225UC  
 $(1:100)$  with  
concrete cover

Note:

1. Catchpit (CP1-CP4) with desilting facility shall follow CEDD's standard drawing No. C2406/1.C2406/2A
2. Catchpit and UC follows Typical Details of Geotechnical Manual for Slope Fig.8.10 and Fig.8.11 respectively.
3. The inverted level of the connection point shall be verified on site prior the commencement of work
4. Grating Concrete Cover follows CEDD's standard drawing No. C2412E: U-CHANNELS WITH PRECAST CONCRETE SLABS