



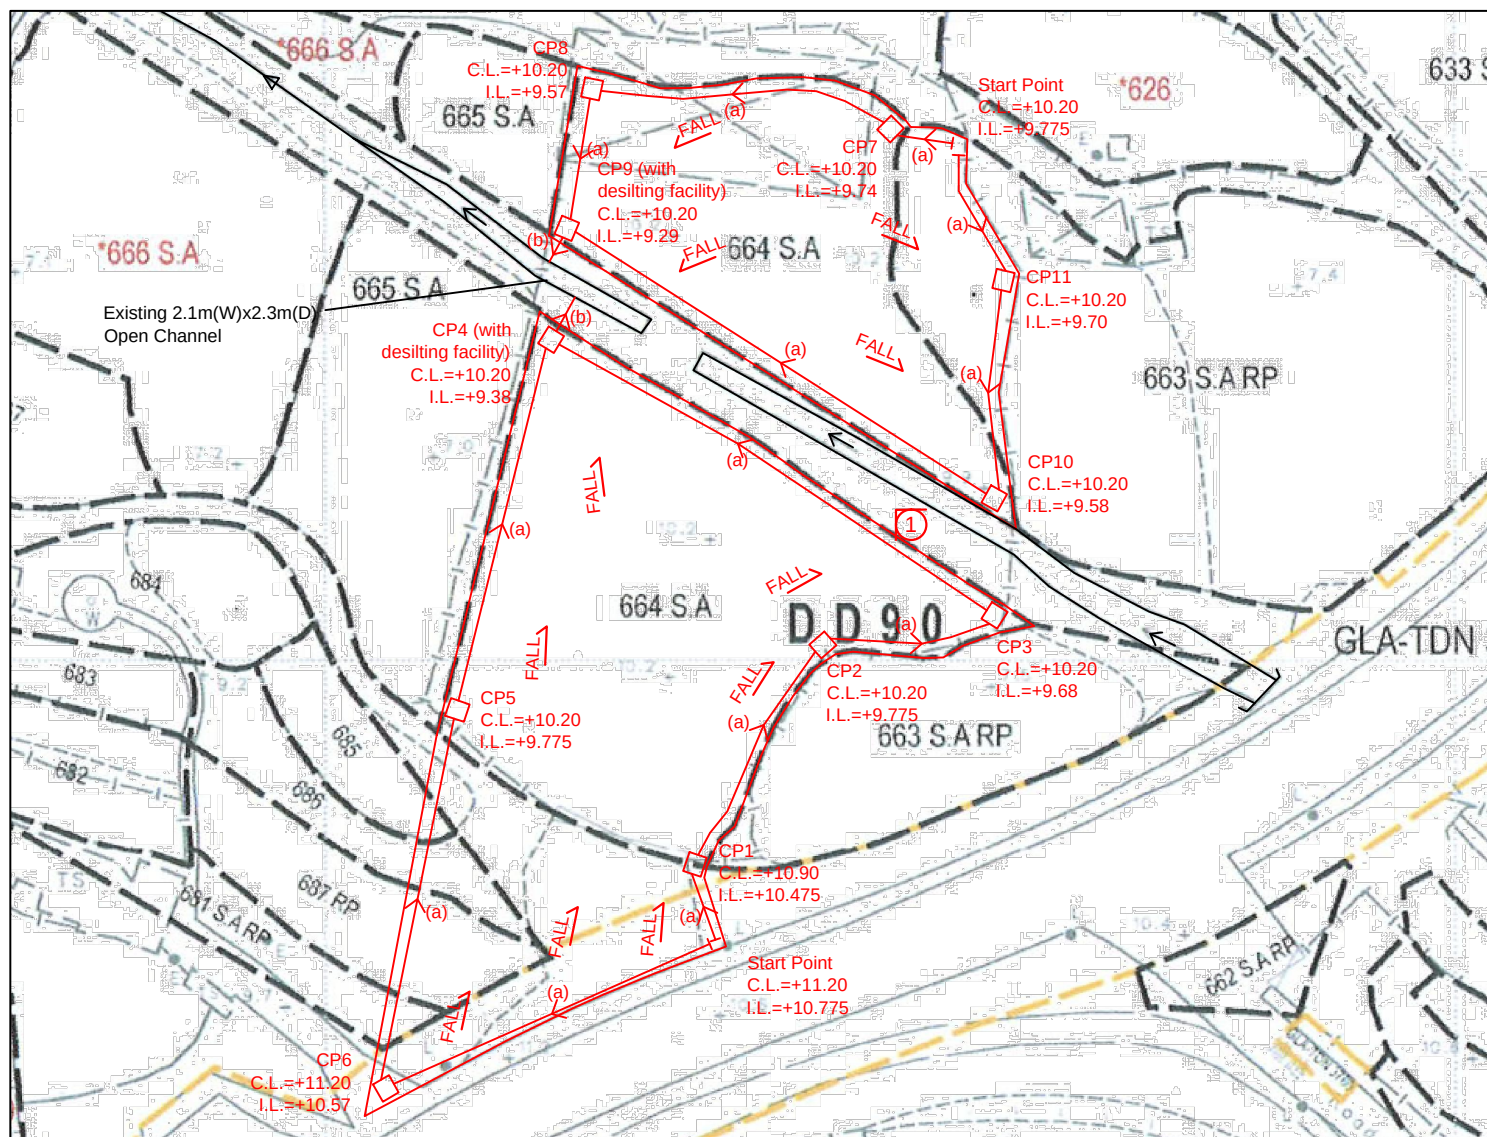

Note:

- Catchpits (CP4 & CP9) with desilting facility shall follow CEDD standard drawing No. C24061.
- Catchpit and UC follows Typical Details of Geotechnical Manual for Slope Fig.8.10 and Fig.8.11 respectively.
- Open-bottom type Fence Wall to be erected.
- No site formation works/ massive land filling works to be carried out. Minor filling works to be carried to leveling the site.

- ☐ CP Proposed CatchPit
- (a) Proposed 375UC (1:150) with Cast Iron Cover
- (b) Proposed 375mm dia. concrete pipe (1:100)
- Existing 2.1m(W)x2.3m(D) Open Channel
- Photo Viewport

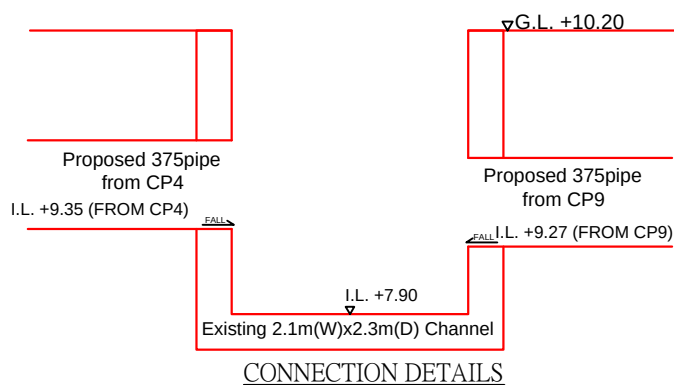

正宏工程顧問公司

CHING WAN ENGINEERING CONSULTANT COMPANY

Project:

Proposed Temporary Open Storage of Scrap Metals with Ancillary Workshop and office and Associated Land Filling for the period of 3 years at Lots 663 S.A RP(Part), 664S.A., 681 S.A RP (part), 685(Part), 686(Part), 687 RP (Part) in DD 90 and Adjoining Government Land, Lin Ma Hang, Ta Kwu Ling (Application No.:)

Title:

Drainage Proposal - LAYOUT

D01

Drawn by:

DM


Date:

23-5-2025

Check by:

DM

Scale:

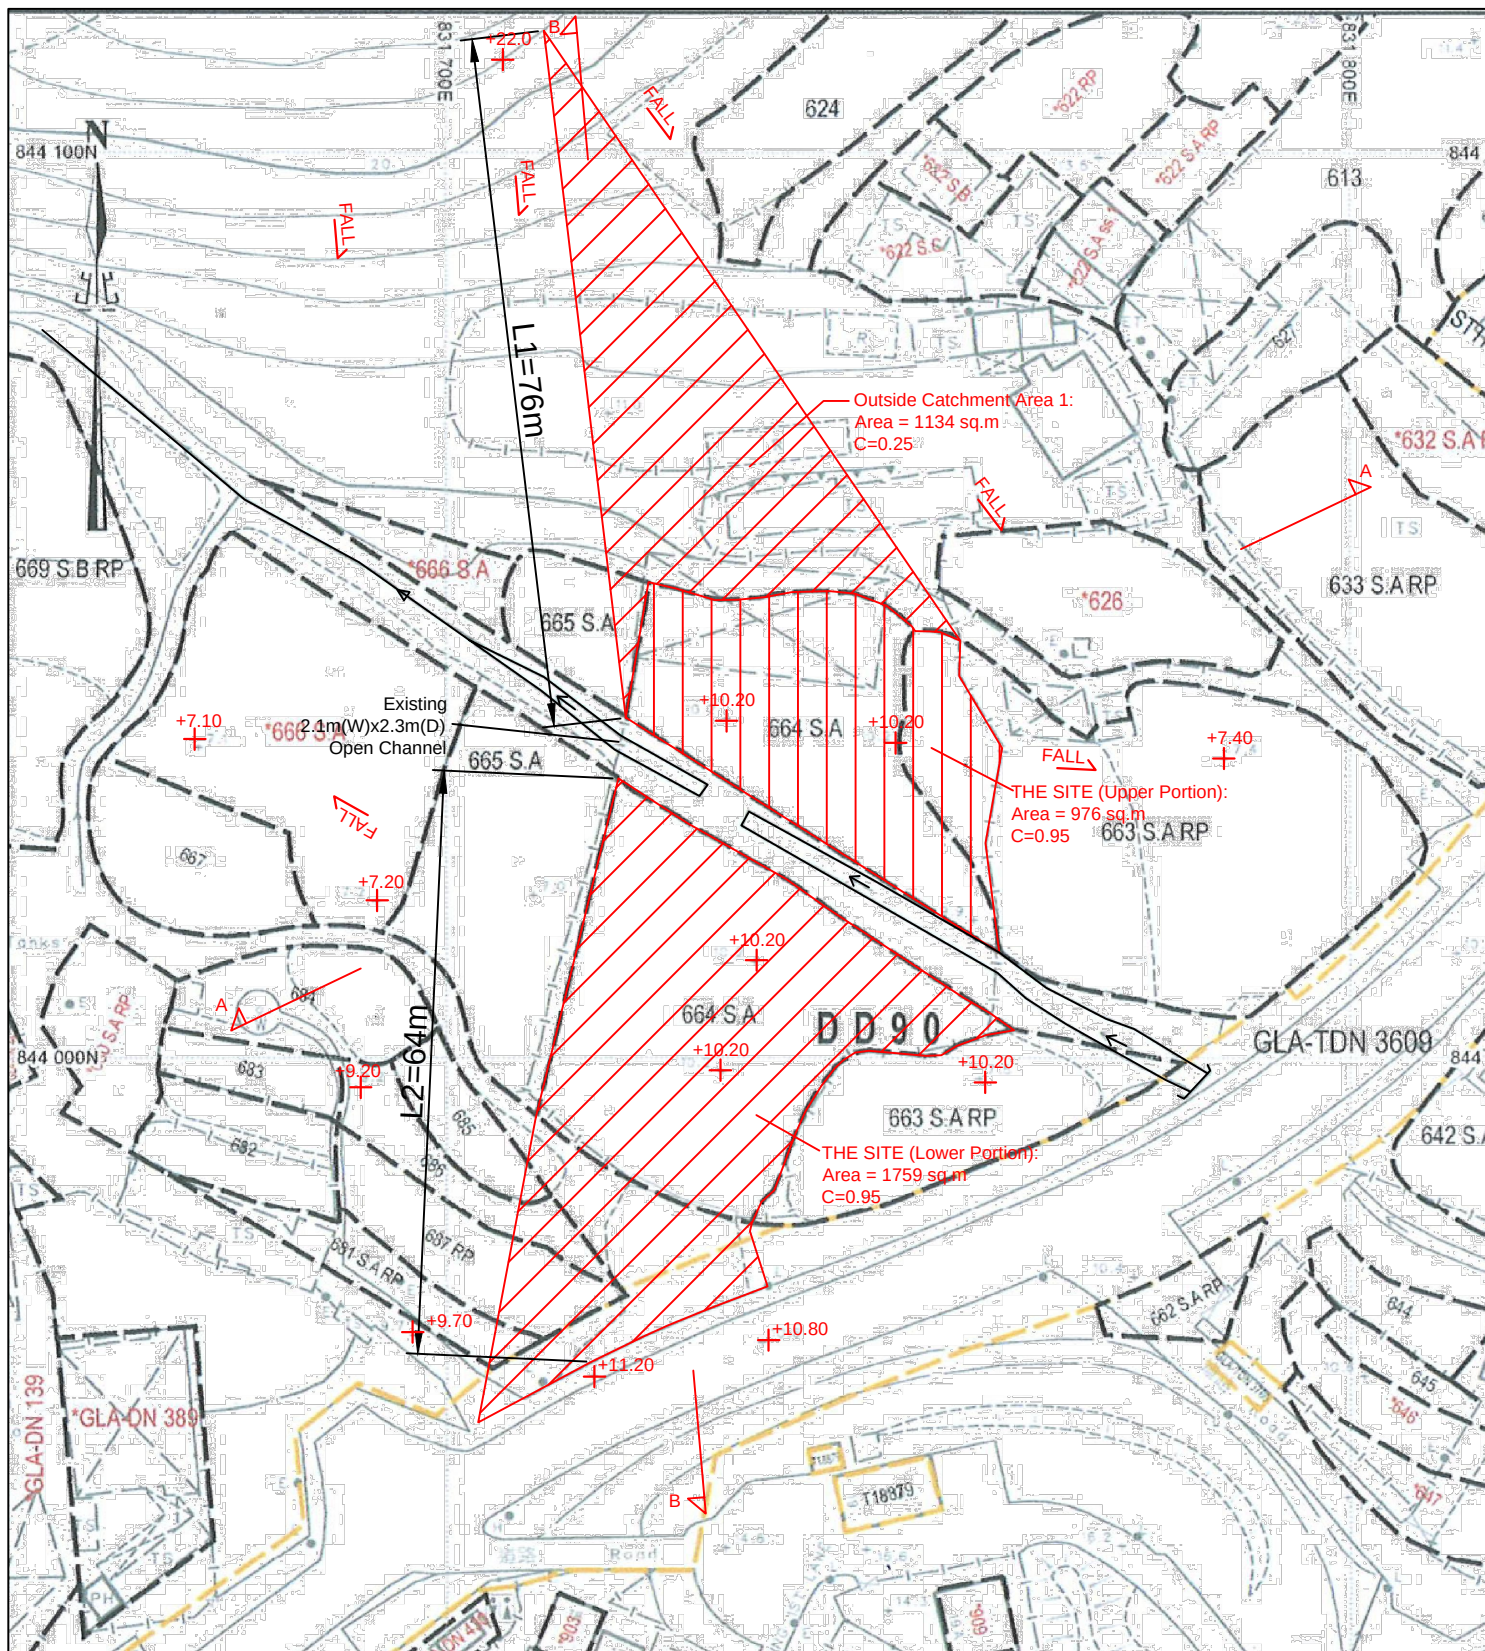

正宏工程顧問公司

CHING WAN ENGINEERING CONSULTANT COMPANY

Project:

Proposed Temporary Open Storage of Scrap Metals with Ancillary Site office and Associated Land Filling for the period of 3 years at Lots 663 S.A RP(Part), 664S.A., 681 S.A RP (part), 685(Part), 686(Part), 687 RP (Part) in DD 90 and Adjoining Government Land, Lin Ma Hang, Ta Kwu Ling (Application No.:)

Title:

Drainage Proposal -
CATCHMENT AREA PLAN

D02

Drawn by:

DM



Date:

23-5-2025

Check by:

DM

Scale:

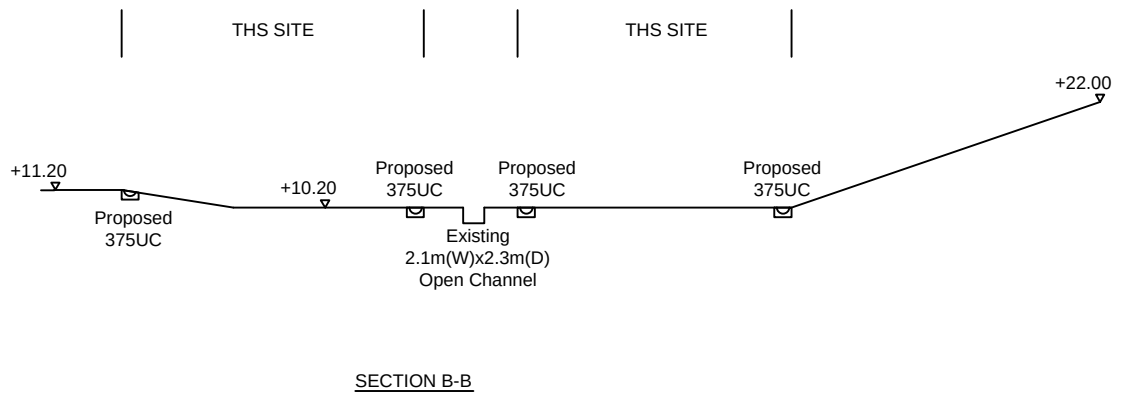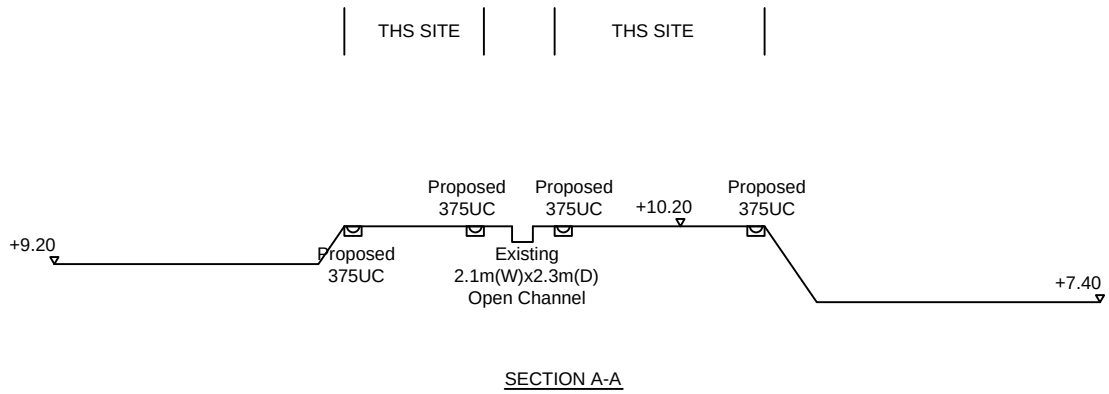

正宏工程顧問公司

CHING WAN ENGINEERING CONSULTANT COMPANY

Project:
Proposed Temporary Open Storage of Scrap Metals with Ancillary Site office and Associated Land Filling for the period of 3 years at Lots 663 S.A RP(Part), 664S.A., 681 S.A RP (part), 685(Part), 686(Part),687 RP (Part) in DD 90 and Adjoining Government Land, Lin Ma Hang, Ta Kwu Ling
 (Application No.:)

Title:

Drainage Proposal -
 SECTIONS

D03

Drawn by:

DM

Date:

23-5-2025

Check by:

DM


Scale:

Photo 1





Further downstream of existing 2.1m(W)x2.3m(D) Open Channel

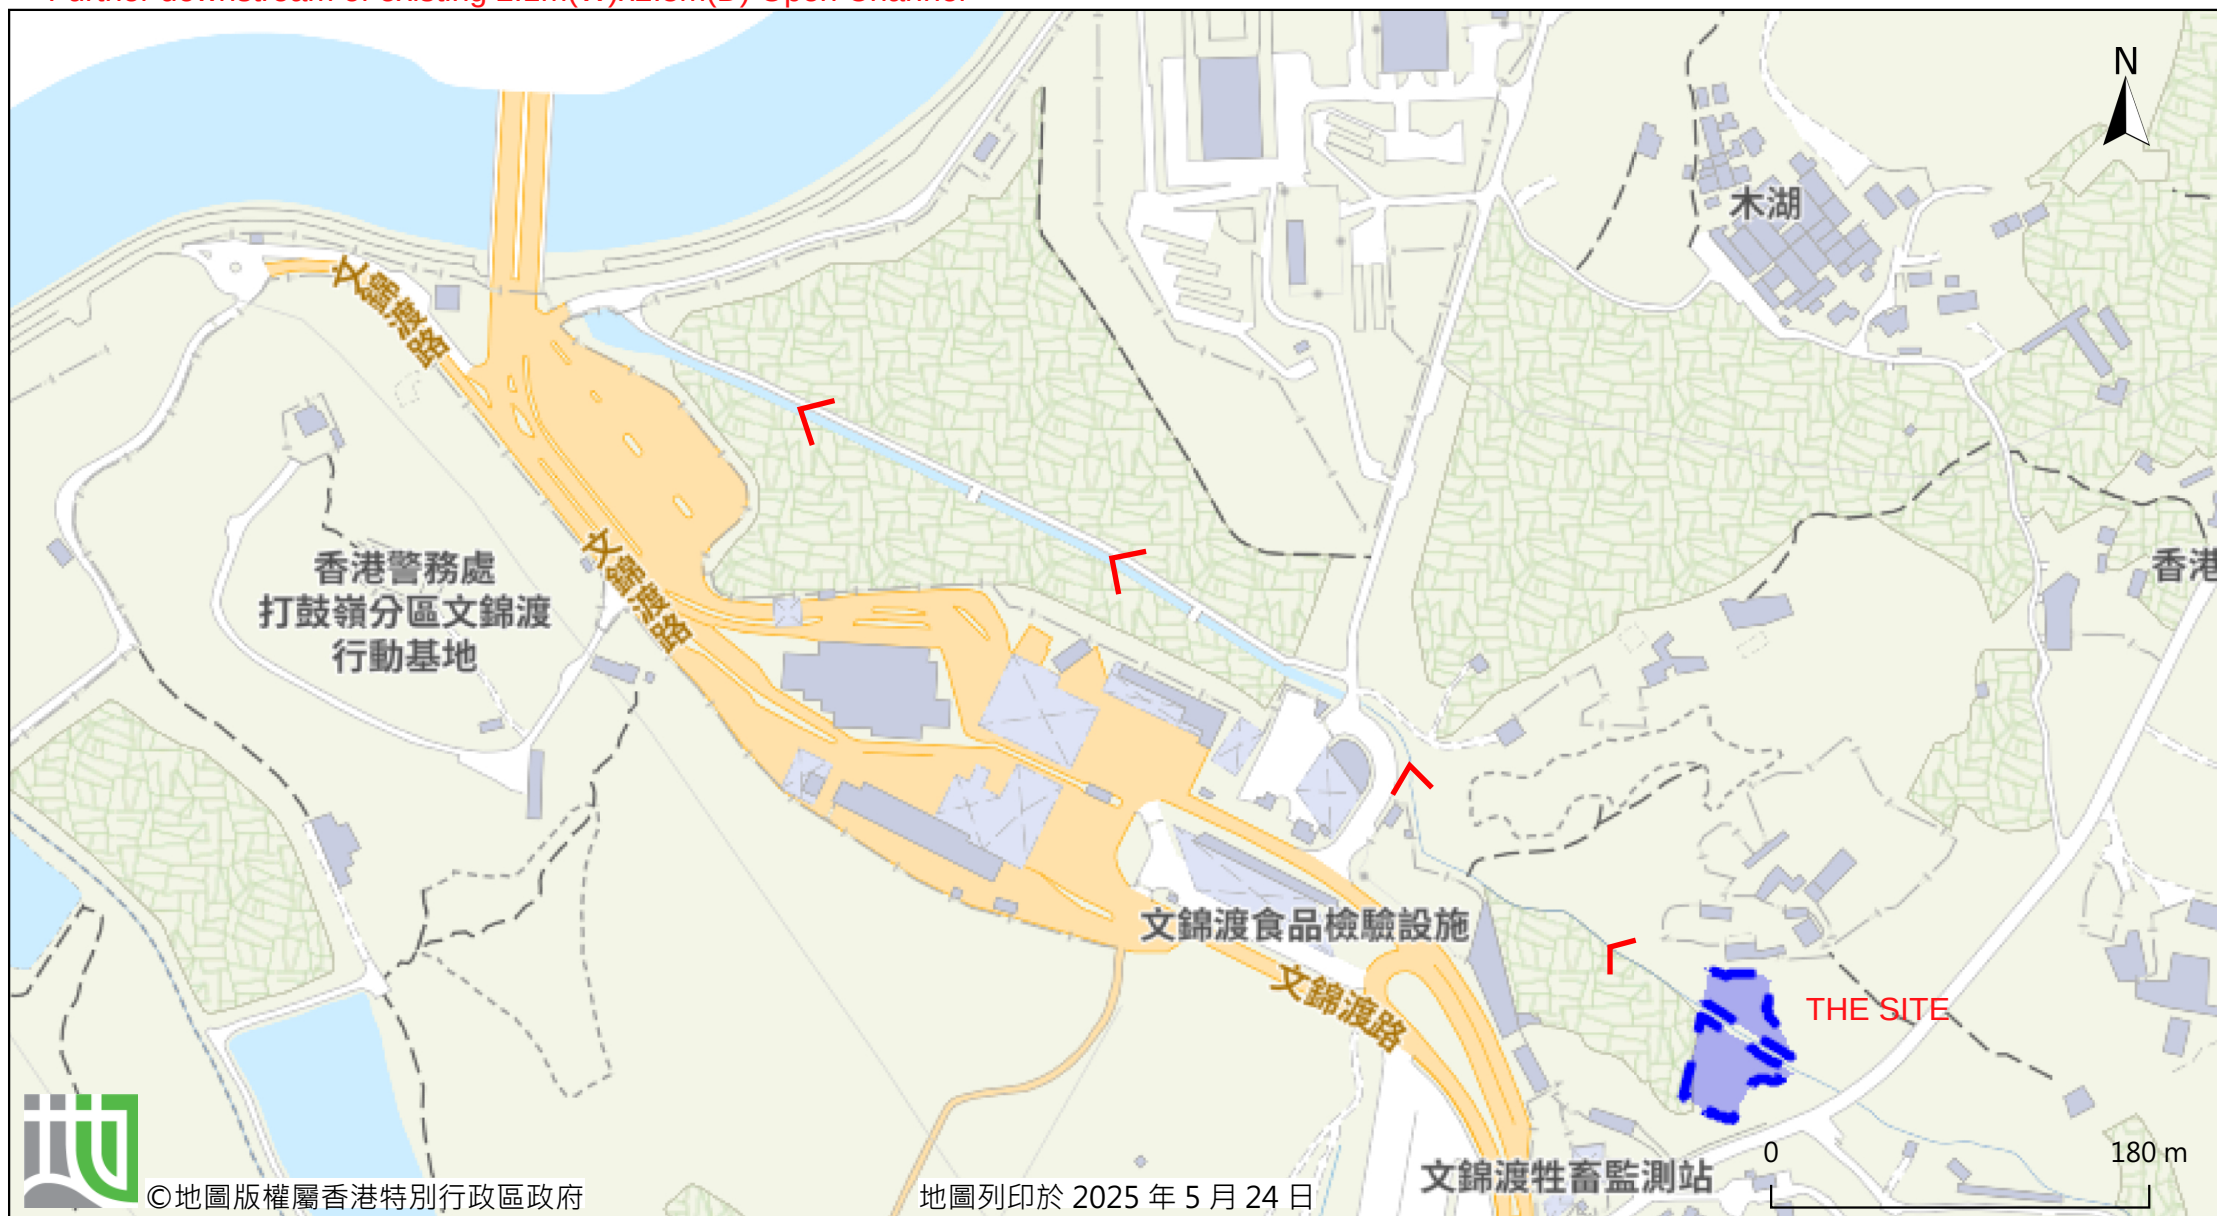

由「地理資訊地圖」網站提供: <https://www.map.gov.hk>

注意: 使用此地圖受「地理資訊地圖」的使用條款及條件以及知識產權告示約束。

Outside Catchment Area 1, Area = 1134 m² (C= 0.25)
 THE SITE (Upper Portion), Area = 976 m² (C= 0.95)
 THE SITE (Lower Portion), Area = 1759 m² (C= 0.95)

Calculation of Design Runoff of the Proposed Development,

For the design of drains of the Upper Portion of the site, Outside Catchment Area 1 + The Site (Upper Portion)

$$\Sigma Q = \Sigma 0.278 C i A$$

$$\begin{aligned} A &= 1134+976 && \text{m}^2 \\ &= 2110 \\ &= 0.00211 && \text{km}^2 \end{aligned}$$

$$\begin{aligned} t &= 0.14465 L1/ H^{0.2} A^{0.1} \\ &= 0.14465*76/1^{0.2}*2110^{0.1} \\ &= 5.113 && \text{min} \end{aligned}$$

$$\begin{aligned} i &= 1.111*a/(t+b)^c && (50 \text{ yrs return period, Table 3d, Corrigendum 2024,} \\ &= 1.111*474.6/(5.113+2.90)^{0.371} && \text{SDM) and (11.1\% increase due to climate change)} \\ &= 243.6 && \text{mm/hr} \end{aligned}$$

$$\begin{aligned} \text{Therefore, } Q &= 0.278*0.25*243.6*0.001134+0.278*0.95*243.6*0.000976 \\ &= 0.0820 && \text{m}^3/\text{sec} \\ &= \underline{4920} && \text{lit/min} \end{aligned}$$

Provide 375UC (1:150) is OK

For the design of drains of the Lower Portion of the site, The Site (Lower Portion)

$$\Sigma Q = \Sigma 0.278 C i A$$

$$\begin{aligned} A &= 1759 && \text{m}^2 \\ &= 0.001759 && \text{km}^2 \end{aligned}$$

$$\begin{aligned} t &= 0.14465 L2/ H^{0.2} A^{0.1} \\ &= 0.14465*64/1^{0.2}*1759^{0.1} \\ &= 4.385 && \text{min} \end{aligned}$$

$$\begin{aligned} i &= 1.111*a/(t+b)^c && (50 \text{ yrs return period, Table 3d, Corrigendum 2024,} \\ &= 1.111*474.6/(4.385+2.90)^{0.371} && \text{SDM) and (11.1\% increase due to climate change)} \\ &= 252.4 && \text{mm/hr} \end{aligned}$$


$$\begin{aligned} \text{Therefore, } Q &= 0.278*0.95*252.4*0.001759 \\ &= 0.1173 && \text{m}^3/\text{sec} \\ &= \underline{7035} && \text{lit/min} \end{aligned}$$

Provide 375UC (1:150) is OK

GEO Technical Guidance Note No. 43 (TGN 43)
Guidelines on Hydraulic Design of U-shaped and Half-round Channels on Slopes

Issue No.: 1 Revision: - Date: 05.06.2014 Page: 3 of 3

Figure 1 - Chart for the rapid design of U-shaped and half-round channels up to 600 mm

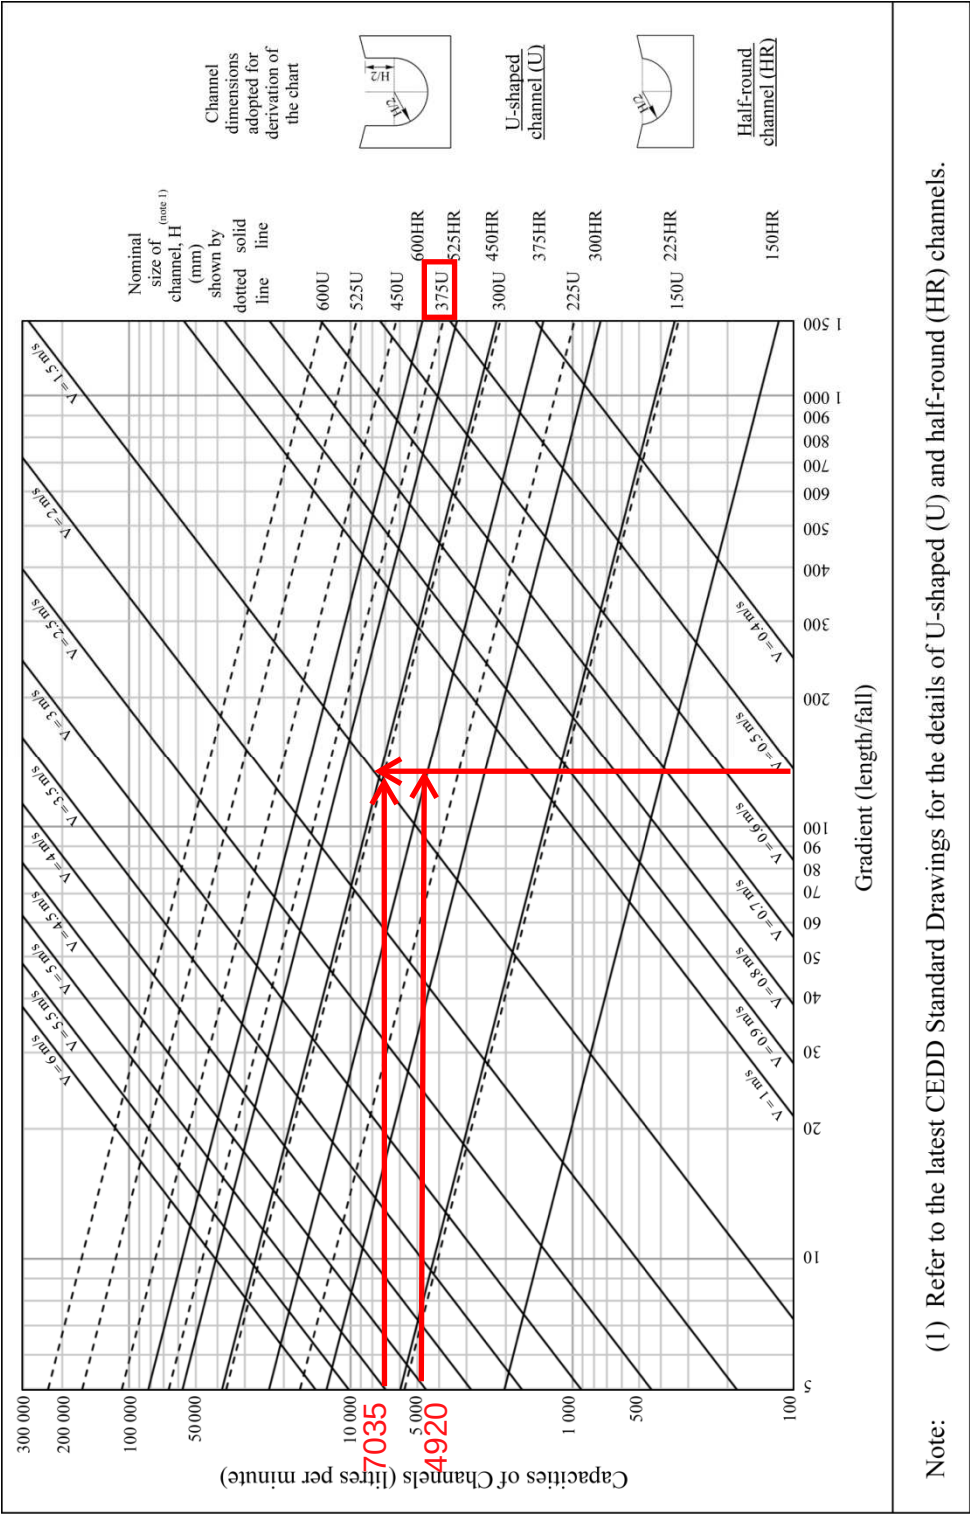

Check 375mm dia. Pipes by Colebrook-White Equation


$$V = -\sqrt{(8gDs)} \log\left(\frac{ks}{3.7D} + \frac{2.51v}{D\sqrt{(2gDs)}}\right)$$

where :


V	=		mean velocity (m/s)	
g	=	9.81	m/s ² gravitational acceleration (m/s ²)	
D	=	0.375	m internal pipe diameter (m)	
ks	=	0.00015	m hydraulic pipeline roughness (m)	(Table14, from DSD SDM 2018, concrete pipe)
v	=	1.14E-06	m ² /s kinematic viscosity of fluid (m ² /s)	
s	=	0.01	hydraulic gradient	

Therefore, design V of pipe capacity = 2.0971 m/s

Q= 0.8VA		(0.8 factor for sedimentation)
= 0.185	m ³ /s	
= 11118	lit/min	
> Max (7035, 4920)	lit/min	Ok
= 15024	lit/min	Ok

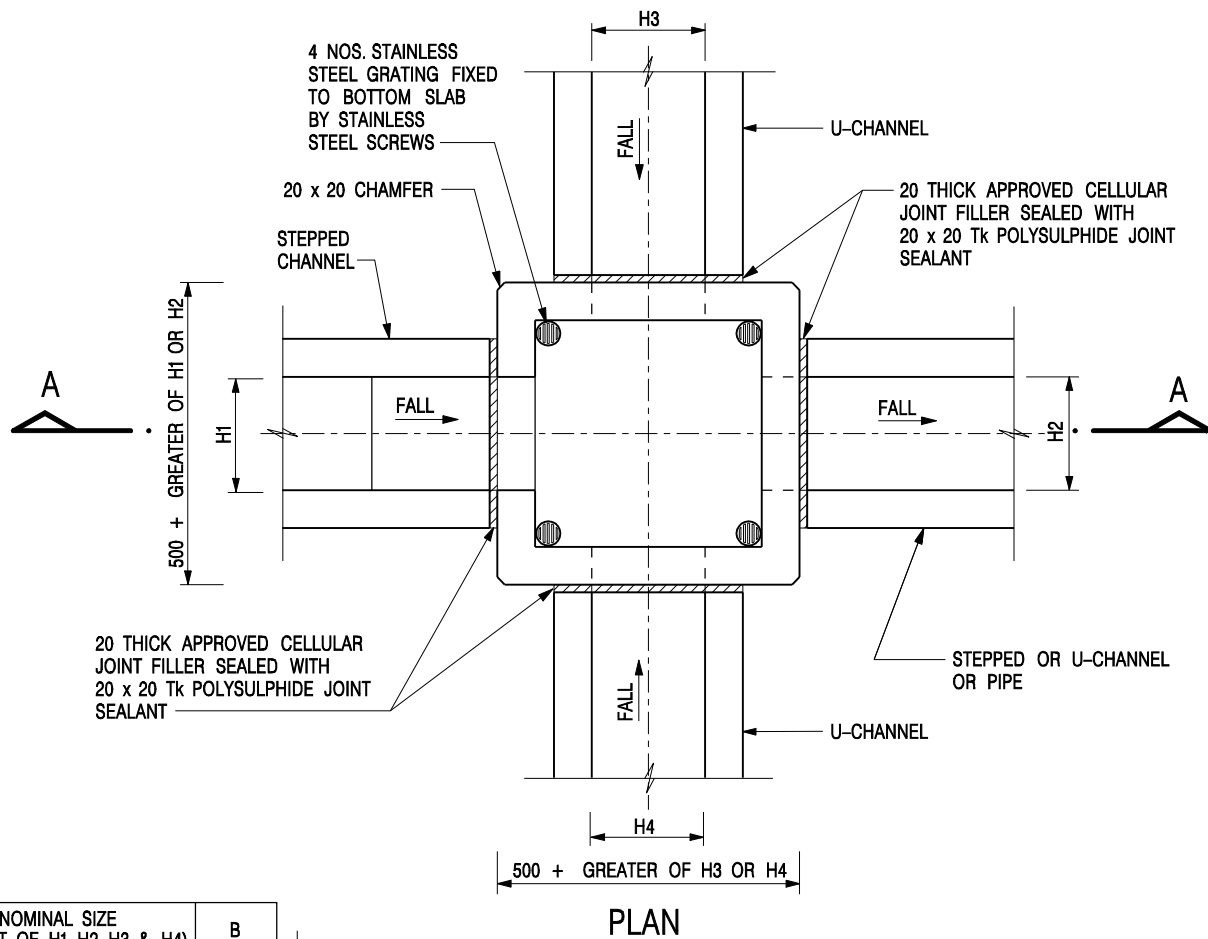

NOMINAL SIZE (LARGEST OF H1, H2, H3 & H4)	B
300 - 600	150
675 - 900	175

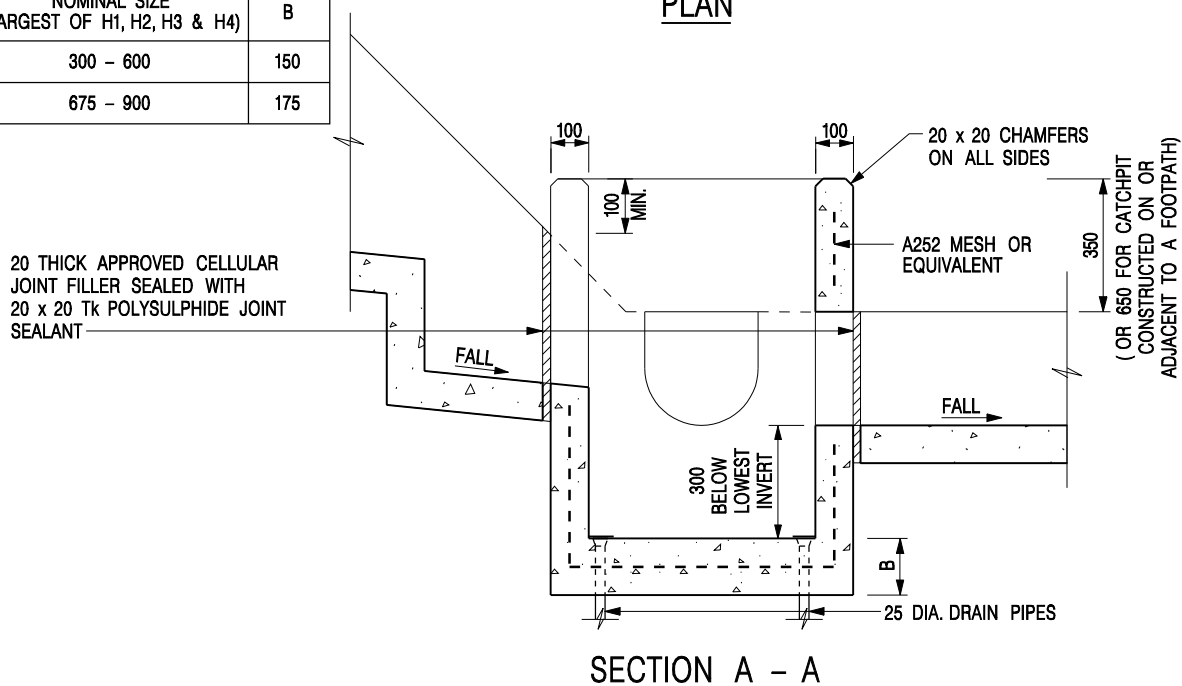

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. REFER TO SHEET 2 FOR OTHER NOTES.

CATCHPIT WITH TRAP
(SHEET 1 OF 2)

-	FORMER DRG. NO. C2406J.	Original Signed	03.2015
REF.	REVISION	SIGNATURE	DATE




**CIVIL ENGINEERING AND
DEVELOPMENT DEPARTMENT**

SCALE 1 : 20

DATE JAN 1991

DRAWING NO.

C2406 /1

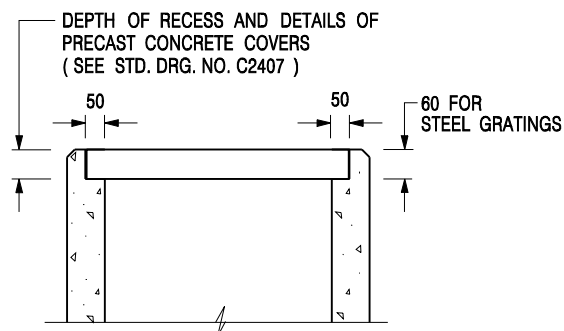

ALTERNATIVE TOP SECTION FOR PRECAST CONCRETE COVERS / GRATINGS

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. ALL CONCRETE SHALL BE GRADE 20 /20.
3. CONCRETE SURFACE FINISH SHALL BE CLASS U2 OR F2 AS APPROPRIATE.
4. FOR DETAILS OF JOINT, REFER TO STD. DRG. NO. C2413.
5. CONCRETE TO BE COLOURED AS SPECIFIED.
6. UNLESS REQUESTED BY THE MAINTENANCE PARTY AND AS DIRECTED BY THE ENGINEER, CATCHPIT WITH TRAP IS NORMALLY NOT PREFERRED DUE TO PONDING PROBLEM.
7. UPON THE REQUEST FROM MAINTENANCE PARTY, DRAIN PIPES AT CATCHPIT BASE CAN BE USED BUT THIS IS FOR CATCHPITS LOCATED AT SLOPE TOE ONLY AND AS DIRECTED BY THE ENGINEER.
8. FOR CATCHPITS CONSTRUCTED ON OR ADJACENT TO A FOOTPATH, STEEL GRATINGS (SEE DETAIL 'A' ON STD. DRG. NO. C2405) OR CONCRETE COVERS (SEE STD. DRG. NO. C2407) SHALL BE PROVIDED AS DIRECTED BY THE ENGINEER.
9. IF INSTRUCTED BY THE ENGINEER, HANDRAILING (SEE DETAIL 'G' ON STD. DRG. NO. C2405; EXCEPT ON THE UPSLOPE SIDE) IN LIEU OF STEEL GRATINGS OR CONCRETE COVERS CAN BE ACCEPTED AS AN ALTERNATIVE SAFETY MEASURE FOR CATCHPITS NOT ON A FOOTPATH NOR ADJACENT TO IT. TOP OF THE HANDRAILING SHALL BE 1 000 mm MIN. MEASURED FROM THE ADJACENT GROUND LEVEL.
10. MINIMUM INTERNAL CATCHPIT WIDTH SHALL BE 1 000 mm FOR CATCHPITS WITH A HEIGHT EXCEEDING 1 000 mm MEASURED FROM THE INVERT LEVEL TO THE ADJACENT GROUND LEVEL. AND, STEP IRONS (SEE DSD STD. DRG. NO. DS1043) AT 300 c/c STAGGERED SHALL BE PROVIDED. THICKNESS OF CATCHPIT WALL FOR INSTALLATION OF STEP IRONS SHALL BE INCREASED TO 150 mm.
11. FOR RETROFITTING AN EXISTING CATCHPIT WITH STEEL GRATING, SEE DETAIL 'F' ON STD. DRG. NO. C2405.
12. SUBJECT TO THE APPROVAL OF THE ENGINEER, OTHER MATERIALS CAN ALSO BE USED AS COVERS / GRATINGS.

-	FORMER DRG. NO. C2406J.	Original Signed	03.2015
REF.	REVISION	SIGNATURE	DATE

**CATCHPIT WITH TRAP
(SHEET 2 OF 2)**



**CIVIL ENGINEERING AND
DEVELOPMENT DEPARTMENT**

SCALE 1 : 20

DATE JAN 1991

DRAWING NO.

C2406 /2


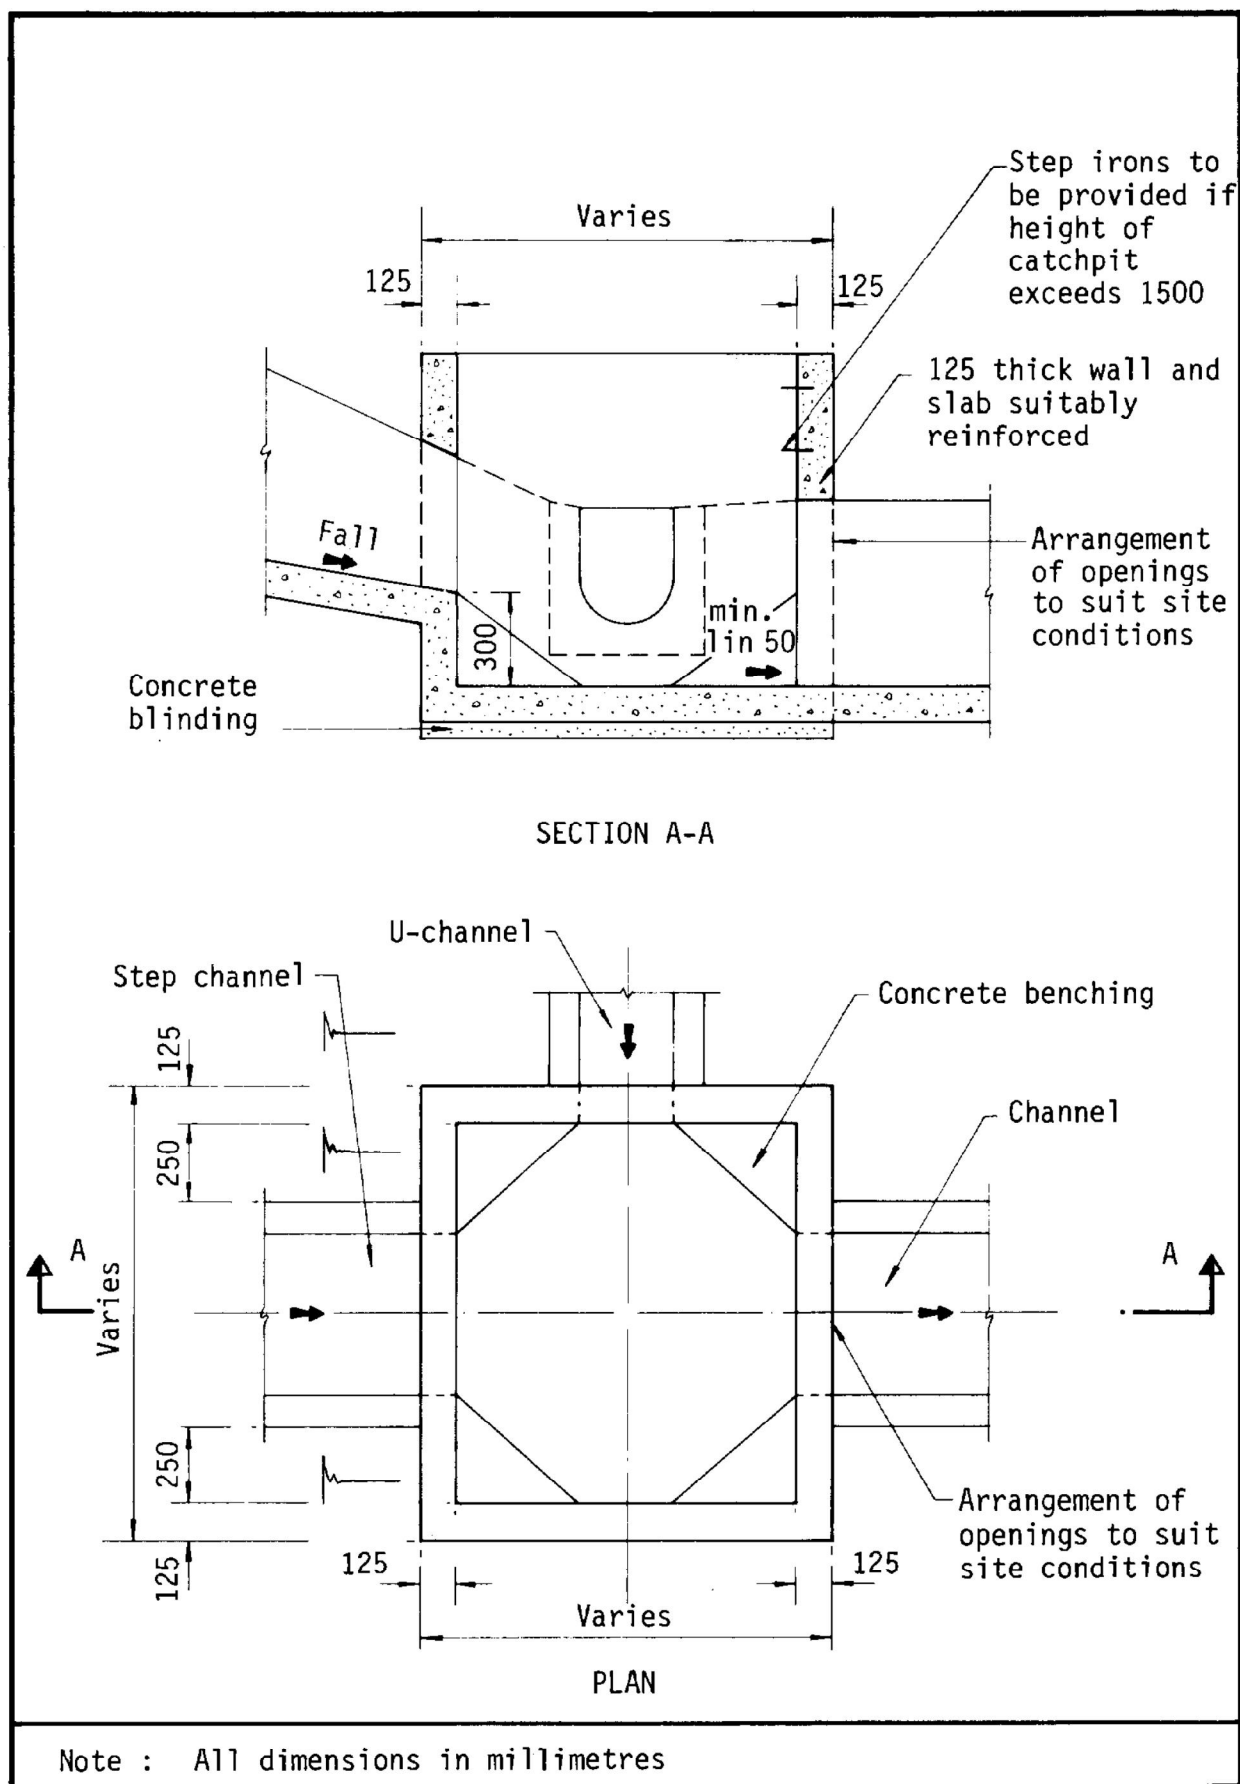


Figure 8.10 - Typical Details of Catchpits

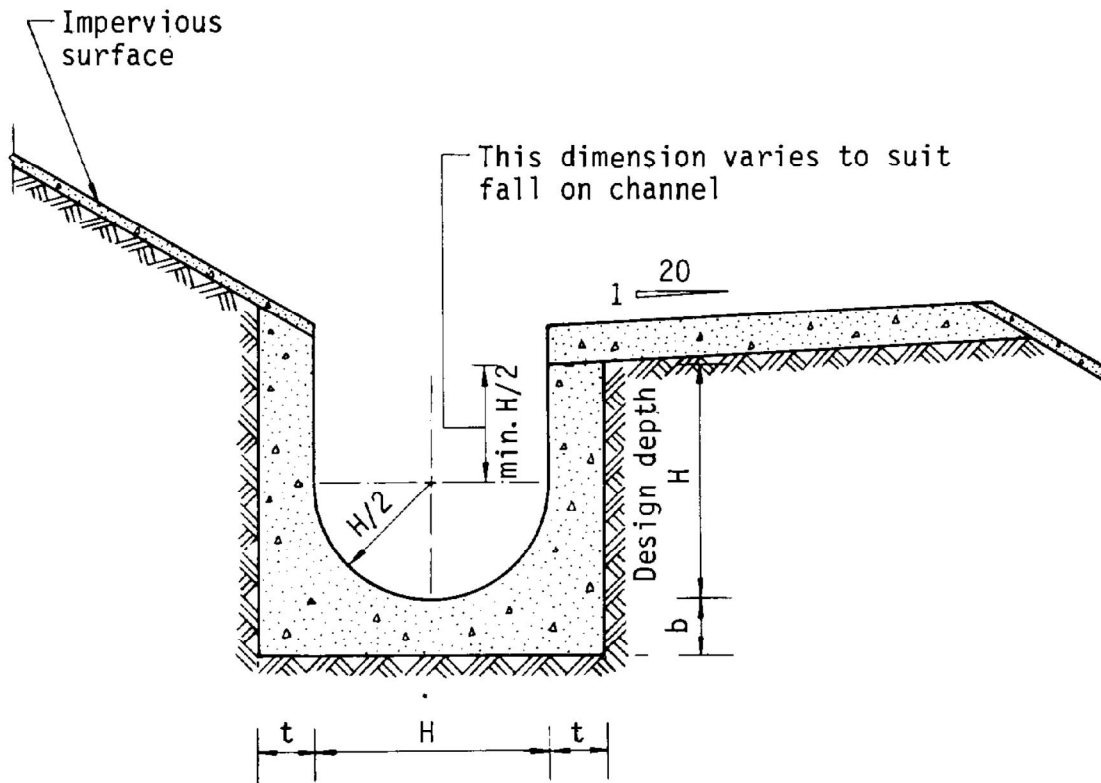

Dimensions of U - channel

Nominal size of channel H (mm)	Thickness t (mm)	Thickness b (mm)
225 to 600	150	150
675 to 1200	175	225

Figure 8.11 - Typical U-channel Details