

正宏工程顧問公司

CHING WAN ENGINEERING CONSULTANT COMPANY

Project:

Proposed Temporary Warehouse (Cold Store for Iced Poultry) and Shop and Services (Fresh Provision Shop) and Associated Filling of Land for a Period of 3 Years at Lots 510, 511, 512 and 524 S.A ss.1 S.A in D.D. 90, Lin Ma Hang Road, Ta Kwu Ling, New Territories

(Application Number:A/NE-MKT/55)

Title:

Drainage Proposal -
CATCHMENT AREA PLAN

D02

Drawn by:

DM


Date:

8-12-2025


Check by:

DM

Scale:

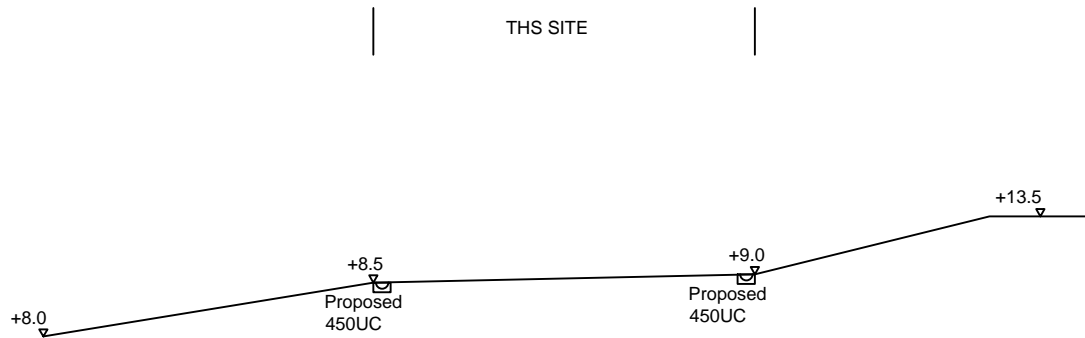

SECTION A-A

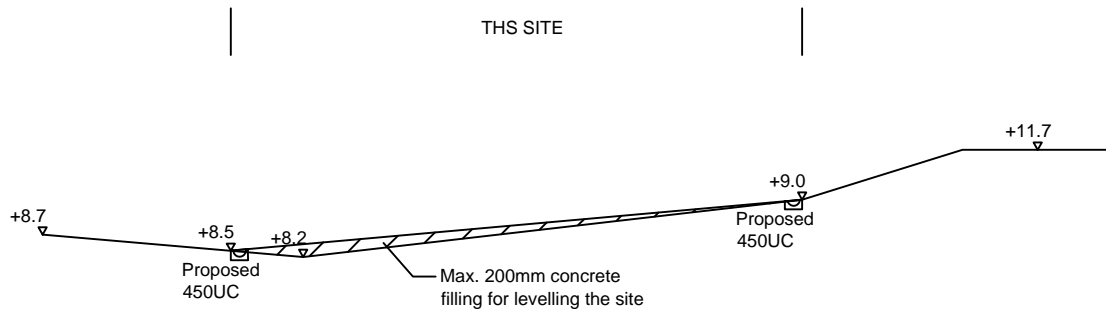

SECTION B-B

正宏工程顧問公司

CHING WAN ENGINEERING CONSULTANT COMPANY

Project:
Proposed Temporary Warehouse (Cold Store for Iced Poultry) and Shop and Services (Fresh Provision Shop) and Associated Filling of Land for a Period of 3 Years at Lots 510, 511, 512 and 524 S.A ss.1 S.A in D.D. 90, Lin Ma Hang Road, Ta Kwu Ling, New Territories
 (Application Number:A/NE-MKT/55)

Title:

Drainage Proposal -
 SECTIONS

D03

Drawn by:

DM

Date:

8-12-2025

Check by:

DM

Scale:

Photo 1



Photo 2

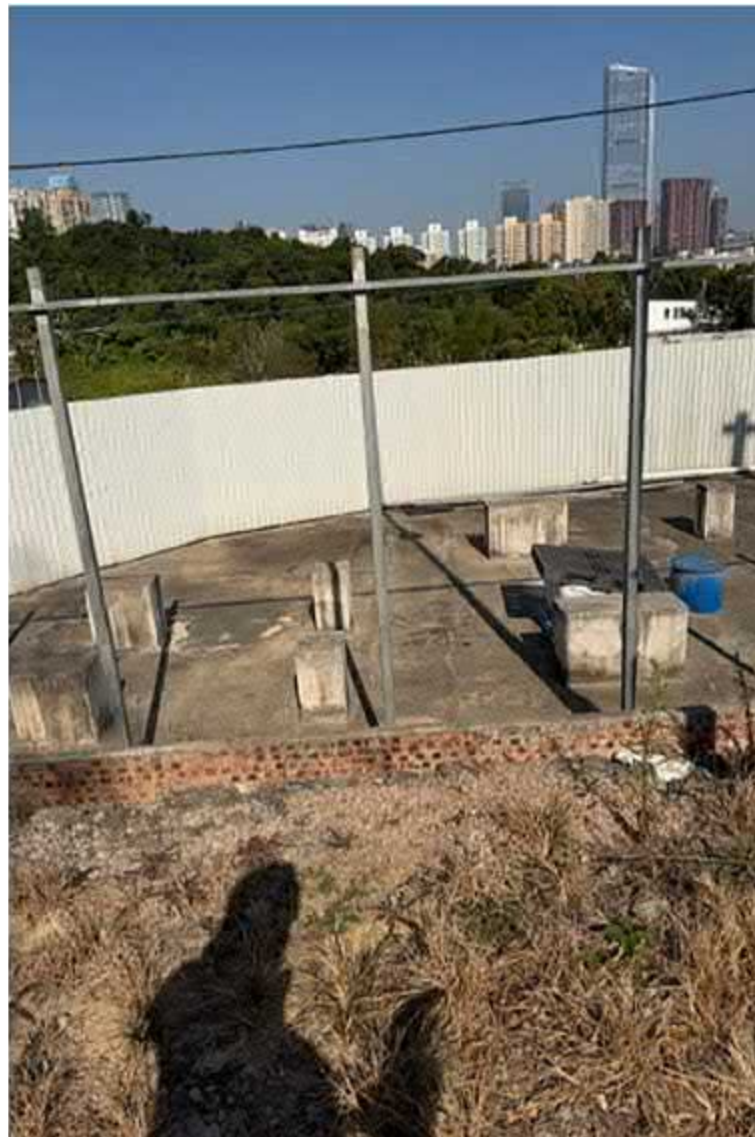


Photo 3



Photo 4



Photo 5



Photo 6



Photo 7



Photo 8



Photo 9



Photo 10



THE SITE, Area = 1500 m² (C= 0.95)

Outside Catchment Area, Area = 3976 m² (C= 0.6)

Calculation of Design Runoff of the Proposed Development,

For the design of drains inside the site,

$$\Sigma Q = \Sigma 0.278 C i A$$

$$\begin{aligned} A &= 1500 + 3976 \text{ m}^2 \\ &= 5476 \\ &= 0.005476 \text{ km}^2 \end{aligned}$$

$$\begin{aligned} t &= 0.14465 L / H^{0.2} A^{0.1} \\ &= 0.14465 * 53 / 1^{0.2} * 5476^{0.1} \\ &= 3.242 \text{ min} \end{aligned}$$

$$\begin{aligned} i &= 1.16 * a / (t + b)^c && (50 \text{ yrs return period, Table 3d, Corrigendum 2024,} \\ &= 1.16 * 474.6 / (3.242 + 2.90)^{0.371} && \text{SDM) and (16\% increase due to climate change)} \\ &= 267.5 \text{ mm/hr} \end{aligned}$$


$$\begin{aligned} \text{Therefore, } Q &= 0.278 * 0.95 * 267.5 * 0.0015 + 0.278 * 0.6 * 267.5 * 0.003976 \\ &= 0.2833 \text{ m}^3/\text{sec} \\ &= \underline{17000} \text{ lit/min} \end{aligned}$$


Provide 450UC (1:150) is OK

GEO Technical Guidance Note No. 43 (TGN 43)
Guidelines on Hydraulic Design of U-shaped and Half-round Channels on Slopes

Issue No.: 1 Revision: - Date: 05.06.2014 Page: 3 of 3


Figure 1 - Chart for the rapid design of U-shaped and half-round channels up to 600 mm

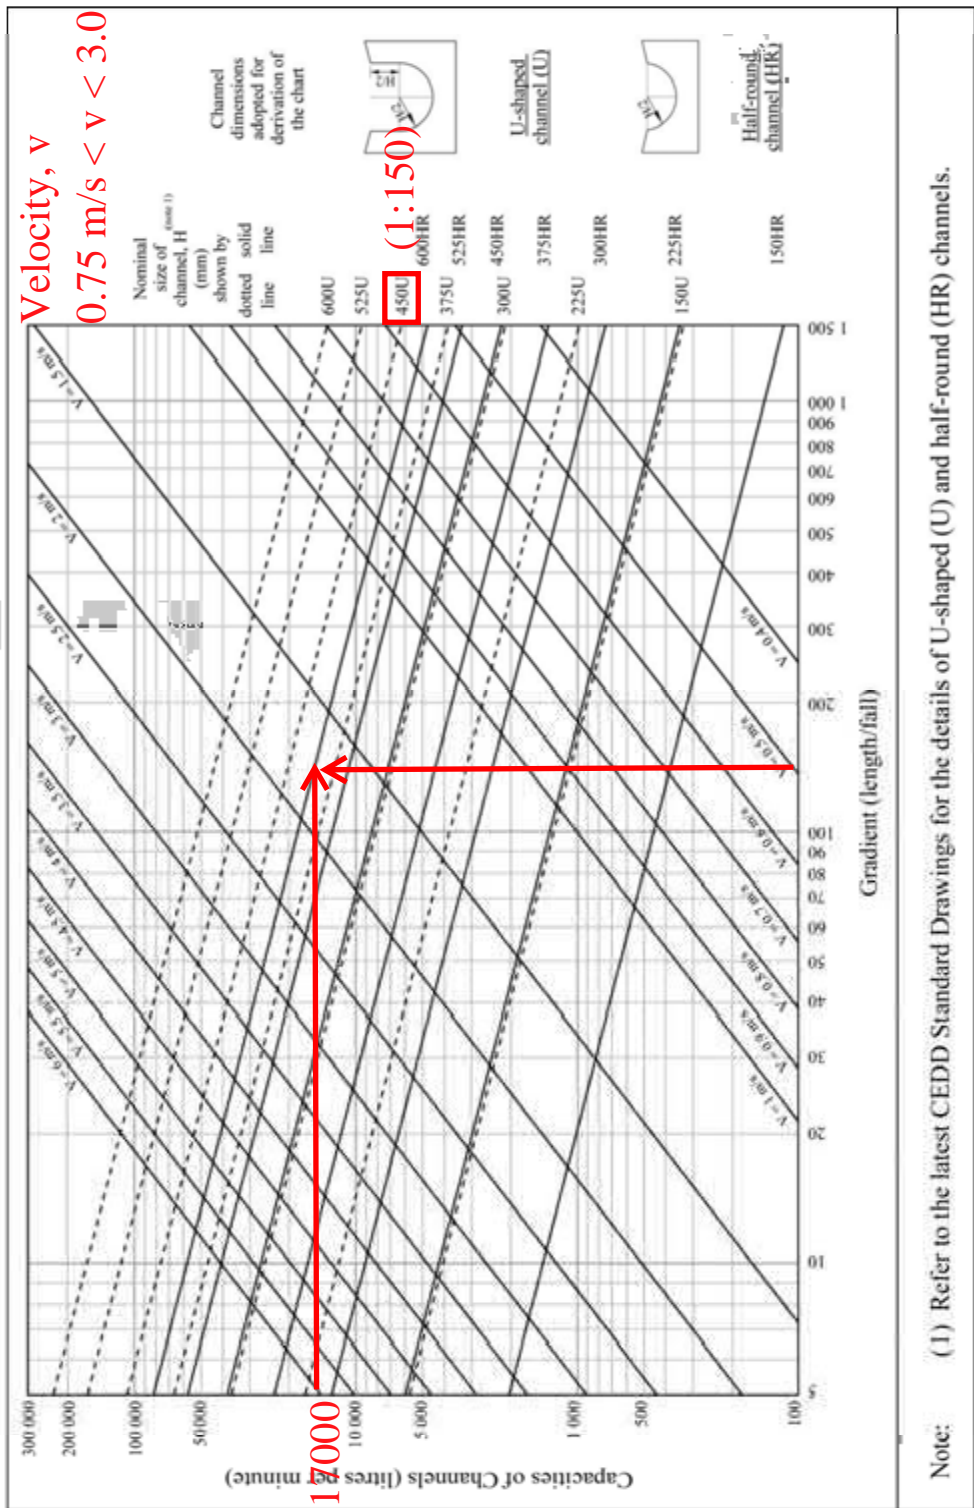

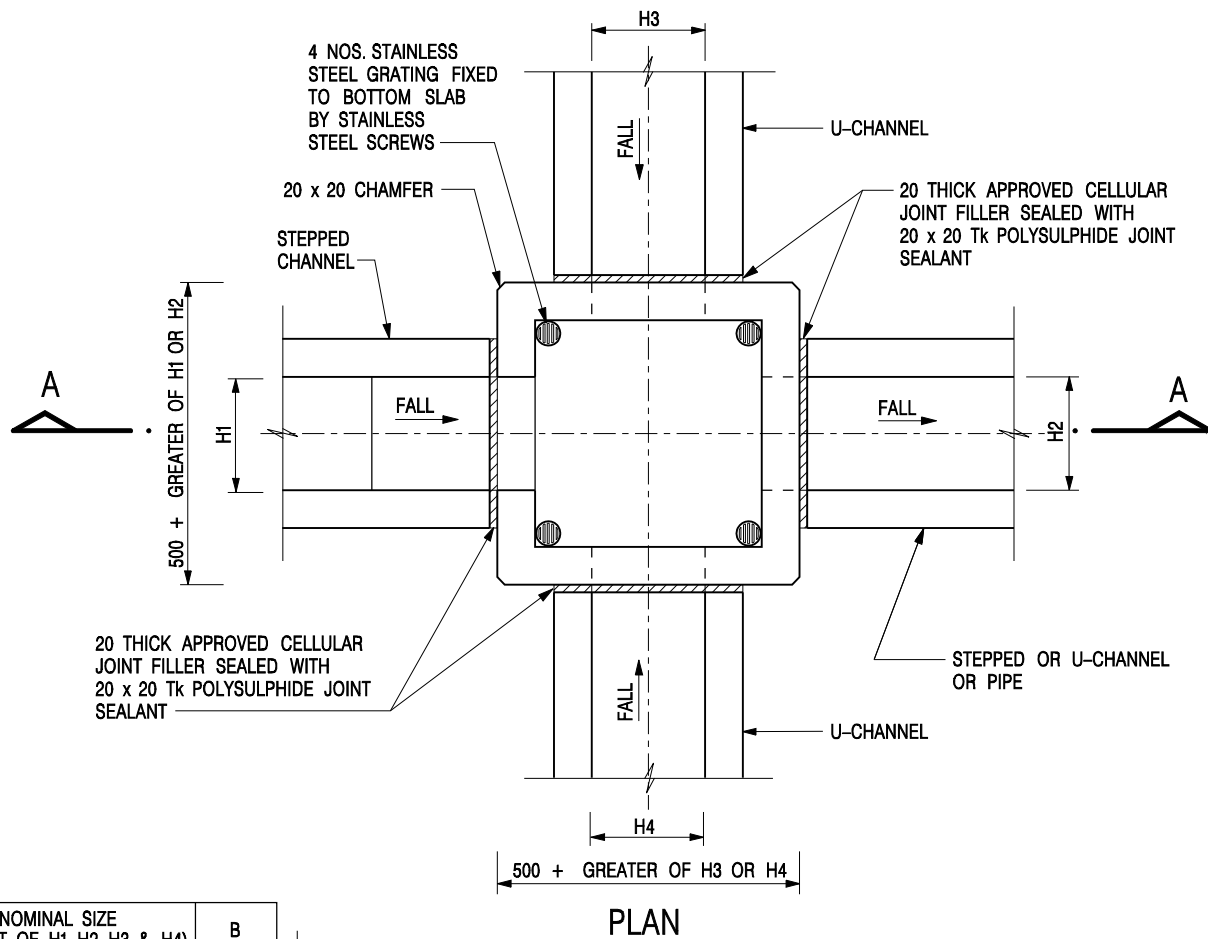

NOMINAL SIZE (LARGEST OF H1, H2, H3 & H4)	B
300 - 600	150
675 - 900	175

20 THICK APPROVED CELLULAR JOINT FILLER SEALED WITH 20 x 20 Tk POLYSULPHIDE JOINT SEALANT

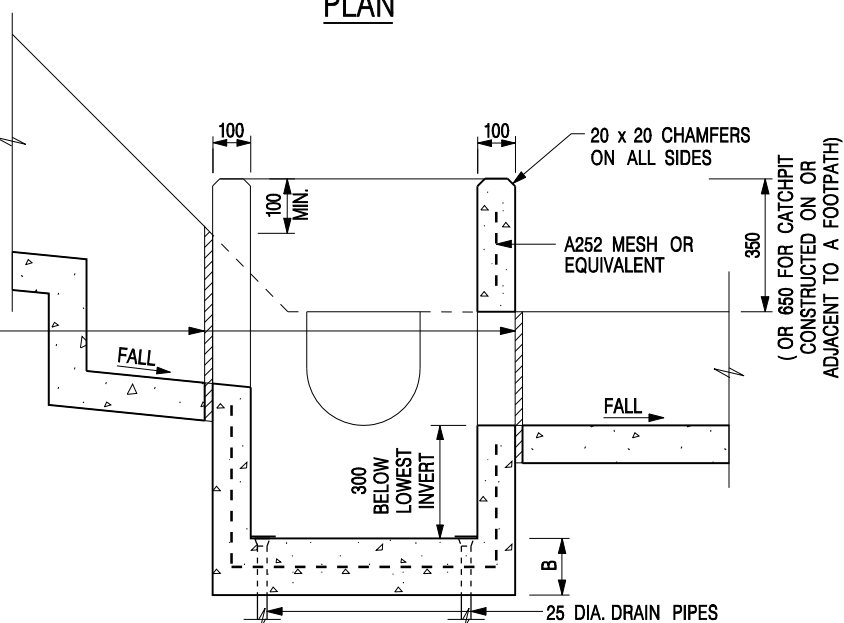

NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES.
- REFER TO SHEET 2 FOR OTHER NOTES.

CATCHPIT WITH TRAP
(SHEET 1 OF 2)

-	FORMER DRG. NO. C2406J.	Original Signed	03.2015
REF.	REVISION	SIGNATURE	DATE




**CIVIL ENGINEERING AND
DEVELOPMENT DEPARTMENT**

SCALE 1 : 20

DATE JAN 1991

DRAWING NO.
C2406 /1

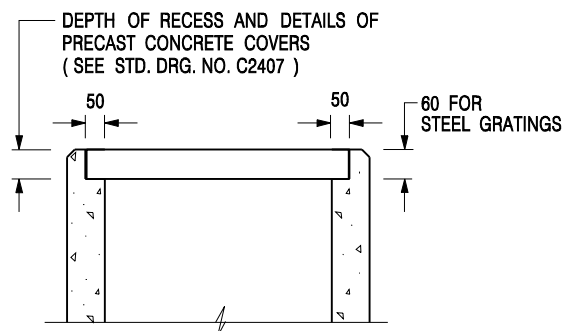

ALTERNATIVE TOP SECTION FOR PRECAST CONCRETE COVERS / GRATINGS

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. ALL CONCRETE SHALL BE GRADE 20 /20.
3. CONCRETE SURFACE FINISH SHALL BE CLASS U2 OR F2 AS APPROPRIATE.
4. FOR DETAILS OF JOINT, REFER TO STD. DRG. NO. C2413.
5. CONCRETE TO BE COLOURED AS SPECIFIED.
6. UNLESS REQUESTED BY THE MAINTENANCE PARTY AND AS DIRECTED BY THE ENGINEER, CATCHPIT WITH TRAP IS NORMALLY NOT PREFERRED DUE TO PONDING PROBLEM.
7. UPON THE REQUEST FROM MAINTENANCE PARTY, DRAIN PIPES AT CATCHPIT BASE CAN BE USED BUT THIS IS FOR CATCHPITS LOCATED AT SLOPE TOE ONLY AND AS DIRECTED BY THE ENGINEER.
8. FOR CATCHPITS CONSTRUCTED ON OR ADJACENT TO A FOOTPATH, STEEL GRATINGS (SEE DETAIL 'A' ON STD. DRG. NO. C2405 /2) OR CONCRETE COVERS (SEE STD. DRG. NO. C2407) SHALL BE PROVIDED AS DIRECTED BY THE ENGINEER.
9. IF INSTRUCTED BY THE ENGINEER, HANDRAILING (SEE DETAIL 'J' ON STD. DRG. NO. C2405 /5; EXCEPT ON THE UPSLOPE SIDE) IN LIEU OF STEEL GRATINGS OR CONCRETE COVERS CAN BE ACCEPTED AS AN ALTERNATIVE SAFETY MEASURE FOR CATCHPITS NOT ON A FOOTPATH NOR ADJACENT TO IT. TOP OF THE HANDRAILING SHALL BE 1 000 mm MIN. MEASURED FROM THE ADJACENT GROUND LEVEL.
10. MINIMUM INTERNAL CATCHPIT WIDTH SHALL BE 1 000 mm FOR CATCHPITS WITH A HEIGHT EXCEEDING 1 000 mm MEASURED FROM THE INVERT LEVEL TO THE ADJACENT GROUND LEVEL. AND, STEP IRONS (SEE DSD STD. DRG. NO. DS1043) AT 300 c/c STAGGERED SHALL BE PROVIDED. THICKNESS OF CATCHPIT WALL FOR INSTALLATION OF STEP IRONS SHALL BE INCREASED TO 150 mm.
11. FOR RETROFITTING AN EXISTING CATCHPIT WITH STEEL GRATING, SEE DETAIL 'G' ON STD. DRG. NO. C2405 /4.
12. SUBJECT TO THE APPROVAL OF THE ENGINEER, OTHER MATERIALS CAN ALSO BE USED AS COVERS / GRATINGS.

A	MINOR AMENDMENT.	Original Signed	04.2016
-	FORMER DRG. NO. C2406J.	Original Signed	03.2015
REF.	REVISION	SIGNATURE	DATE

**CATCHPIT WITH TRAP
(SHEET 2 OF 2)**



**CIVIL ENGINEERING AND
DEVELOPMENT DEPARTMENT**

SCALE 1 : 20

DATE JAN 1991

DRAWING NO.

C2406 /2A


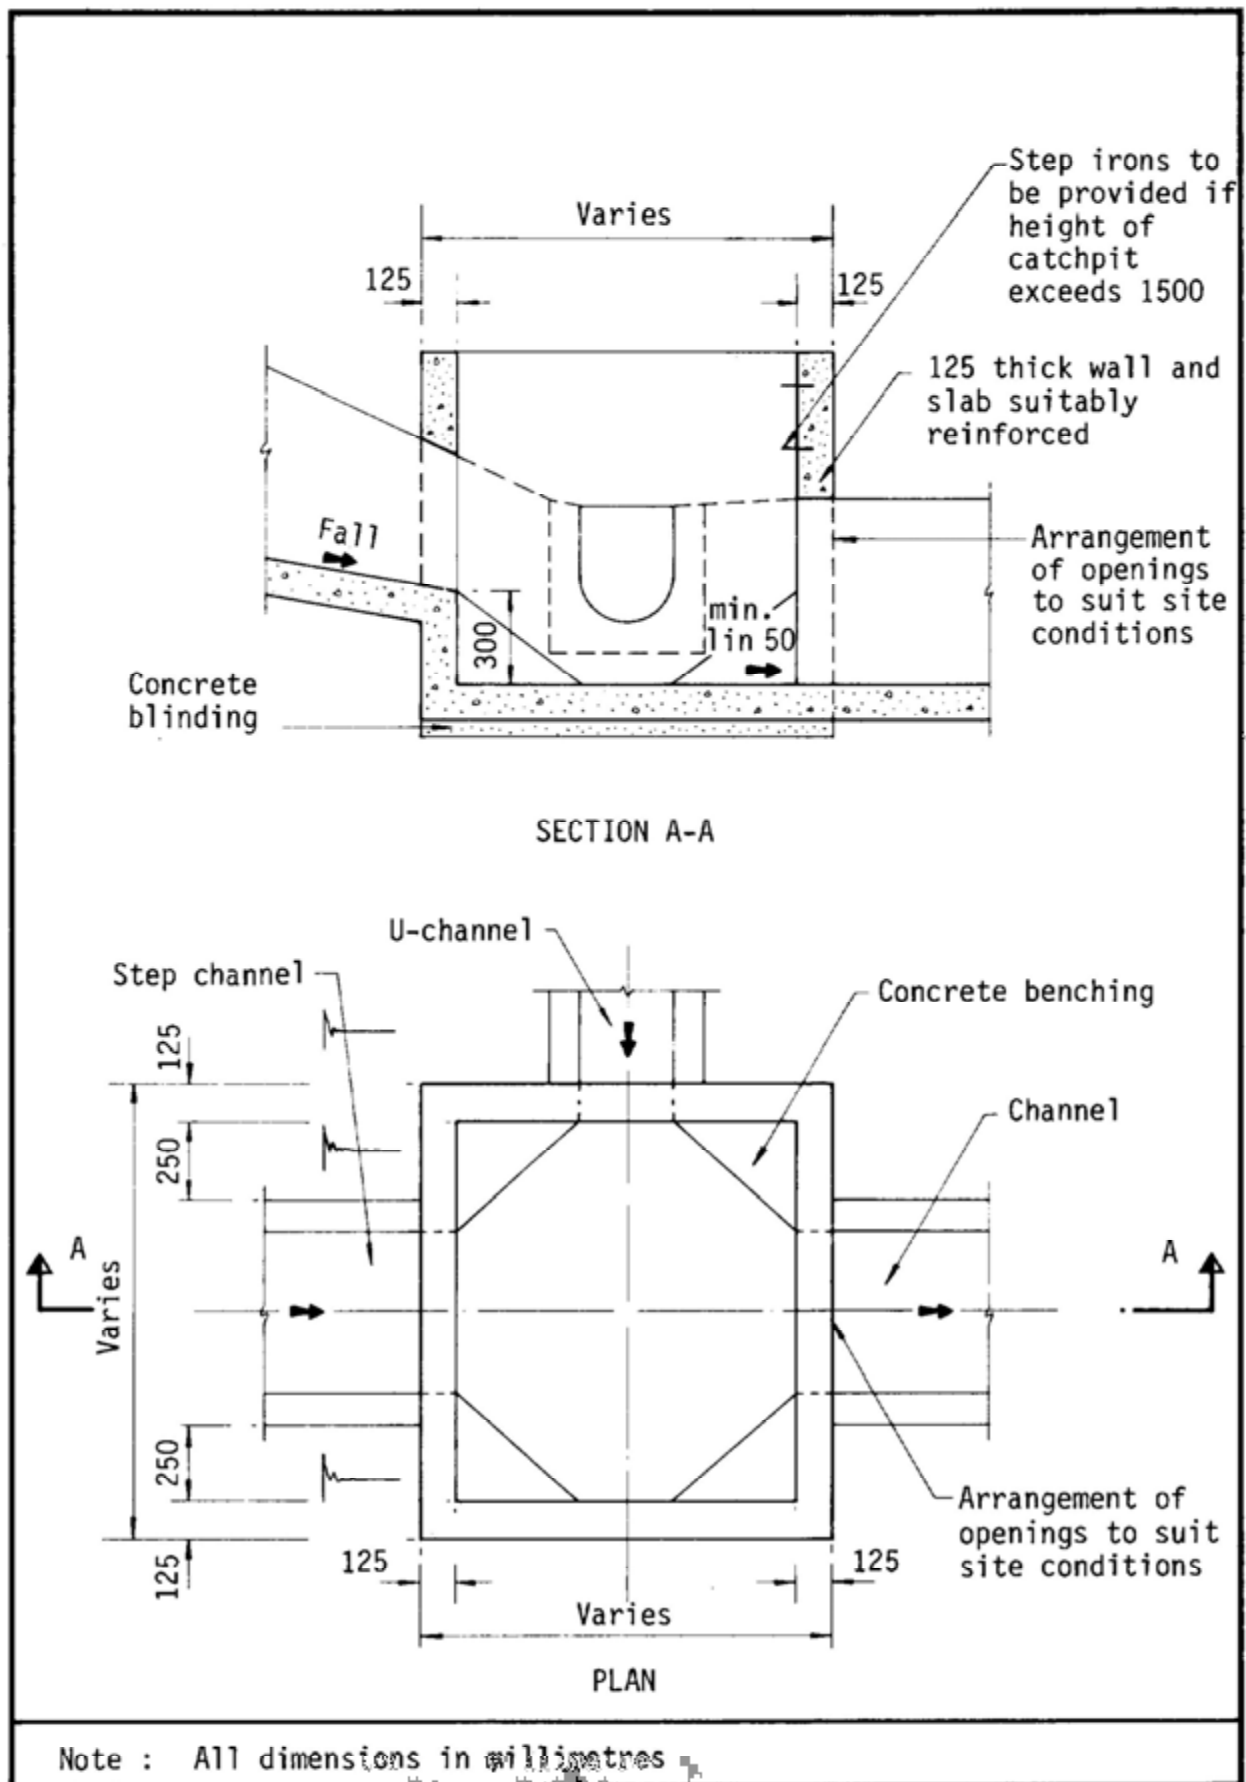


Figure 8.10 - Typical Details of Catchpits

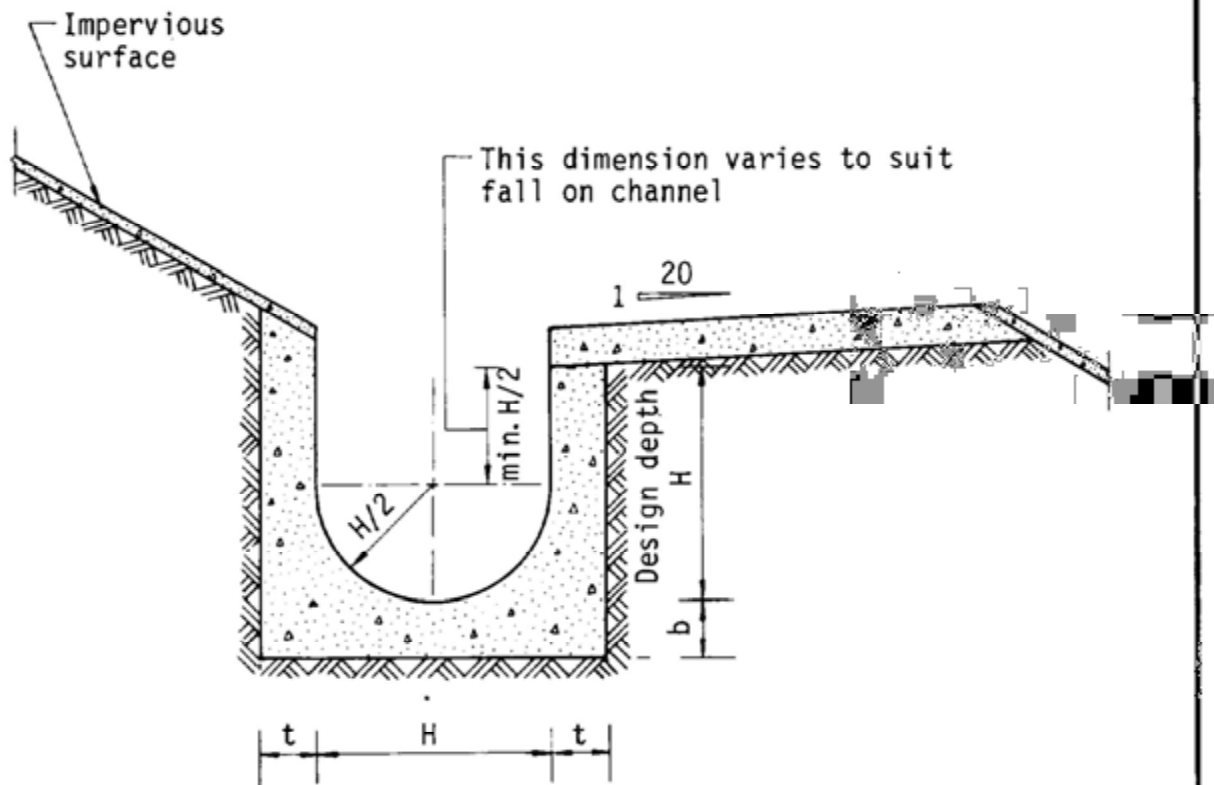

Dimensions of U - channel

Nominal size of channel H (mm)	Thickness t (mm)	Thickness b (mm)
225 to 600	150	150
675 to 1200	175	225

Figure 8.11 - Typical U-channel Details