


Sectional Plan_HV


NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TITLES TO BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm

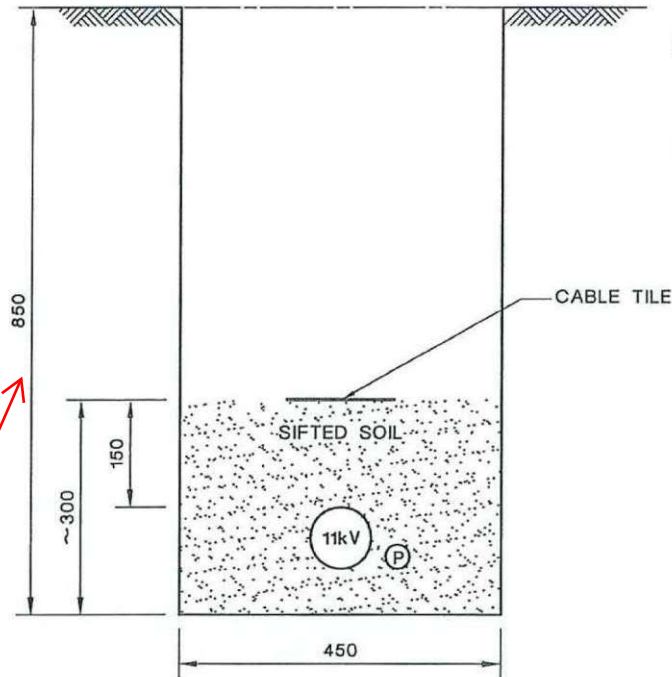

STANDARD 850mm
(Buffer up to 1200mm)

EXISTING ARRANGEMENT OF 11kV CABLE TRENCH

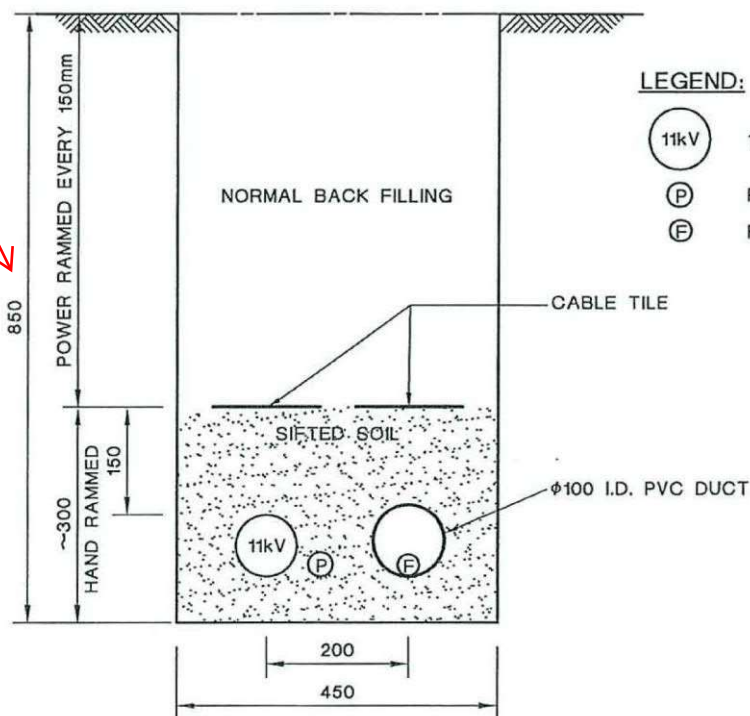

LEGEND:

- 11kV 11kV 3/C XLPE POWER CABLE
- (P) PILOT CABLE
- (F) FIBRE OPTIC CABLE

11kV CABLE TRENCH WITH FIBRE OPTIC CABLE IN PVC DUCT

D	GENERAL REVISION			C	NOTE ADDED				A	NO AMENDMENT AFTER REVIEW																
CLP 中電					REVS.	15.8.03	4.4.07	18.6.07	28.6.11																	
						A	B	C	D	E	F	G	H	J	K	L										
					INITIAL	C.F.YAM	Y.K.MAN	W.B.LEE	Y.K.MAN																	
					TITLE :																					
					TYPICAL 11kV CABLE TRENCH WITH PILOT AND FIBRE OPTIC CABLES - TYPE II																					
DRAWN: K. F. CHEUNG		DATE: 11-4-2000																								
CHECKED: C. Y. IP		APPROVED: W. B. LEE																								
SCALE:		SHEET(S) IN SET: 1		PROJECT NO.						CONTRACT NO.																
ASSET MANAGEMENT					DRG. NO.	T	G	E	N	1	0	5	2	0	D	E	3	3	0	0	0	6	0	1	D	A