


Location Plan



LEGEND :

- | | |
|--|--|
| PROPOSED TRENCH FOR LAYING / RECOVERING CABLE | EXISTING OVERHEAD LINE & POLE |
| PROPOSED TRENCH FOR LAYING DUCTS | PROPOSED 11kV, L.V., OHL, OF STEEL / WOODEN POLE |
| PROPOSED CABLE THROUGH EXISTING DUCTS | OVERHEAD LINE & POLE TO BE REMOVED |
| EXISTING PILLAR | PROPOSED TREE TRIMMING / CUTTING |
| PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX | EXISTING POLE MOUNTED TRANSFORMER |
| EXCAVATION FOR JOINTING / REPAIRING / INSPECTING CABLE | PROPOSED POLE MOUNTED TRANSFORMER |
| PROPOSED 5.0M(L) x 2.39M(W) x 3.0M(H) PACKAGE SUBSTATION | PROPOSED STAY / STAY POLE |

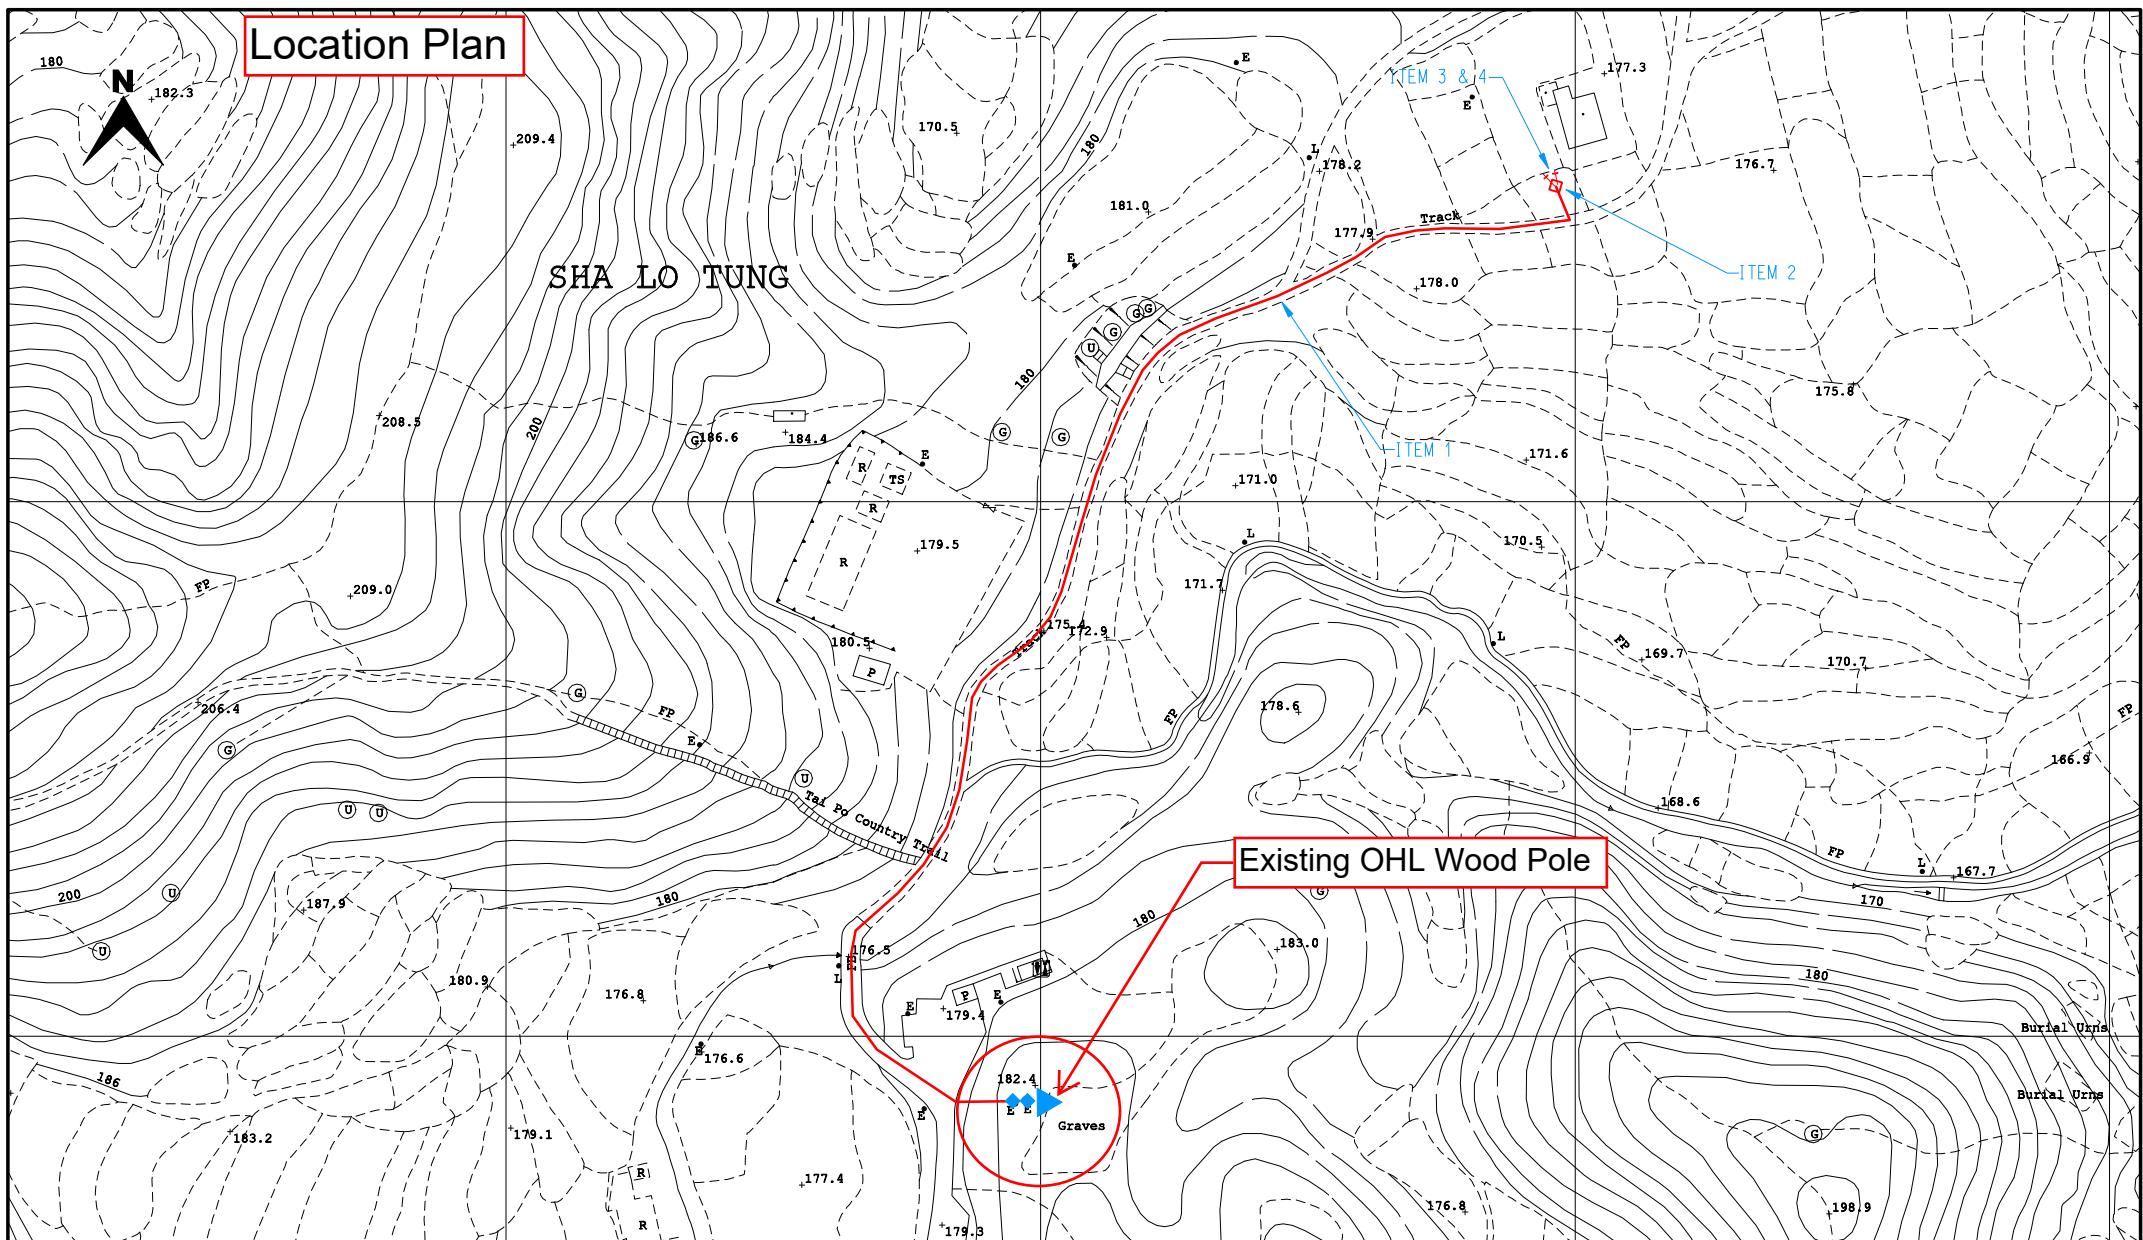

TITLE :11kV Cable Laying &
Pole & Stay Erection
At Sha Lo Tung

SCALE 1:1000

DRAWN :KATE WONG

DATE :08-06-2018

CHECKED : C.C.CHEUNG

REGION :NR

O.C. : SS

E/O NO :

MAP NO : 03SW20C, 03SW20D

PROJECT REF. : NRSS2016-0835

PLAN REF. :NRSS2016-0835-06TH