

電話 Tel: 2654 1307

圖文傳真 Fax: 2650 9896

電郵地址 Email: gendlotp@landsd.gov.hk

本署檔號 Our Ref: (130) in DLO/TP 439/TLT/90

來函檔號 Your Ref: DD15/H19/16

來函請註明本署檔號

Please quote our reference in your reply

Access Consulting Limited
Flat 92, 7th Floor, Lee Fung Bldg.,
Nos. 88-96, Argyle Street,
Mong Kok, Kowloon



地政總署
大埔地政處
DISTRICT LANDS OFFICE/
TAI PO
LANDS DEPARTMENT

我們矢志努力不懈，提供盡善盡美的土地行政服務。
We strive to achieve excellence in land administration.

新界大埔汀角路一號大埔政府合署一樓
1/F, TAI PO GOVERNMENT OFFICES BUILDING,
1 TING KOK ROAD, TAI PO, NEW TERRITORIES.
網址 Website: www.landsd.gov.hk

16 MAR 2017

Dear Sir,

Application for the construction of Small House (SH)
Lots Nos. 646 S.K ss.1 and 652 S.C ss.1 in D.D. 15
Shan Liu Village, Tai Po, N.T.
(Re-Submission of Sewerage Connection Proposal)

I refer to your letter 28 June 2016 enclosing a sewerage drainage proposal in respect of the subject site.

2. Please be informed that the proposal has been examined by staff of Drainage Services Department (DSD) and DSD has no further comment on the proposed works.
3. However, You are reminded that the requirements/general comments in paragraphs 3(a) to 3(f) in my previous letter dated 2 June 2016 are still valid.
4. Should you have any enquiries, please contact the undersigned at 2654 1307.

Yours faithfully,

(Wales H.C LEUNG)
for District Lands Officer, Tai Po

c.c.
Mr. CHEUNG Chi Keung
M/F., No. 8 Fook On Building,
Wan Tau Street,
Tai Po, N.T.

Access Consulting Limited

惠實顧問有限公司

Flat 92, 7th floor, Lee Fung Bldg., Nos.88-96 Argyle Street, Mongkok, Kowloon.

Tel: 2390 5319 Fax: 2787 6407

E-mail: accessconsulting18@yahoo.com.hk

(Civil & Structural Engineering Consultant)

Your Ref.:

Our Ref.:

Date:

DLO/TP 439/TLT/90

DD15/H19/16

28 June 2016

District Lands Office, Tai Po
District Lands Department
1/F., Tai Po District Government Offices,
1 Ting Kok Road, Tai Po, New Territories

Dear Sir,

Application for the construction of Small House(SH)
Lot No. 646K1 and 652C1 in D.D 15 Shan Liu, Tai Po, N.T.
Submission of Sewerage connection Proposal


We refer to your letter dated 2nd June 2016 regarding the captioned project, we would like to reply DSD comments as follows:

2.(a) The revised sewerage plan is attached for your consideration


3.(a)-(f) Noted.

Should you have any question, please contact our Mr. John Lo at 2390 5319.

Yours faithfully,
Access Consulting Limited

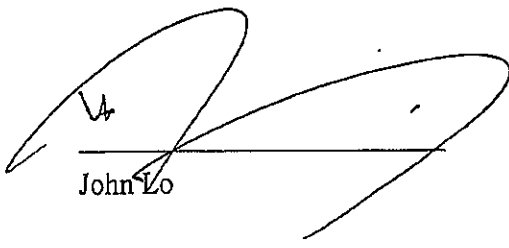

John Lo

RECEIVED BY
2016 JUN 29 A 11:26
DLO/TP



Legend:

- T1  Proposed Terminal Manhole (Type T1)
(Refer to DSD standard drawing DS1053)
-  Proposed 200mm Dia. Ductile Iron Pipe (DI)
-  Proposed Sewer Manhole (Type E1)
(Refer to DSD standard drawing DS1080)
-  Proposed 200mm PVC Downpipe
-  Existing Sewer Manhole Building By Government

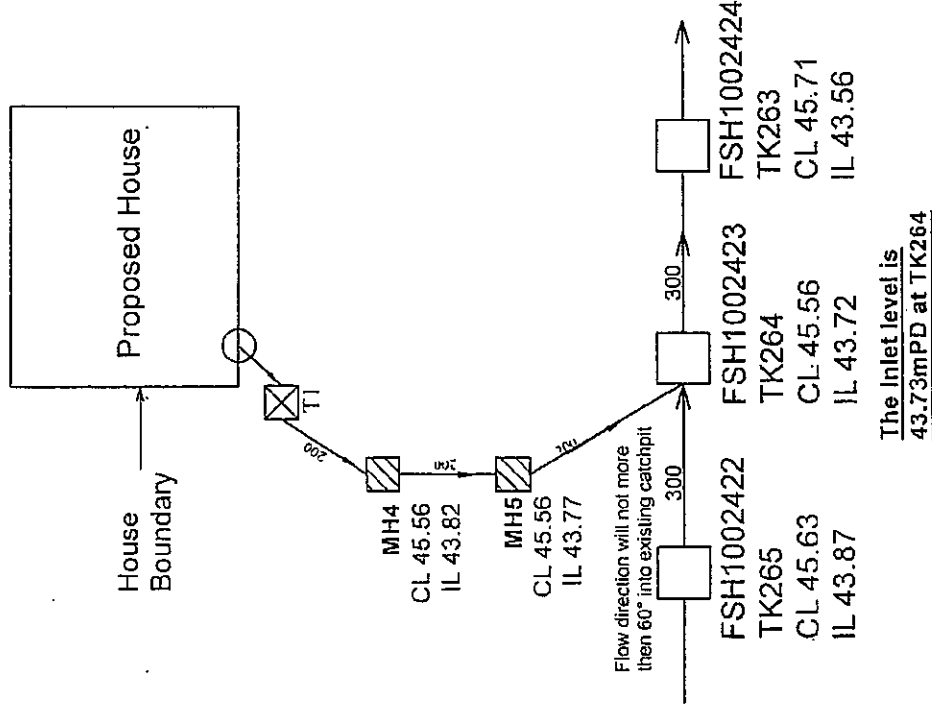

Manhole No.	Cover Level (mPD)	Invert Level (mPD)	D.T.I.L. (mPD)
FSH1002423	45.56	43.720	-
TK264	45.56	43.820	-
MH4	45.56	43.770	-
MH5	45.56	44.000	43.850
T1	45.56	44.000	43.850

Access Consulting Ltd.

Tel: 23905319 Fax: 27876407

Project:

Lot no. 646 K1 & 652 C1
in D.D. 15 Shan Liu, Tai Po, N.T.


Title:

Proposal Sewerage Plan


Drawing No.:

DD15/H19/SP-1(in)160107-R2

Scale: N.T.S. **Date:**



840500E



The Site

