


An updated drawing illustrating the proposed drawpits
and ducting layout plan

DRAWPIT SCHEDULE

| DRAWPIT NO. | L. | | W. | | D. |
|-------------------|------|---|------|---|------|
| A | 1200 | X | 1200 | X | 850 |
| C | 2000 | X | 2000 | X | 1200 |
| D | 3000 | X | 2000 | X | 1200 |
| CABLE JOINT PIT 1 | 8000 | X | 2000 | X | 1200 |
| CABLE JOINT PIT 2 | 8000 | X | 2000 | X | 1200 |
| | | | | | |

⑥ : TOTAL 6 NOS. Ø150 HDPE/UPVC PIPE WITH CONCRETE SURROUND

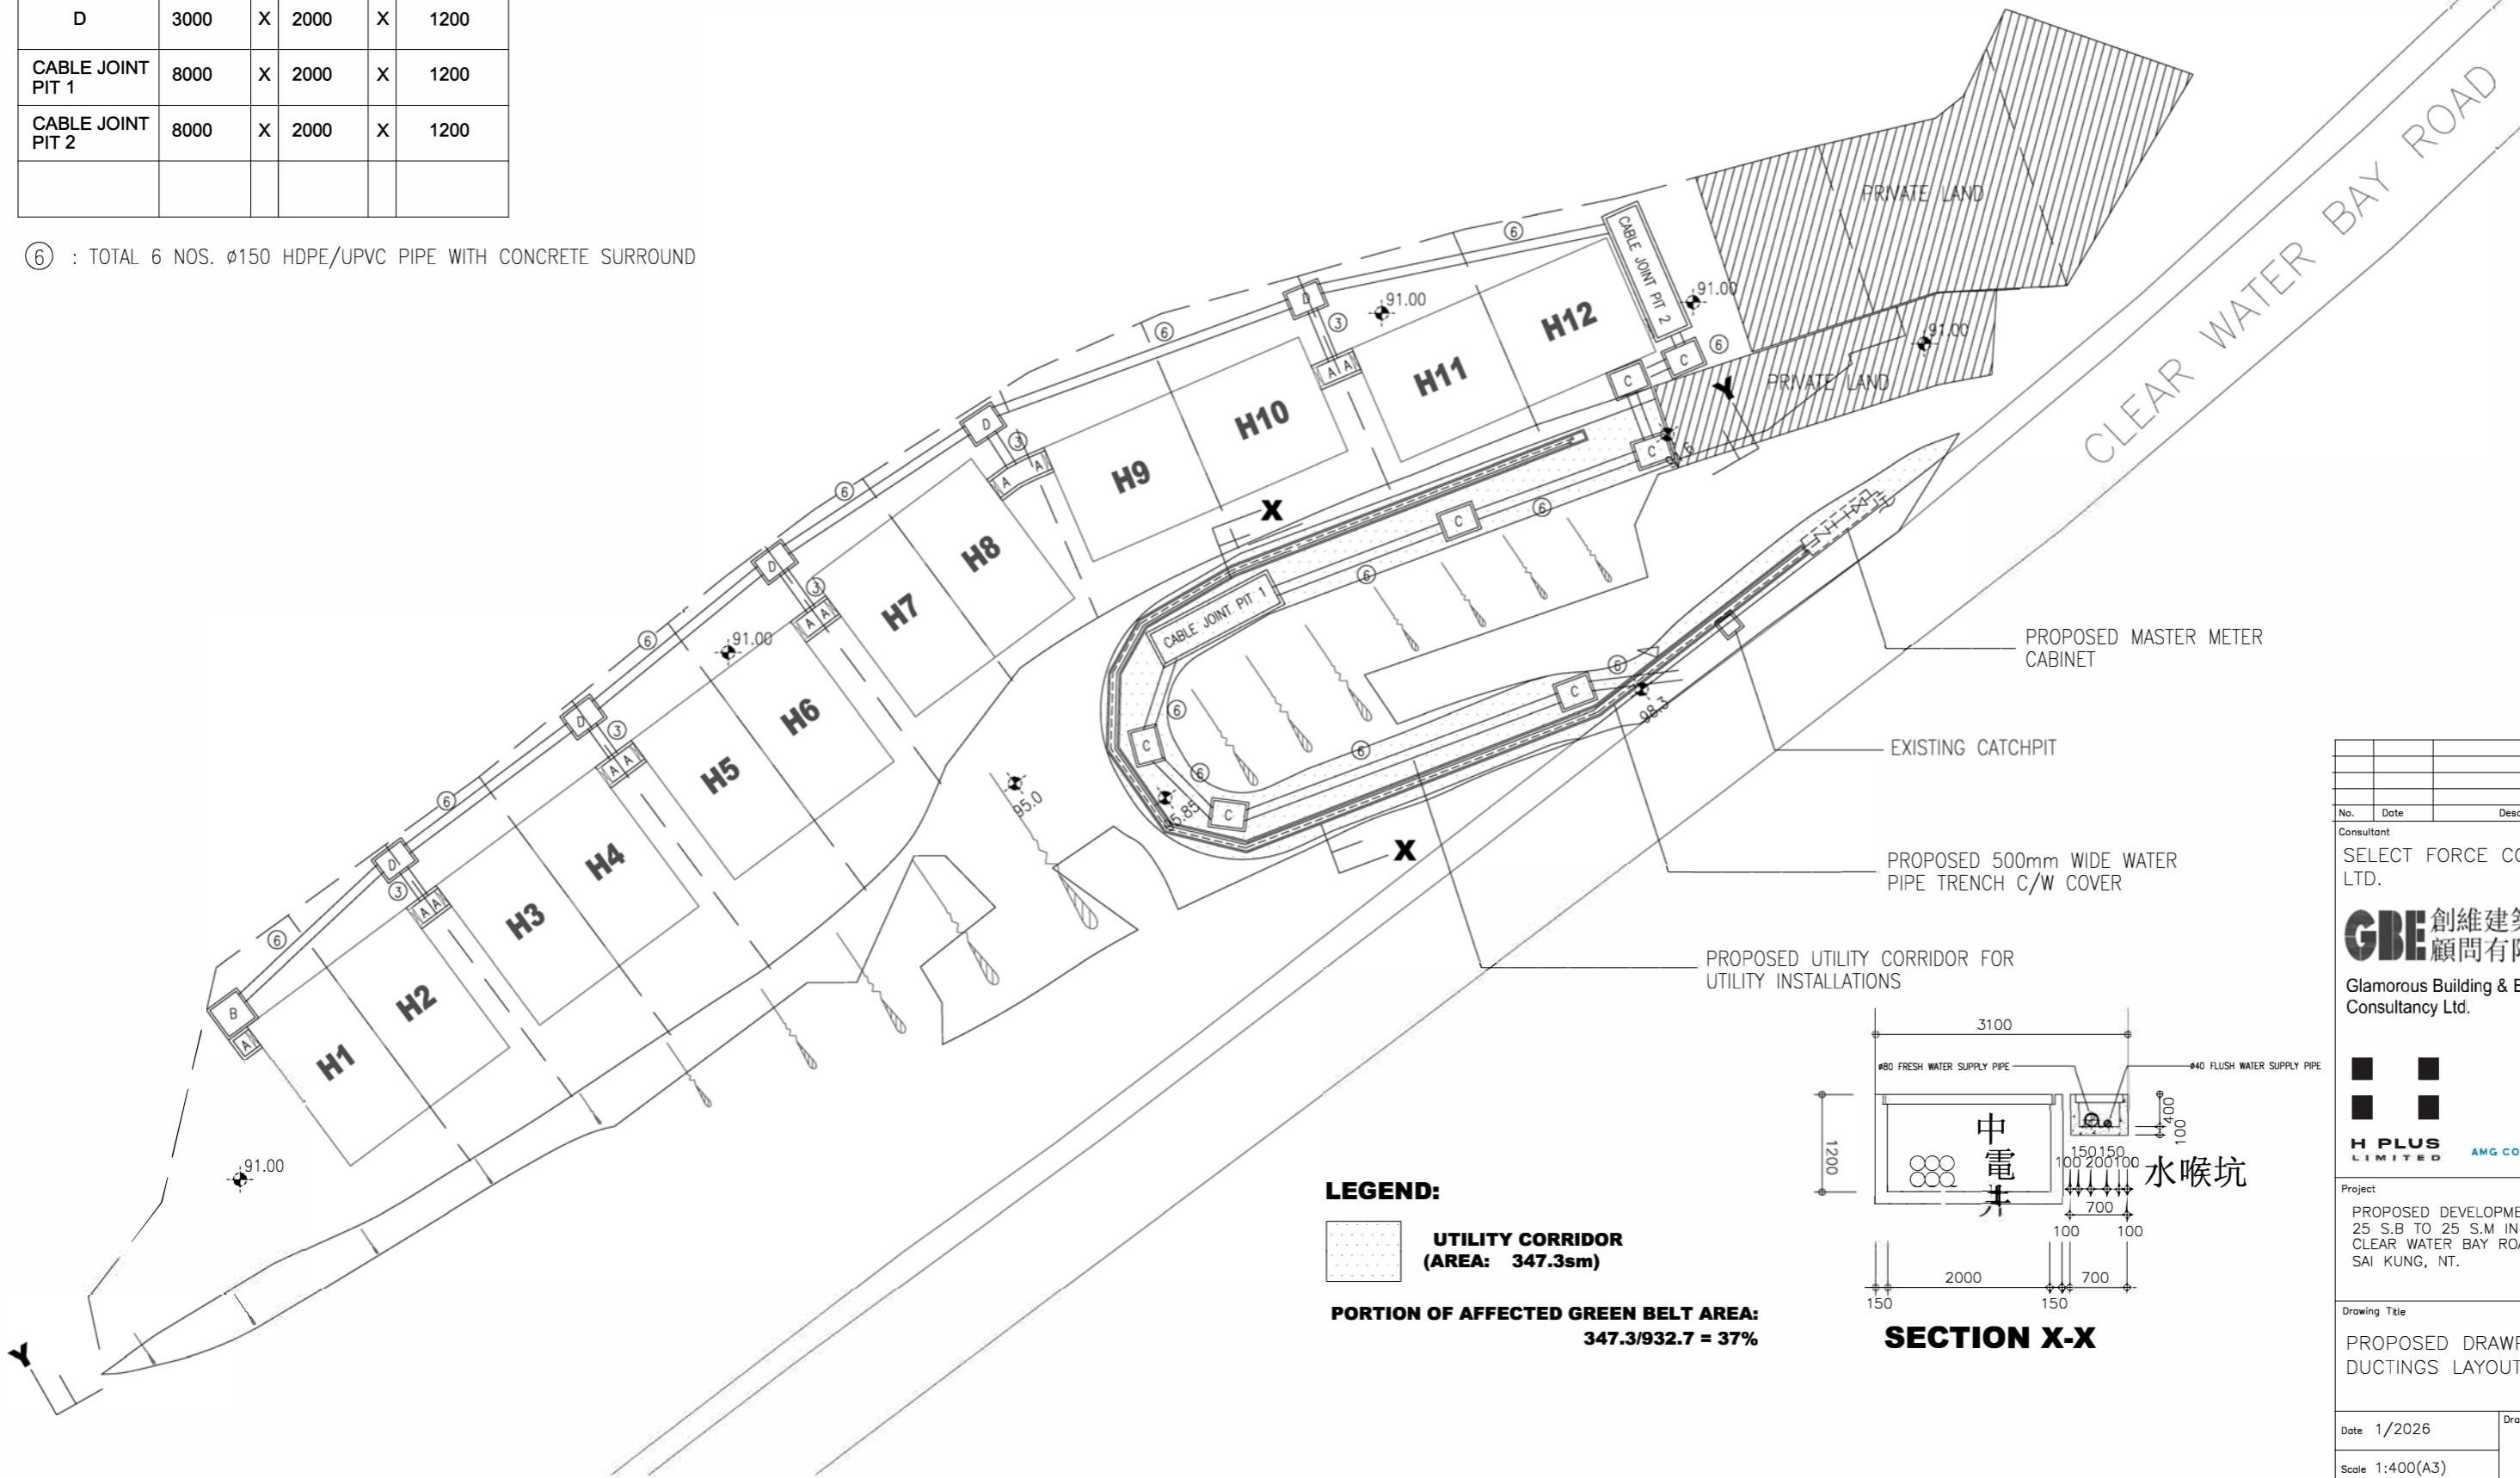

| No. | Date | Description |
|---|-------------|-------------|
| Consultant | | |
| SELECT FORCE CONSULTANTS LTD. | | |
| GBE 創維建築工程顧問有限公司 | | |
| Glamorous Building & Engineering Consultancy Ltd. | | |
| H PLUS LIMITED | | |
| AMG CONSULTANCY LIMITED | | |
| Project | | |
| PROPOSED DEVELOPMENT AT LOT NOS. 25 S.B TO 25 S.M IN D.D.233, CLEAR WATER BAY ROAD, SAI KUNG, NT. | | |
| Drawing Title | | |
| PROPOSED DRAWPITS AND DUCTINGS LAYOUT PLAN | | |
| Date 1/2026 | Drawing No. | CSD-01 |
| Scale 1:400(A3) | | |
| Drawn MFY | Rev. No. | A |
| Checked MFY | | |
| Approved | | |