
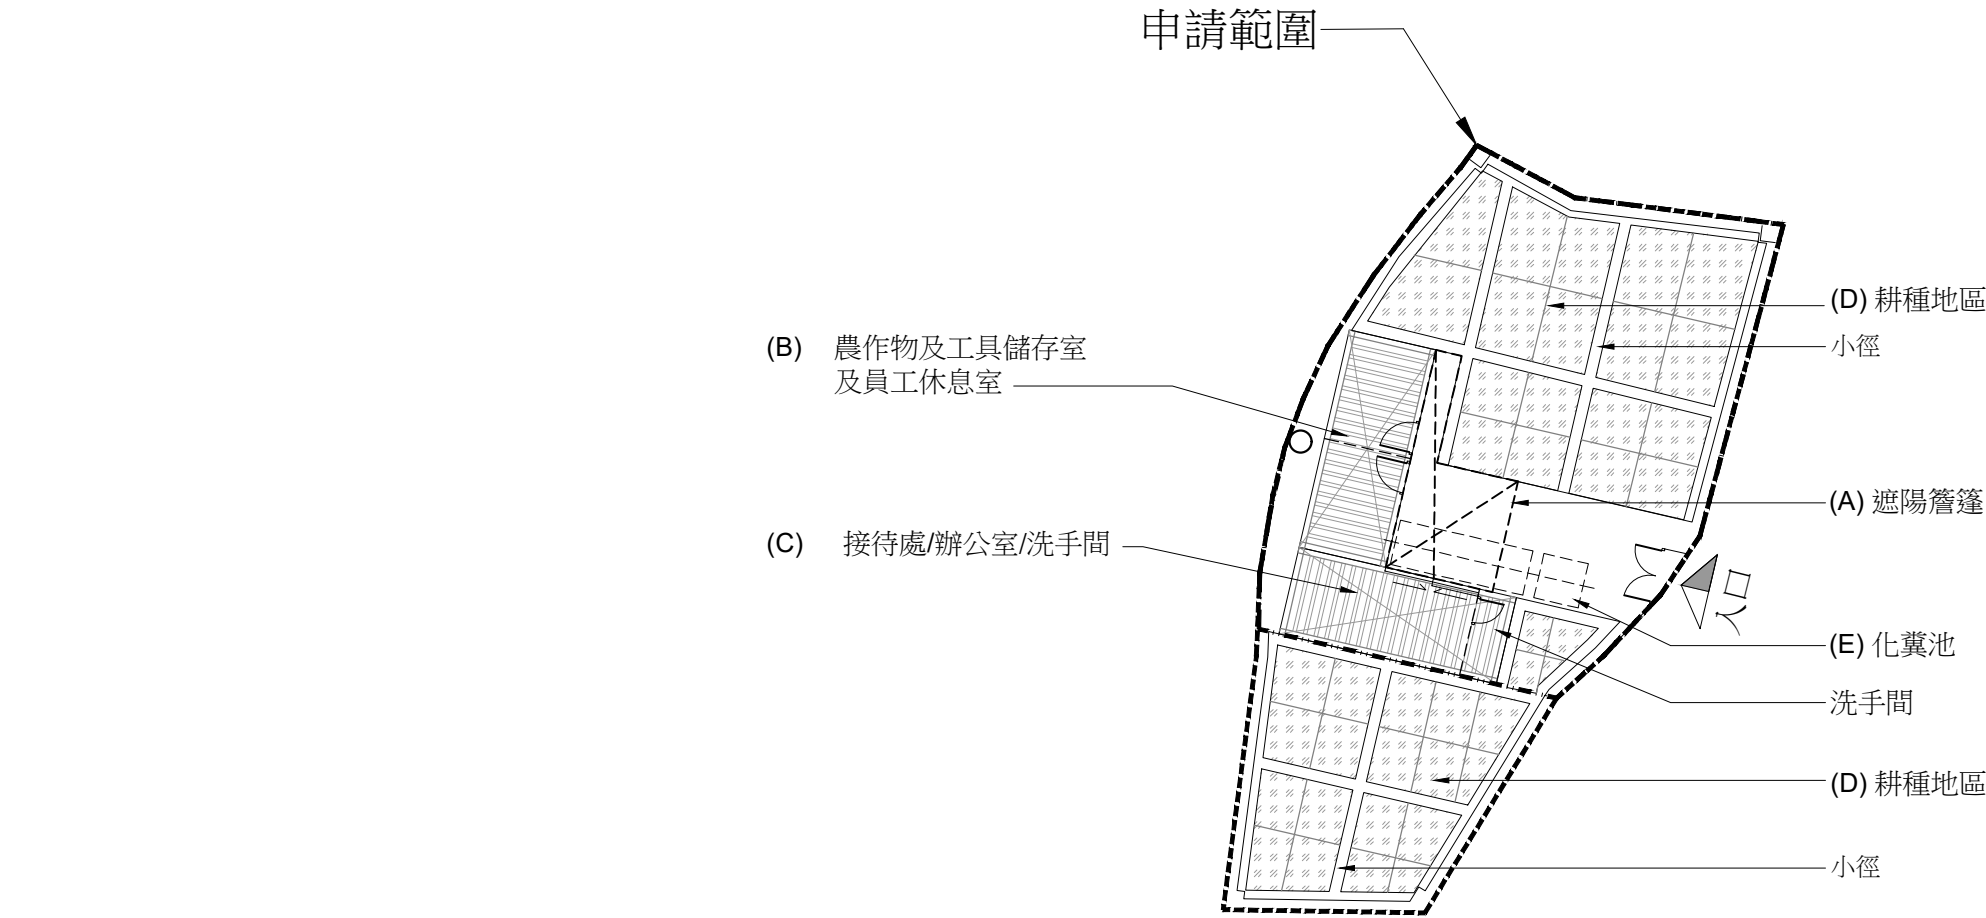




■ ■ ■ ■ ■ 申請範圍：179.81m ²						
圖例	構築物	用途	有蓋面積	層數	非住用樓面面積	構築物高度
	A	遮陽簷篷	10.73m ²	1	10.73m ²	約2.6m
	B	農作物及工具儲存室 及員工休息室	13.865m ²	1	13.865m ²	約2.6m
	C	接待處/辦公室/洗手間	13.865m ²	1	13.865m ²	約2.6m
				總數	38.46m ²	
	D	耕種地區(包括小徑)	107.9m ² (ABOUT)			
	E	化糞池	(1.2M X1.2M X1.1M(H)) (3.6M X1.2M X1.1M(H))	1.44M ² (ABOUT) 4.32M ² (ABOUT)		

B.D. Reference	數字等幅本
M.W. Reference	小型工程圖本
L.D. Reference	地政等幅本
F.S.D. Reference	測繪等幅本

Notes 註釋

Copyright Reserved nothing may be reprinted or utilized in any form or by any means without written permission from the M&D.

REV	DESCRIPTION	DATE



Project 項目

新界西貢丈量約份214地段
第512號A分段,512號餘段,
513號,514號A分段,
514號餘段及515號

Application 申請

臨時康體文娛場所(休閒農莊)
之規劃許可申請為期三年

Drawing Title 標題


PROPOSED LAYOUT PLAN

Scale 比例	Revisions 修訂
1:200 (A3)	—
Designed by 設計者	Drawn by 繪圖人
LW	Arthur
Checked by 檢查	Date 日期
LW	12-JUNE-2025
Job No. 工程項目	Drawing No. 圖號
—	LP-01

	緊急照明燈
	4.5公斤二氧化碳滅火器
	緊急出路指示牌
■■■■■	申請範圍

FIRE SERVICES NOTES

1. PORTABLE FIRE EXTINGUISHERS SHALL BE PROVIDED AS INDICATED ON THE BUILDING PLANS.
2. ALL LININGS FOR ACOUSTIC, THERMAL INSULATION PURPOSES IN DUCTINGS AND CONCEALED LOCATIONS SHALL BE OF CLASS 1 OR CLASS 2 RATE OF SURFACE SPREAD OF FLAME AS PER BRITISH STANDARD 476: PART 7 OR ITS INTERNATIONAL EQUIVALENT, OR BE BROUGHT UP TO THAT STANDARD BY USE OF AN APPROVED FIRE RETARDANT PRODUCT.
3. ALL LINING FOR ACOUSTIC, THERMAL INSULATION PURPOSES WITHIN THE PROTECTED MEANS OF ESCAPE SHALL BE OF CLASS 1 OR CLASS 2 RATE OF SURFACE SPREAD OF FLAME AS PER BRITISH STANDARD 476: PART 7 OR ITS INTERNATIONAL EQUIVALENT, OR BE BROUGHT UP TO THAT STANDARD BY USE OF AN APPROVED RETARDANT PRODUCT.
4. ANY INTENDED STORAGE OR USE OF DANGEROUS GOODS AS DEFINED IN CHAPTER 295 OF THE LAWS OF HONG KONG SHOULD BE NOTIFIED TO THE DIRECTOR OF FIRE SERVICES.
5. EMERGENCY LIGHTING SHALL BE PROVIDED THROUGHOUT THE ENTIRE BUILDING AND ALL EXIT ROUTES LEADING TO GROUND LEVEL AND COMPLIED WITH BS 5266 PART 1:2016 AND BS EN 1838:2013 AND FSD CIRCULAR LETTER 4/2021
6. SECONDARY POWER SUPPLY TO BE CONNECTED BEFORE BUILDING'S MAIN SWITCH.
7. EXIT SIGN SHALL BE PROVIDED AND COMPLIED WITH BS5266 PART 1:2016 AND FSD CIRCULAR LETTER 5 / 2008
8. ALL EXIT SIGNS, DIRECTIONAL SIGNS AND EMERGENCY LIGHTING WILL BE BACKED UP BY EMERGENCY GENERATOR POWER SUPPLY AND 2 HOURS SELF-CONTAINED BATTERY.

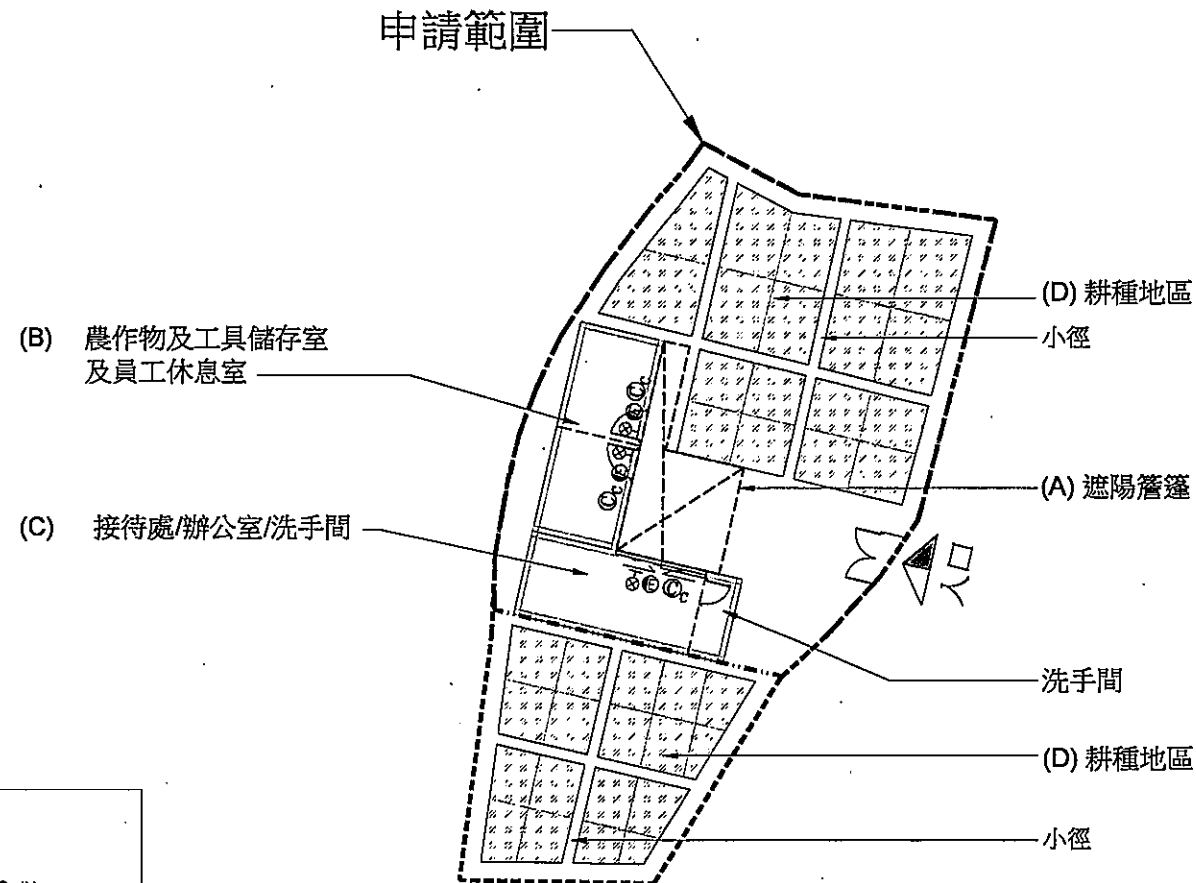

B.D. Reference	B.D. 參考	
M.W. Reference	M.W. 參考	
L.D. Reference	L.D. 參考	
F.S.D. Reference	F.S.D. 參考	
Notes	1. 備註	
Copyright Reserved nothing may be reprinted or utilized in any form or by any means without written permission from the M&D.		
REV	DESCRIPTION	DATE
		
Project	項目	
新界西貢丈量約份214地段 第512號A分段, 512號餘段, 513號, 514號A分段, 514號餘段及515號		
Application	申請	
臨時康體文娛場所(休閒農莊) 之規劃許可申請為期三年		
Drawing Title	圖名	
PROPOSED FIRE SERVICE INSTALLATION AND EQUIPMENT PLAN		
Scale	比例	Revision
1:200 (A3)		—
Designed by	設計	Drawn by
LW		Arthur
Checked by	校核	Date
LW		12-JUNE-2025
Job No.	工程號碼	Drawing No.
—		FS-01