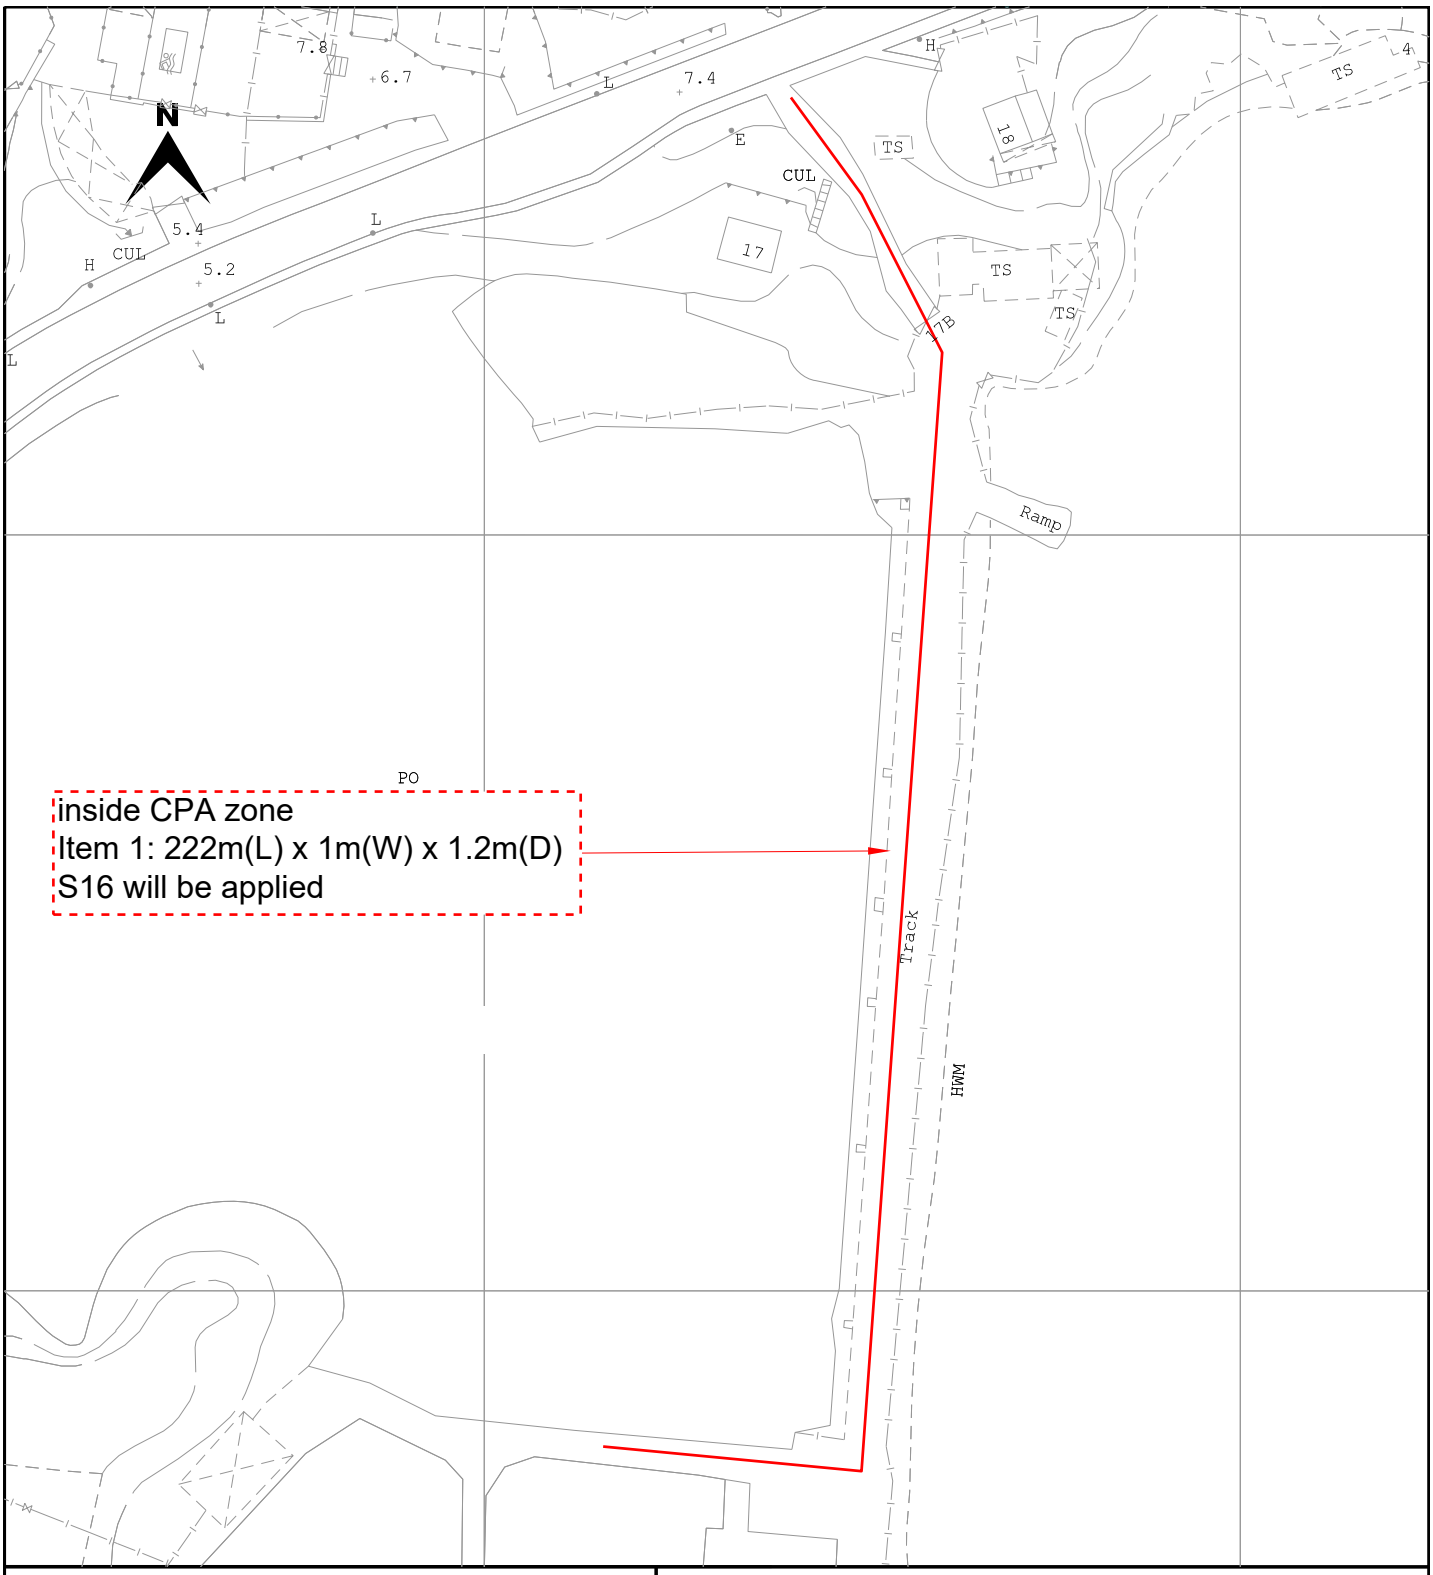


CLP 中電

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS (NO)
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX
- EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- EXISTING POLE MOUNTED TRANSFORMER
- PROPOSED POLE MOUNTED TRANSFORMER
- PROPOSED STAY / STAY POLE
- PROPOSED 3.6M(L) x 3.32M(W) x 2.7M(H) HV PILLAR

TITLE : LV CABLE LAYING
NEAR TAI MONG TSAI ROAD
TSAM CHUK WAN
SAI KUNG

MAP NO : 08SW09C

DRAWN : H.Y. WONG	E/O NO :	
CHECKED : W.Y. KWAN	REGION : WE	O.C. : SK
DATE : 23-06-2025	PROJECT REF. : SK2025-0149	
SCALE : 1:1000	PLAN REF. : WESK2025-0149-01	

Map data reproduced with permission of the Director of Lands. (C) Hong Kong
Information Classification: PROPRIETARY