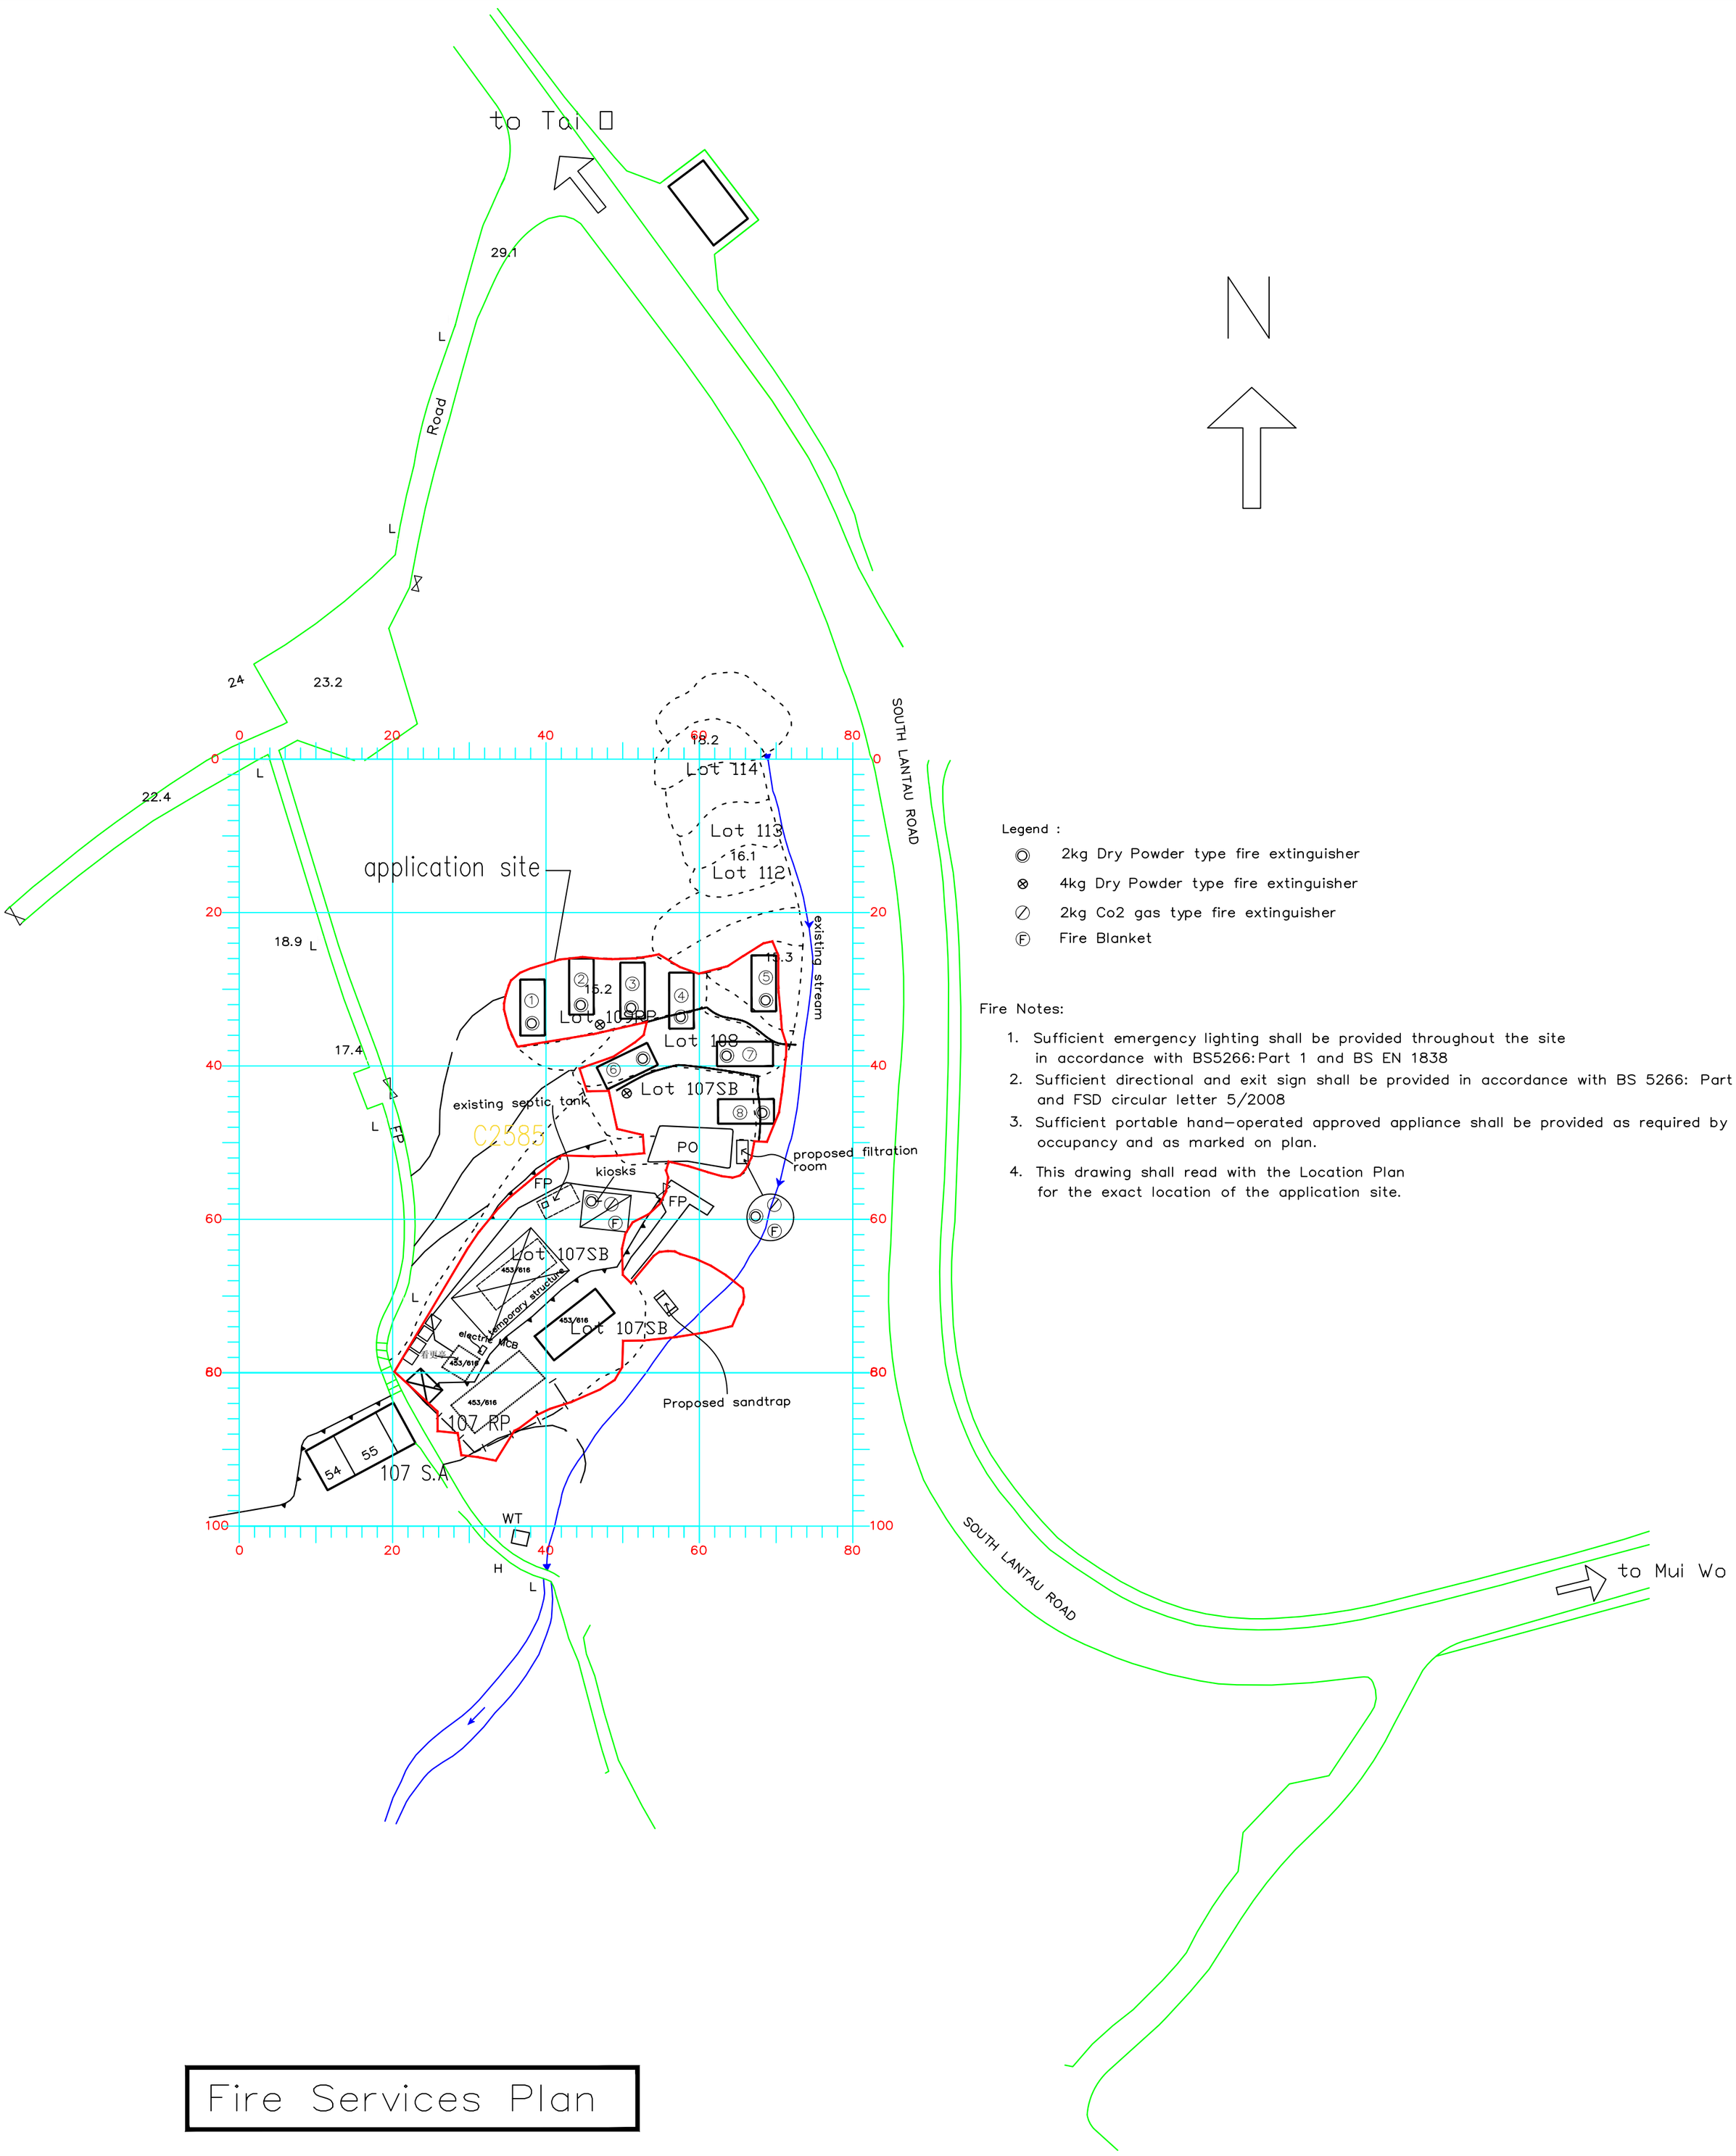

Legend :

- ◎ 2kg Dry Powder type fire extinguisher
- ⊗ 4kg Dry Powder type fire extinguisher
- ⊘ 2kg Co2 gas type fire extinguisher
- Ⓕ Fire Blanket

Fire Notes:

1. Sufficient emergency lighting shall be provided throughout the site in accordance with BS5266:Part 1 and BS EN 1838
2. Sufficient directional and exit sign shall be provided in accordance with BS 5266: Part 1 and FSD circular letter 5/2008
3. Sufficient portable hand–operated approved appliance shall be provided as required by occupancy and as marked on plan.
4. This drawing shall read with the Location Plan for the exact location of the application site.

Fire Services Plan

Outdoor education and expedition Camp

OZP : S/SLC/23	Proposed OEE Camp on Lots107SB,107RP,108 & 109RP in DD332L, Cheung Sha, Lantau	Drawing no : FS01
Designed by : Kay Hon		Scale : As shown
Checked by : CY Hon		Date : March 2025