
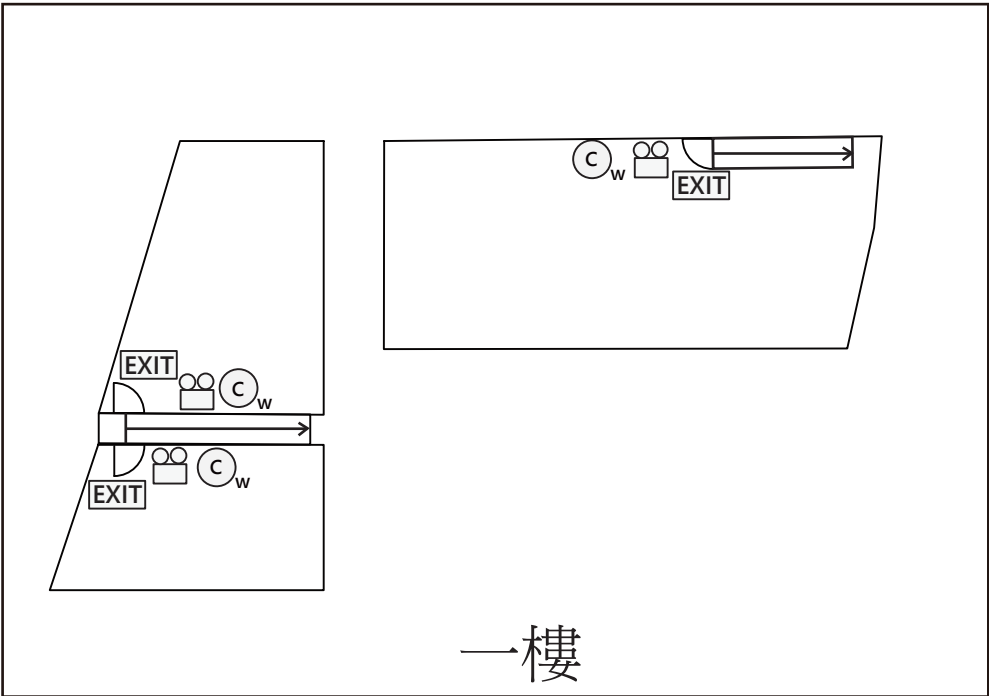
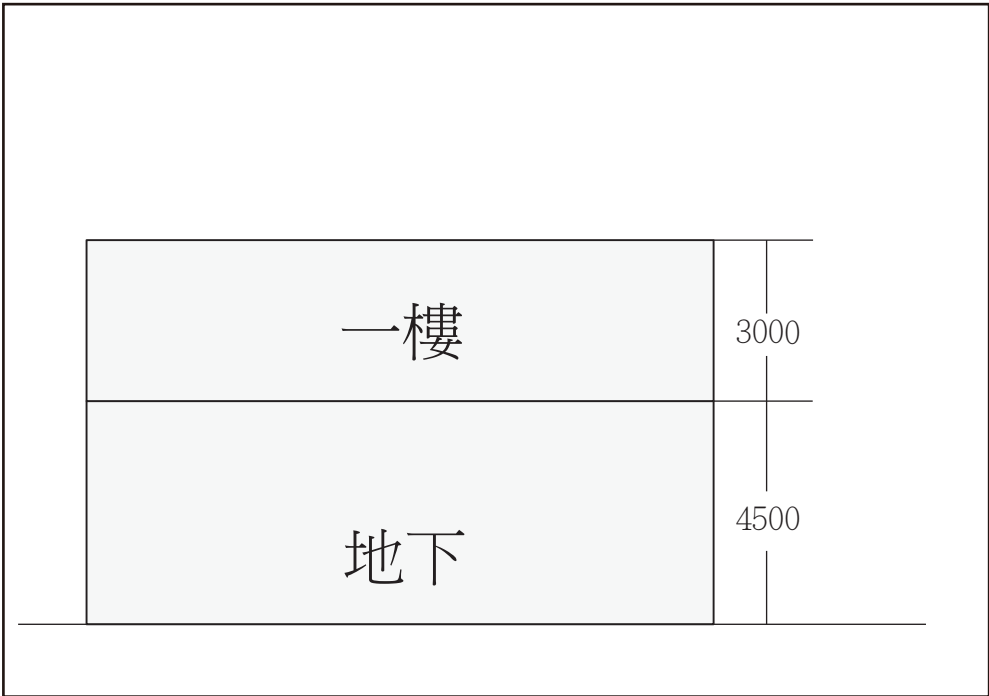
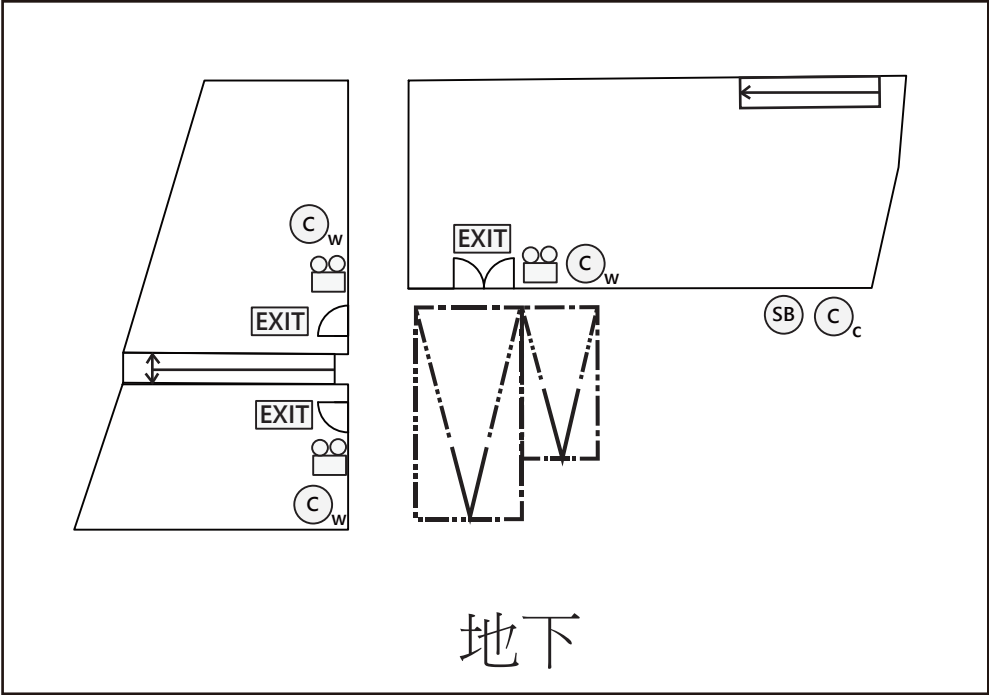


申請地點內設有3個構築物：

構築物	總佔地面積	總樓面面積	佈置	用途
A(2層高)	55平方米	110平方米	座地不高於7.5米	商店辦公室及員工休息室
C(2層高)	39.7平方米	79.4平方米	座地不高於7.5米	商店辦公室及洗手間
A側面	3平方米	3平方米	座地不高於4米	樓梯
B(2層高)	111平方米	222平方米	座地不高於7.5米	商店零售
208.7平方米		414.4平方米		

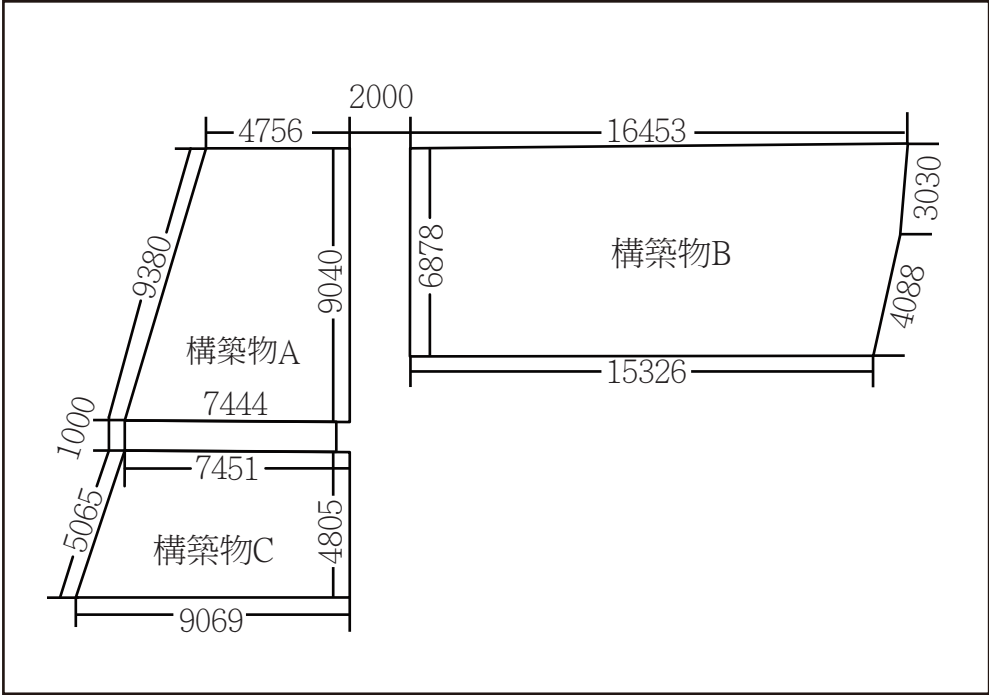

NOT FOR SCALE

Project 項目名稱：

Drawing Title 圖紙標題：

消防裝置布局圖

Drawing No 圖紙號：

FBI-FS01-LTS-RD2023-0710-01

註：

- EMERGENCY LIGHTING
- EXIT SIGN
- 4.5KG CO2 FIRE EXTINGUISHER
- 9L WATER TYPE FIRE EXTINGUISHER
- SAND BOX

F.S. Notes:
1. There will be no storage of dangerous goods without the prior approval of the director of fire services.
2. All existing fire services installation shall be retained unless otherwise specified.
3. Existing emergency lighting, exit sign and fire extinguisher shall be provided as indicated on plan.
4. All previously fire service requirement shall be maintained and complied with.
5. Exit signs shall be provided and comply with BS 5266 - 1:2016 and FSD Circular Letter No. 5/2008.
6. Sufficient emergency lighting shall be provided throughout the building in accordance with BS 5266 - 1:2016 and BS EN 1838:2013 and FSD Circular Letter No.4/2021.



FiBi International Project Consultancy Co. Limited