


公共設施安裝 - 地下電纜  
鋪設及相關的土挖掘及回填工程。

Public Utility Installation - Underground Cable  
Laying and associated excavation and filling of land.

Government land in D.D.128 Sha Kong Tsuen



Outline Zoning Plan (OZP)

參考編號


REFERENCE No.

NRTM2022-0637-02

圖 PLAN

N/A



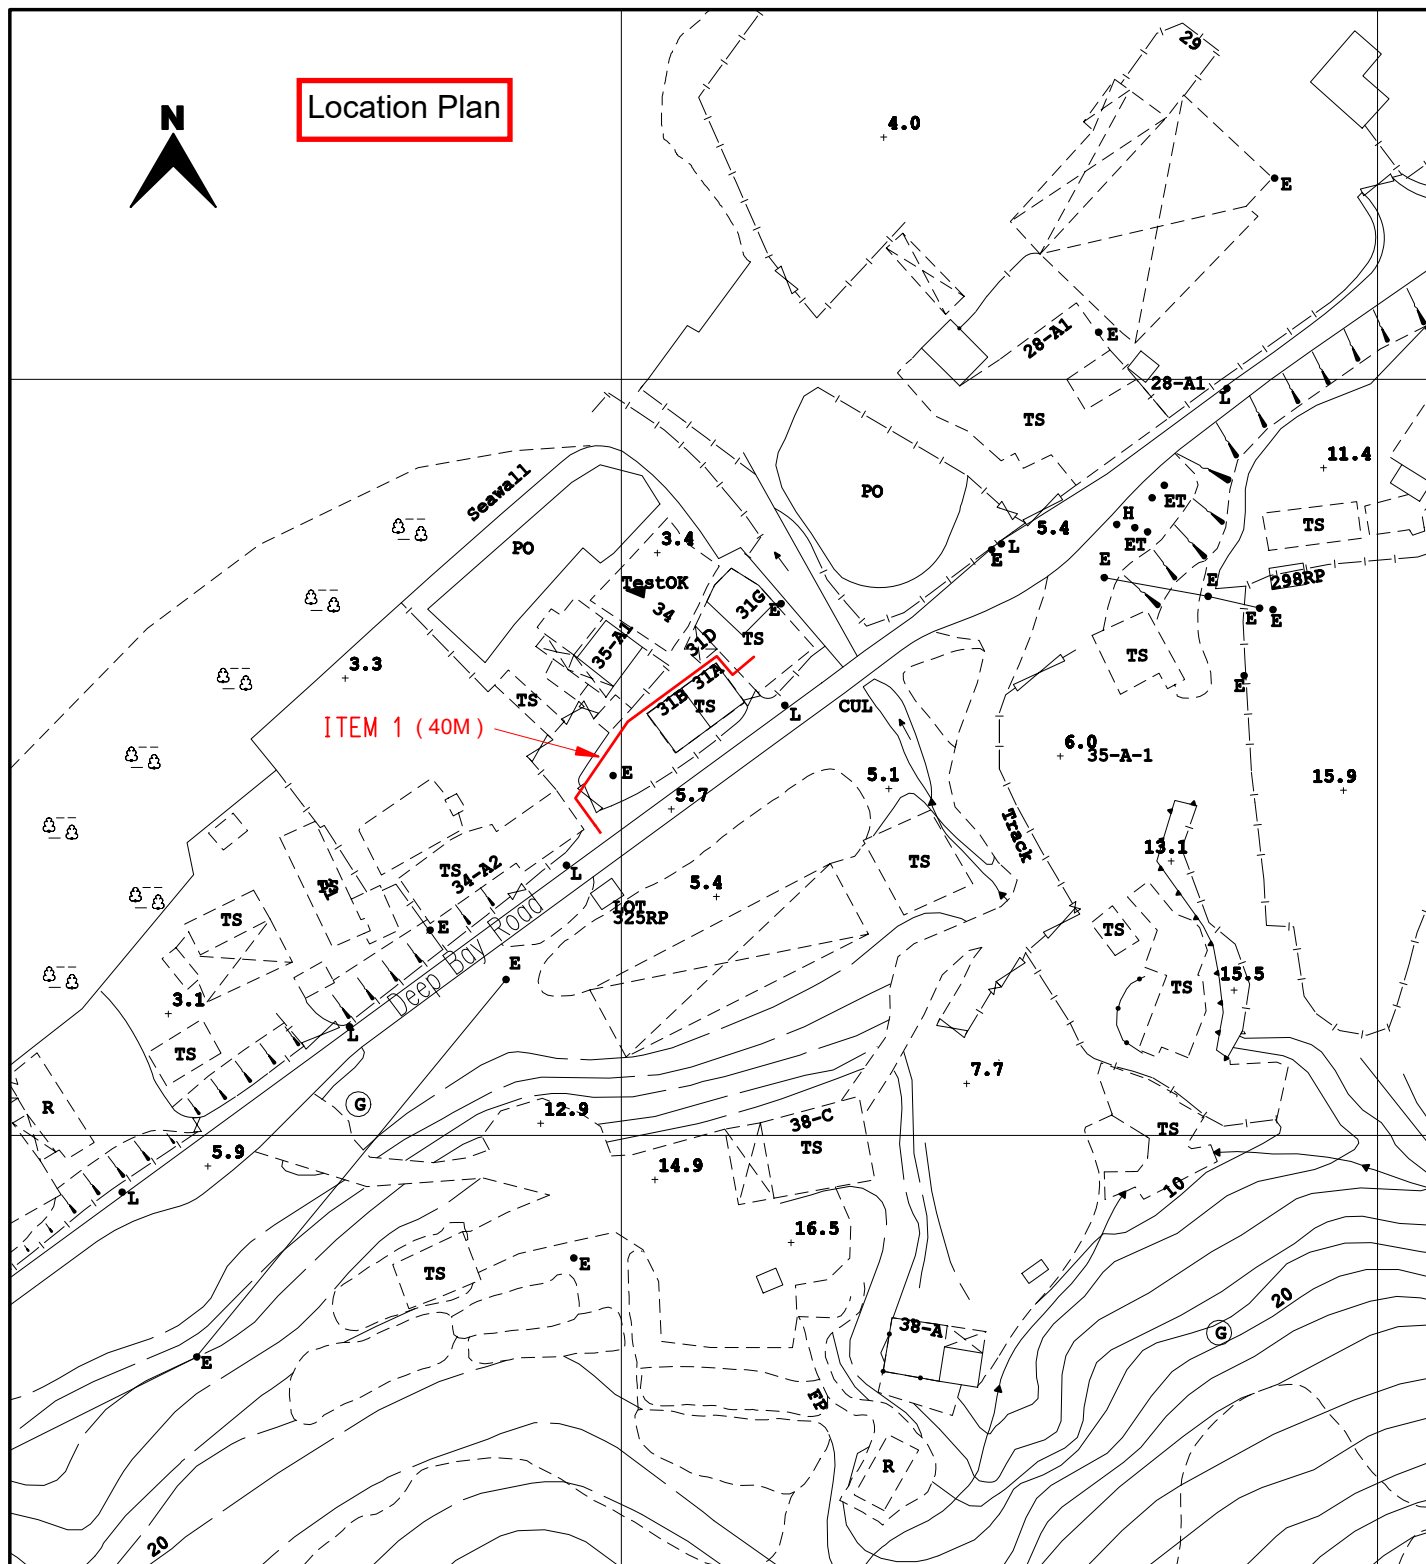

CLP 中電

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- = PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- ✕ PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX
- ✕ EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- ✕ OVERHEAD LINE & POLE TO BE REMOVED
- ✕ PROPOSED TREE TRIMMING / CUTTING
- ⬆ EXISTING POLE MOUNTED TRANSFORMER
- ⬆ PROPOSED POLE MOUNTED TRANSFORMER
- + PROPOSED STAY / STAY POLE
- ⊠ PROPOSED 5.0M(L) x 2.39M(W) x 3.0M(H) PACKAGE SUBSTATION

TITLE : LV Cable Laying  
At Deep Bay Road  
Near Sha Kong Tsuen

MAP NO : 06NW01C, 06NW01D, 06NW01B, 06NW01A

DRAWN : BENSON

E/O NO :

CHECKED : Alex Ko

REGION : NR

O.C. : YL

DATE : 25-11-2022


PROJECT REF. : TM2022-0637

SCALE : 1:1000


PLAN REF. : NRTM2022-0637-02



## Sectional Plan\_LV

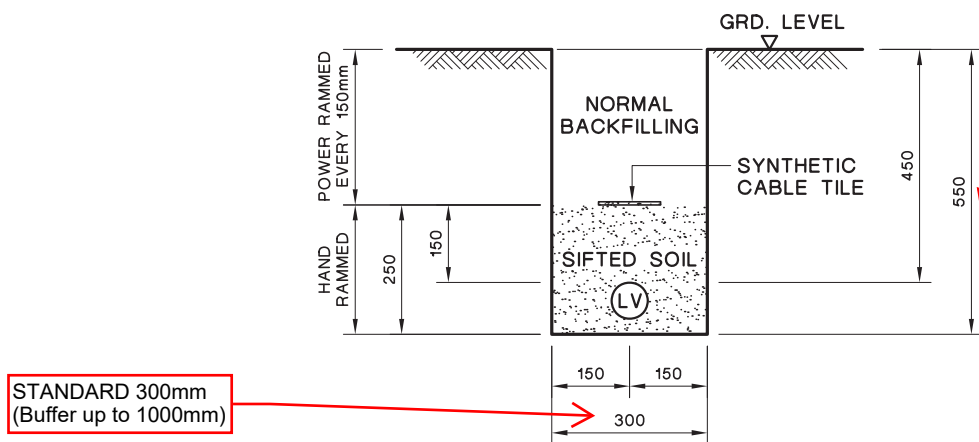

**TYPICAL CABLE TRENCH FOR SINGLE LV CABLE**

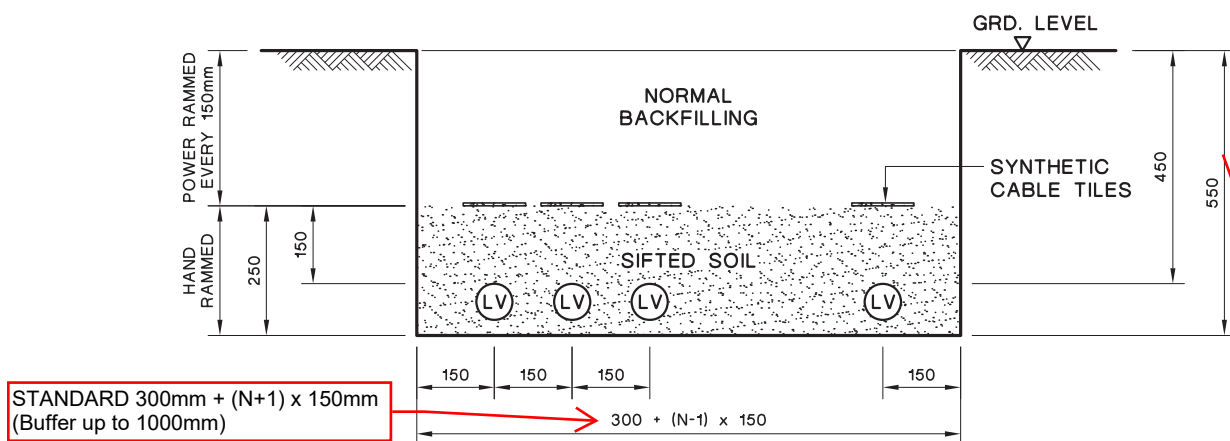

**TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES**

### LEGEND :



LV CABLE

N

NUMBER OF CABLE CIRCUITS

### NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.

C GENERAL REVISION

B GENERAL REVISION

A SYNTHETIC CABLE TILE SPECIFIED



REVS.	16-2-04	18-6-07	28-6-07										
	A	B	C	D	E	F	G	H	J	K	L		
INITIAL	C.Y.IP	W.B.LEE	Y.K.MAN										

TITLE :

**TYPICAL LV CABLE TRENCH**

DRAWN: S.C.T. DATE: 15 Aug., 2003

CHECKED: K. K. LEUNG APPROVED: W. B. LEE

SCALE: 1 : 15 SHEET(S) IN SET: 1

PROJECT NO.

CONTRACT NO.

**ASSET MANAGEMENT**

DRG. NO. T G E N 2 5 5 0 0 D E 3 3 0 0 0 2 0 1 C A