

☐Urgent ☐Return receipt ☐Expand Group ☐Restricted ☐Prevent Copy

## **Tracy Wing Sum LAW/PLAND**

---

寄件者: tmylwdpo\_pd/PLAND  
寄件日期: 2025年09月15日星期一 16:54  
收件者: Jessie Man Heng KWOK/PLAND  
副本: Eric Chi Yeung CHIU/PLAND; Tracy Wing Sum LAW/PLAND  
主旨: 轉寄: Amended file for s.16 Planning Application No. A/YL-HTF\_1199, Our ref. TM-220637, DD 128 Sha Kong Tsuen  
附件: Form No. S.16-I\_Nov 2023\_NRTM2022-0637-02\_v3\_P11.pdf; OZP TM-220637\_R2\_V1.pdf; Sectional Plan\_LV\_R.pdf

---

**From:** tpbpd/PLAND <tpbpd@pland.gov.hk>  
**Sent:** Monday, September 15, 2025 4:52 PM  
**To:** tmylwdpo\_pd/PLAND <tmylwdpo@pland.gov.hk>  
**Cc:** Yuki Man Yin YIU/PLAND <ymyyiu@pland.gov.hk>  
**Subject:** Fw: Amended file for s.16 Planning Application No. A/YL-HTF\_1199, Our ref. TM-220637, DD 128 Sha Kong Tsuen

---

**From:**  
**Sent:** Monday, September 15, 2025 4:50 PM  
**To:** tpbpd/PLAND <[tpbpd@pland.gov.hk](mailto:tpbpd@pland.gov.hk)>  
**Cc:** Jessie Man Heng KWOK/PLAND <[jmhkwok@pland.gov.hk](mailto:jmhkwok@pland.gov.hk)>;  
**Subject:** RE: Amended file for s.16 Planning Application No. A/YL-HTF\_1199, Our ref. TM-220637, DD 128 Sha Kong Tsuen

Dear Sirs / Madams,

Please ignore the email sent 2025 4:16 PM today. On the other hand, please find the amended file for your information.

Thanks & regards,

**Kum Shing Group 金城營造集團**

---

**From:**  
**Sent:** Monday, 15 September, 2025 4:16 PM  
**To:** tpbpd/PLAND <[tpbpd@pland.gov.hk](mailto:tpbpd@pland.gov.hk)>

☐Urgent ☐Return receipt ☐Expand Group ☐Restricted ☐Prevent Copy

Cc: 'jmhkwok@pland.gov.hk' <[jmhkwok@pland.gov.hk](mailto:jmhkwok@pland.gov.hk)>;


**Subject:** Amended file for s.16 Planning Application No. A/HSK/584, Our ref. TM-220637, DD 128 Sha Kong Tsuen

Dear Sirs / Madams,

Please find the amended file for your information.

Thanks & regards,

**Kum Shing Group 金城營造集團**



[集團通訊《城訊》 KUM SHING NEWS | \[www.kumshing.com.hk\]\(http://www.kumshing.com.hk\)](#)

Disclaimer: This e-mail and its attachment(s) are confidential and may be subject to legal professional privilege and copyright. If you are not the intended addressee, you are hereby notified that any disclosure, usage, retention, dissemination is strictly prohibited. If you have received this mail in error, please contact the sender by returning this email. Thereafter, proceed to delete the entire e-mail from your computer immediately and permanently.

**10. Justifications 理由**

The applicant is invited to provide justifications in support of the application. Use separate sheets if necessary.  
 現請申請人提供申請理由及支持其申請的資料。如有需要，請另頁說明。

CLP received electricity supply application at location near DD 128 in Sha Kong Tsuen and the major purpose is for home use only. No power before completion the captioned works.

Based on "Cap. 406 Electricity Ordinance"

**Part III****Electricity Supplier's Powers and Obligations****13. Connection and continued supply**

- (1) Where a fixed electrical installation complies with this Ordinance an electricity supplier shall, within a reasonable time after being requested to do so by the owner of the installation, connect the electricity supply to the installation.

For the New power supply of S/YL-HTF/12 in Sha Kong Tsuen, CLP planned to excavate trench to lay two new 95mm sq. cables with size 40m(L) x 0.45m(W) x 1.2m(D) and back fill the trench for the last procedures of this project. No tree will be removed.

The most shortest cable route is to lay cables from existing cable in Highway Polygon to the customer's meter box. However, the new cable laying work will fall into the CPA zone unavoidably.

New underground cables laid under existing carriageway and vacant, which bring minor impact to existing landscape of CPA zone. No visual impact would occur after the underground cable laying works.

In conclusion, the above method is the best method with least environmental impact for this application.

.....

.....

.....

.....


.....

.....

.....

.....


.....

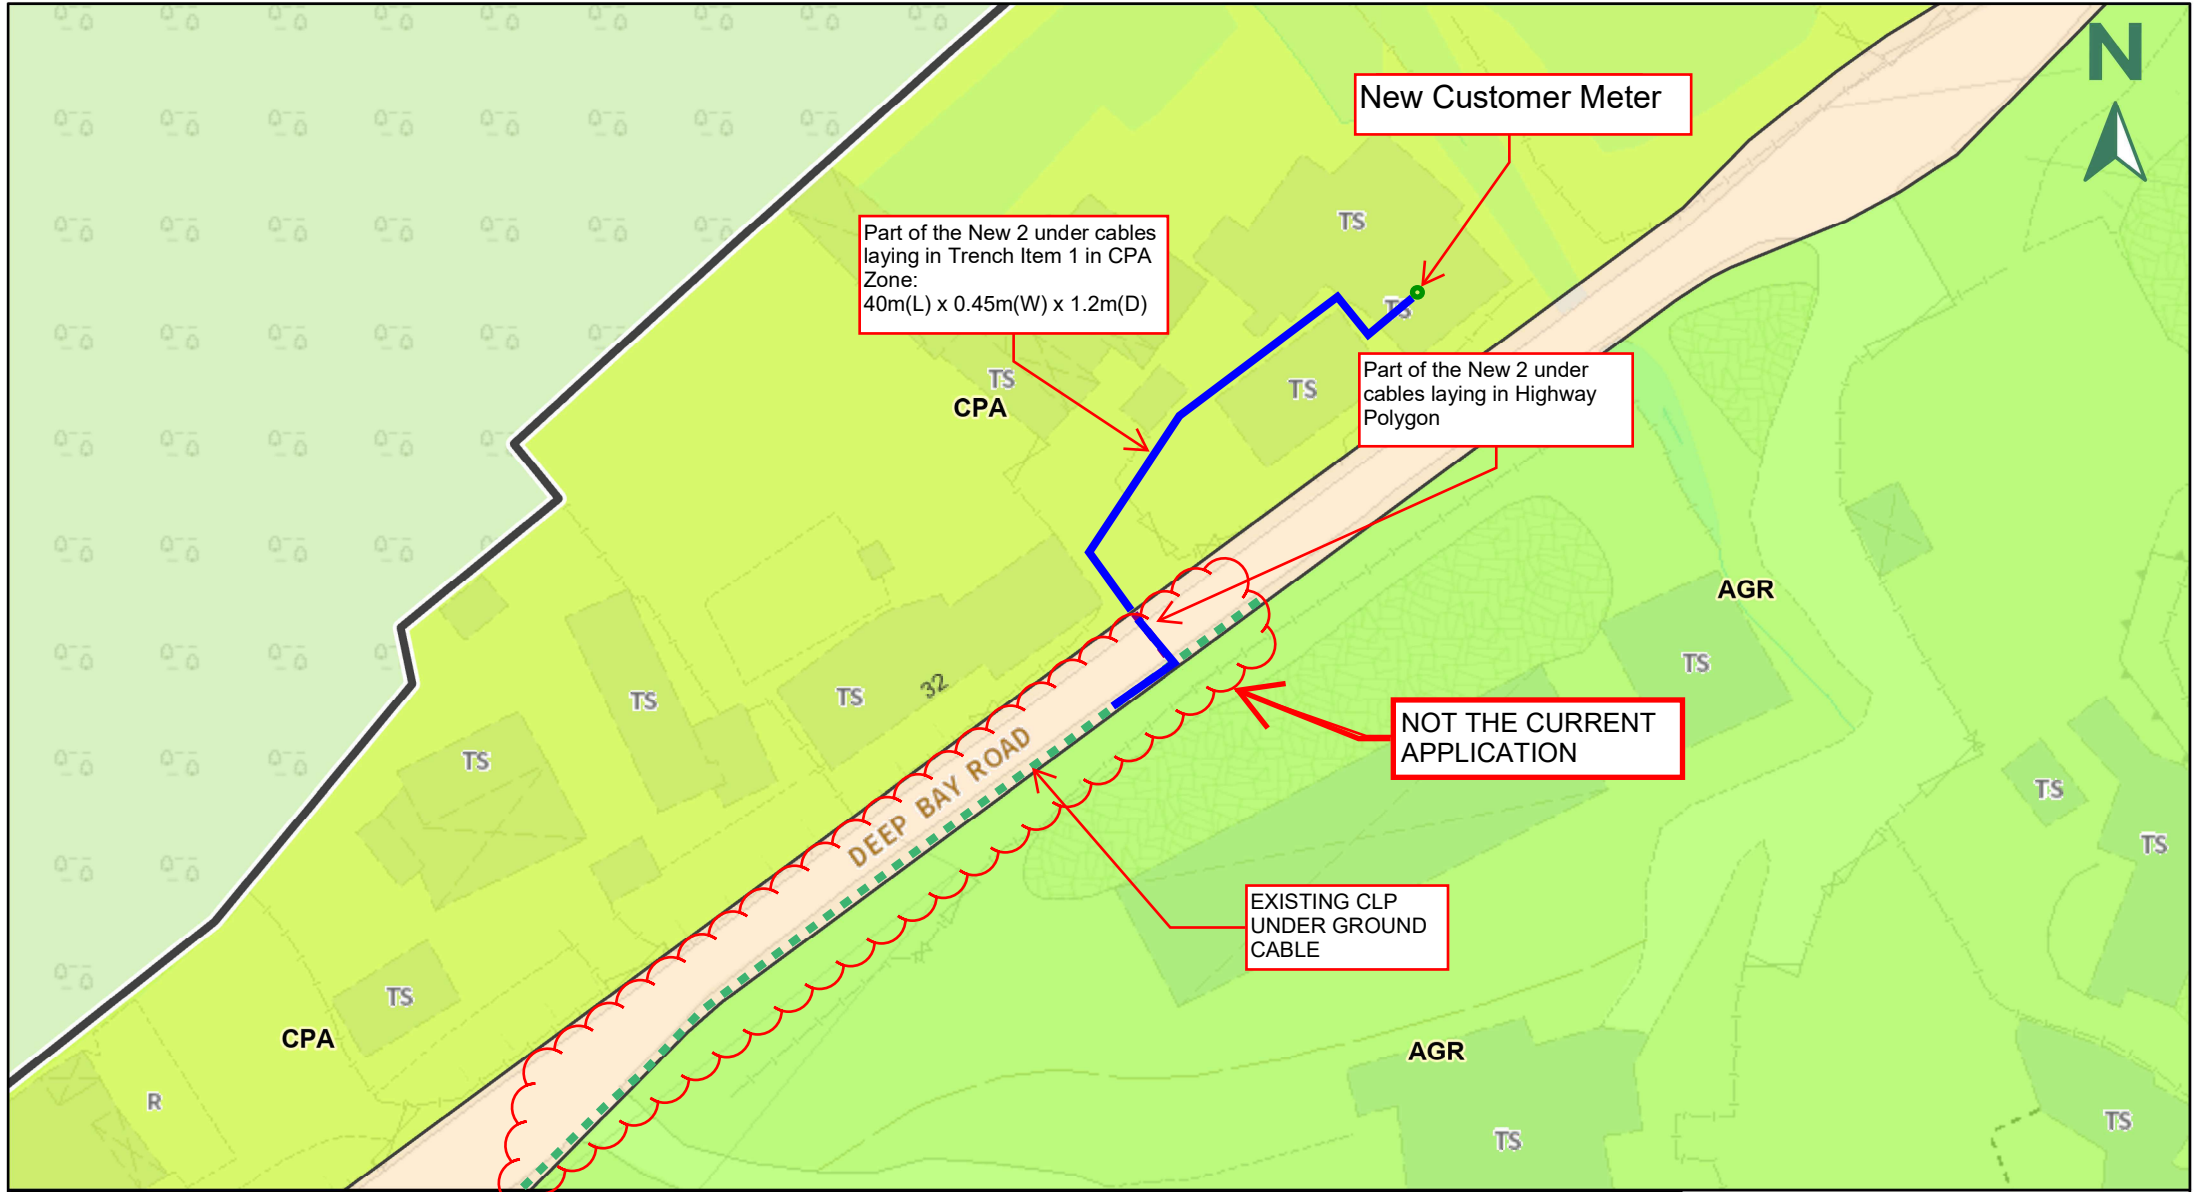

公共設施安裝 - 地下電纜  
鋪設及相關的土挖掘及回填工程。

Public Utility Installation - Underground Cable  
Laying and associated excavation and filling of land.

Government land in D.D.128 Sha Kong Tsuen



## Outline Zoning Plan (OZP)

參考編號


REFERENCE No.

NRTM2022-0637-02

圖 PLAN

N/A


# Sectional Plan\_LV

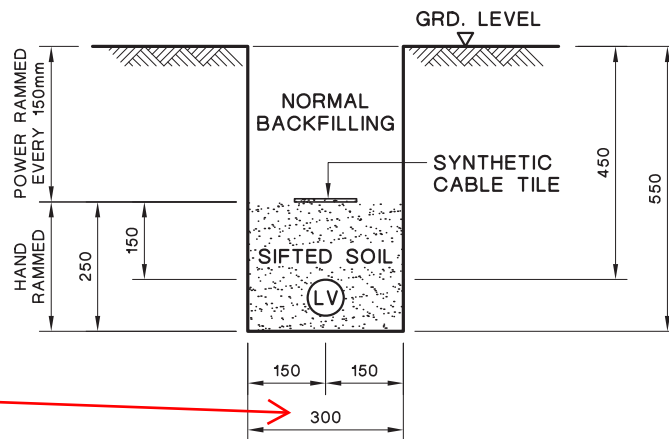

STANDARD 300mm  
(Buffer up to 1000mm)

TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

STANDARD 550mm  
(Buffer up to 1200mm)

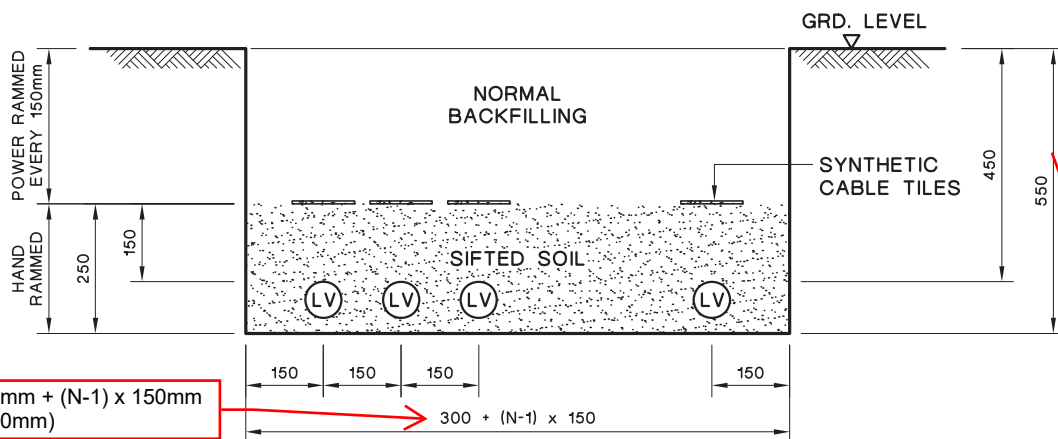

STANDARD 300mm + (N-1) x 150mm  
(Buffer up to 1000mm)

TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES

## LEGEND :

- (LV) LV CABLE  
N NUMBER OF CABLE CIRCUITS

## NOTES:

- ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
- ALL DIMENSIONS ARE IN mm.

FOR CURRENT APPLICATION

C GENERAL REVISION

B GENERAL REVISION

A SYNTHETIC CABLE TILE SPECIFIED



REVS.	16-2-04	18-6-07	28-6-07										
	A	B	C	D	E	F	G	H	J	K	L		
INITIAL	C.Y.IP	W.B.LEE	Y.K.MAN										

TITLE :

TYPICAL LV CABLE TRENCH

DRAWN: S.C.T. DATE: 15 Aug., 2003

CHECKED: K. K. LEUNG APPROVED: W. B. LEE

SCALE: 1 : 15 SHEET(S) IN SET: 1

PROJECT NO.

CONTRACT NO.

ASSET MANAGEMENT

DRG. NO. T G E N 2 5 5 0 0 D E 3 3 0 0 0 2 0 1 C A