

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

FSD Ref.:
消防處編號消防(裝置及設備)規例
(Regulation 9(1))
(第九條(1)款)

Serial Number

10607 240142

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

Name of Client 顧客姓名

王太

Address 地址

新界元朗八鄉 錦田公路 D.D.110 LOTS 629Q 630 S.B 5515 and 653 S.B RP (Part)

Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☒ Licensed premises 持牌處所 ☐ Institutional 社團

Part 1 Annual Maintenance ONLY

第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)條例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
11	應急照明系統 x 6支	工場 / 寫字樓	符合消防設備條件	13/12/2024	12/12/2025
12	出口指示牌 x 4支	工場 / 寫字樓	符合消防設備條件	13/12/2024	12/12/2025

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)
16	消防喉轆	工場 / 寫字樓	更換射咀箱 x 1套, 射咀喉轆 x 1套, 喉轆拉輪 x 1套	符合消防設備條件	13/12/2024
16	消防喉轆	工場 / 寫字樓	加回消防泵房指示牌 x 1塊, 消防水缸指示牌 x 1塊	符合消防設備條件	13/12/2024

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人/我們特此證明以上之消防裝置及設備經測試, 證明性能良好, 符合消防處處長不時公佈之最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

F.S. 251 (Rev. 01/2012)
8820-45d0-3d8a-1141-ed2a-b974-a7a2-8d1d

Authorized

Signature:

受權人簽署

Name:

姓名

Ng Yiu Lun

FSD/RC No.:

消防處註冊號碼

RC1 / 0607

RC2 / 0794

Company Name:

公司名稱

Asia Brilliant Construction Engineer Limited

Telephone:

聯絡電話

Date:

日期

16/12/2024

For FSD
use only

Inspected

Key-in

Verified

Serial Number

10607240142






Name of Client 顧客姓名

王太

Part 1 Annual Maintenance ONLY**第一部 只適用於年檢事項**

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款，擁有裝置在任何處所內的任何消防裝置或設備的人，須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
13	防水拎手/警鐘 x 2套	工場 / 寫字樓	符合消防設備條件	06/12/2024	05/12/2025
16	消防喉轆 x 2套	工場 / 寫字樓	符合消防設備條件	06/12/2024	05/12/2025

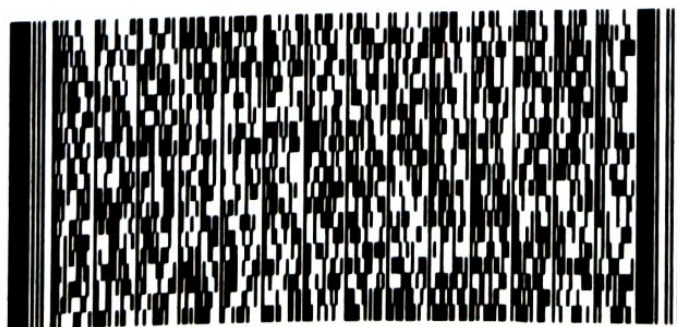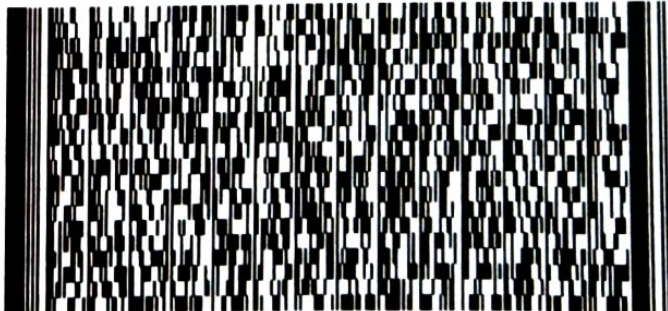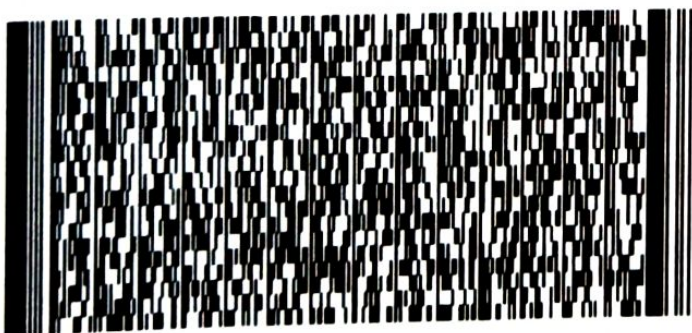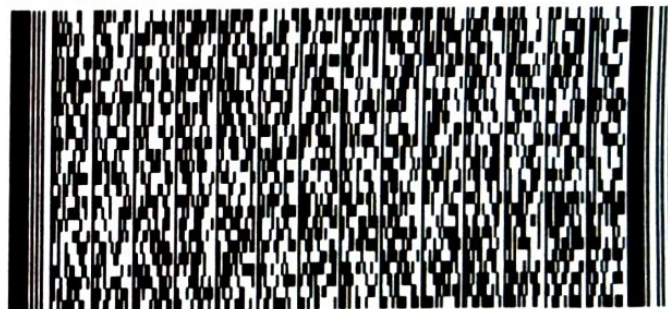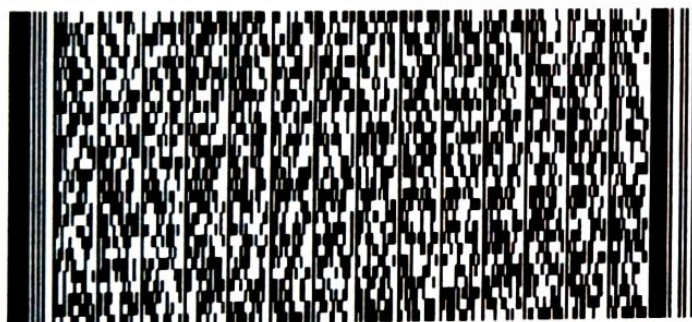

Serial Number

10607240142

Name of Client 顧客姓名

王太

