


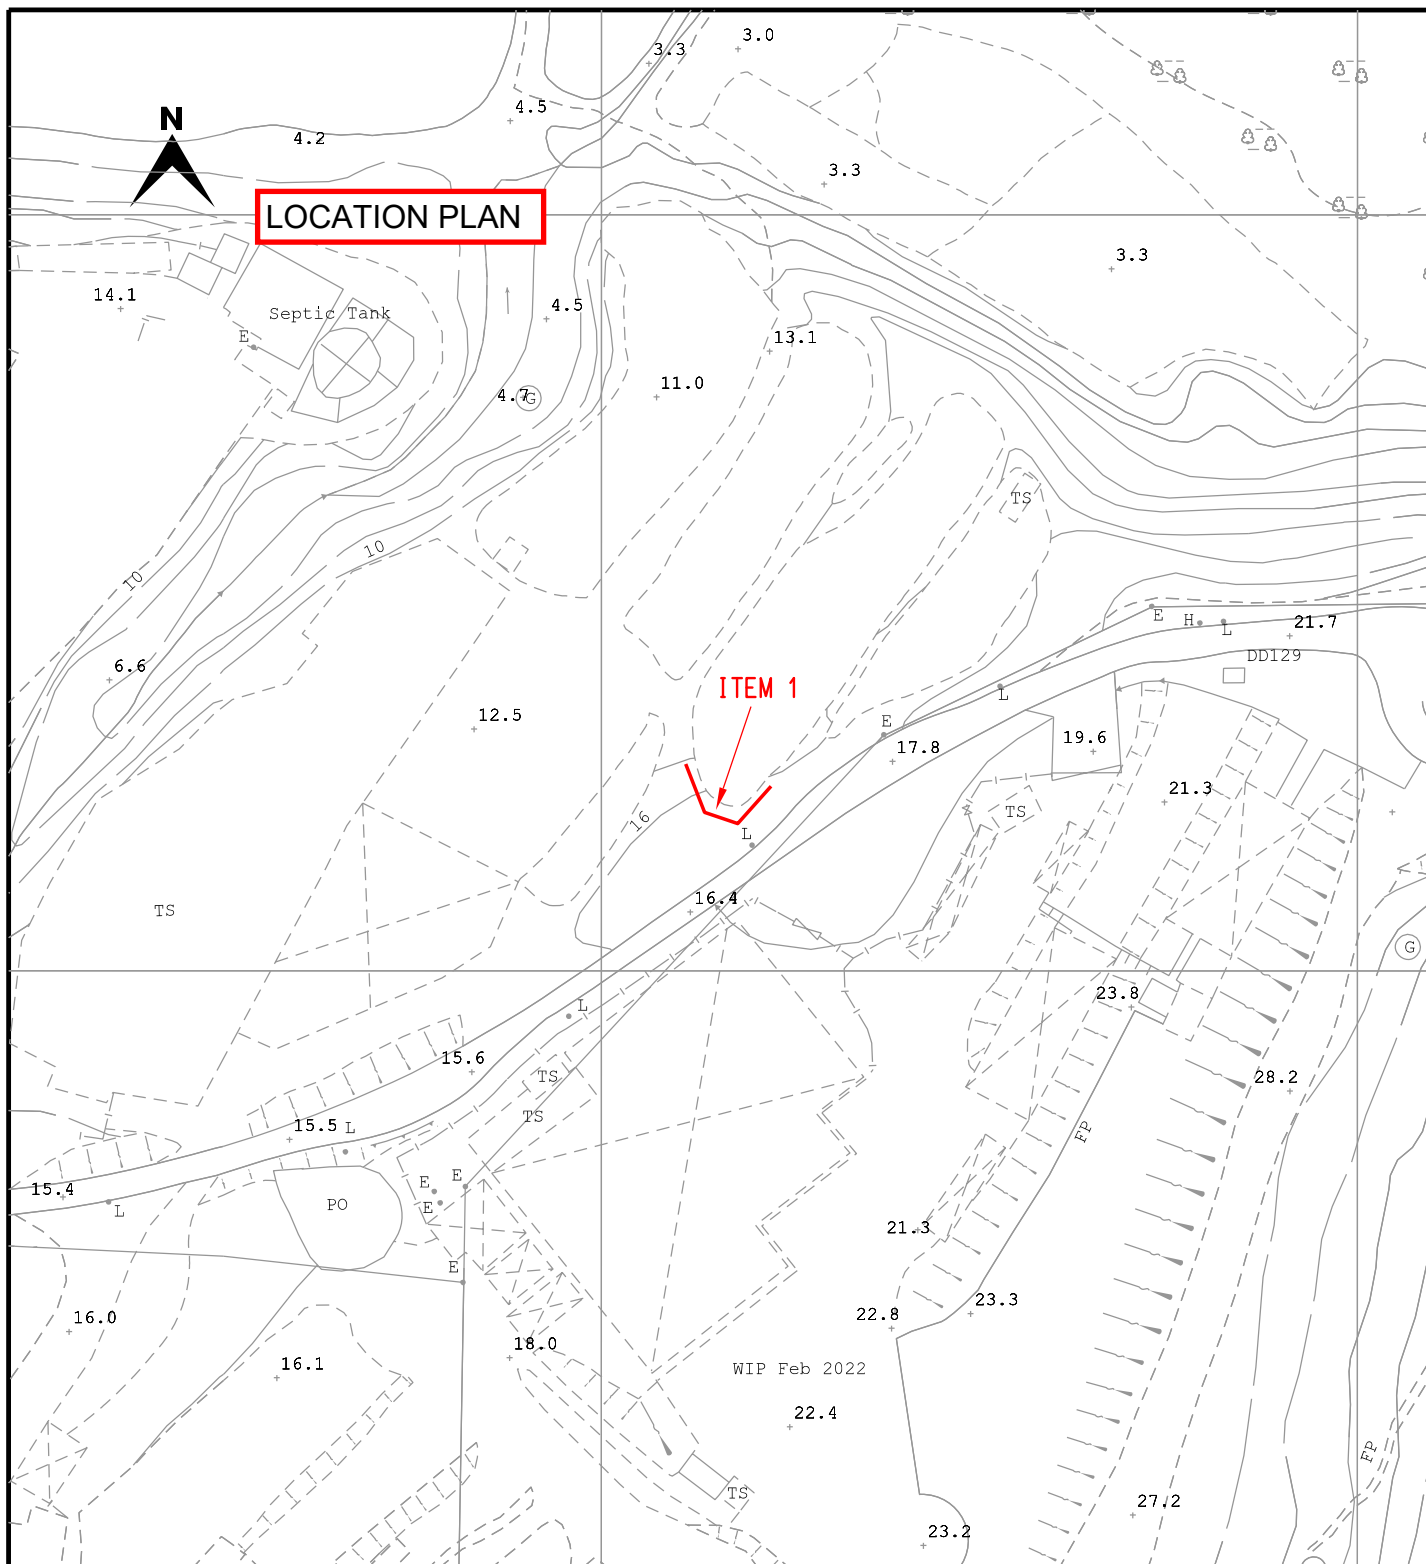

CLP 中電

TITLE : LV CABLE LAYING
AT SHA KIU TSUEN

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- (NO) PROPOSED TRENCH FOR LAYING DUCTS
- = PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOFF BOX
- x EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- x OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- ▲ EXISTING POLE MOUNTED TRANSFORMER
- ▲ PROPOSED POLE MOUNTED TRANSFORMER
- + PROPOSED STAY / STAY POLE
- ⊠ PROPOSED 3.6M(L) x 3.32M(W) x 2.7M(H) HV PILLAR

MAP NO : 02SW13C, 02SW13D

DRAWN : BENSON

E/O NO :

CHECKED : C.H.LI

REGION : NR


O.C. : TM

DATE : 10-03-2025

PROJECT REF. : TM2021-0454


SCALE : 1:1000

PLAN REF. : NRTM2021-0454-03

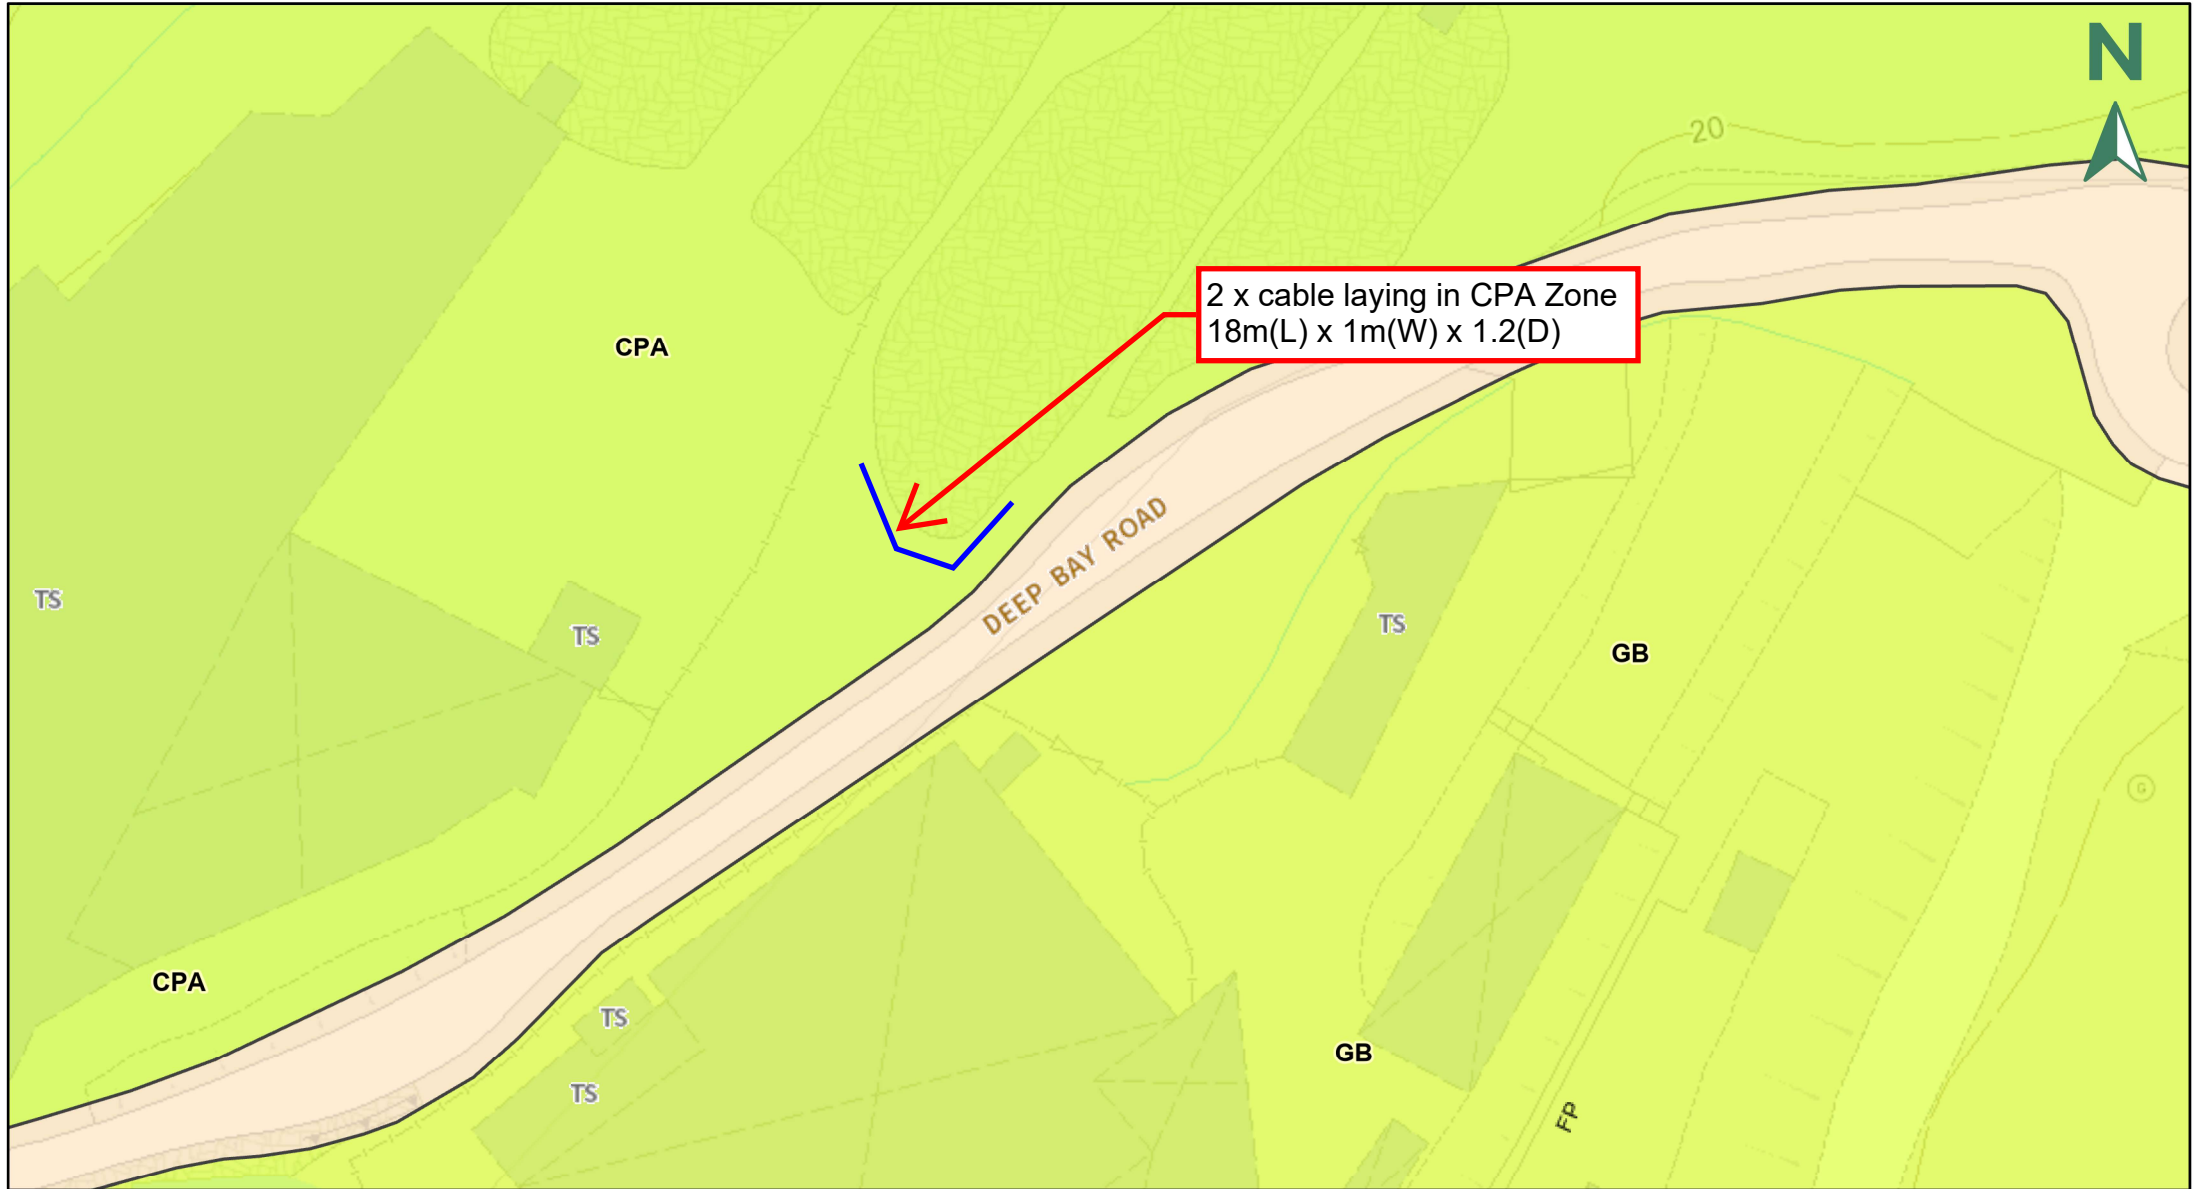


公共設施安裝 - 地下電纜 鋪設及相關土地挖掘和回填。

Public Utility Installation - Underground Cable Laying and associated excavation and filling of land.

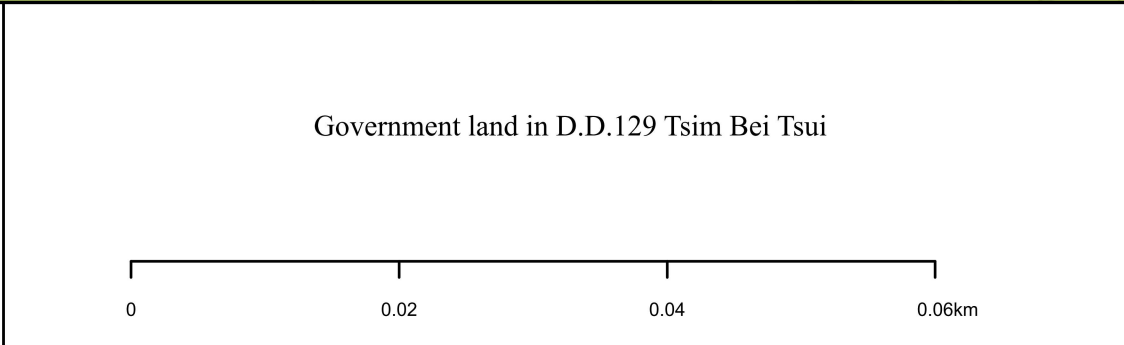


Outline Zoning Plan (OZP)	
參考編號 REFERENCE No. NRTM2021-0454-03	圖 PLAN N/A

Sectional Plan_LV



TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

STANDARD 550mm
(Buffer up to 1200mm)



TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES

LEGEND :

LV

LV CABLE

N

NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.

C	GENERAL REVISION	B	GENERAL REVISION	A	SYNTHETIC CABLE TILE SPECIFIED
---	------------------	---	------------------	---	--------------------------------

REVS.	16-2-04	18-6-07	28-6-07								
	A	B	C	D	E	F	G	H	J	K	L
INITIAL	C.Y.IP	W.B.LEE	Y.K.MAN								

TITLE :

TYPICAL LV CABLE TRENCH

DRAWN: S.C.T.	DATE: 15 Aug., 2003
CHECKED: K. K. LEUNG	APPROVED: W. B. LEE
SCALE: 1 : 15	SHEET(S) IN SET: 1

PROJECT NO.	CONTRACT NO.
-------------	--------------

ASSET MANAGEMENT

DRG. NO. T G E N 2 5 5 0 0 D E 3 3 0 0 0 2 0 1 C A