


申請地點位置圖




地政總署測繪處 Survey and Mapping Office, Lands Department

比例尺 SCALE 1:1 000

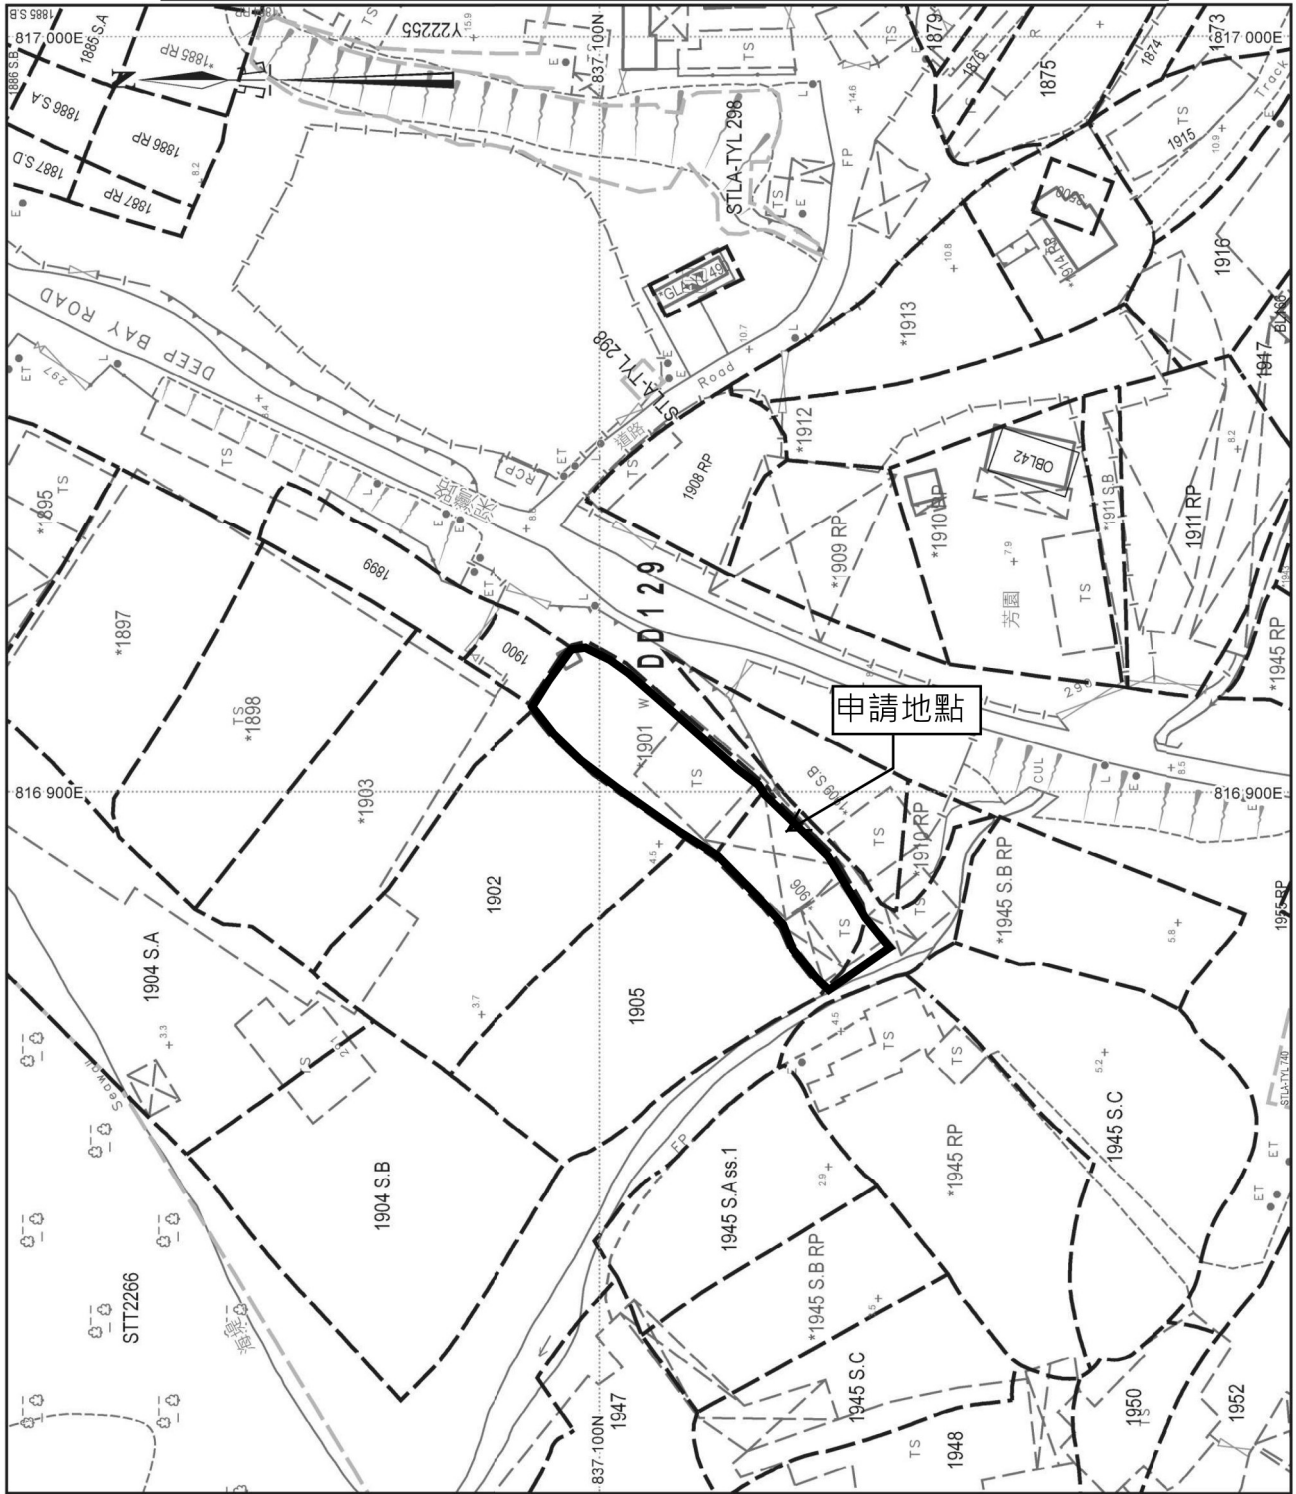

申請填土範圍圖

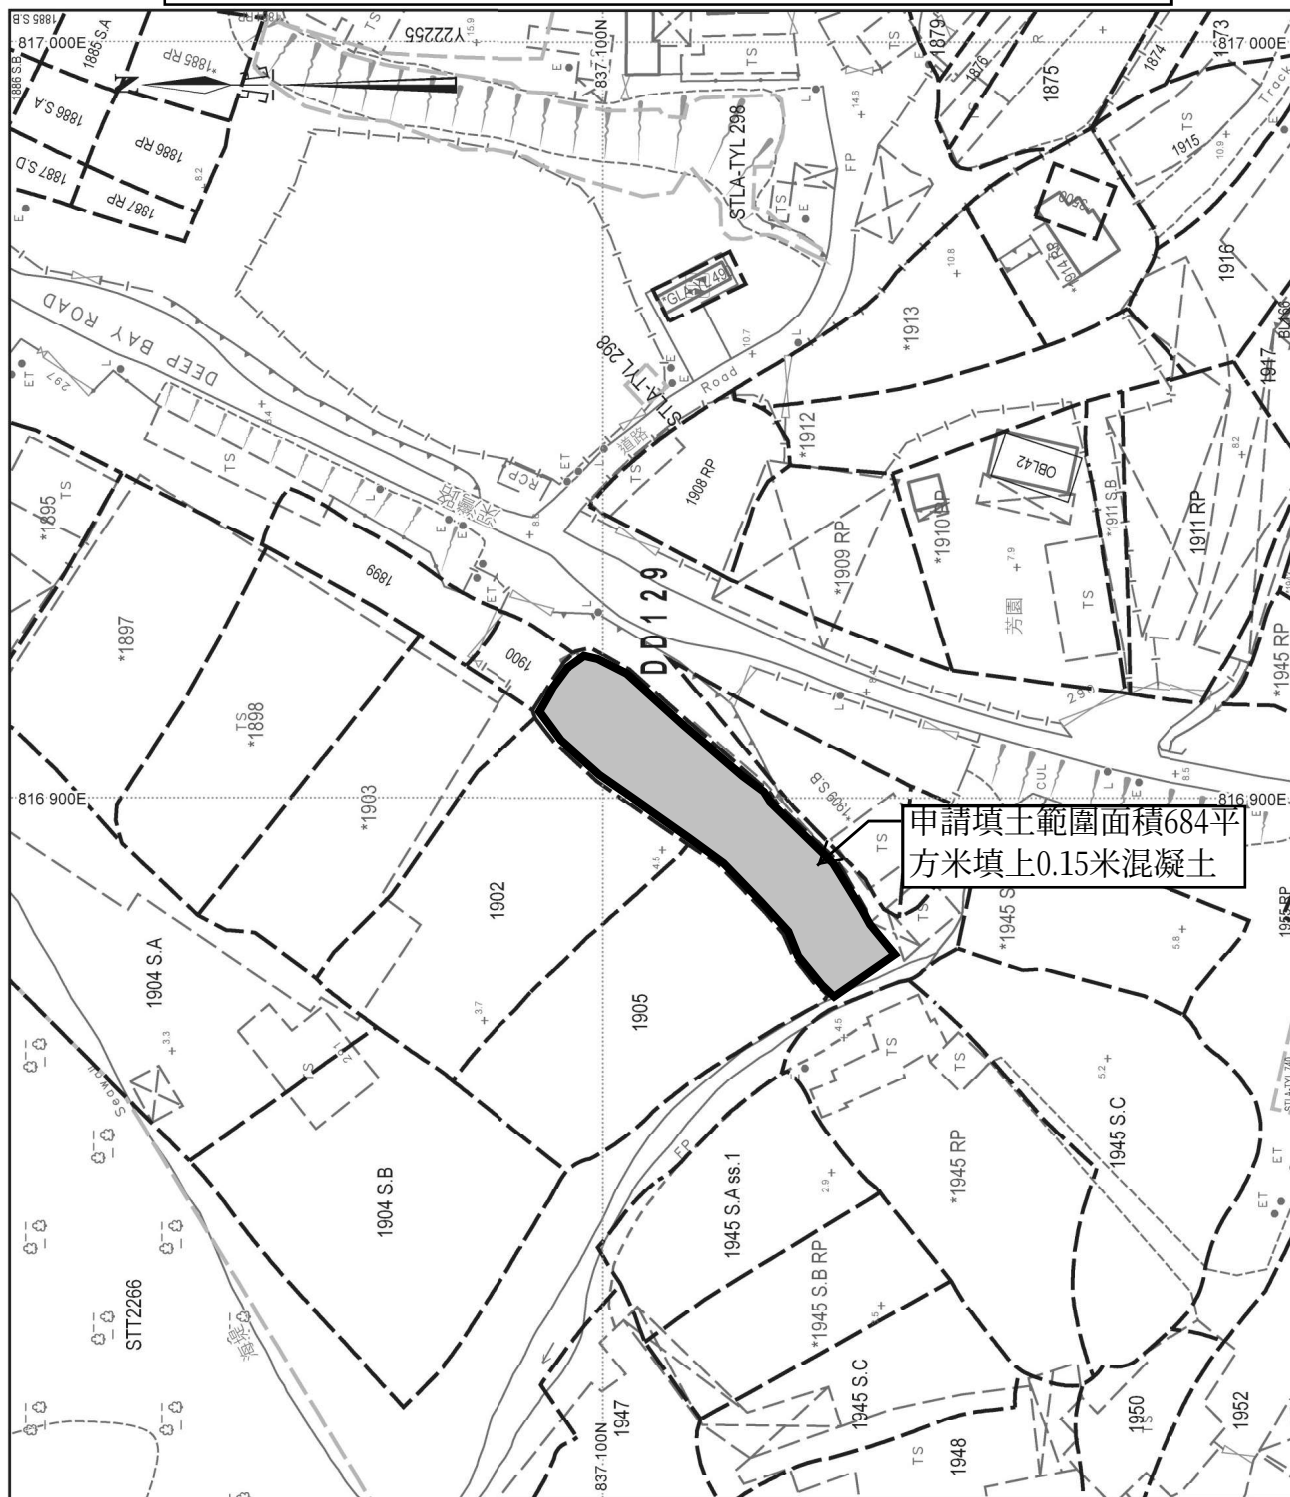


地政總署測繪處 Survey and Mapping Office, Lands Department

比例尺 SCALE 1:1000



申請填塘範圍圖

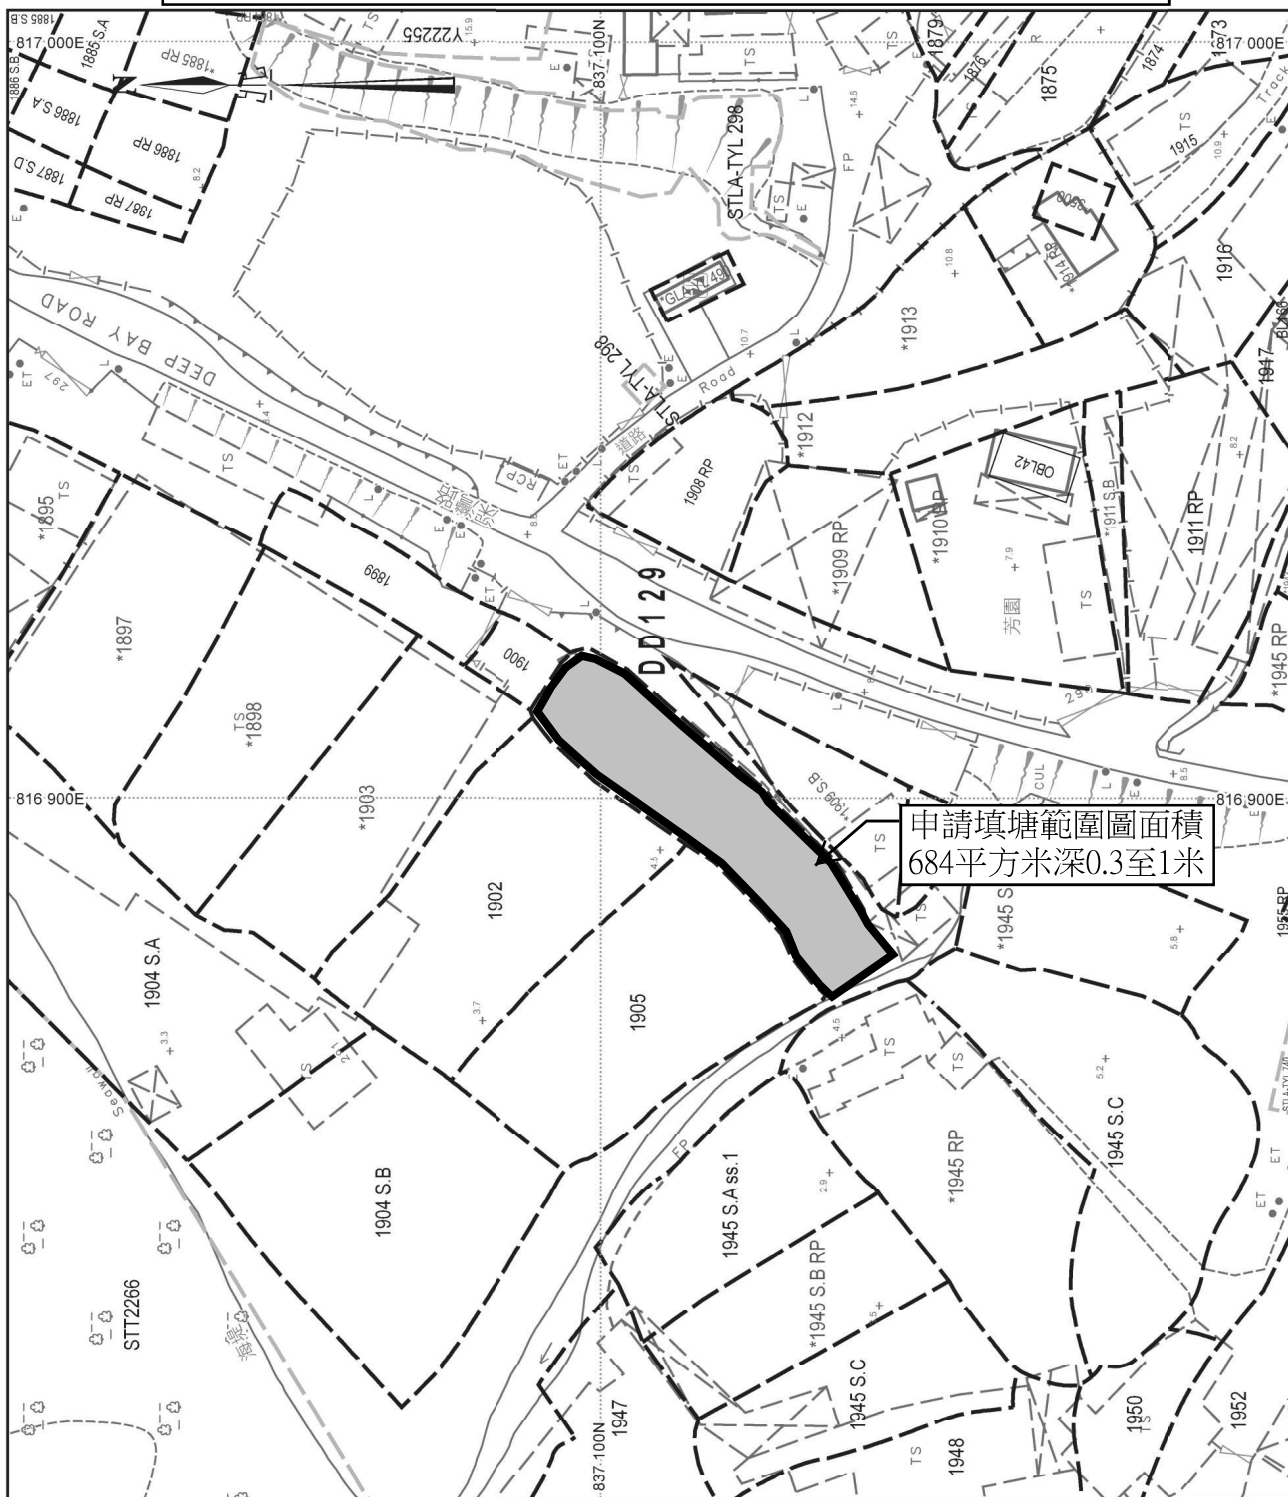


地政總署測繪處 Survey and Mapping Office, Lands Department

比例尺 SCALE 1:1000




布局圖

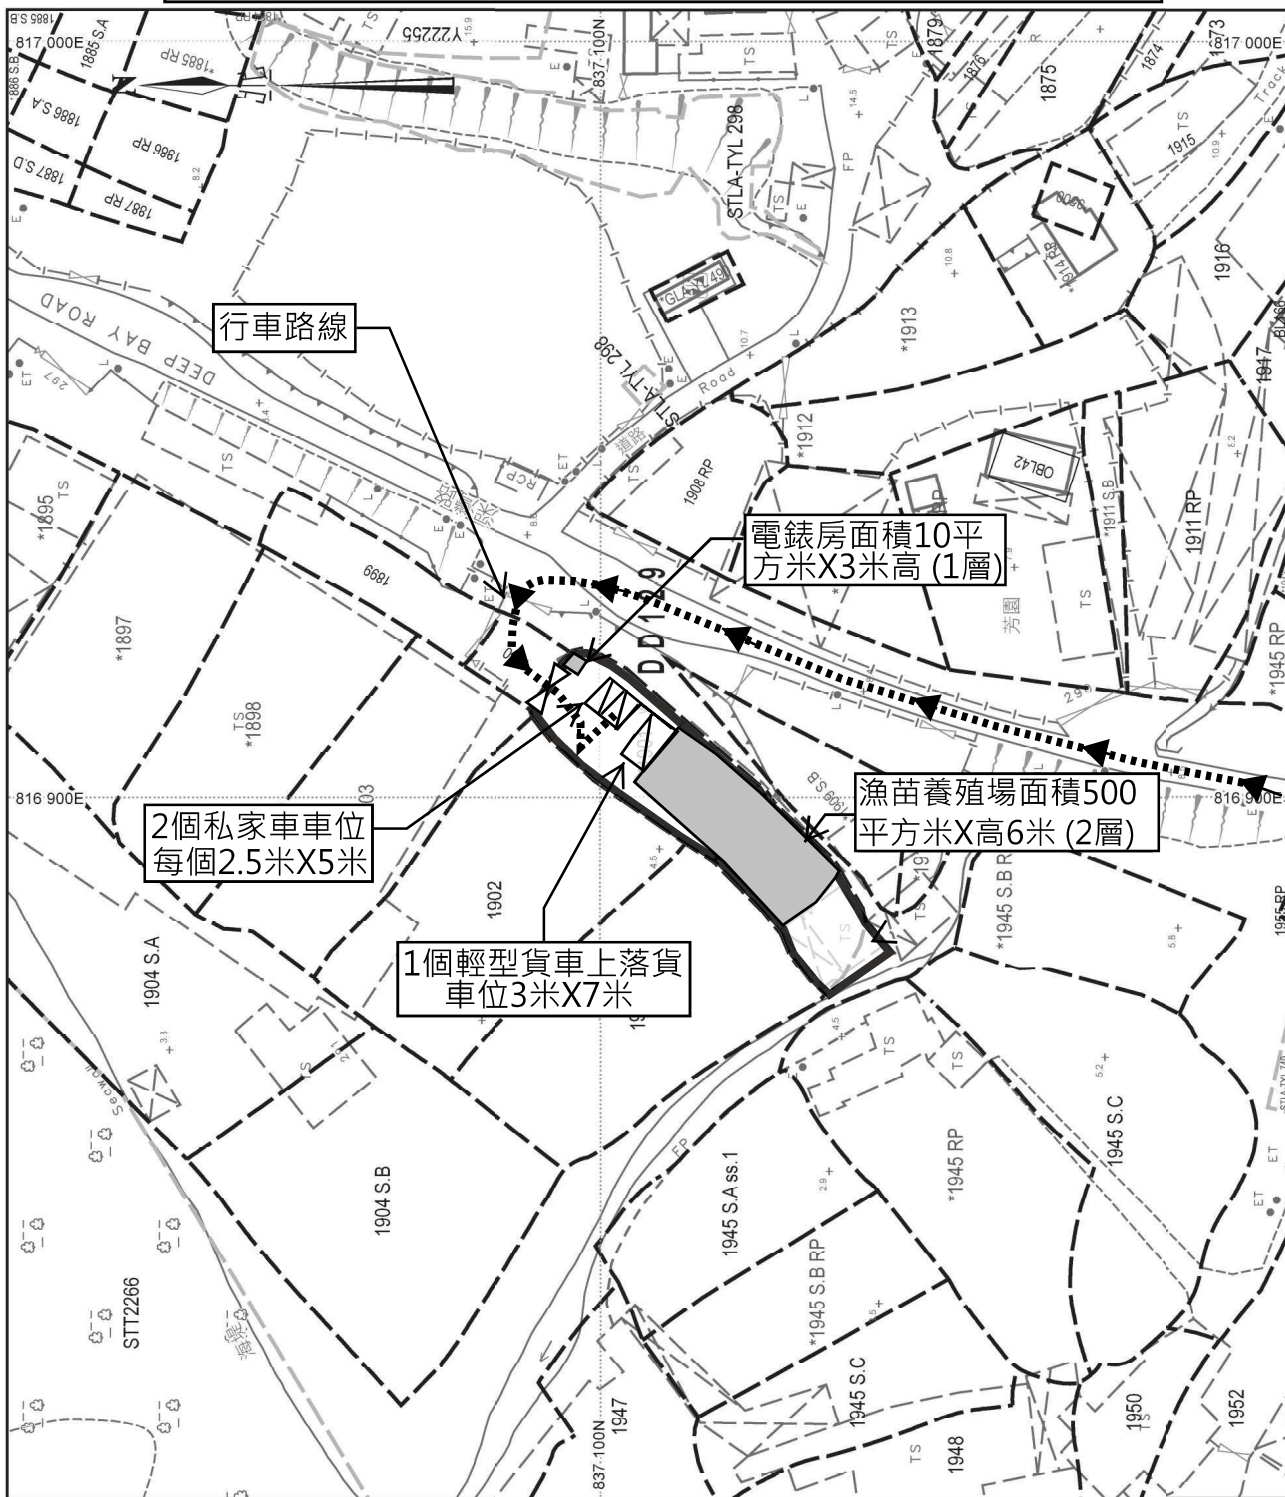

地政總署測繪處 Survey and Mapping Office, Lands Department

比例尺 SCALE 1:1 000

米 10 0 10 20 30 40 50 metres

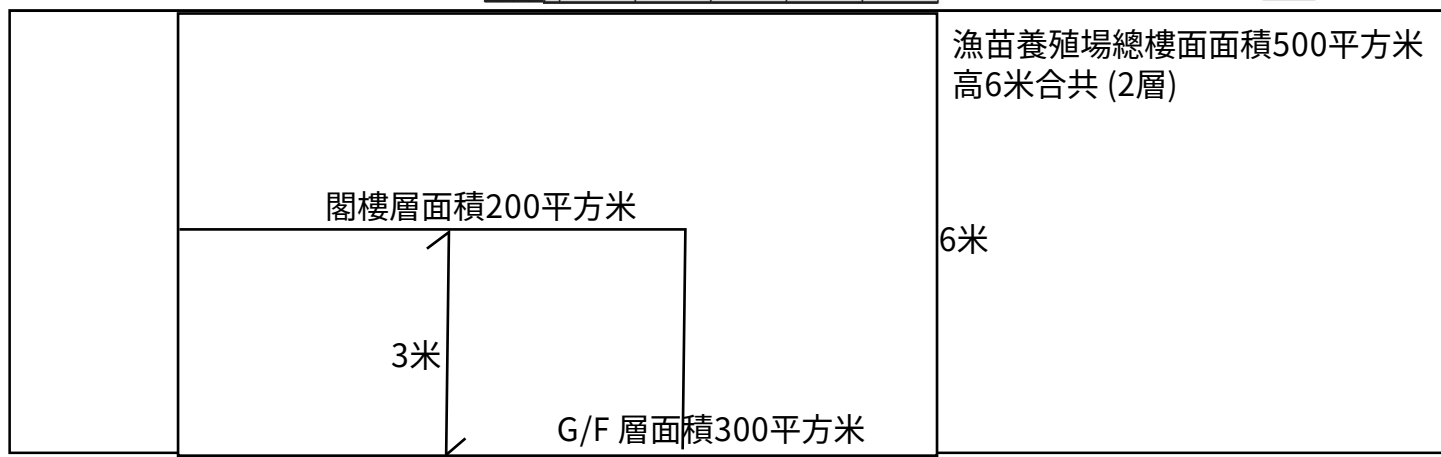

雨水排放建議圖


Catchment Area

Site Catchment Area = 1100m^2

= 0.001100 km^2

Peak runoff in $\text{m}^3/\text{s} = 0.278 \times 0.95 \times 240\text{ mm/hr} \times 0.001100\text{ km}^2 = 0.06972\text{m}^3/\text{s}$

= 4357 liter/min

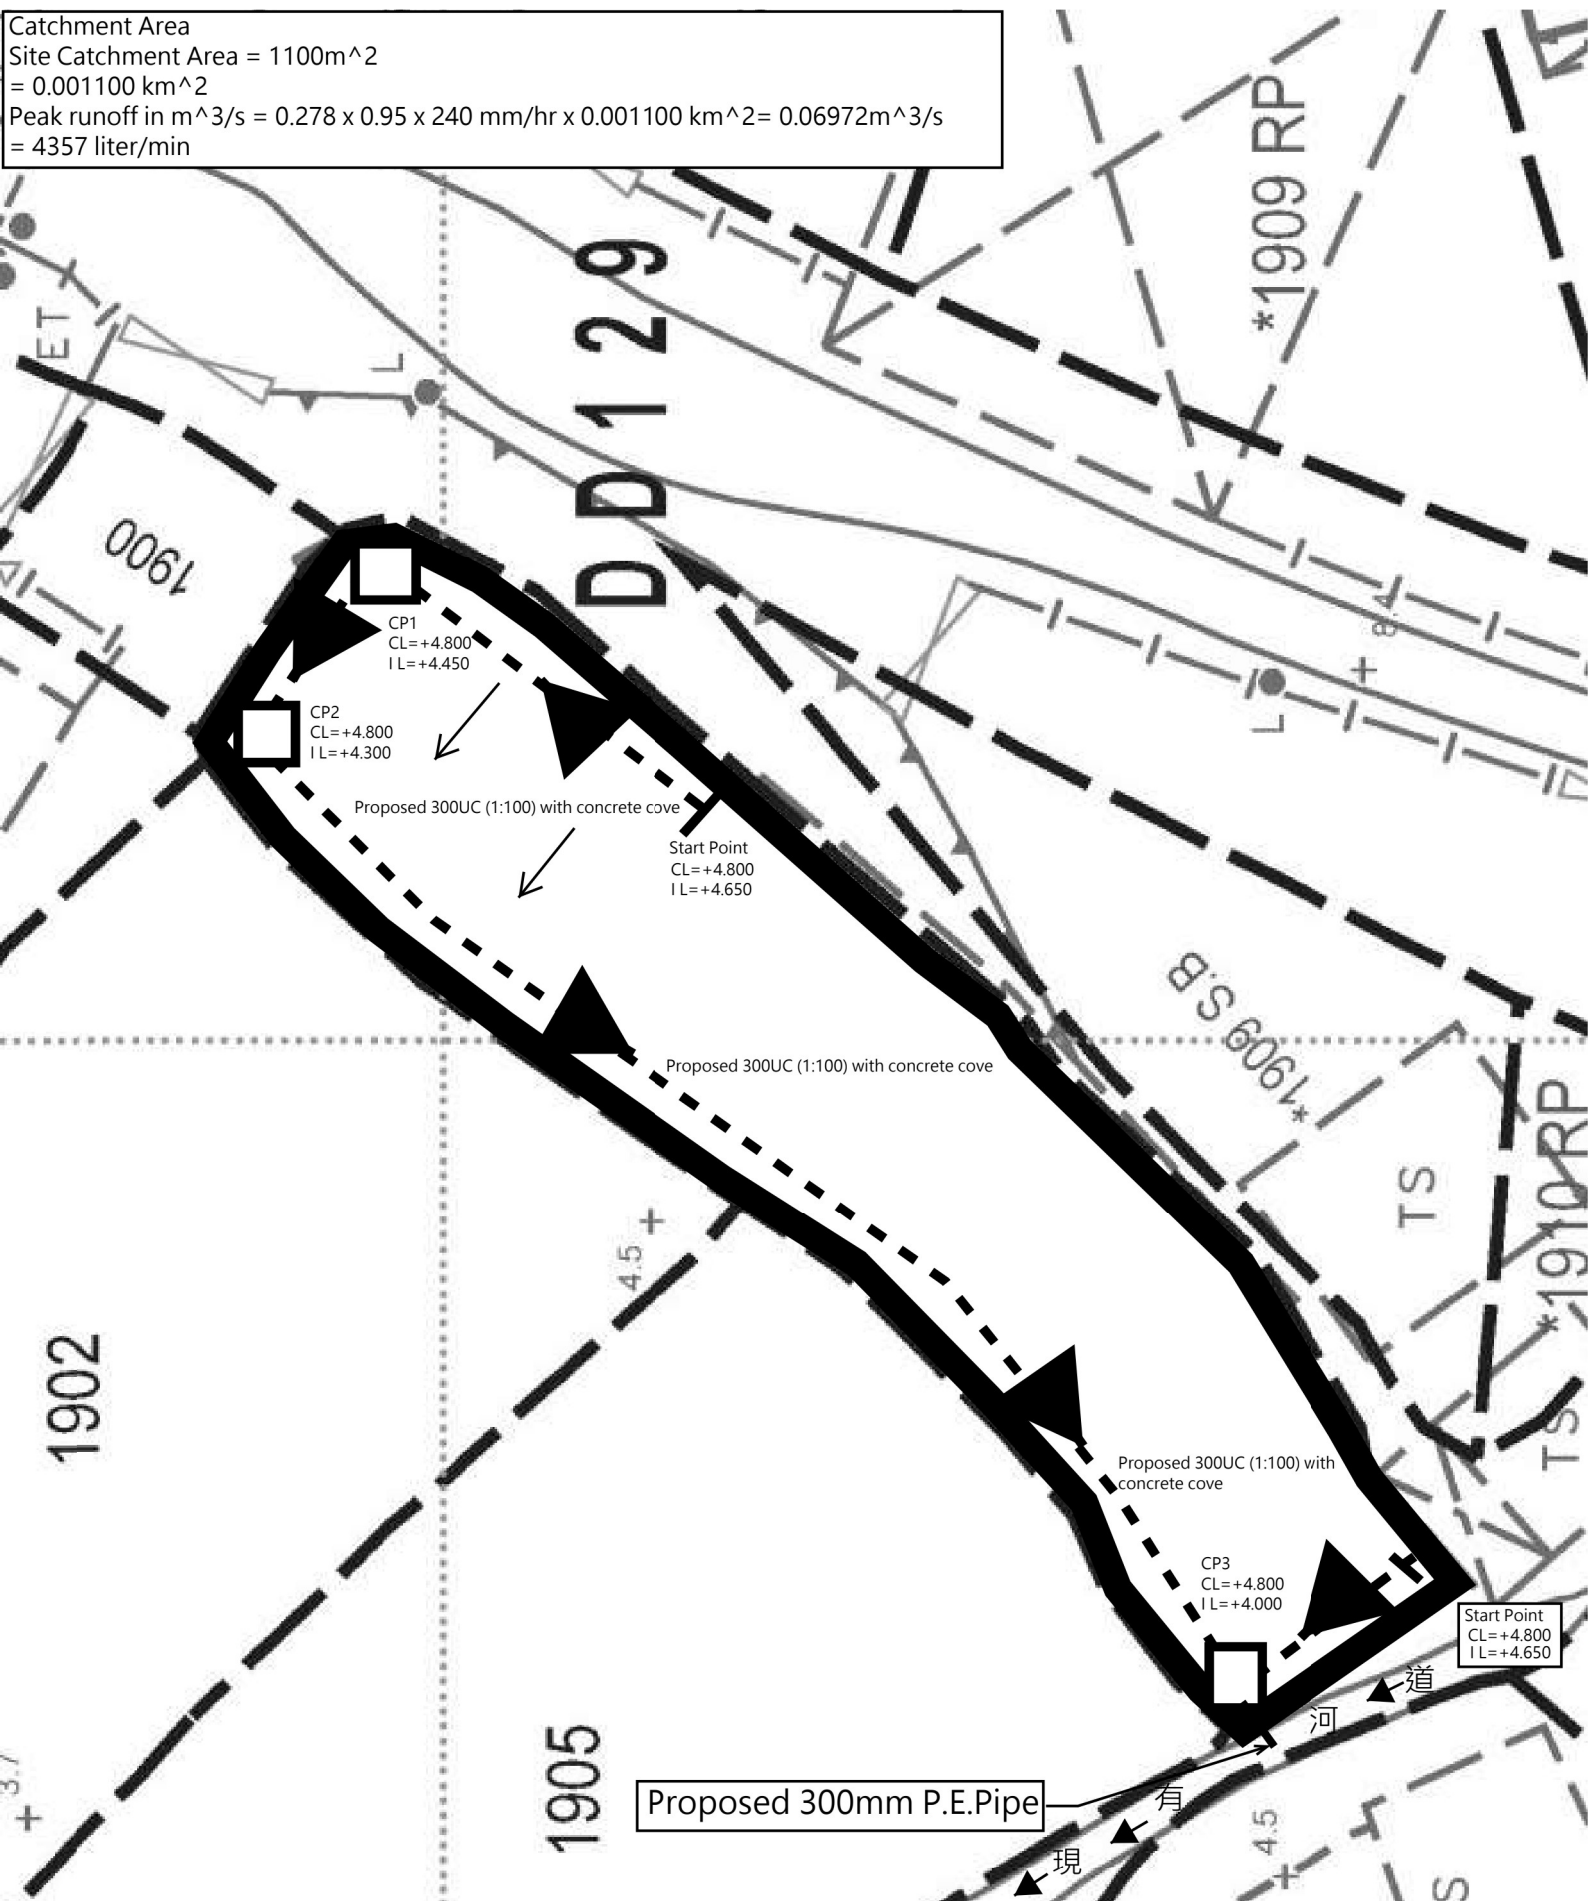

Note:

1. Catchpit (CP3) with desilting facility shall follow CEDD's standard drawing No. C2406/1. C2406/2A
2. Catchpit and UC follows Typical Details of Geotechnical Manual for Slope Fig.8.10 and Fig.8.11 respectively.
3. The inverted level of the connection point shall be verified on site prior the commencement of work
4. Grating Concrete Cover follows CEDD's standard drawing No. C2412E: U-CHANNELS WITH PRECAST CONCRETE SLABS