


Legend:

- ⊗ 4kg dry powder type fire extinguisher
- ⊕ 9 Litre water type fire extinguisher
- ⊙ 5kg co2 type fire extinguisher
- ⊠ SAND BUCKET
- Lot Boundary
- New installations

Fire Notes:

1. Sufficient emergency lighting shall be provided throughout the entire building in accordance with BS5266:Part 1 and BS EN 1838.
2. Sufficient directional and exit sign shall be provided in accordance with BS 5266:Part 1 and FSD Circulars letter 5/2008.
3. Sufficient portable hand-operated approved appliance shall be provided as required by occupancy and as marked on plans.

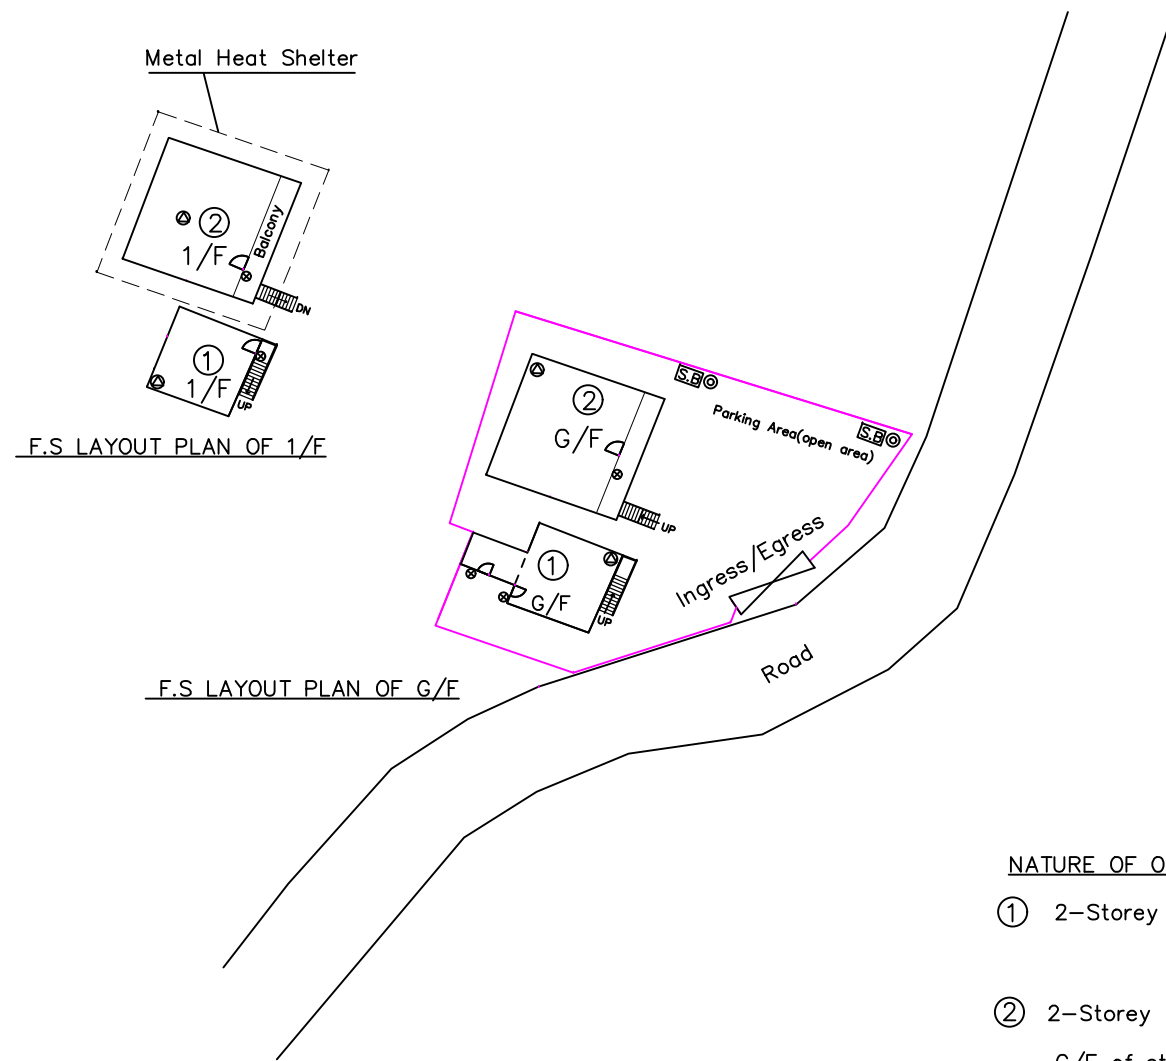

NATURE OF OCCUPANCY:

- ① 2-Storey structure for shop (GFA: Not exceeding 91.5 sq.m, Height: Not exceeding 5.5m)
- ② 2-Storey structure for shop and office (GFA: Not exceeding 183.5 sq.m. Height: Not exceeding 7.5m) under the Metal Heat Shelter.
G/F of structure for shop.
1/F of structure for office.

INTERCEPT FIRE & SECURITY TECHNICIANS LIMITED

Registered Address:
Shop 25 & 84, G/F, Man Fung Building, YLTL329 Fung Kwan Street, Yuen Long, N.T
Tel: 92637766, Fax: 24285932
Business Address:
8/F, Block L, Phase 2, Wah Fung Industrial Centre, 33-39 Kwai Fung Street Kwai Chung, N.T
Tel: 24255404, Fax: 24285932

Project:
Proposed Temporary Shop and Services for A Period of 3 years at Lots 3250 S.B. ss.48 and 3250 S.B. ss 49 (Part) in D.D 104 and Adjoining Government Land, Mai Po, Yuen Long.

Title:
Proposed Fire Service Installation Layout Plan

Drawn by:	W.C.WONG
Date:	2022-04-28
Scale:	1:500@ A3
Ref No:	TPB/A/YL-MP/361
Drawing No:	2022/FS/007