


TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

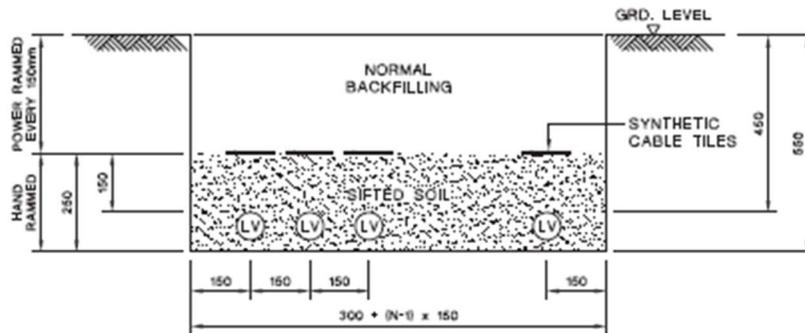

TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES

LEGEND :

- (LV) LV CABLE
- N NUMBER OF CABLE CIRCUITS



NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.


C GENERAL REVISION	B GENERAL REVISION	A SYNTHETIC CABLE TILE SPECIFIED																																							
DRAWN: S.C.T. CHECKED: K. K. LEUNG SCALE: 1 : 15	DATE: 15 Aug, 2003 APPROVED: W. B. LEE SHEET(S) IN SET: 1	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>REVS.</th> <td>16-2-04</td> <td>19-4-07</td> <td>28-6-07</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <th>INITIAL</th> <td>A</td> <td>B</td> <td>C</td> <td>D</td> <td>E</td> <td>F</td> <td>G</td> <td>H</td> <td>J</td> <td>K</td> <td>L</td> <td></td> </tr> <tr> <th></th> <td>C.Y.P.</td> <td>W.B.LEE</td> <td>YXMAN</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </table> <p>TITLE :</p> <p style="text-align: center; font-size: 1.2em;">TYPICAL LV CABLE TRENCH</p> <p>PROJECT NO. _____ CONTRACT NO. _____</p>	REVS.	16-2-04	19-4-07	28-6-07										INITIAL	A	B	C	D	E	F	G	H	J	K	L			C.Y.P.	W.B.LEE	YXMAN									
REVS.	16-2-04	19-4-07	28-6-07																																						
INITIAL	A	B	C	D	E	F	G	H	J	K	L																														
	C.Y.P.	W.B.LEE	YXMAN																																						
ASSET MANAGEMENT																																									
DRG. NO. T G E N 2 5 5 0 0 0 D E 3 3 0 0 0 2 0 1 C A																																									

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

Typical LV Cable Trench

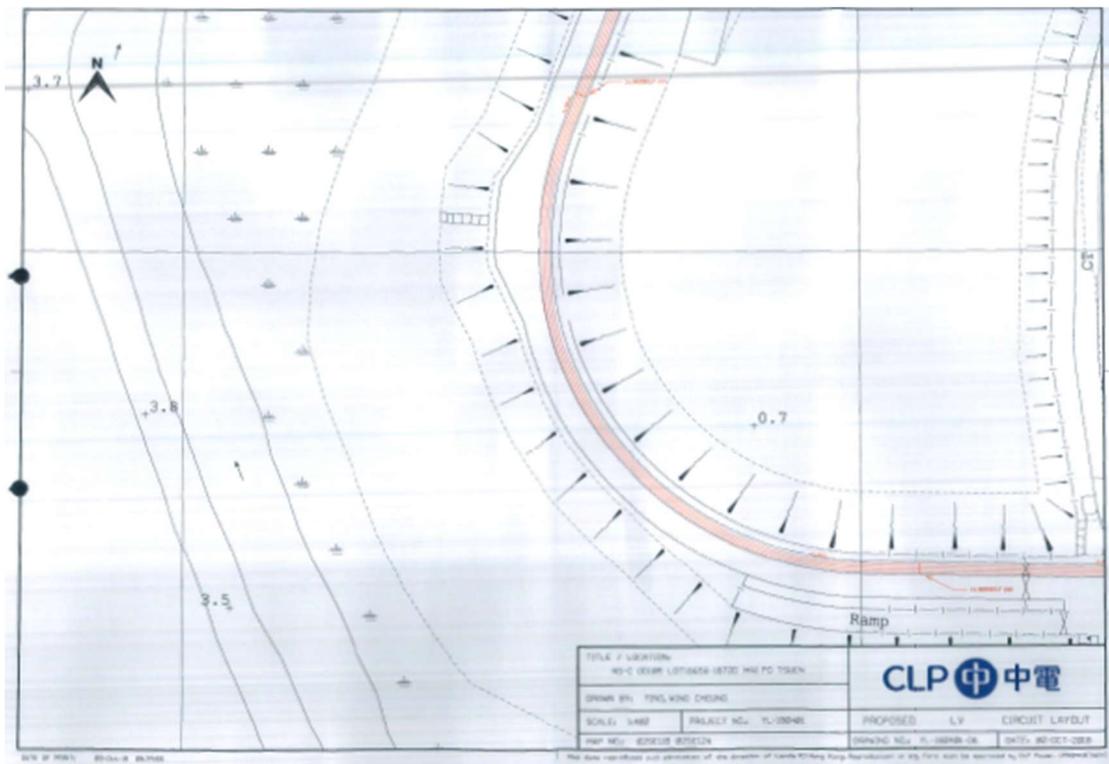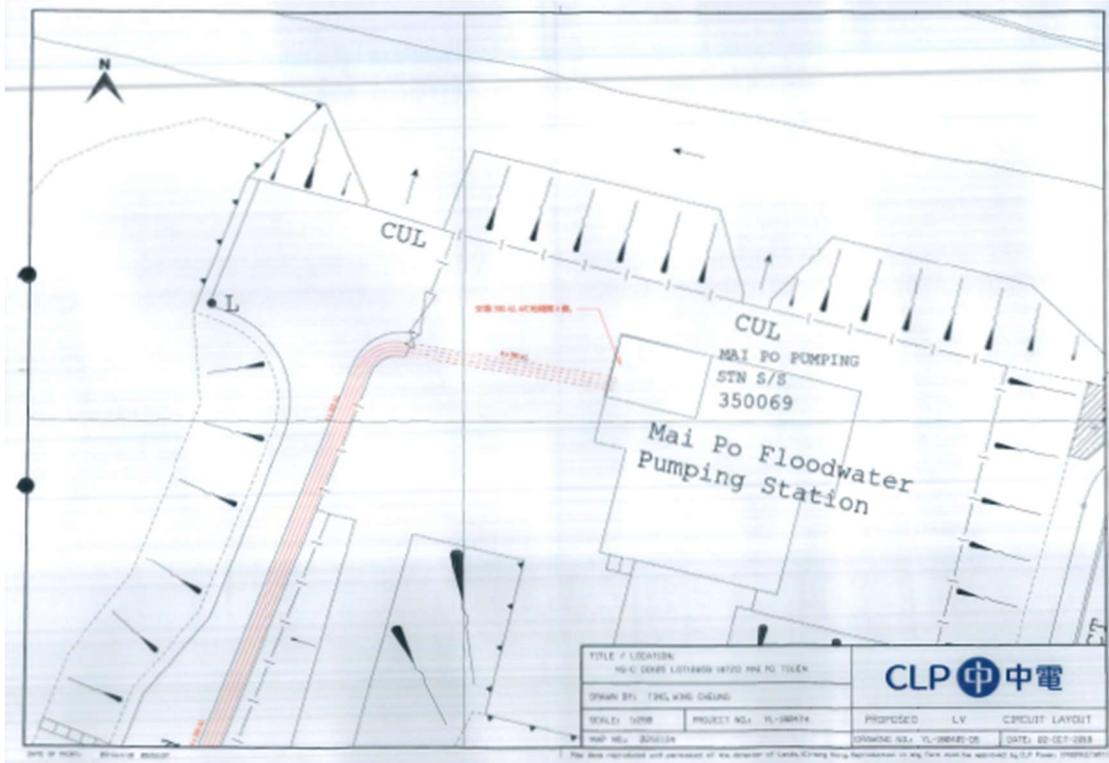

Layout Plan

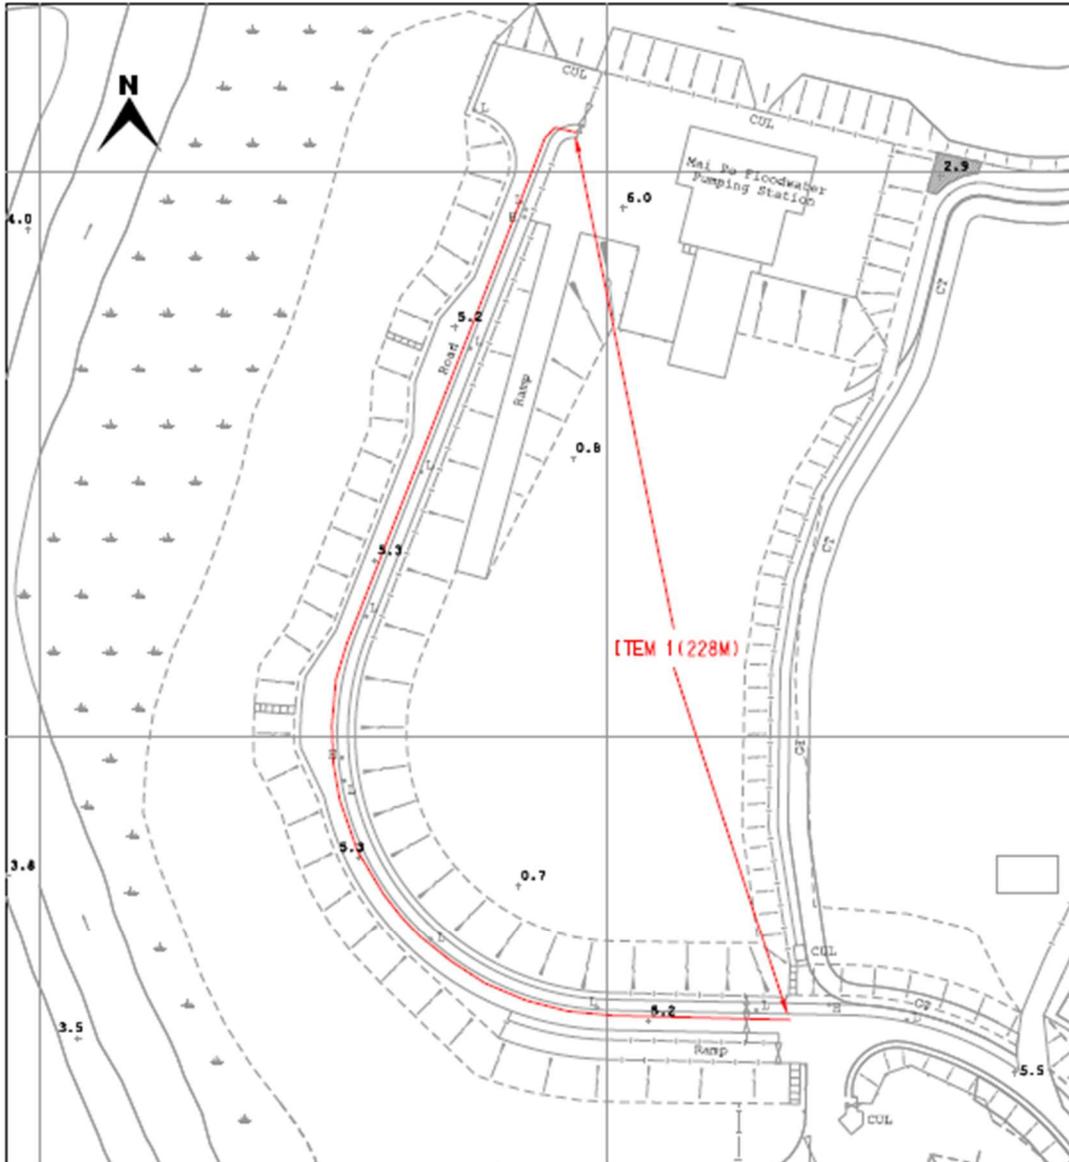

TITLE : LV Cable Laying
Near Mai Po Road
& Mai Po San Tsuen

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.5M x 0.6M x 0.75M / CUTOFF BOX
- EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL OF STEEL / WOODEN POLE
- OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- EXISTING POLE MOUNTED TRANSFORMER
- PROPOSED POLE MOUNTED TRANSFORMER
- PROPOSED STAY / STAY POLE
- PROPOSED 3.0M(L) x 3.32M(W) x 2.7M(H) HV PILLAR

MAP NO : 02SE11B, 02SE12A

DRAWN : BENSON		E/O NO :	
CHECKED : S.W.TAM		REGION : NR	O.C. : YL
DATE : 29-12-2023		PROJECT REF. : YL2018-0401	
SCALE : 1:1000		PLAN REF. : NRYL2018-0401-05	

Map data reproduced with permission of the Director of Lands. © Hong Kong Information Classification PROHIBITARY

Location Plan(DLO Permit)



Vehicular Access Plan

- The Green Line is the location of site
- The blue arrow symbols are Vehicular Access Route