

**FIRE SERVICES NOTES:**

1. EMERGENCY LIGHTING


1.1 SUFFICIENT EMERGENCY LIGHTING SHALL BE PROVIDED THROUGHOUT THE ENTIRE BUILDINGS/STRUCTURES IN ACCORDANCE WITH BS 5266-1:2016 AND BS EN 1838:2013 AND FSD CIRCULAR LETTER 4/2021.

2. EXIT SIGN

2.1 SUFFICIENT DIRECTIONAL AND EXIT SIGN SHALL BE PROVIDED IN ACCORDANCE WITH BS 5266: PART 1 AND FSD CIRCULAR LETTER 5/2008.

3. MISCELLANEOUS F.S. INSTALLATION

3.1 PORTABLE FIRE EXTINGUISHERS WITH SPECIFIED TYPE AND CAPACITY TO BE PROVIDED AT LOCATION AS INDICATED ON PLANS.

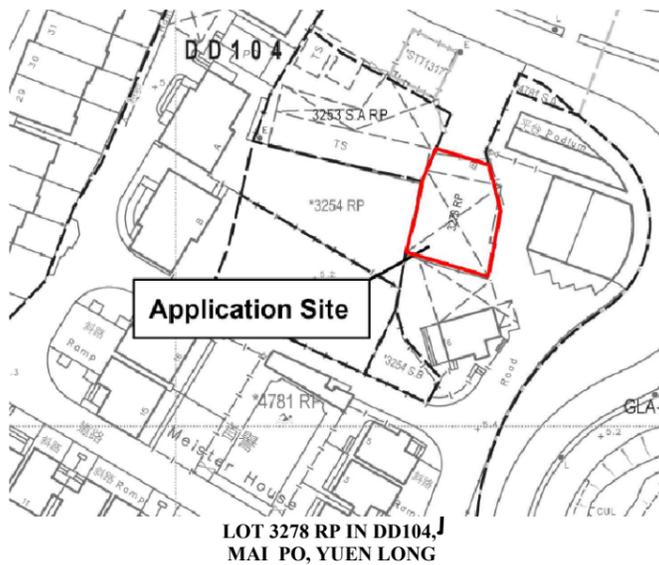


**BLOCK PLAN (N.T.S)**

**LEGEND:**

- Emergency Lighting complete with 2 hours battery backup
- Exit Sign complete with 2 hours battery backup
- 5KG CO<sup>2</sup> TYPE Fire Extinguisher

**SUMMARY OF STRUCTURE CONTENT:**

NO.	STRUCTURE CONTENT:	HEIGHT: (M)	AREA: (M <sup>2</sup> )	VOLUME: (M <sup>3</sup> )
B1	OFFICE AND STORAGE	3.5	32	112
B2	OFFICE AND STORAGE	3.5	32	112
B3	STORAGE	3.5	16	56
B4	STORAGE	3.5	16	56
B5	RECEPTION	3.5	16	56
B6	STORAGE	3.5	16	56
B7	METAL HEAT SHELTER	8	220	1760

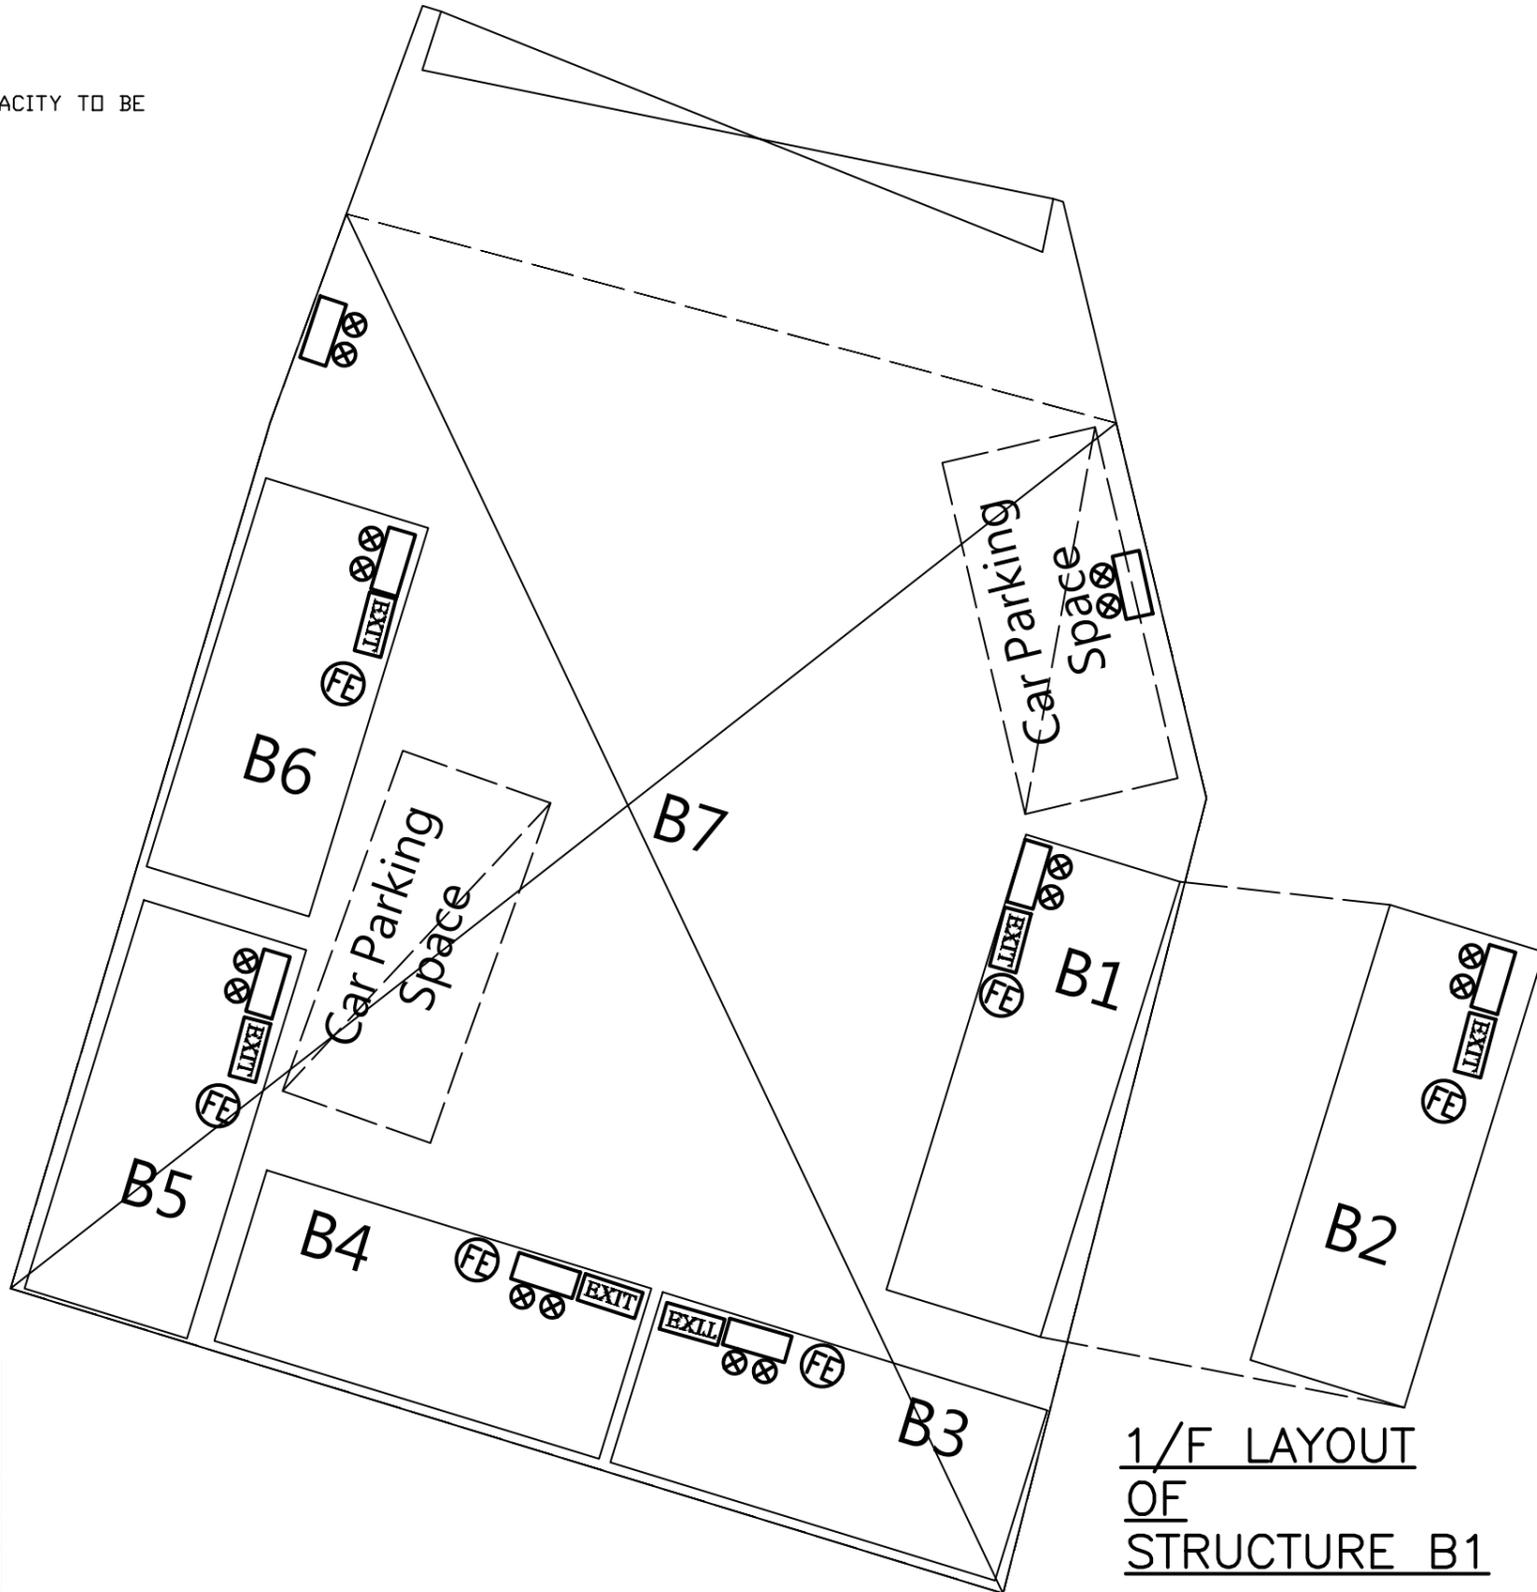

**F.S. LAYOUT PLAN AT G/F**

REV.	DATE	DESCRIPTION	DRAWN
0	05/2025	1ST SUBMISSION	LM

PROJECT  
 FIRE SERVICES INSTALLATION WORK  
 AT LOT 3278 RP IN DD104, MAI PO,  
 YUEN LONG, N.T.

TITLE  
 FIRE SERVICE INSTALLATION LAYOUT  
 PLAN

DRAWING NO.  
 RP-DD104-FS01

SCALE  
 1:100 @ A3

DATE  
 MAY/2025

REVISION  
 0

R.F.S.I.C.  
 MAN LICK ENGINEERING AND  
 TRADING CO. LTD.

