



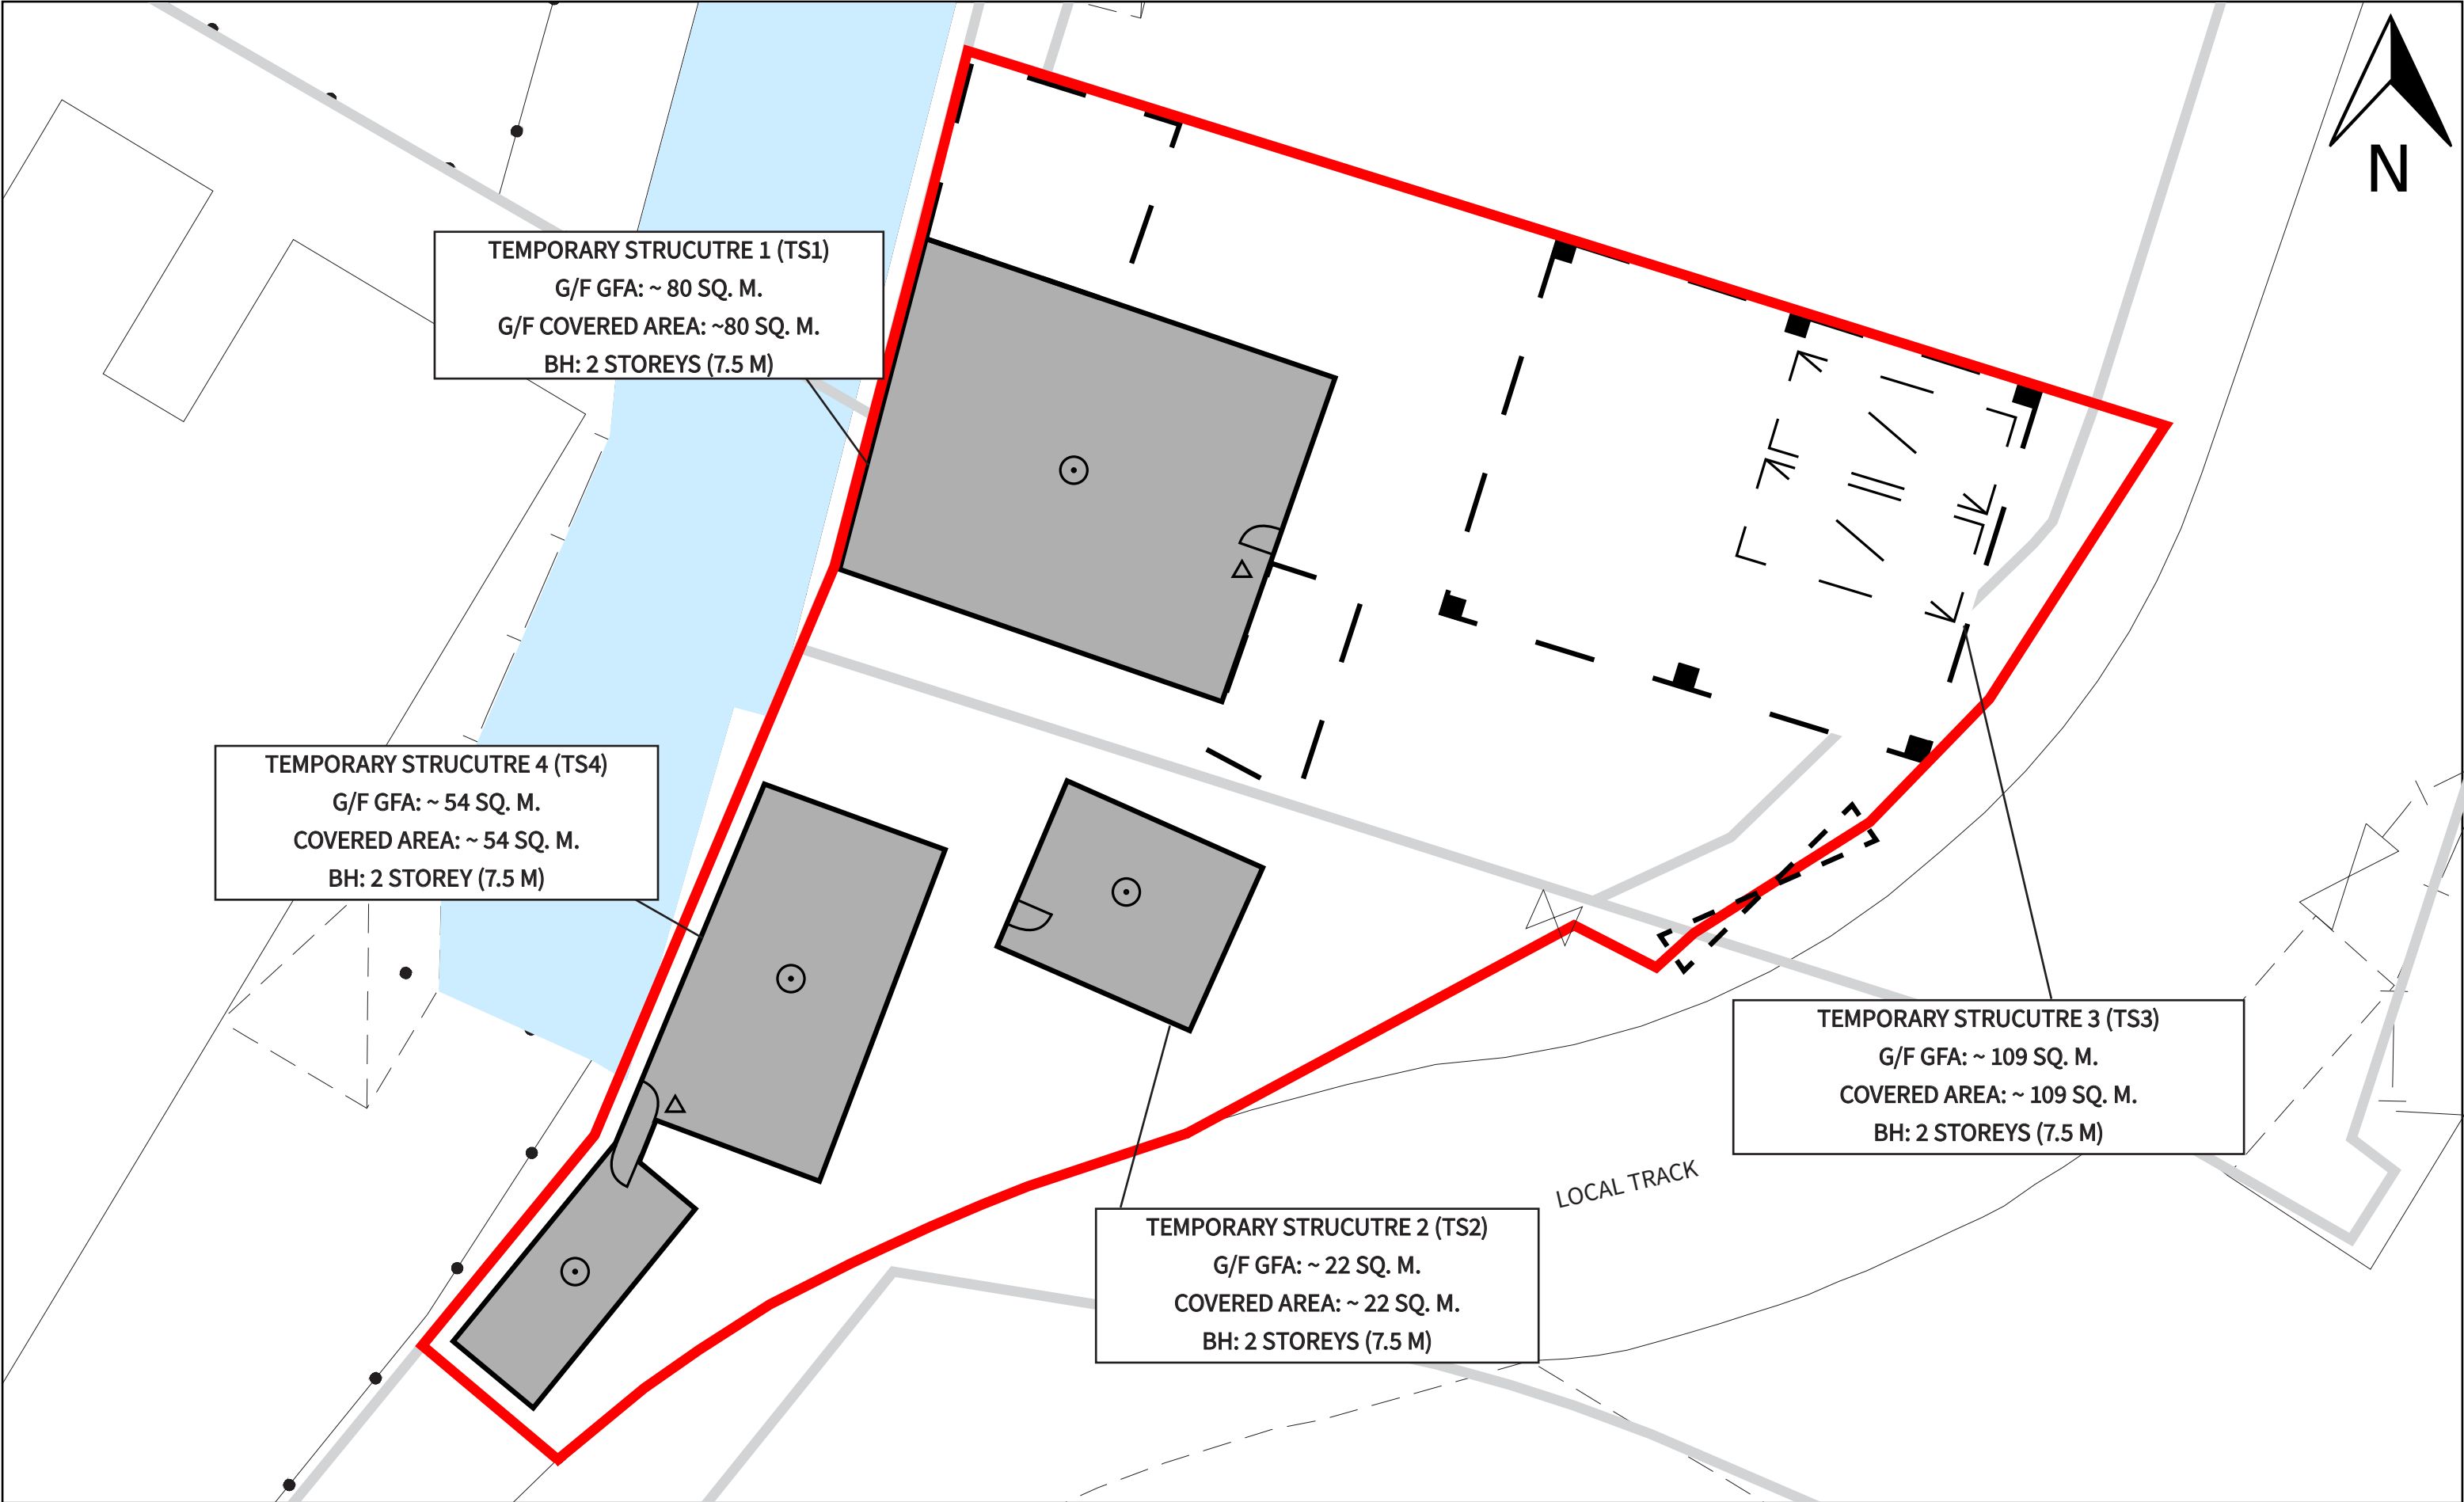

DRAWING TITLE: GROUND FLOOR PLAN	LEGEND:  APPLICATION BOUNDARY  ENCLOSED STRUCTURE  STRUCTURE ABOVE  PORTABLE FIRE EXTINGUISHER  STANDALONE FIRE DETECTOR	SCALE: NOT TO SCALE	PREPARED BY:  DeSPACE (International) Limited
DRAWING NO.: FIGURE 1		DATE: AUGUST 2026	

- FS NOTES:
- 1. THE WHOLE OF THE FIRE SERVICE INSTALLATIONS SHALL COMPLY WITH THE CODES OF PRACTICE (2022 EDITION) ISSUED BY THE HONG KONG FIRE SERVICES DEPARTMENT.
 - 2. THE INSTALLATIONS PROPOSED ARE IN ACCORDANCE TO FIRE SAFETY REQUIREMENTS FOR “TEMPORARY STORAGE AND STRUCTURES UNDER PLANNING APPLICATION, SHORT TERM TENANCY & SHORT TERM WAIVER (06/2025).”
 - 3. THE STANDALONE FIRE DETECTOR PROVISION IS IN ACCORDANCE TO “STANDALONE FIRE DETECTOR GENERAL GUIDELINES ON PURCHASE, INSTALLATION & MAINTENANCE (SEP 2021).”
 - 4. ALL DETECTORS WITHIN THE APPLICATION SITE SHALL BE INTERCONNECTED (EITHER WIRED OR WIRELESSLY) SUCH THAT WHEN ONE OF THE DETECTORS IS TRIGGERED, ALL CONNECTED DETECTORS SHALL SOUND AN ALARM SIMULTANEOUSLY.
 - 5. STAND-ALONE FIRE DETECTORS SHALL BE PROVIDED IN EVERY ROOM/COMPARTMENT EXCEPT IN KITCHEN AND WASHROOM.

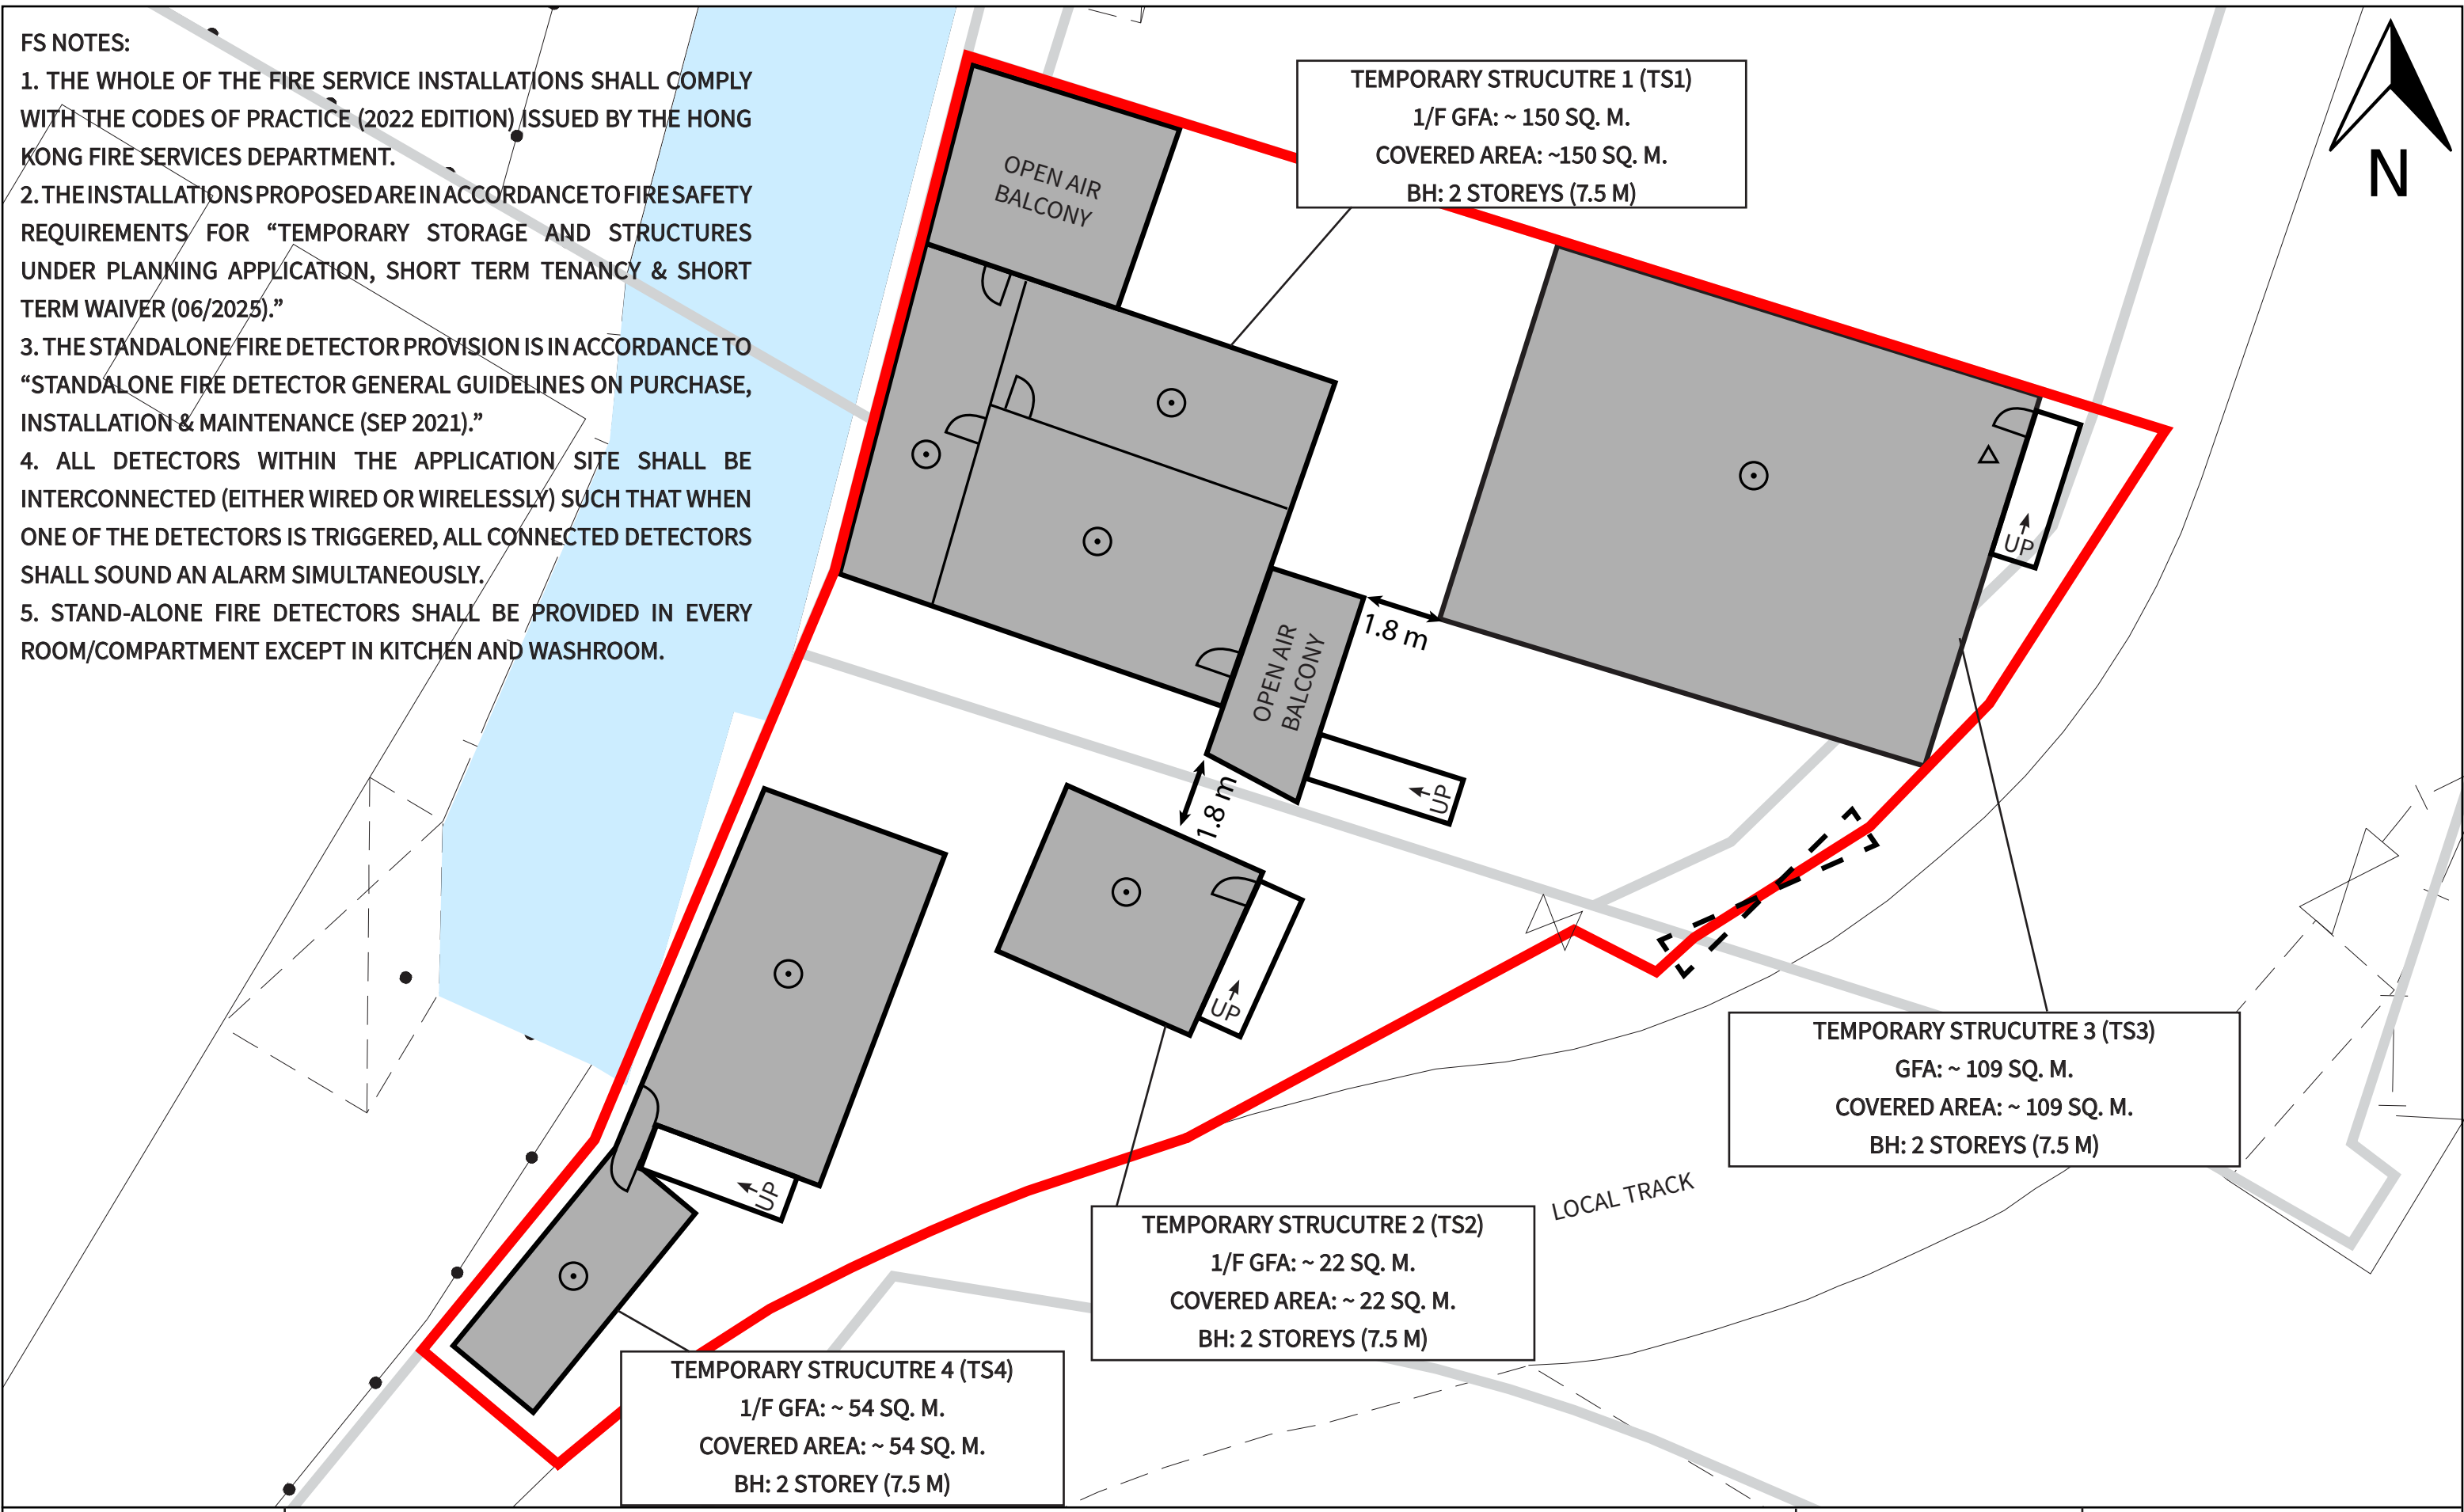

TEMPORARY STRUCUTRE 1 (TS1)
1/F GFA: ~ 150 SQ. M.
COVERED AREA: ~150 SQ. M.
BH: 2 STOREYS (7.5 M)

TEMPORARY STRUCUTRE 3 (TS3)
GFA: ~ 109 SQ. M.
COVERED AREA: ~ 109 SQ. M.
BH: 2 STOREYS (7.5 M)

TEMPORARY STRUCUTRE 2 (TS2)
1/F GFA: ~ 22 SQ. M.
COVERED AREA: ~ 22 SQ. M.
BH: 2 STOREYS (7.5 M)

TEMPORARY STRUCUTRE 4 (TS4)
1/F GFA: ~ 54 SQ. M.
COVERED AREA: ~ 54 SQ. M.
BH: 2 STOREY (7.5 M)

DRAWING TITLE:

FIRST FLOOR PLAN

LEGEND:



APPLICATION BOUNDARY



ENCLOSED STRUCTURE



PORTABLE
FIRE EXTINGUISHER



STANDALONE
FIRE DETECTOR

SCALE:

NOT TO SCALE

DATE:

AUGUST 2026

PREPARED BY:



DeSPACE (International) Limited

DRAWING NO.:

FIGURE 2