

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS
消防（裝置及設備）規例
(Regulation 9(1))
(第九條(1)款)
CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT
消防裝置及設備證書

FSD Ref.:
消防處檔號

Serial Number
30929 001997

Name of Client 顧客姓名
Construction Sector Imported Labour Quarters Limited

Address 地址
Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT



Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☐ Licensed premises 持牌處所 ☐ Institutional 社團

Part 1 Annual Maintenance ONLY 第一部 只適用於年檢事項					
In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。					
Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
24	2 nos. x 5 kg CO2 F.E.	Transformer Room no. 1	Conforms with FSD requirements	24/06/2025	23/06/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作					
Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項				
Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

For and on behalf of
美利堅消防工程有限公司
AMERICAN FIRE ENGINEERING COMPANY LIMITED

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核
This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

Authorized Signature:
受權人簽署
Name: Chung Matthew Chi Hin
姓名

FSD/RC No.: RC3 / 0929 RC /
消防處註冊號碼
Company Name: CHUNG Matthew Chi-hin
公司名稱

Telephone:
聯絡電話
Date: 30/06/2025
日期

For FSD use only

Inspected ☐

Key-in ☐

Verified ☐











Serial Number

30929001997

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

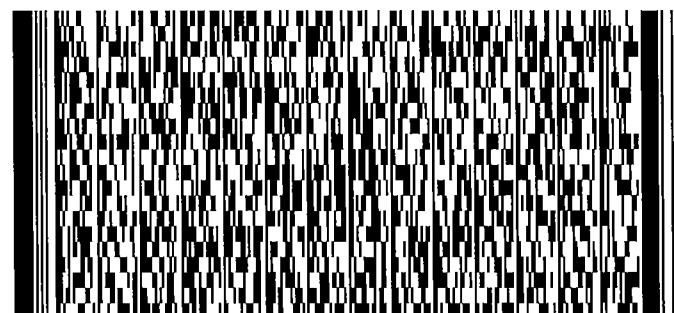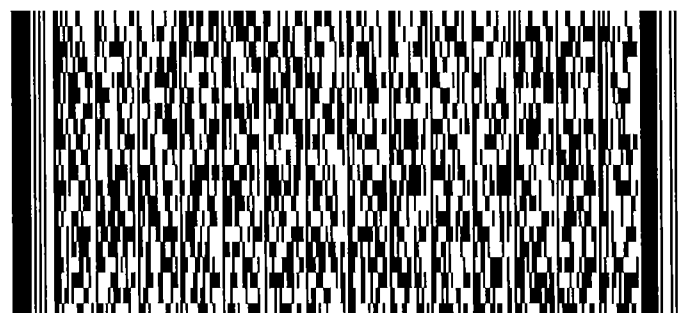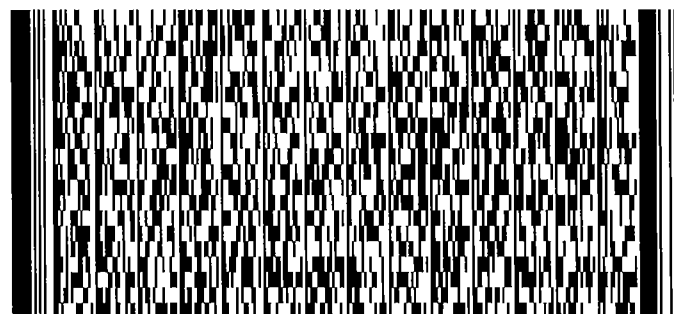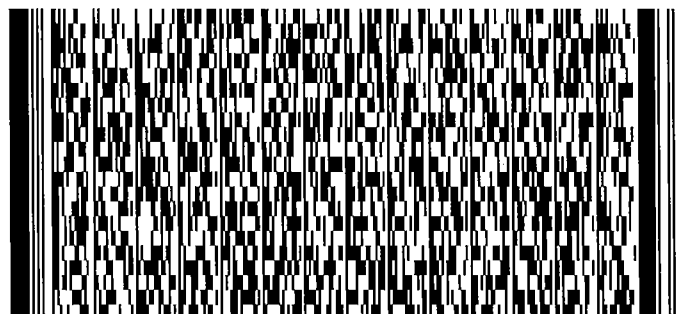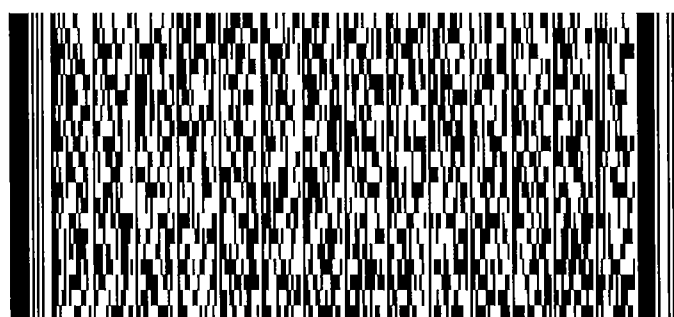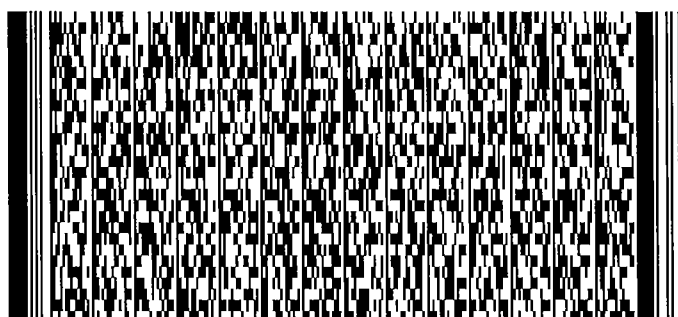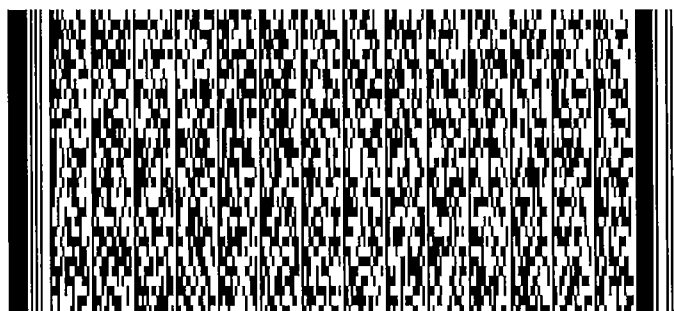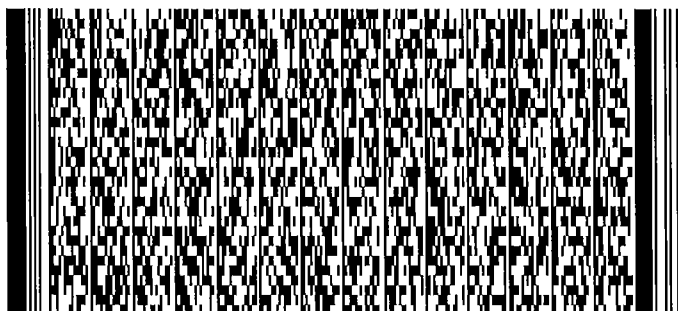

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防(裝置及設備)規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.:

消防處檔號

Serial Number

30929 001998

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Address 地址

Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT

Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☐ Licensed premises 持牌處所 ☐ Institutional 社團**Part 1 Annual Maintenance ONLY**
第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
24	2 nos. x 5 kg CO2 F.E.	Transformer Room no. 2	Conforms with FSD requirements	24/06/2025	23/06/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

For and on behalf of
美利堅消防工程有限公司

AMERICAN FIRE ENGINEERING COMPANY LIMITED

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

Authorized

Signature:

受權人簽署

Name:

姓名

Authorized Signature(s)
Chung Matthew Chi Hin

FSD/RC No.:

消防處註冊號碼

RC3 / 0929 RC /

Company Name:

公司名稱

CHUNG Matthew Chi-hin

Telephone:

聯絡電話

Date:

日期

30/06/2025

For FSD use only

Inspected

Key-in

Verified











Serial Number

30929001998

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

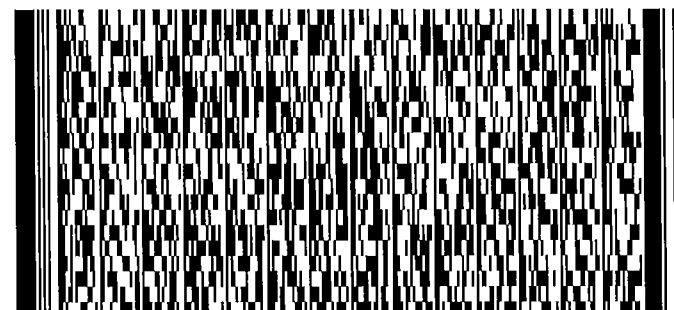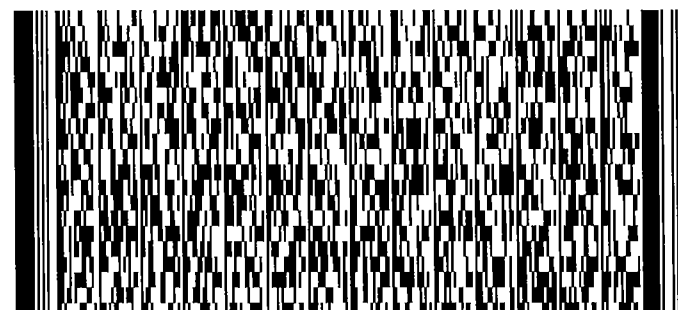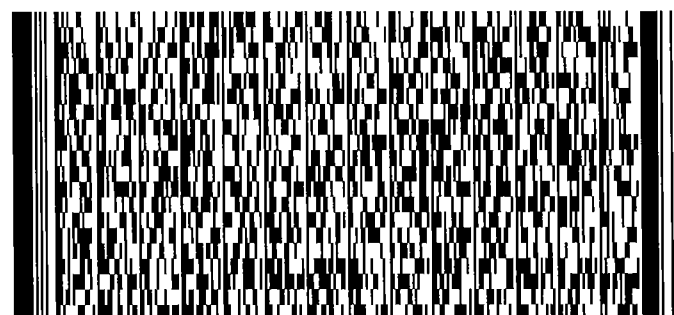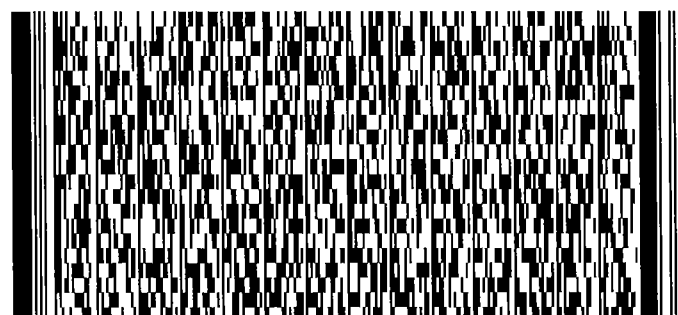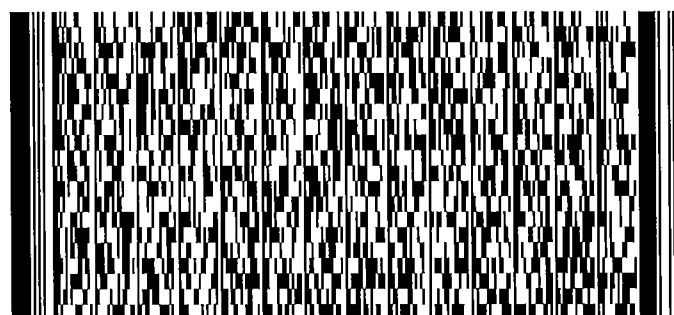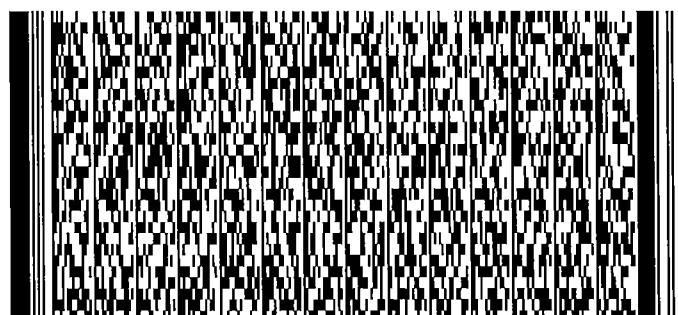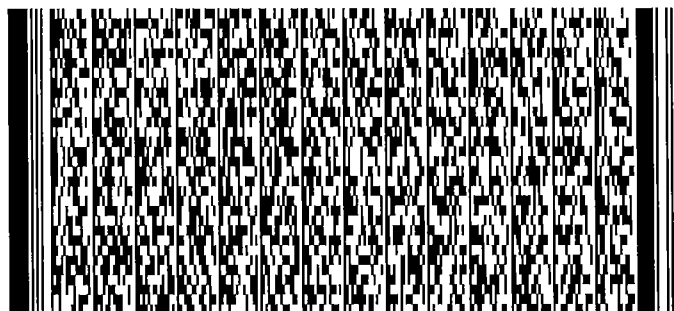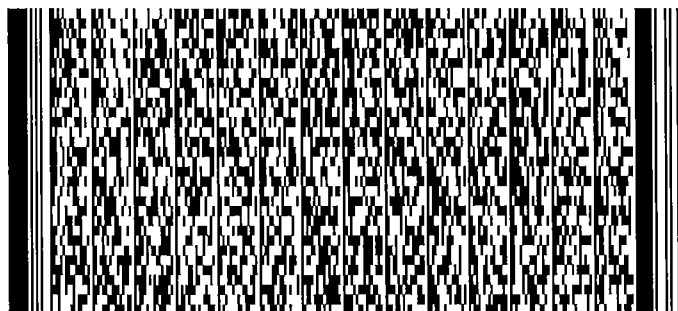

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防(裝置及設備)規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.:
消防處檔號

Serial Number

30929 001999

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Address 地址

Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT

Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☐ Licensed premises 持牌處所 ☐ Institutional 社團**Part 1 Annual Maintenance ONLY**
第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
24	2 nos. x 5 kg CO2 F.E.	Transformer Room no. 3	Conforms with FSD requirements	24/06/2025	23/06/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

For and on behalf of
美利堅消防工程有限公司

AMERICAN FIRE ENGINEERING COMPANY LIMITED

Authorized

Signature:

受權人簽署

Name:

姓名

Authorized Signature(s)
Chung Matthew Chi Hin

FSD/RC No.:

消防處註冊號碼

RC3 / 0929 RC /

Company Name:

公司名稱

CHUNG Matthew Chi-hin

Telephone:

聯絡電話

Date:

日期

30/06/2025

For FSD
use only

Inspected

Key-in

Verified











Serial Number

30929001999

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

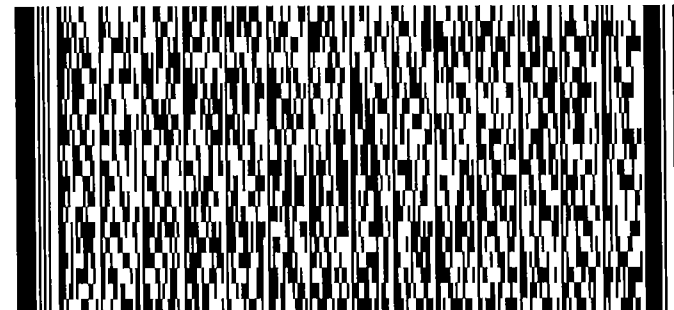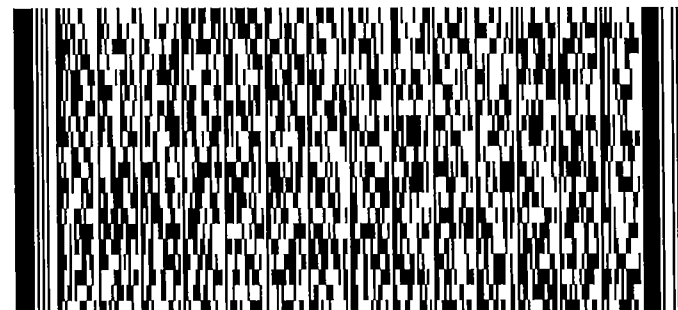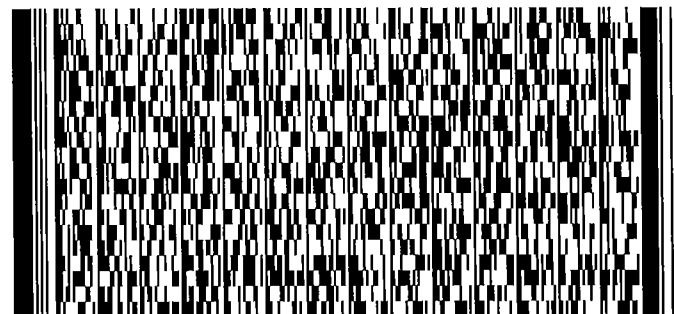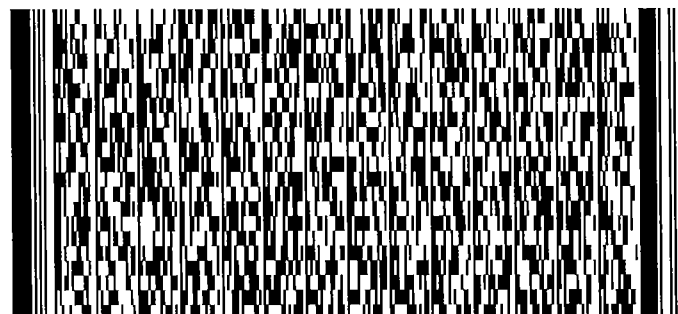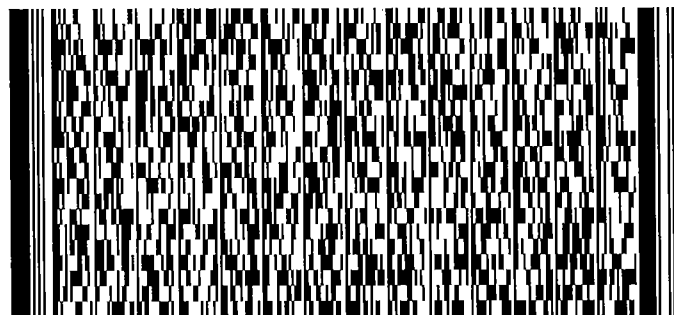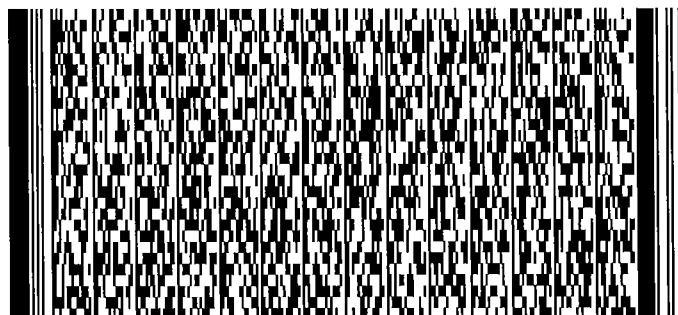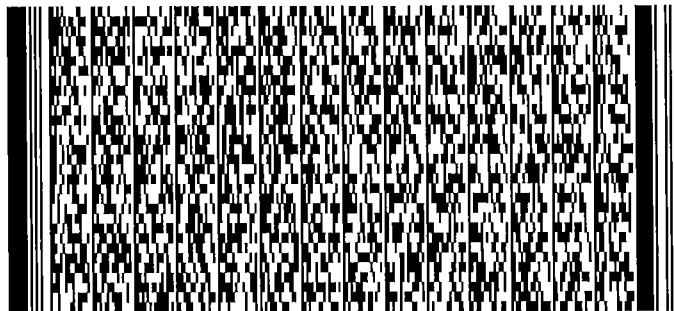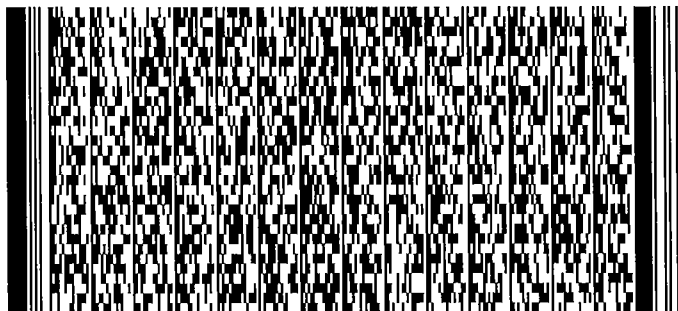

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防(裝置及設備)規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.:

消防處檔號

Serial Number

30929 002000

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Address 地址

Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT



Type of Building 樓宇類型:

☐ Industrial 工業☐ Commercial 商業☐ Domestic 住宅☐ Composite 綜合☐ Licensed premises 持牌處所☐ Institutional 社團

Part 1 Annual Maintenance ONLY

第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
24	2221 nos. x 2 kg dry powder F.E.	Entire Area	Conforms with FSD requirements (Defects see Part 3)	24/06/2025	23/06/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述
24	155 nos. x 2 kg dry powder F.E.	Entire Area	Defective	Need replacement

For and on behalf of
美利堅消防工程有限公司

AMERICAN FIRE ENGINEERING COMPANY LIMITED

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或
處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

Authorized

Signature:

受權人簽署

Name:

姓名

Authorized Signature(s)
Chung Matthew Chi Hin

FSD/RC No.:

消防處註冊號碼

Company Name:

公司名稱

Telephone:

聯絡電話

Date:

日期

RC3 / 0929 RC /

CHUNG Matthew Chi-hin

30/06/2025

For FSD
use only

Inspected

Key-in

Verified











Serial Number

30929002000

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

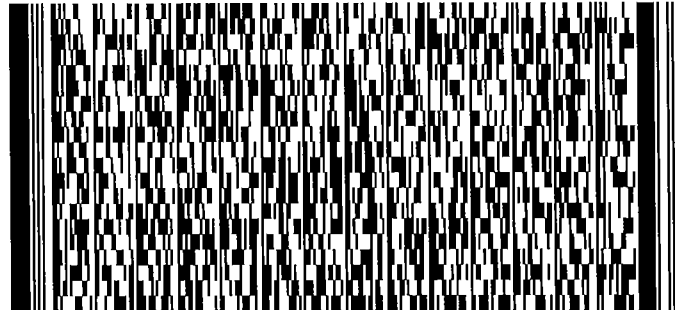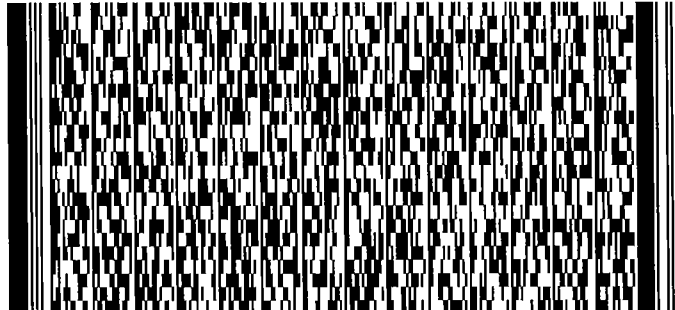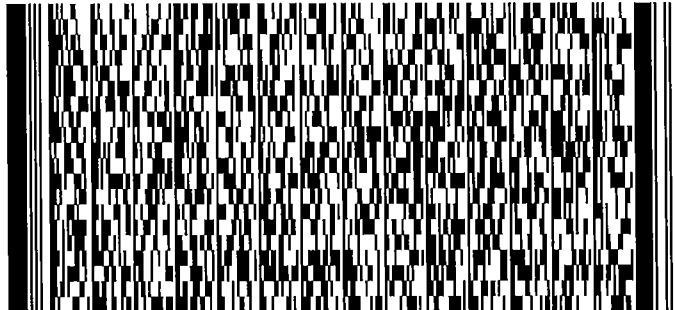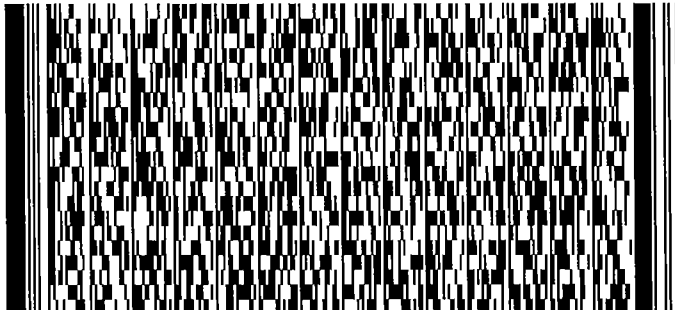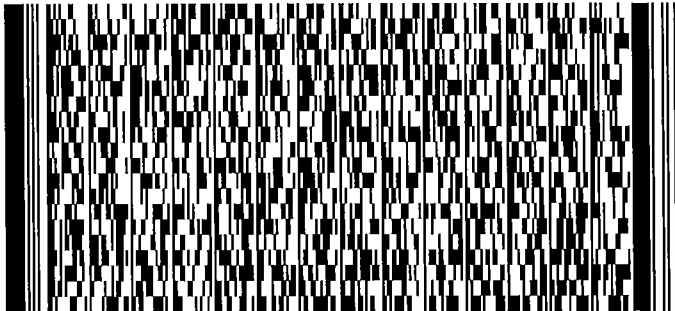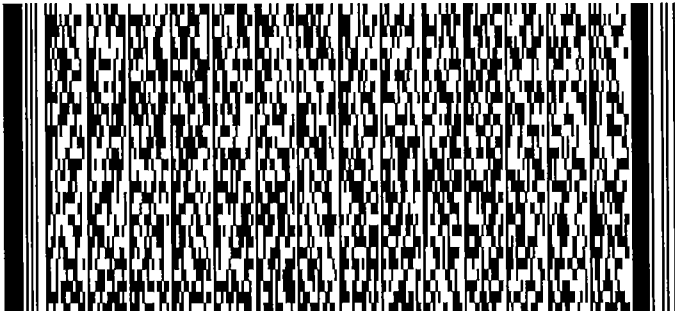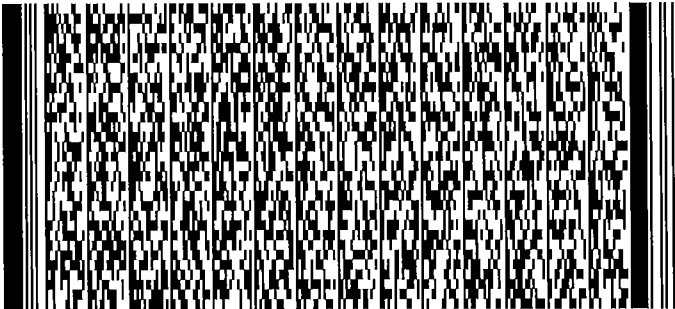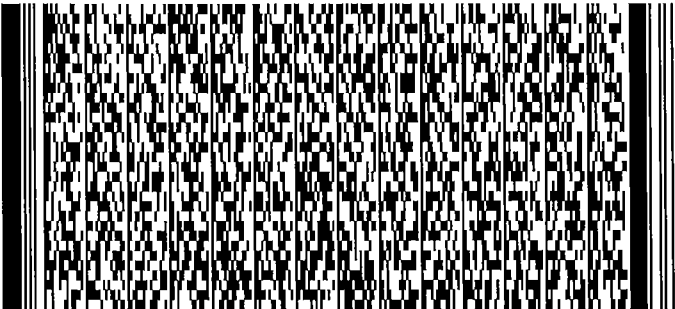

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防（裝置及設備）規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.:
消防處檔號

Serial Number

10259 020969

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Address 地址

Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT

Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☐ Licensed premises 持牌處所 ☐ Institutional 社團**Part 1 Annual Maintenance ONLY**
第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款，擁有裝置在任何處所內的任何消防裝置或設備的人，須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
7	Dry Riser System (Fire Hydrant)	External area	Conforms with FSD requirements	24/06/2025	23/06/2026
13	Fire Alarm System (MFA)	External area (Fire Alarm Panel No. 1 to 8)	Ditto	24/06/2025	23/06/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗，證明性能良好，符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格，損壞事項列於第三部。

如證書涉及年檢事項，應張貼於大廈或處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

For and on behalf of

美利堅消防工程有限公司

AMERICAN FIRE ENGINEERING COMPANY LIMITED

Authorized

Signature:

受權人簽署

Name:

姓名

Matthew Chi Hin
Authorized Signature(s)
Chung Matthew Chi Hin

FSD/RC No.:

消防處註冊號碼

RC1 / 0259 RC2 / 0405

Company Name:

公司名稱

American Fire Engineering Company Limited

Telephone:

聯絡電話

Date:

日期

30/06/2025

For FSD use only

Inspected

Key-in

Verified



Serial Number

10259020969

Name of Client 顧客姓名






Construction Sector Imported Labour Quarters Limited

Part 1 Annual Maintenance ONLY

第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
35	Standalone type Smoke Detector	All Bed Room and Activated Room for Zone No. 1 to 14	Conforms with FSD requirements	24/06/2025	23/06/2026
		(except Female/Male Toilet and Female/Male Shower Room area)			




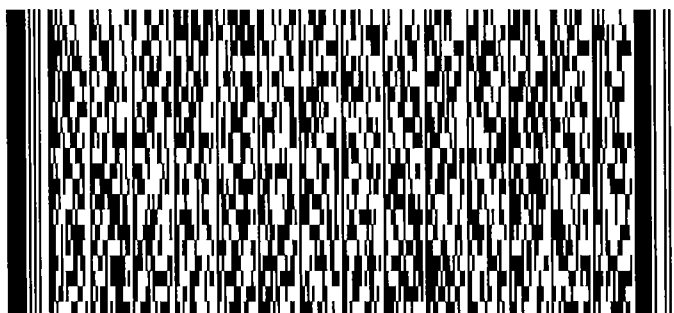
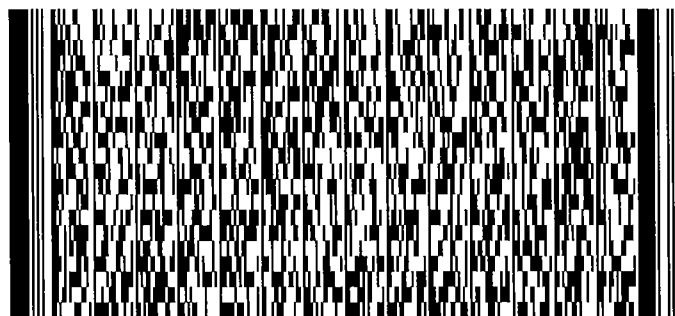
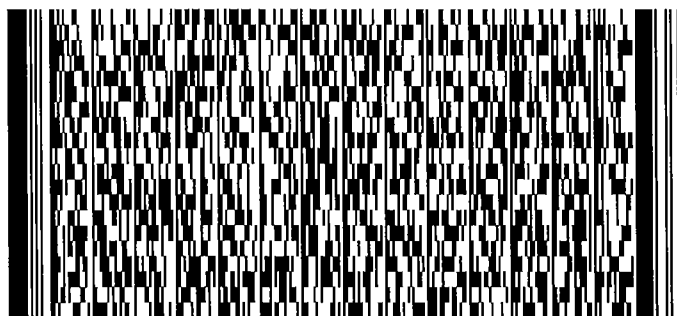
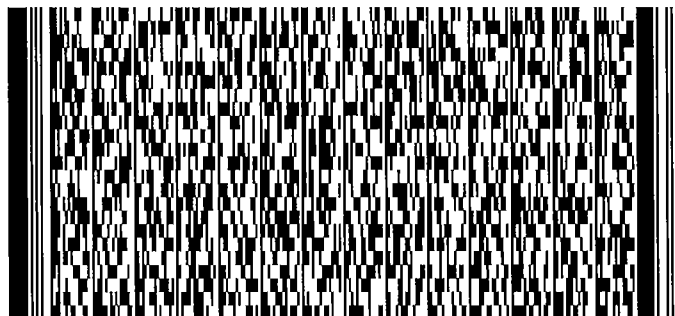
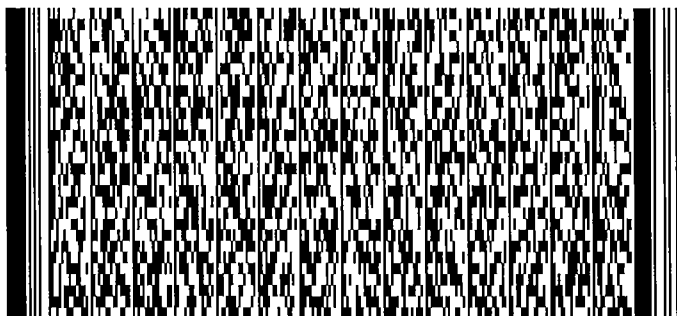


Serial Number

10259020969

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

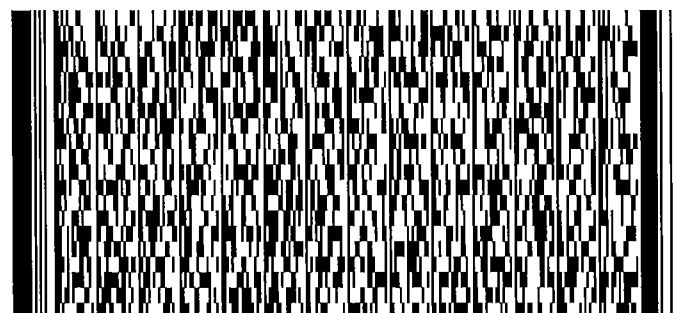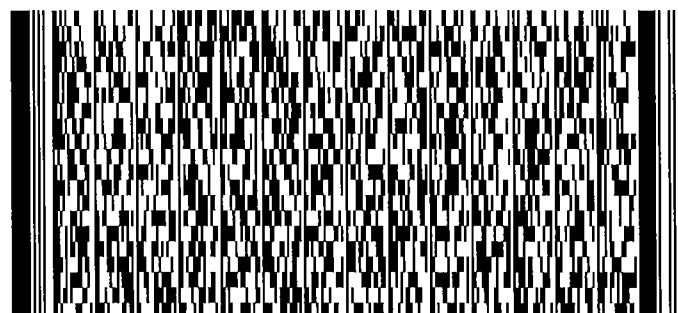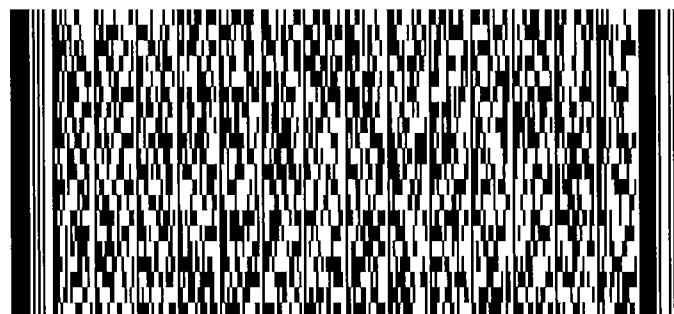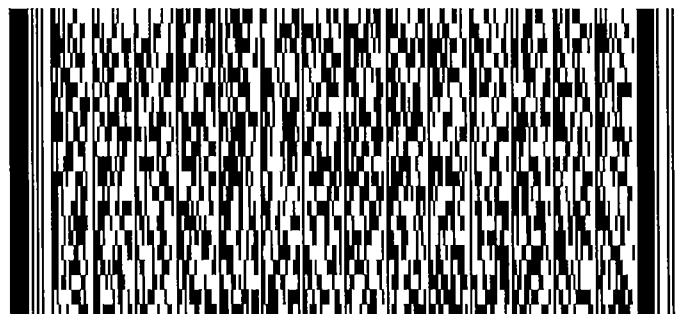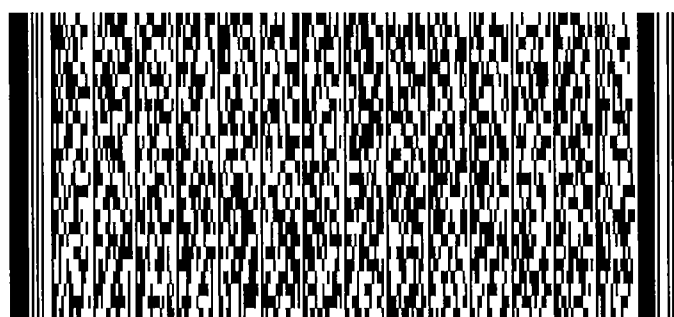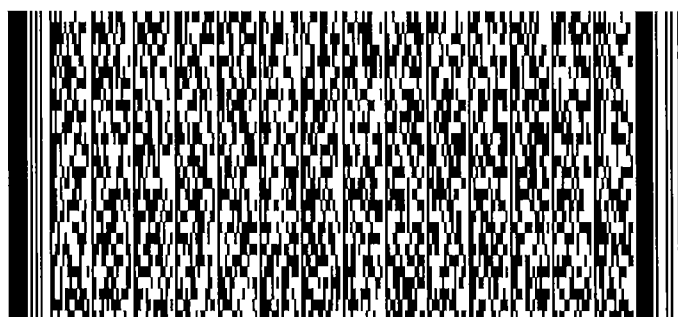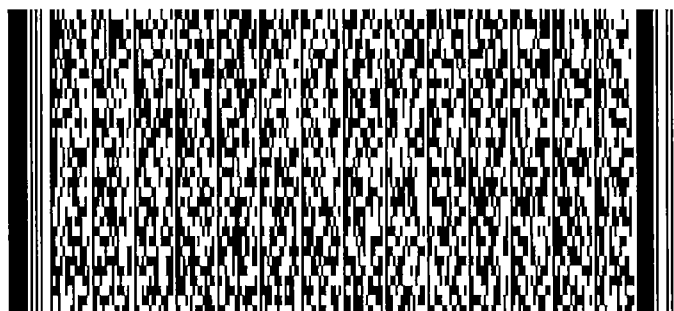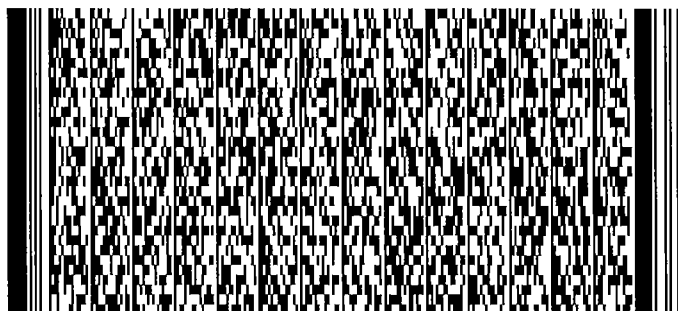

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防(裝置及設備)規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.:
消防處檔號

Serial Number

10259 020970

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Address 地址

Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT

Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☐ Licensed premises 持牌處所 ☐ Institutional 社團

Part 1 Annual Maintenance ONLY

第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
15	Fire Detection System	Transformer Room no. 1	Conforms with FSD requirements	24/06/2025	23/06/2026
13	Fire Alarm System (MFA)	Ditto	Ditto	24/06/2025	23/06/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

For and on behalf of
美利堅消防工程有限公司

AMERICAN FIRE ENGINEERING COMPANY LIMITED

Authorized

Signature:

授權人簽署

Name:

姓名

Authorized Signature(s)
Chung Matthew Chi Hin

FSD/RC No.:

消防處註冊號碼

RC1 / 0259 RC2 / 0405

Company Name:

公司名稱

American Fire Engineering
Company Limited

Telephone:

聯絡電話

Date:

日期

30/06/2025

For FSD
use only

Inspected

Key-in

Verified








Serial Number

10259020970

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

<div>Part 1 Annual Maintenance ONLY</div> <div>第一部 只適用於年檢事項</div> <div>In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款，擁有裝置在任何處所內的任何消防裝置或設備的人，須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。</div>					
Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
11	Emergency Lighting System	Transformer Room no. 1	Conforms with FSD requirements	24/06/2025	23/06/2026




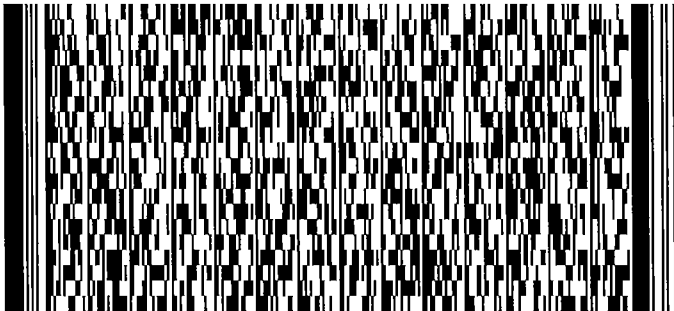
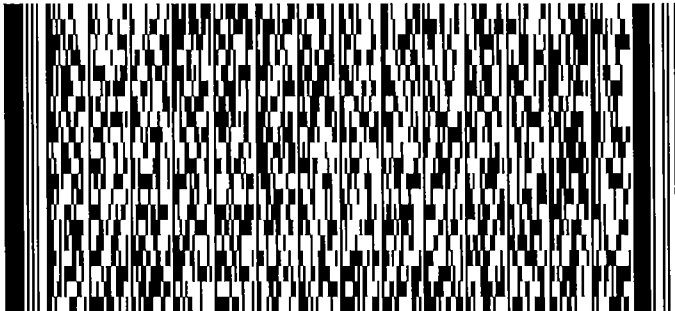
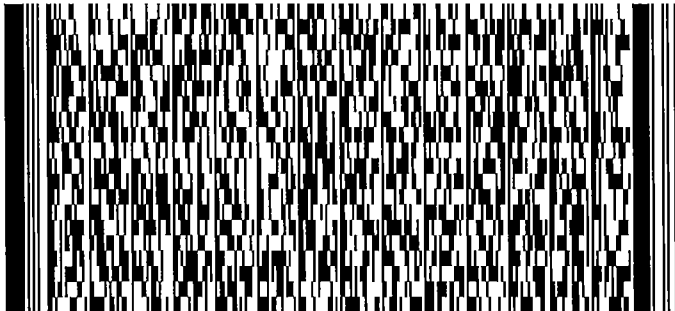
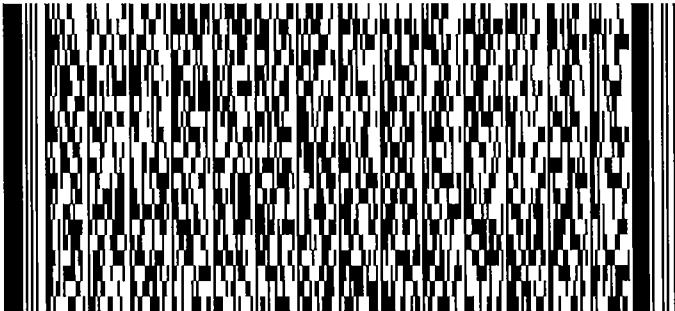
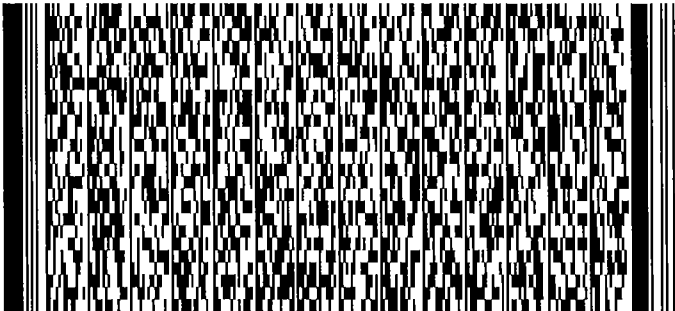


Serial Number

10259020970

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

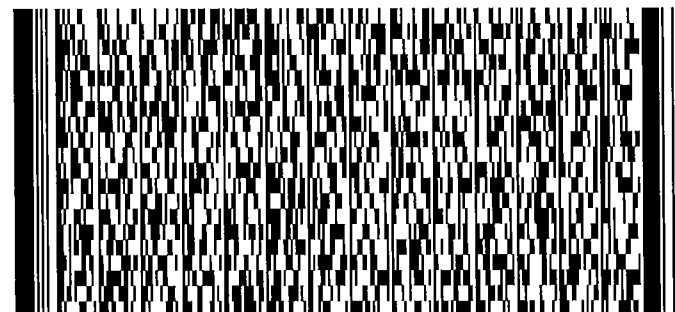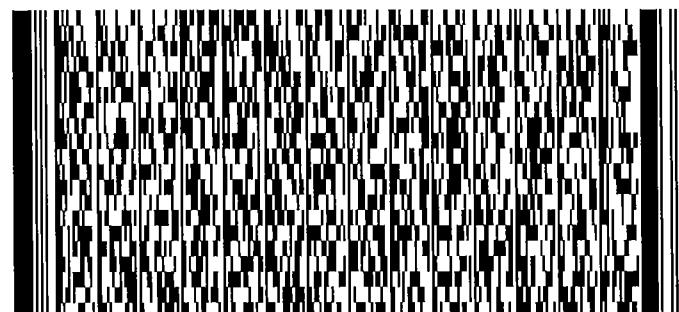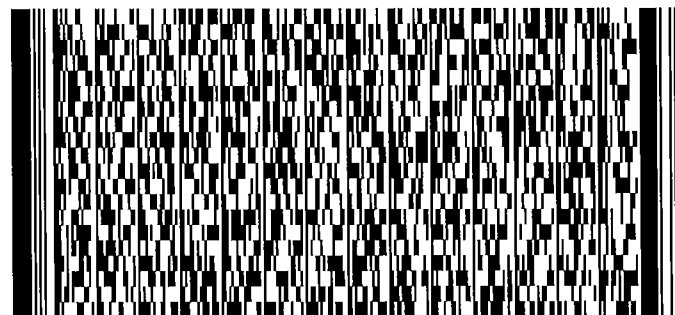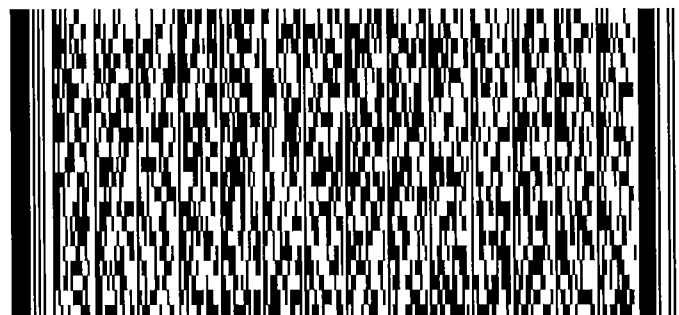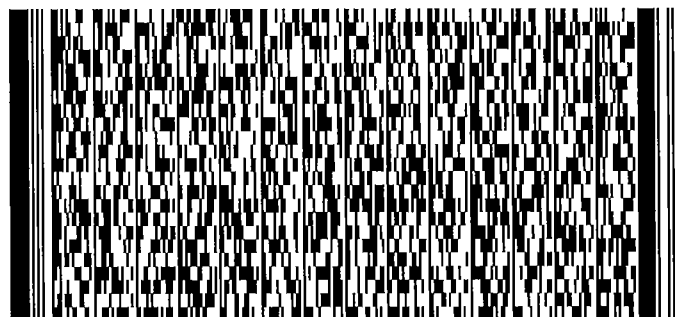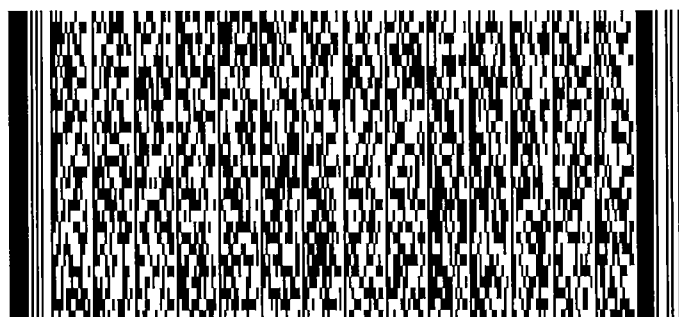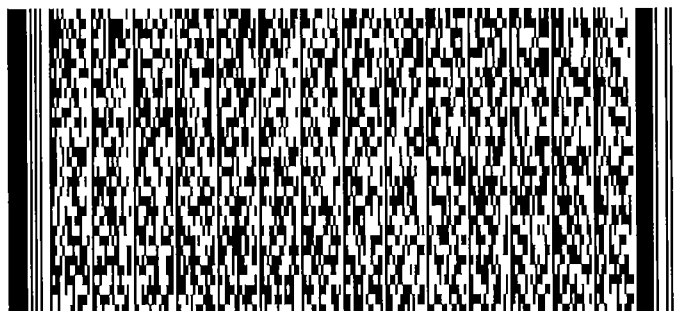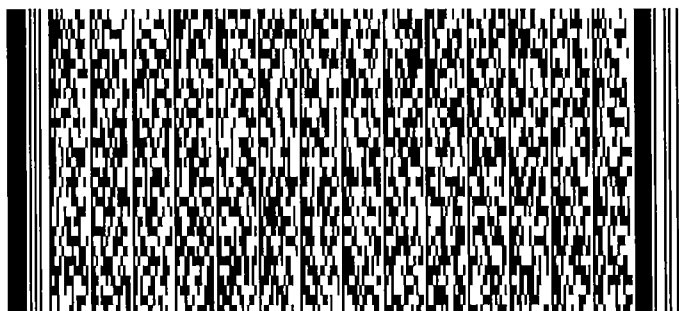

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防(裝置及設備)規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.:

消防處檔號

Serial Number

10259 020971

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Address 地址

Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT

Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☐ Licensed premises 持牌處所 ☐ Institutional 社團**Part 1 Annual Maintenance ONLY****第一部 只適用於年檢事項**

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
15	Fire Detection System	Transformer Room no. 2	Conforms with FSD requirements	24/06/2025	23/06/2026
13	Fire Alarm System (MFA)	Ditto	Ditto	24/06/2025	23/06/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

For and on behalf of

美利堅消防工程有限公司

AMERICAN FIRE ENGINEERING COMPANY LIMITED

Authorized

Signature:

受權人簽署

Name:

姓名

Authorized Signature(s)
Chung Matthew CHI HIN

FSD/RC No.:

消防處註冊號碼

RC1 / 0259 RC2 / 0405

Company Name:

公司名稱

American Fire Engineering
Company Limited

Telephone:

聯絡電話

Date:

日期

30/06/2025

For FSD
use only

Inspected

Key-in

Verified

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或
處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or
premises for FSD's inspection if any annual maintenance work is involved.








Serial Number

10259 020971

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Part 1 Annual Maintenance ONLY 第一部 只適用於年檢事項		In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款，擁有裝置在任何處所內的任何消防裝置或設備的人，須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。			
Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
11	Emergency Lighting System	Transformer Room no. 2	Conforms with FSD requirements	24/06/2025	23/06/2026




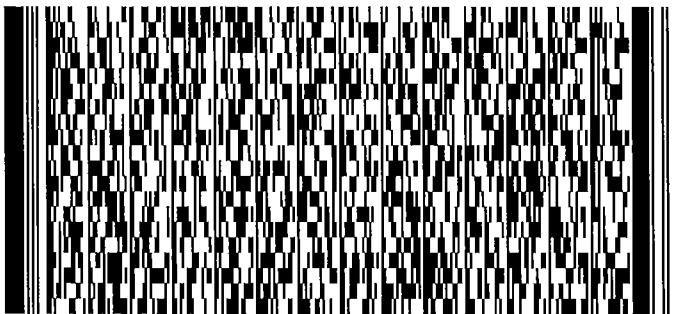
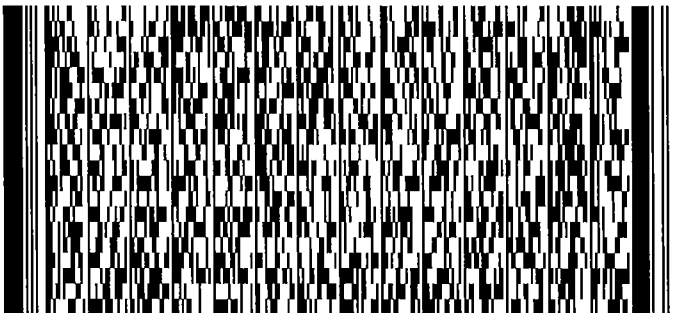
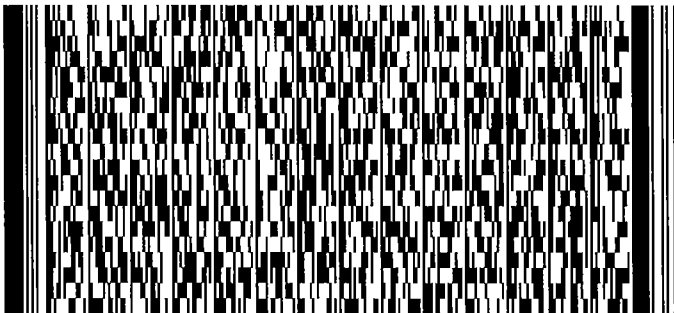
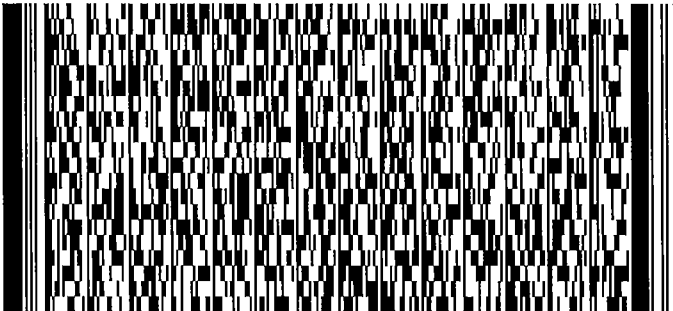
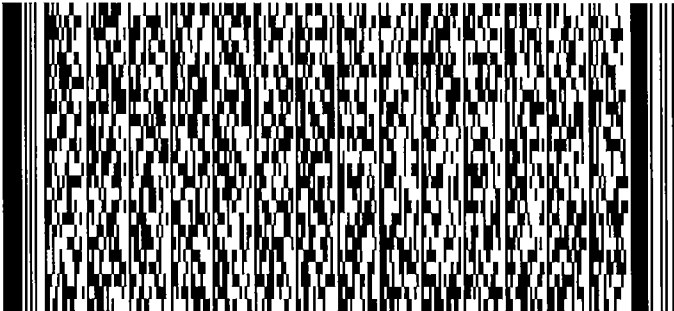


Serial Number

10259020971

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

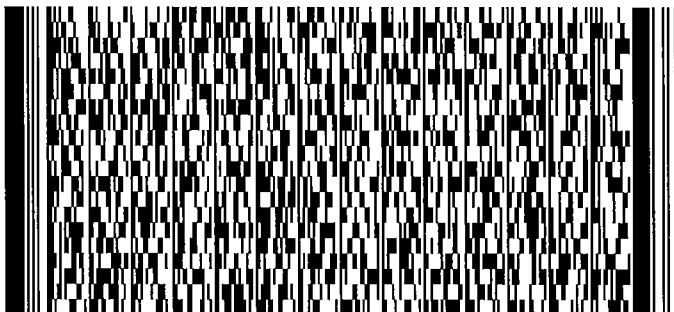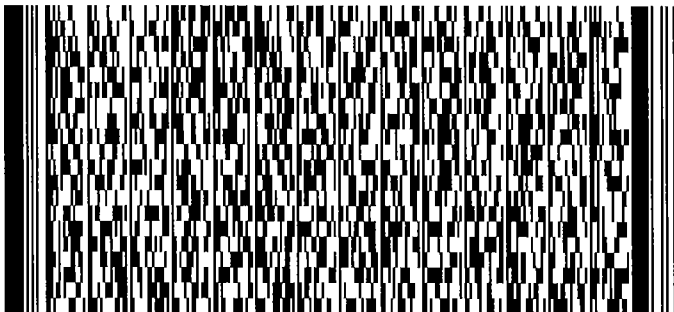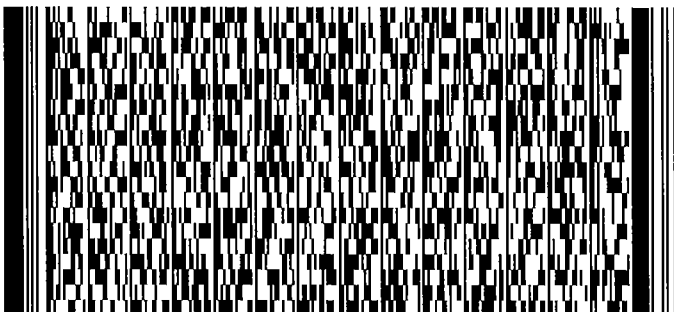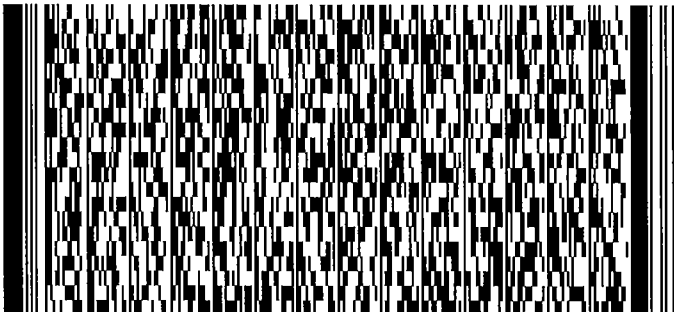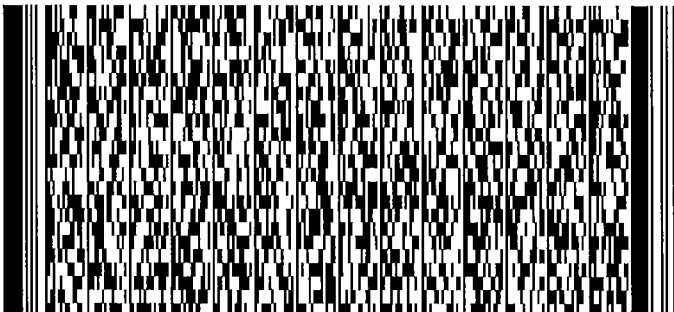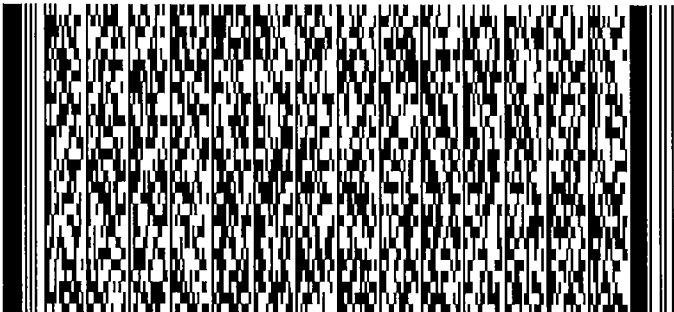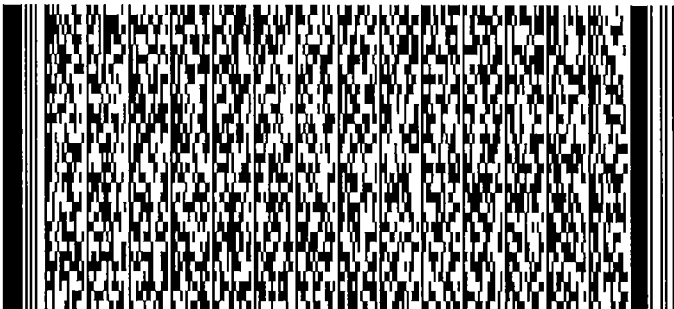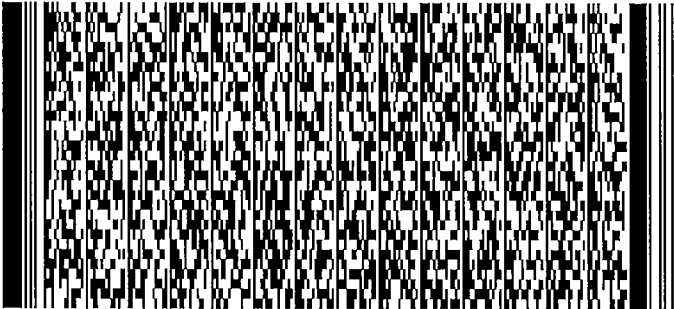

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防(裝置及設備)規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.:

消防處檔號

Serial Number

10259 020972

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Address 地址

Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT

Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☐ Licensed premises 持牌處所 ☐ Institutional 社團**Part 1 Annual Maintenance ONLY****第一部 只適用於年檢事項**

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
15	Fire Detection System	Transformer Room no. 3	Conforms with FSD requirements	24/06/2025	23/06/2026
13	Fire Alarm System (MFA)	Ditto	Ditto	24/06/2025	23/06/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

For and on behalf of

美利堅消防工程有限公司

AMERICAN FIRE ENGINEERING COMPANY LIMITED

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

Authorized

Signature:

受權人簽署

Name:

姓名

Chung Matthew Chi Hin

FSD/RC No.:

消防處註冊號碼

RC1 / 0259 RC2 / 0405

Company Name:

公司名稱

American Fire Engineering Company Limited

Telephone:

聯絡電話

Date:

日期

30/06/2025

For FSD use only

Inspected

Key-in

Verified








Serial Number

10259020972

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

<div>Part 1 Annual Maintenance ONLY</div> <div>第一部 只適用於年檢事項</div> <div>In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款，擁有裝置在任何處所內的任何消防裝置或設備的人，須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。</div>					
Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
11	Emergency Lighting System	Transformer Room no. 3	Conforms with FSD requirements	24/06/2025	23/06/2026




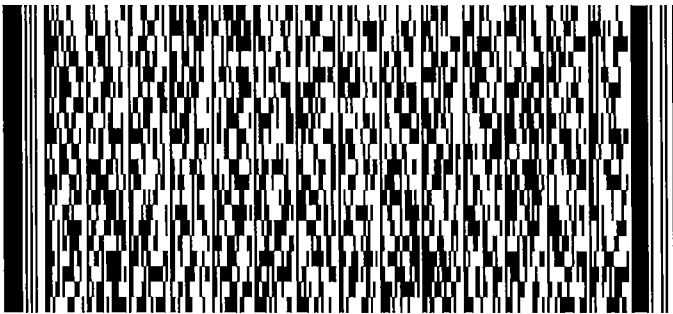
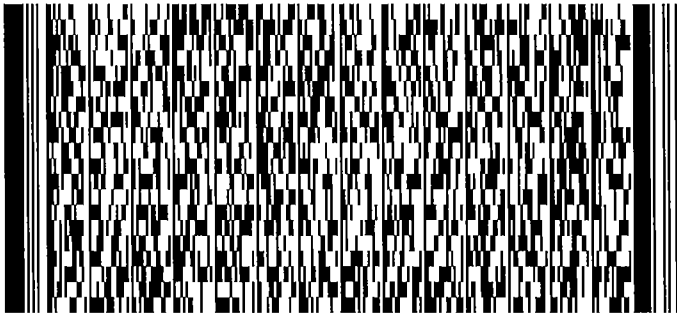
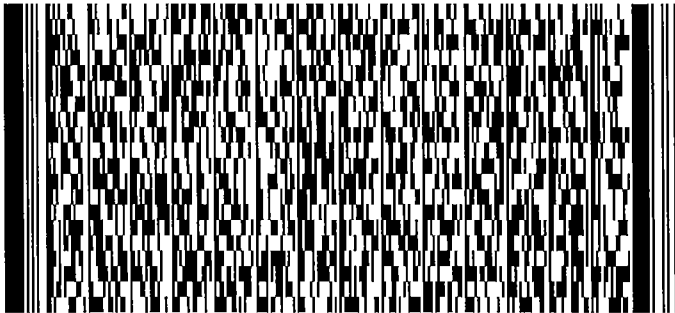
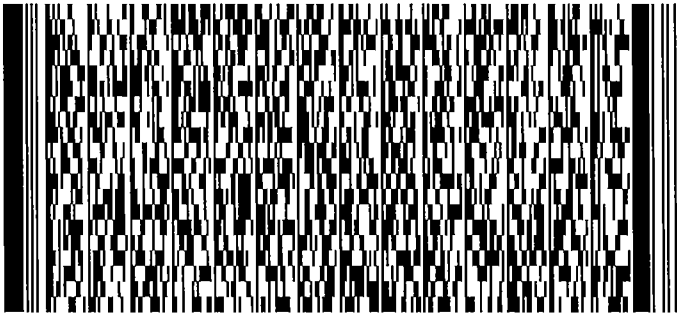
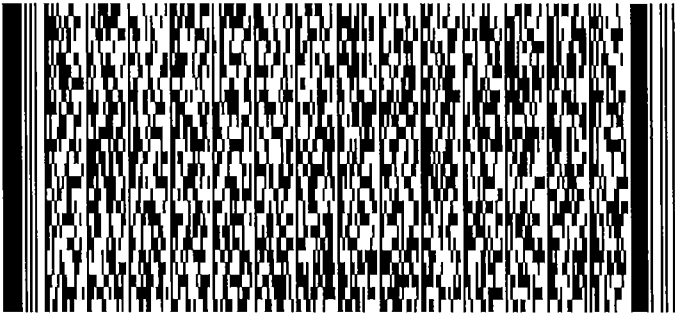


Serial Number

10259020972

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

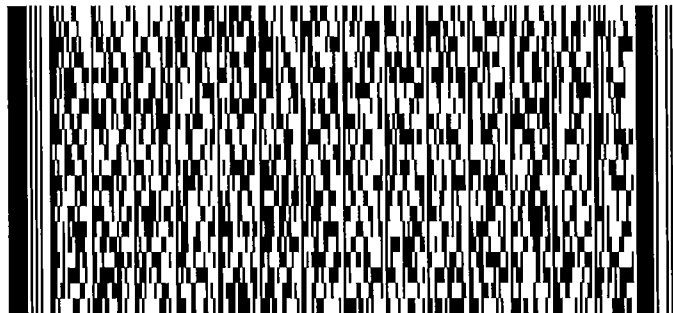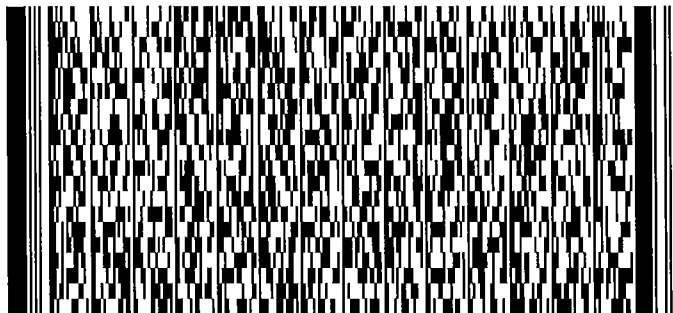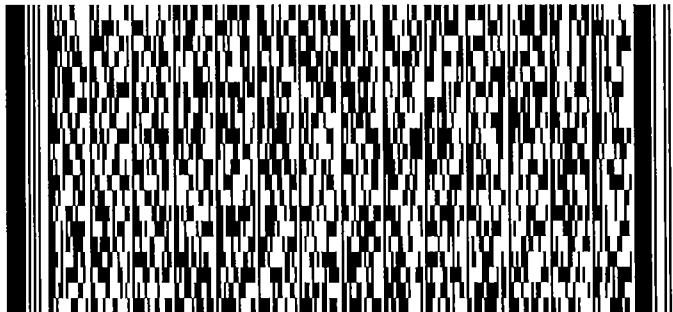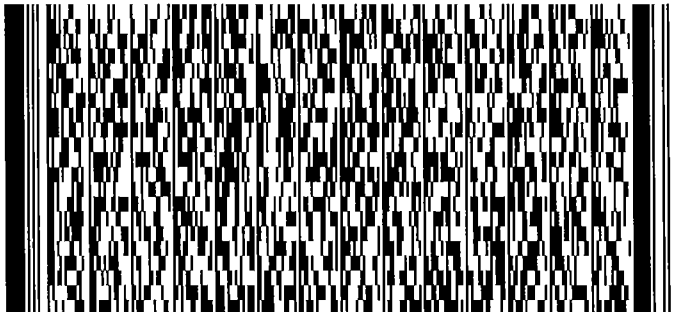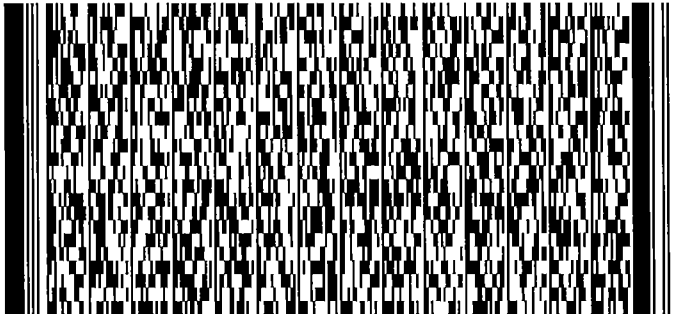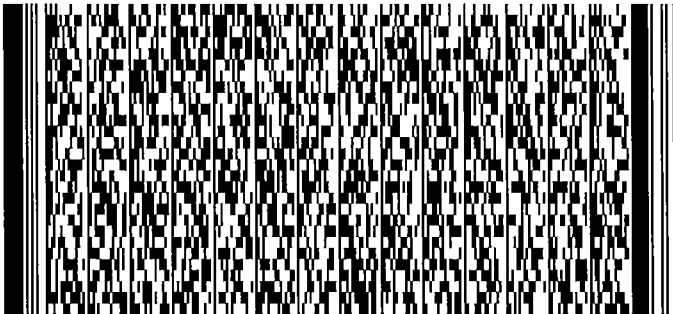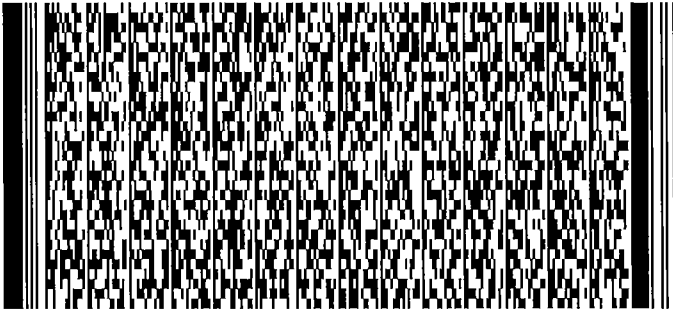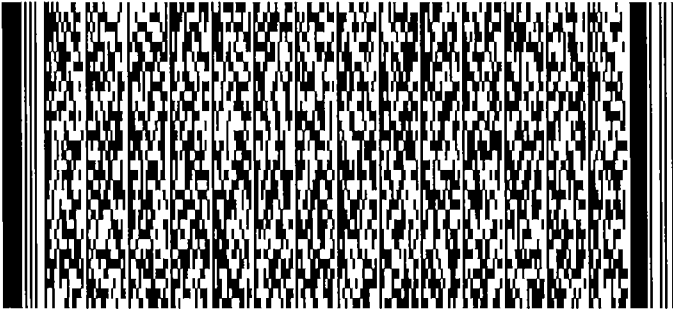

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防(裝置及設備)規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.:

消防處檔號

Serial Number

30929 002760

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

Address 地址

Construction Sector Imported Labour Quarters, No. 61 Castle Peak Road, Tam Mei Yuen Long, NT

Type of Building 樓宇類型: ☐ Industrial 工業 ☐ Commercial 商業 ☐ Domestic 住宅 ☐ Composite 綜合 ☐ Licensed premises 持牌處所 ☐ Institutional 社團

Part 1 Annual Maintenance ONLY

第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
24	105 nos. x 2 kg dry powder F.E.	Entire Area	Conforms with FSD requirements	28/07/2025	27/07/2026

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)
24	205 nos. x 2 kg dry powder F.E.	Entire Area	F.E. for replaced	Conforms with FSD requirements	28/07/2025

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

For and on behalf of
美利堅消防工程有限公司

AMERICAN FIRE ENGINEERING COMPANY LIMITED

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈之最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

Authorized

Signature:

授權人簽署

Name:

姓名

Chung Matthew Chi Hin

FSD/RC No.:

消防處註冊號碼

RC3 / 0929 RC /

Company Name:

公司名稱

CHUNG Matthew Chi-hin

Telephone:

聯絡電話

Date:

日期

08/08/2025

For FSD use only

Inspected

Key-in

Verified











Serial Number

30929 002760

Name of Client 顧客姓名

Construction Sector Imported Labour Quarters Limited

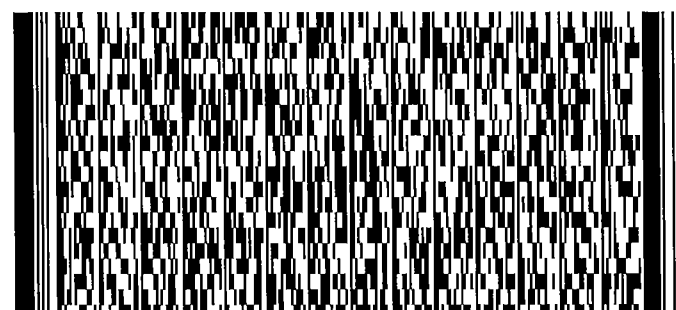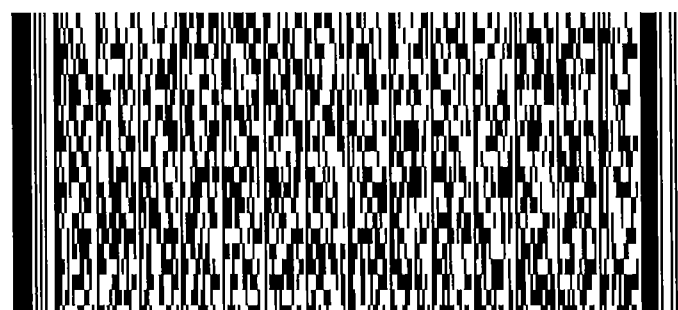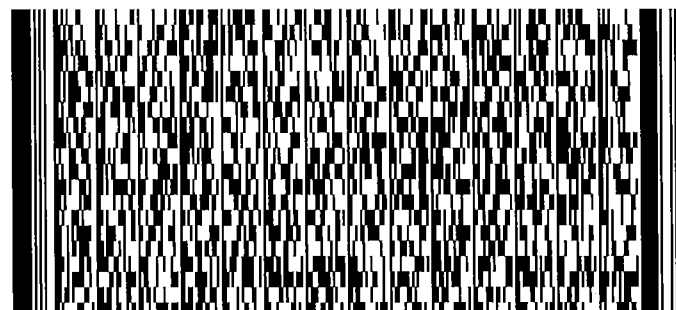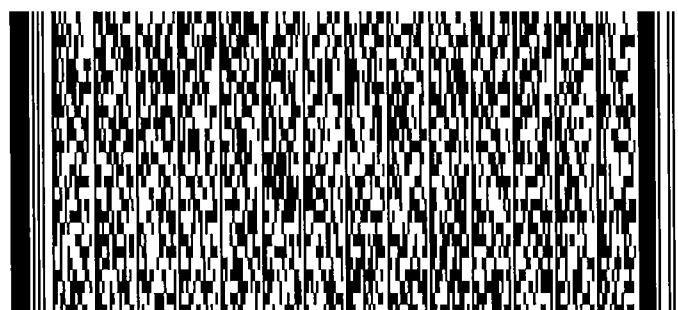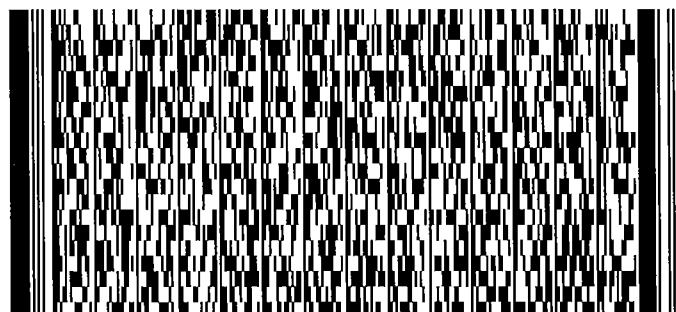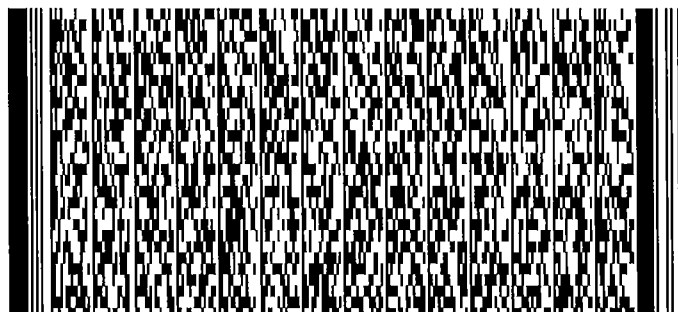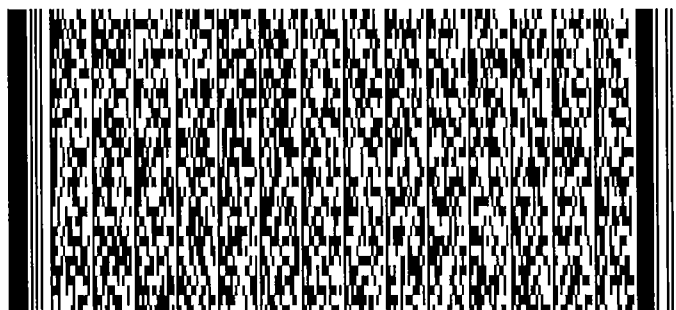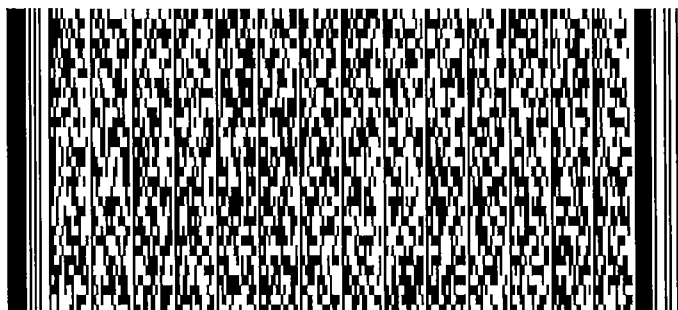

Anna Ka Yan TONG/PLAND

寄件者: MAN LOK LEUNG <mlleung@cedd.gov.hk>
寄件日期: 2025年09月16日星期二 10:38
收件者: tpbpd/PLAND
副本: Ajyum Distinction CHAN/PLAND; Anna Ka Yan TONG/PLAND; CHI HO CHIU/CEDD;
Michael Chi Kin SO/PLAND; Sunny CY CHENG/DEVB
主旨: Re: s.16 Planning Application A/YL-NSW/354 - Further Information
附件: 001997-002000.pdf; 020969-020972.pdf; CSILQ_GC.pdf

Dear Sir/Madam,

Further to my emails below, please find the following FI regarding the responses to the departmental comments.

Comments from the Fanling, Sheung Shui & Yuen Long East District Planning Office, Planning Department
(Contact person: Mr. Ajyum CHAN, Tel: 3168 4043):

- According to the information from previous application No. A/YL-NSW/319, it is noted that there is another access at Pok Wai South Road for contingency use only. Please confirm whether the concerned access is still in use for contingency purpose.

Response to the comment:

It is confirmed that the access at Pok Wai South Road is still in use for contingency purpose.

Thank you.

Regards,
Alex LEUNG
E/7 (W), WDO, CEDD
Tel: 2417 6399