
From: [REDACTED]
Sent: Monday, March 10, 2025 6:01 PM
To: [REDACTED]
Subject: Re: 遞交 TPB/A/YL-PH/1026 雨水渠務及消防報告

現回應運輸署對路面測量結果的意見，請查閱本郵件內的附件，謝謝。另附上早前於 2025 年 2 月 12 日對渠務署及運輸署意見的回應。

如有疑問請致電 [REDACTED]

[REDACTED] 在 2025 年 2 月 12 日星期三 上午 09:55:14 [GMT+8] 寫道：

有關渠務署及運輸署意見的回應，請查閱本郵件內的附件，謝謝。

如有疑問請致電 [REDACTED]

申請編號： TPB/A/YL-PH/1026

申請地點： 新界元朗八鄉橫台山永寧里丈量約份第 111 約地段編號第 2902 號(部份)、2905 號(部份)、2909 號(部份)、2910 號(部份)、2911 號(部份)

聯絡地址： 新界元朗八鄉橫台山永寧里 2 號 1 樓

聯絡電話： XXXXXXXXXX

致：城市規劃委員會

回應渠務署意見

2. (a) (b) (c) 詳情請查閱附件：對渠務署意見的回應


回應運輸署意見

(a) 輕型貨車能在申請場地及鄰近路段順暢行駛，詳情請查閱附件：路面測量結果圖。

(b) 申請人已知悉，位於錦田公路及申請地點之間的路段並非由運輸署管理。

A / YL-PH / 1026


Comments	Answer
(a) Please show calculation details for the reainfall intensity " i " in the submission.	資料在b5-1中示
(b) Catchpit should be provied at the turnong points of the u-channel.	已經加了井, 在b3-1, b4-1. 井細織在b6-1, b8-1中示
(c) The applicant shall resolve any conflict/disagreement with relevant lot owner(s) and seek LandsD's permission for laying new drains/channels and/or modifying/upgrading existing ones in other private lots or on Government land outside the application stie.	知道和明白

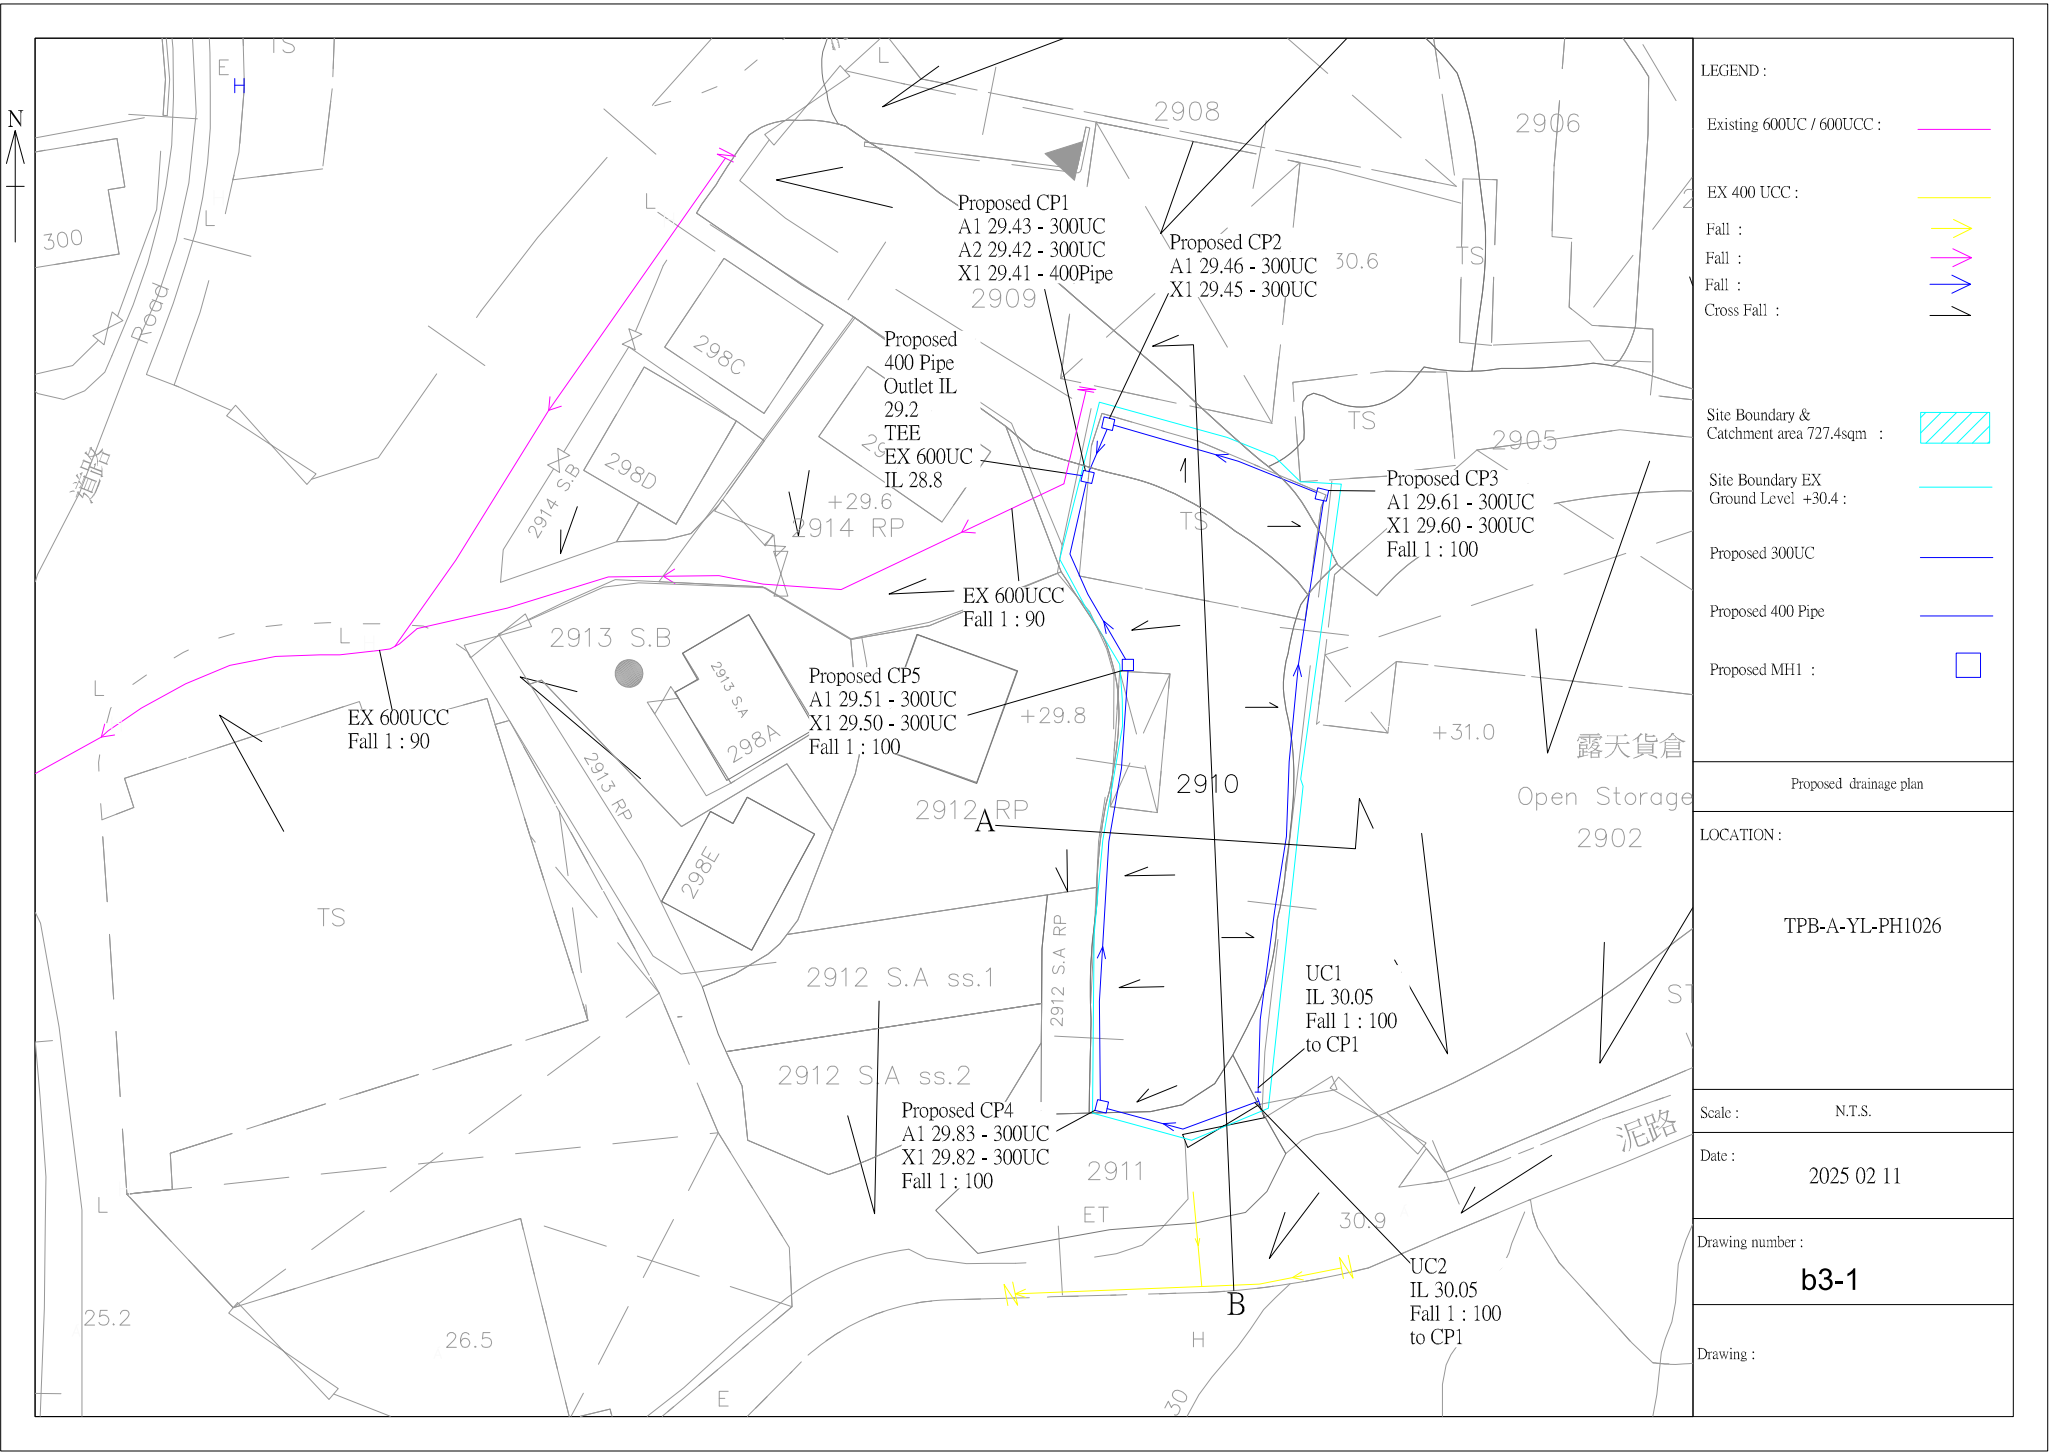

申請編號 TPB-A-YL-PH1026

TYPE / DRAWING	MH no	GL	CL	A I.L	X I.L	TO MH / Existing	% Fall
C2406/1	CP1	30.40	30.90	A1 29.43 - 300UC A2 29.43 - 300UC	X1 29.41 - 400Pipe	ECX 600UC	1 : 40
C2405/1	CP2	30.40	30.90	A1 29.46 - 300UC	X1 29.45 - 300UC	CP1	1 : 100
C2405/1	CP3	30.40	30.90	A1 29.61 - 300UC	X1 29.60 - 300UC	CP2	1 : 100
C2405/1	CP4	30.40	30.90	A1 29.83 - 300UC	X1 29.82 - 300UC	CP5	1 : 100
C2405/1	CP5	30.40	30.90	A1 29.51 - 300UC	X1 29.51 - 300UC	CP1	1 : 100
UC1		30.40	30.40		X1 30.05 - 300UC	CP3	1 : 100
UC2		30.40	30.40		X1 30.05 - 300UC	CP4	1 : 100

b3-1

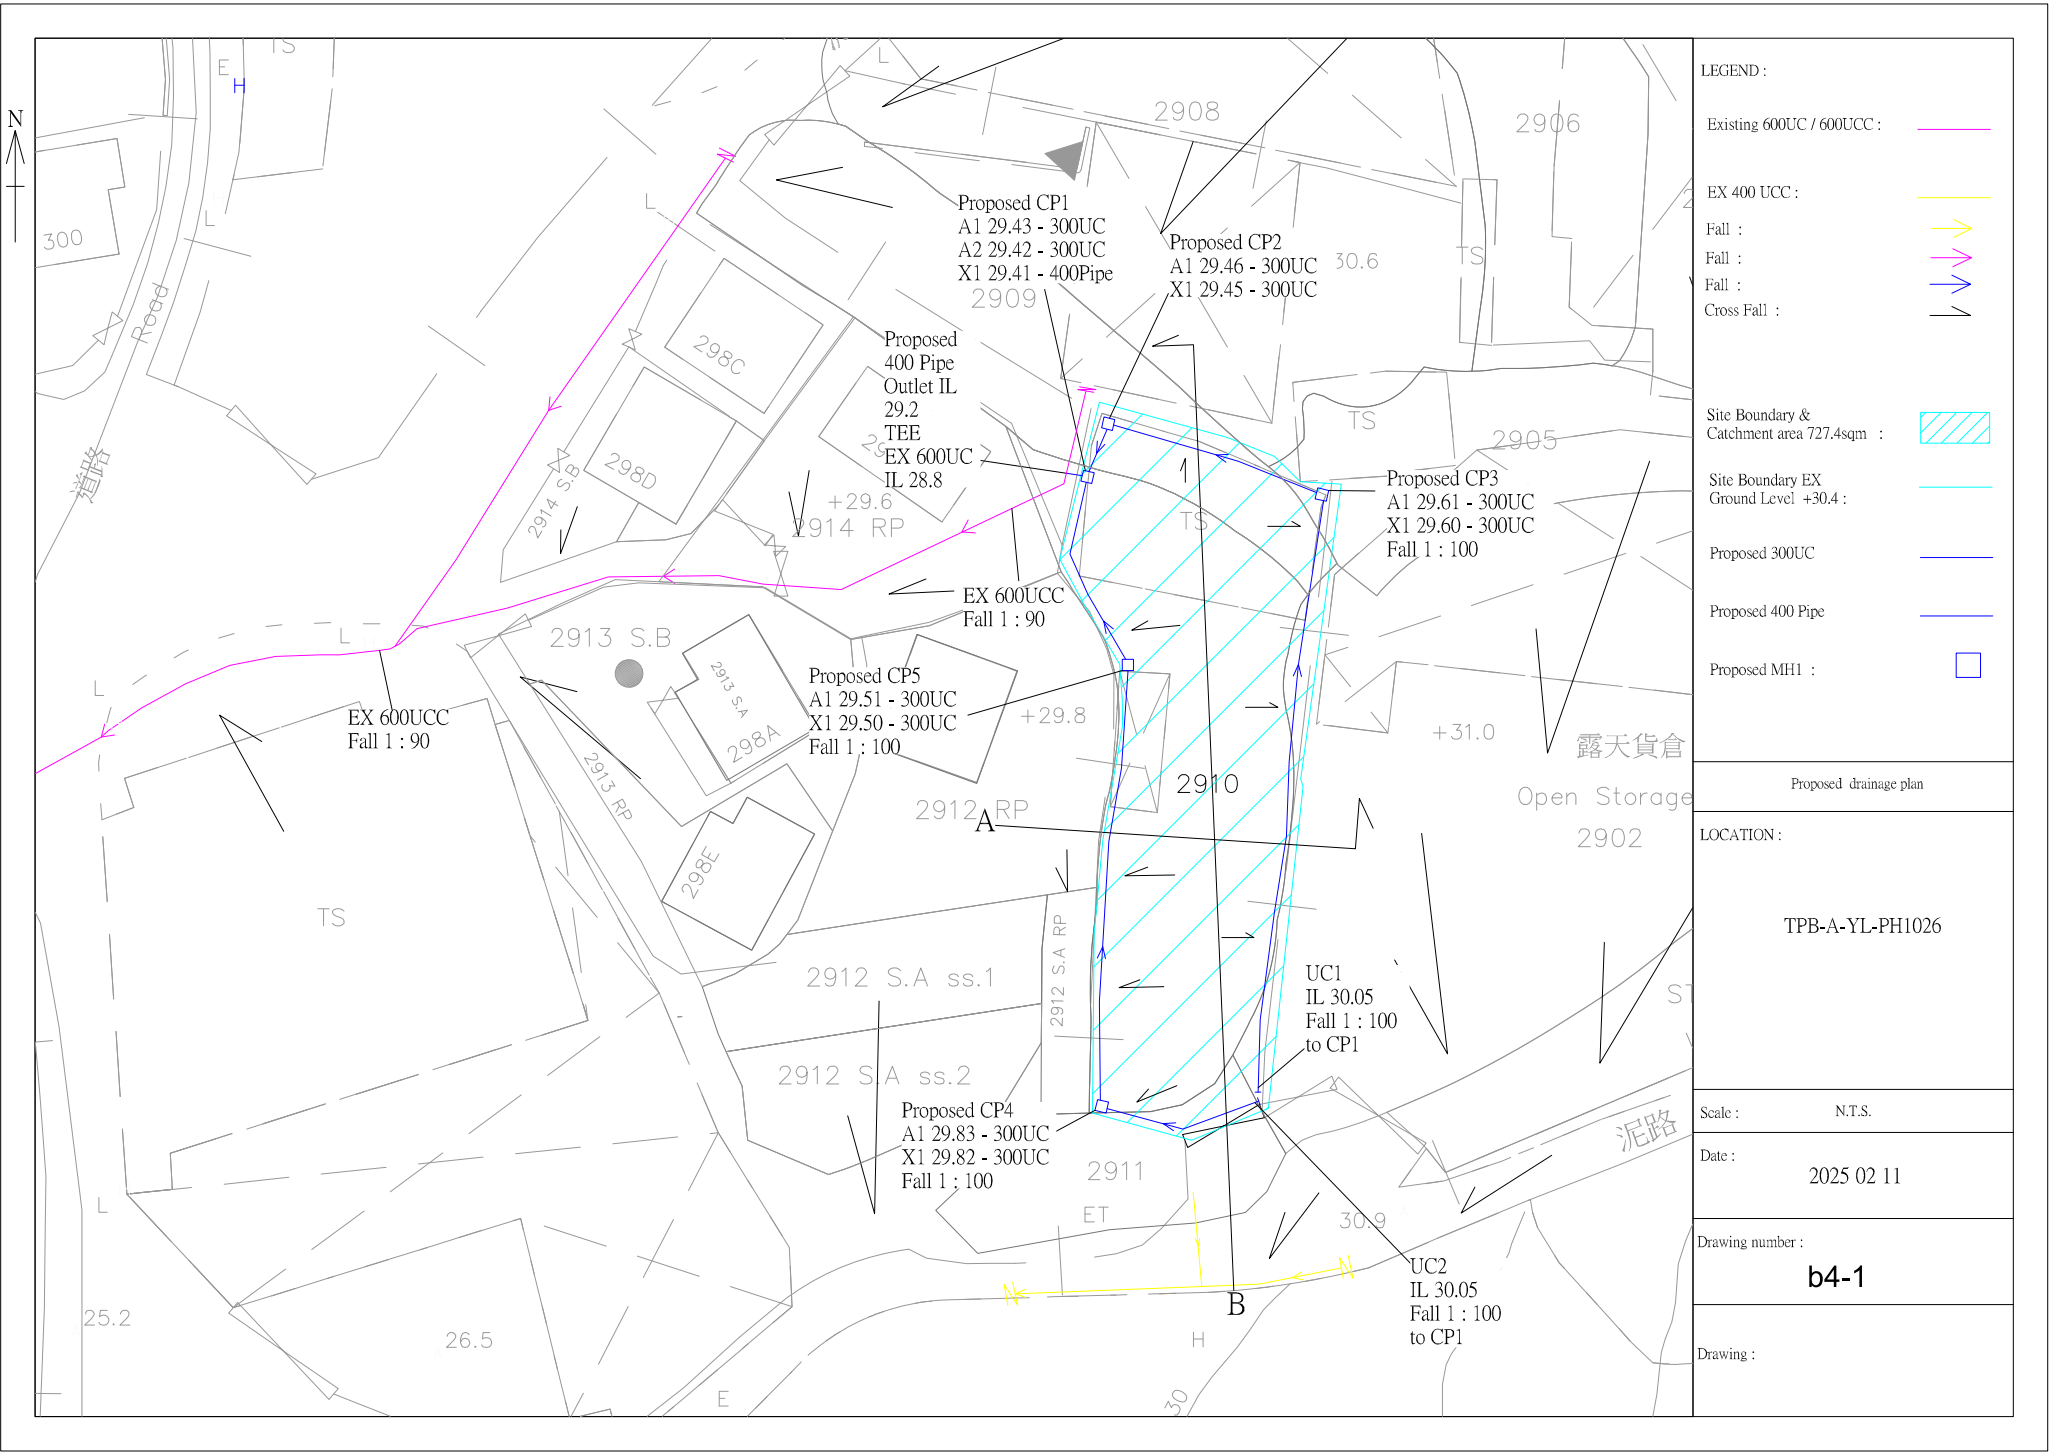

LEGEND :

Existing 600UC / 600UCC :

EX 400 UCC :

Fall :

Fall :

Fall :

Cross Fall :

Site Boundary & Catchment area 727.4sqm :

Site Boundary EX Ground Level +30.4 :

Proposed 300UC

Proposed 400 Pipe

Proposed MH1 :

Proposed drainage plan

LOCATION :

TPB-A-YL-PH1026

Scale : N.T.S.

Date : 2025 02 11

Drawing number : **b4-1**

Drawing :

TPB-A-YL-PH1026

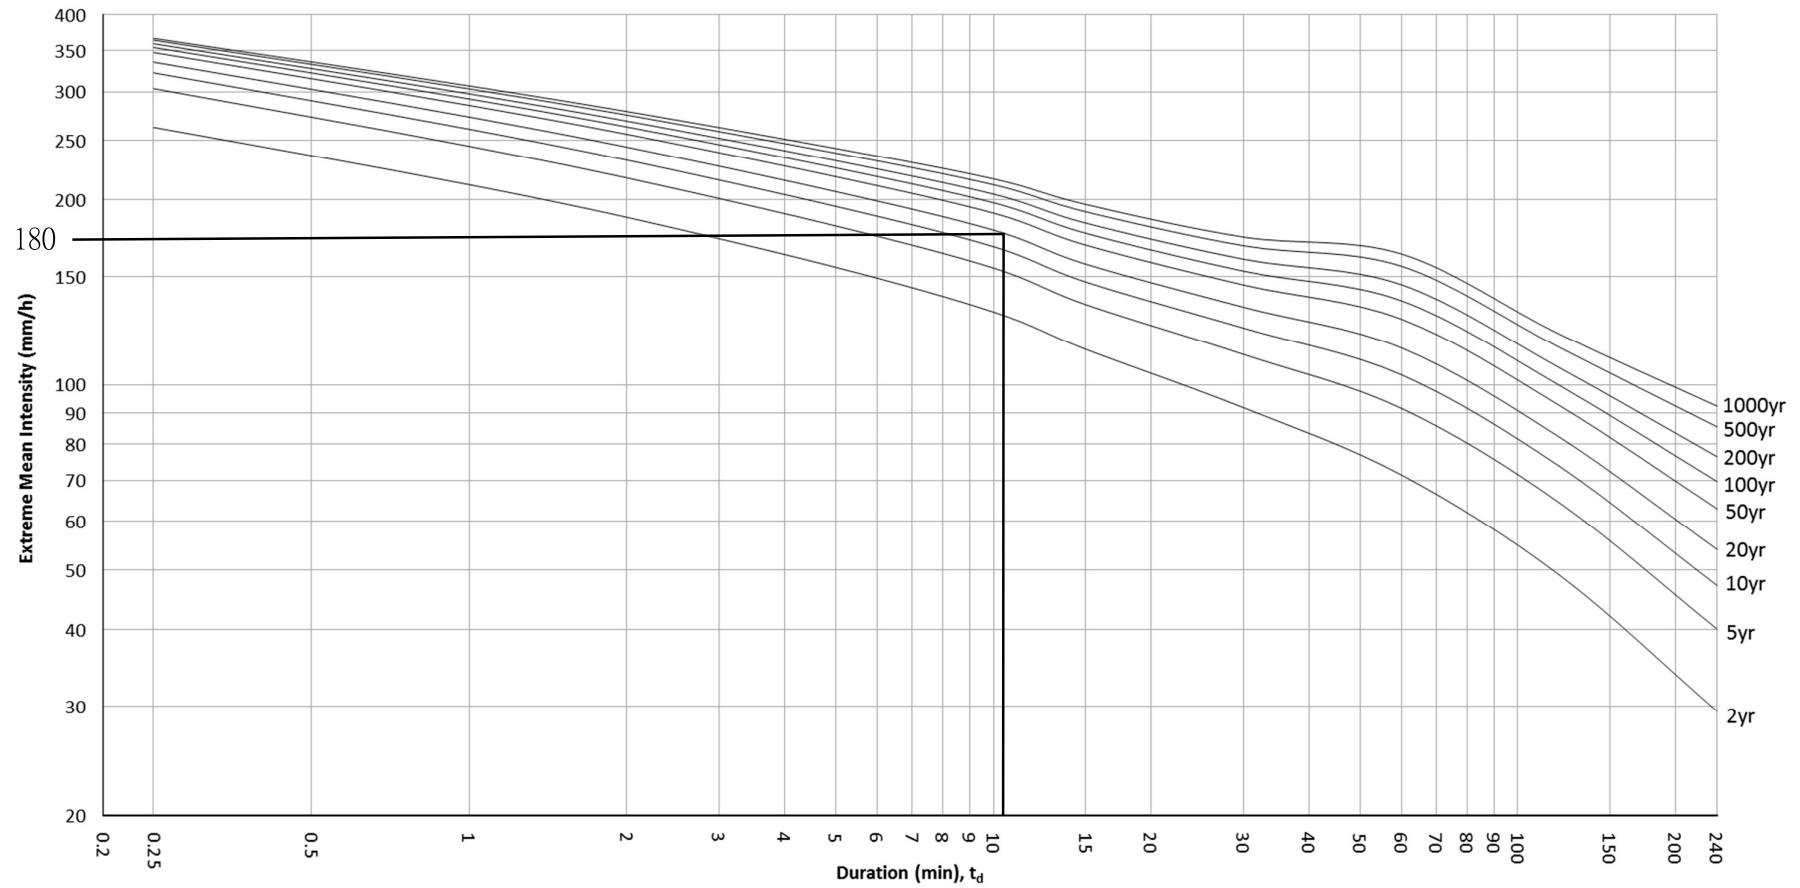


Figure 4a – Intensity-Duration-Frequency Curves of HKO Headquarters
(for durations not exceeding 4 hours)

b5-1

Technical drawing of a square manhole assembly, showing a top view and a side view (A-A).

Top View Labels:

- 20 x 20 CHAMFER
- STEPPED CHANNEL
- 20 THICK APPROVED CELLULAR JOINT FILLER SEALED WITH 20 x 20 Tk POLYSULPHIDE JOINT SEALANT
- U-CHANNEL
- 20 THICK APPROVED CELLULAR JOINT FILLER SEALED WITH 20 x 20 Tk POLYSULPHIDE JOINT SEALANT
- STEPPED OR U-CHANNEL (OR PIPE)
- U-CHANNEL

Dimensions:

- H1
- H2
- H3
- H4
- 500 + GREATER OF H1 OR H2
- 500 + GREATER OF H3 OR H4

Section A-A: A horizontal section line labeled 'A' at both ends, indicating the plane for the side view.

20 THICK APPROVED CELLULAR
JOINT FILLER SEALED WITH
20 x 20 Tk POLYSULPHIDE JOINT
SEALANT _____

Technical drawing of a parapet wall cross-section showing construction details and dimensions.

Dimensions:

- Top width: 100
- Bottom width: 100
- Height: 350
- Base width: B

Labels and Notes:

- 20 THICK APPROVED CELLULAR JOINT FILLER SEALED WITH 20 x 20 Tk POLYSULPHIDE JOINT SEALANT
- FALL (indicated by arrows pointing down the slope)
- 20 x 20 CHAMFERS ON ALL SIDES
- A252 MESH OR EQUIVALENT
- (OR 650 FOR CATCHPI (CONSTRUCTED ON OR ADJACENT TO A FOOTPATH))

DEPTH OF RECESS AND DETAILS OF PRECAST CONCRETE COVERS
(SEE STD. DRG. NO. C2407)

50

50

60 FOR STEEL GRATINGS

S

1. ALL DIMENSIONS ARE IN MILLIMETRES.

2. REFER TO SHEET 5 FOR OTHER NOTES.

b8-1


STANDARD CATCHPIT DETAILS

(SHEET 1 OF 5)

**CIVIL ENGINEERING AND
DEVELOPMENT DEPARTMENT**

DRAWING NO.

C2405 /1

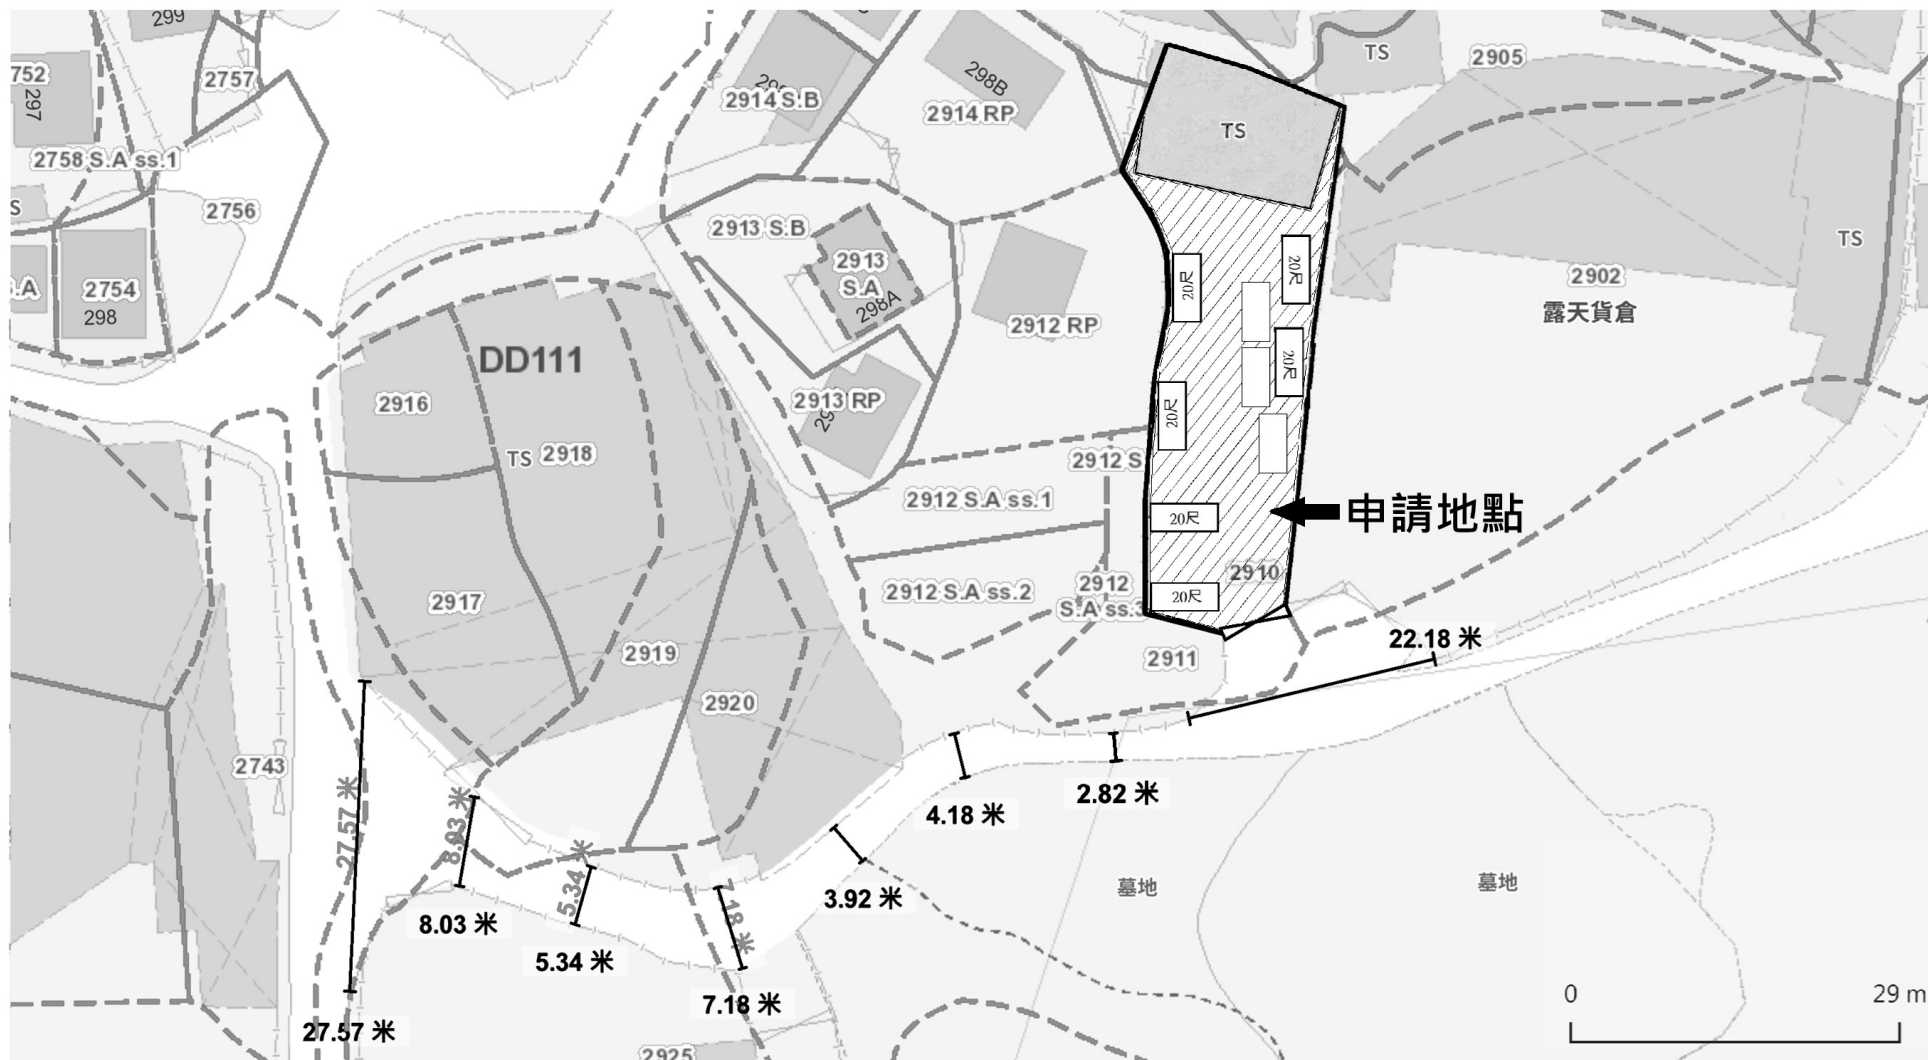



路面測量結果圖

申請地段：新界元朗八鄉橫台山丈量約份第111約地段編號第2902(部份),
2905(部份), 2909(部份), 2910(部份), 2911(部份)

申請用途：臨時露天存放建築材料及機械(為期三年)及相關填土工程

OZP No. : S/YL-PH/11

圖例	解釋
2911	地段編號
---	地段界線
	申請地點

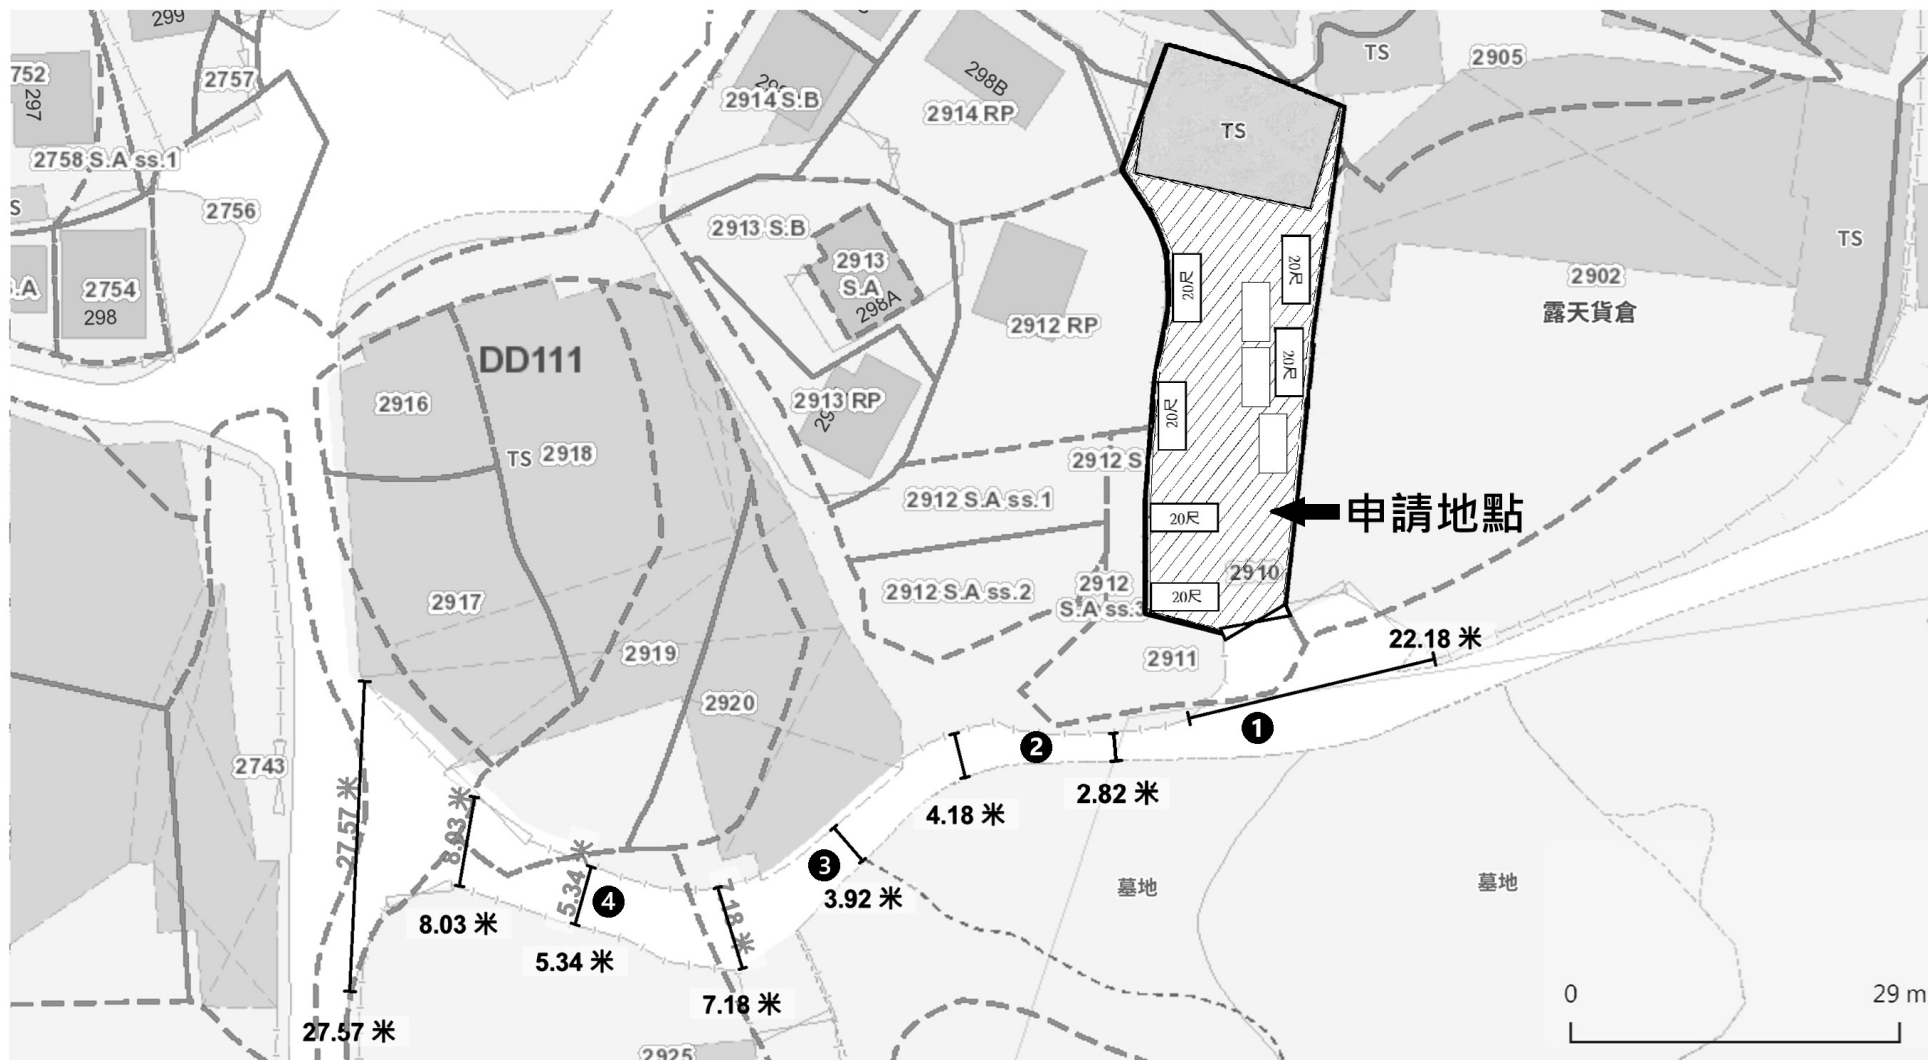

路面拍攝位置圖

申請地段：新界元朗八鄉橫台山丈量約份第111約地段編號第2902(部份),
2905(部份), 2909(部份), 2910(部份), 2911(部份)

申請用途：臨時露天存放建築材料及機械(為期三年)及相關填土工程

OZP No. : S/YL-PH/11

圖例	解釋
2911	地段編號
---	地段界線
	申請地點
①	拍攝位置

申請編號： TPB/A/YL-PH/1026

申請地點： 新界元朗八鄉橫台山永寧里丈量約份第 111 約地段編號第 2902 號(部份)、2905 號(部份)、2909 號(部份)、2910 號(部份)、2911 號(部份)

聯絡地址： 新界元朗八鄉橫台山永寧里 2 號 1 樓

聯絡電話： [REDACTED]

致：城市規劃委員會

回應運輸署意見

有關於 2025 年 2 月 10 日發出的路面測量結果圖，現回應貴署相關意見並附上路面情況的圖片（請參考附件：路面拍攝位置圖），以證明輕型貨車能在申請場地及鄰近路段順暢行駛。



圖 1



圖 2



圖 3



圖 4