


F.S. NOTES :

Proposed Fire Services Installation

- 1.Sufficient emergency lighting shall be provided throughout the entire building in accordance with BS 5266-1:2016, BS EN 1838:2013 and the FSD Circular Letter No.4/2021.
- 2. Sufficient directional and exit sign shall be provided throughout the entire building in accordance with BS 5266-1:2016 and the FSD Circular Letter No. 5/2008.
- 3. Portable fire extinguisher shall be provided for structures in the application site.

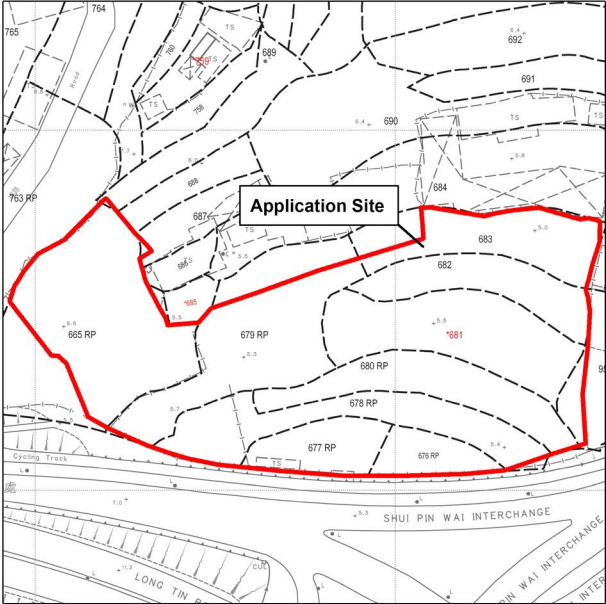

DD 122 Lots 665 RP (Part), 676 RP, 677 RP, 678 RP(Part), 679 RP(Part), 680 RP(Part), 681, 682(Part), 683(Part), 687(Part), 689(Part) and 954 RP (Part), Ping Shan, Yuen Long, N.T.

Structure 10
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 9
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 8
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 7
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 6
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 5
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 4
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m


Structure 3
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 2
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 1
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 11
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

Structure 12
Warehouse
GFA: 220m² (ABOUT)
No. of storey: 1
Height: Not exceeding 7m

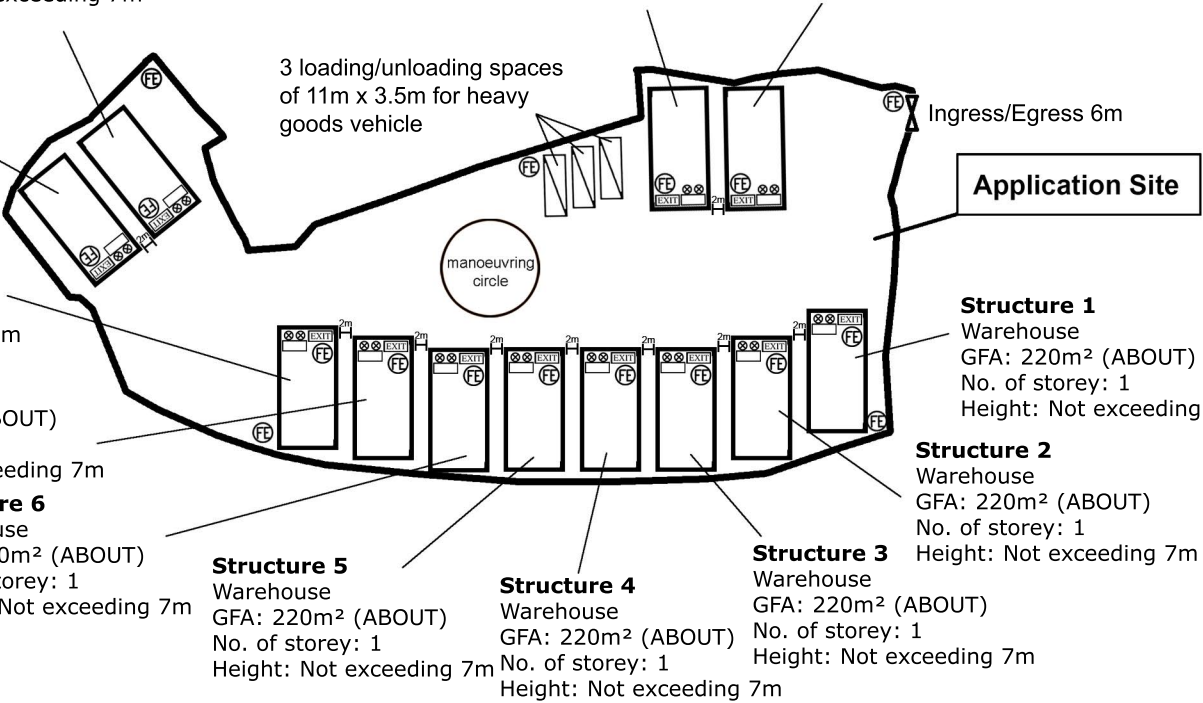

Project 項目名稱:
Proposed Temporary Warehouse for a Period of 3 Years at
Lots 665 RP (Part), 676 RP, 677 RP, 678 RP(Part),
679 RP(Part), 680 RP(Part), 681, 682(Part), 683(Part),
687(Part), 689(Part) and 954 RP (Part) in D.D.122,
Ping Shan, Yuen Long, New Territories

Drawing Title 圖紙標題:

FS Plan

Drawing No. 圖號:

20250821

Remarks 備註:

- Proposed New Emergency Lighting complete with 2 hours battery backup
- Proposed New Exit Sign complete with 2 hours battery backup
- Proposed New 5KG CO₂ Fire Extinguisher