


F.S. NOTES :

Proposed Fire Services Installation

- 1) SUFFICIENT STAND-ALONE FIRE DETECTOR SHALL BE PROVIDED THROUGHOUT THE ENTIRE BUILDING INACCORDANCE WITH "STAND-ALONE FIRE DETECTOR GENERAL GUIDELINES ON PURCHASE, INSTALLATION & MAINTENANCE [SEP 2021]".
- 2) IN RELATION TO 1) ABOVE, WHERE TWO OR MORE STAND-ALONE FIRE DETECTORS ARE INSTALLED IN AN ENCLOSED STRUCTURE, ALL STAND-ALONE DETECTORS SHALL BE INTERCONNECTED (EITHER WIRED OR WIRELESSLY) SUCH THAT WHEN ONE OF THE STAND-ALONE FIRE DETECTOR IS TRIGGERED, ALL CONNECTED STAND-ALONE FIRE DETECTORS SHALL SOUND AN ALARM SIMULTANEOUSLY.
- 3) PORTABLE HAND-OPERATED APPROVED APPLIANCE SHALL BE PROVIDED AS REQUIRED BY OCCUPANCY.

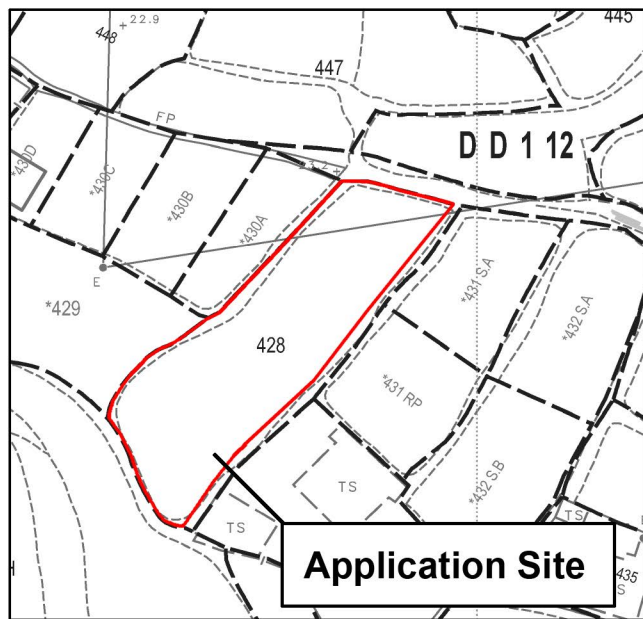

DD 112 Lot 428 (Part), Shek Kong, Yuen Long

Structure 1

Shop and service
GFA: 50m² (ABOUT)
No. of storey: 1
Height: Not exceeding 5m

Structure 2


Shop and service
GFA: 50m² (ABOUT)
No. of storey: 1
Height: Not exceeding 5m

Structure 3

Shop and service
GFA: 50m² (ABOUT)
No. of storey: 1
Height: Not exceeding 5m

Structure 4

Shop and service
GFA: 70m² (ABOUT)
No. of storey: 1
Height: Not exceeding 5m

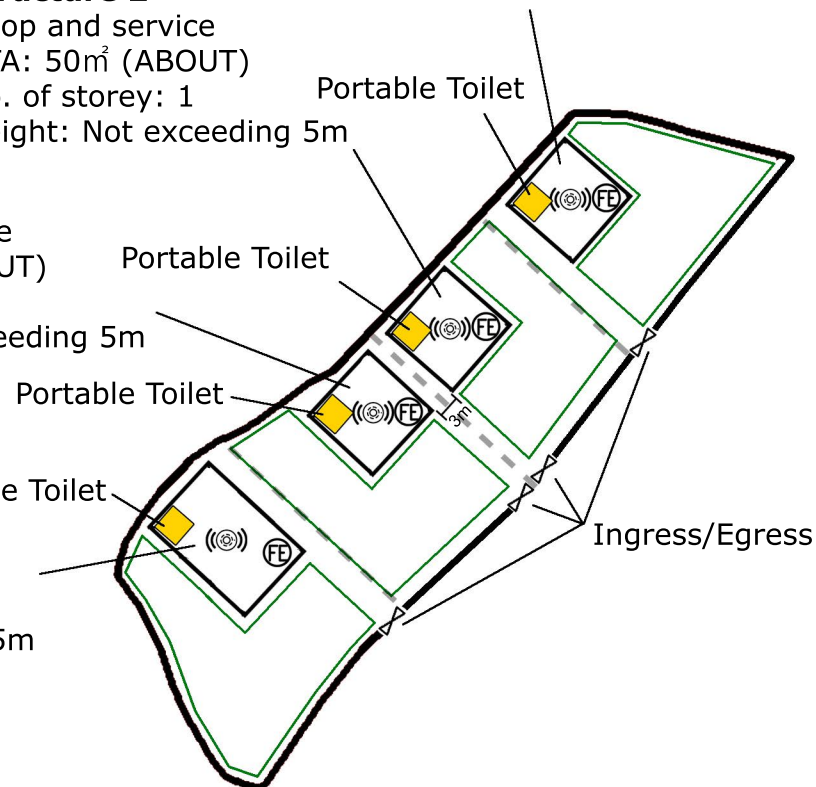

Project 項目名稱:

Proposed Temporary Shop and Service for a Period of 3 Years and Associated Filling of Land at Lots 428 S.A, 428 S.B, 428 S.C & 428 S.D in D.D.112, Shek Kong, Yuen Long, New Territories

Drawing Title 圖紙標題:

Proposed FS Plan

Drawing No. 圖號:

20260720

Remarks 備註:



Stand-Alone Fire Detector



4 KG Dry Powder Type Fire Extinguisher