



1. GENERAL



- 1 SUFFICIENT EMERGENCY LIGHTING SHALL BE PROVIDED THROUGHOUT THE ENTIRE BUILDING IN ACCORDANCE WITH 'BS 5266-PART 1 :2016 AND BS EN 1838 :2013', FSD CIRCULAR LETTER 4/2021.
- 2 PORTABLE FIRE FIGHTING APPLIANCES SHALL BE PROVIDED AT POSITIONS AS INDICATED ON LAYOUT PLAN. IN ACCORDING TO CODES OF PRACTICE FOR MINIMUM FIRE SERVICES INSTALLATIONS AND EQUIPMENT.

NO STORAGE OF DANGEROUS GOODS WITHOUT THE PERMISSION BY THE DIRECTOR OF FIRE SERVICES ANY INTENDED STORAGE OR USE DEFINED IN CHAPTER 295 OF THE LAWS OF HONG KONG SHOULD BE NOTIFIED TO THE DIRECTOR OF FIRE SERVICES.



兩層高有蓋附屬寫字樓
6.1米(長) x 2.44米(闊) x 5.18米(高)





兩層高有蓋附屬寫字樓
6.1米(長) x 2.44米(闊) x 5.18米(高)



兩層高有蓋附屬寫字樓
6.1米(長) x 4.88米(闊) x 5.18米(高)



兩層高有蓋附屬寫字樓
6.1米(長) x 2.44米(闊) x 5.18米(高)





LEGEND

- (CO2) 5KG CO2 FIRE EXTINGUISHER
- (SB) SAND BUCKET
- (P) 5KG DRY POWDER FIRE EXTINGUISHER
- Emergency Light

Equipments specifications are following
Code of Practice
September 2022 13thVersion

Location Plan:

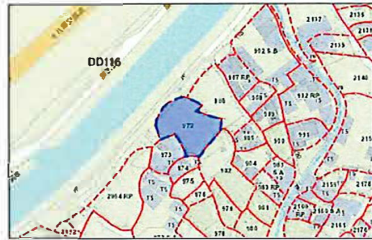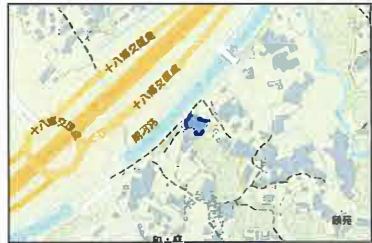

N



FSI Contractor :
Hang Yue Engineering Consultants Limited
恒裕工程顧問有限公司 RC 1/432 , RC 2/606

Address :
LOT 972 (Part) in D.D. 116,
Yuen Long

Title :
F.S. Layout Plan

Drawn By :
Isaac Wong
Signature :

Checked By :
Anky Lee
Signature :

Drawing No :
E-W003CI
Scale :
1:100 (A1)

Rev :
4
Date :
14-JAN-2025