

## **Annex B**

---

*Updated Report of the Water Supply Impact Assessment*

Prepared for

**Glory Queen Ltd.**

Prepared by

**Ramboll Hong Kong Limited**

**REZONING APPLICATION ON THE APPROVED MAI PO &  
FAIRVIEW PARK OZP NO. S/YL-MP/8  
REZONING FROM "R(D)" TO "R(C)2" ZONE AT LOT 4822 IN D.D.  
104 & ADJOINING GOVERNMENT LAND, EAST OF KAM POK ROAD,  
MAI PO, YUEN LONG, N.T.**

## **WATER SUPPLY IMPACT ASSESSMENT**

Date **April 2026**

Prepared by **Eric Chan**  
**Assistant Environmental Consultant**



Signed \_\_\_\_\_

Approved by **Henry Ng**  
**Principal Consultant**



Signed \_\_\_\_\_


Project Reference **HENKPRRDEI03**

Document No. **R9962\_v2.1.docx**

No part of this document may be reproduced or transmitted, in any form or by any means electronic, mechanical, photographic, recording or otherwise, or stored in a retrieval system of any nature without the written permission of Ramboll Hong Kong Ltd, application for which shall be made to Ramboll Hong Kong Ltd, 21/F, BEA Harbour View Centre, 56 Gloucester Road, Wan Chai, Hong Kong.

Disclaimer: This report is made on behalf of Ramboll Hong Kong Ltd. No individual is personally liable in connection with the preparation of this report. By receiving this report and acting on it, the client or any third party relying on it accepts that no individual is personally liable in contract, tort or breach of statutory duty (including negligence).

Ramboll Hong Kong Limited



Q:\Projects\HENKPRRDEI03\04 Deliverables\03 WSIA\R9962\_v2.1.docx

## CHAPTERS

	Page
<b>1. INTRODUCTION .....</b>	<b>1-1</b>
1.1 Background and Objectives.....	1-1
1.2 The Application Site and its Environs.....	1-1
1.3 The Proposed Development .....	1-1
<b>2. WATER SUPPLY IMPACT ASSESSMENT .....</b>	<b>2-1</b>
2.1 Scope of Work.....	2-1
2.2 Existing Water Main .....	2-1
2.3 Assessment Criteria and Methodology .....	2-1
2.4 Assessment of Water Supply Impact .....	2-1
<b>3. OVERALL CONCLUSION.....</b>	<b>3-1</b>

## FIGURES

Figure 1.1 Location of Application Site and its Environs

Figure 2.1 Proposed Freshwater Main Alignment

## APPENDICES

- Appendix 1.1 Indicative MLP of the Proposed Development
- Appendix 2.1 Records obtained from Water Supplies Department
- Appendix 2.2 Water Demand Calculations for the Proposed Development

## 1. INTRODUCTION

### 1.1 Background and Objectives

- 1.1.1 The Application Site is located at Lot 4822 in D.D. 104 & adjoining government land, east of Kam Pok Road, Mai Po, Yuen Long. It is currently zoned as "Residential (D)" ("R(D)") on the Approved Mai Po & Fairview Park Outline Zoning Plan No. S/YL-MP/8.
- 1.1.2 The Applicant intends to increase the maximum domestic plot ratio up to 1.5, for the residential development with a maximum building height of +59.85 mPD and one block of 2-storey facility compound comprises a clubhouse, a 6-classroom kindergarten and one Elderly Activity Centre ("EAC"). This change requires a S12A Planning Application to the approval of Town Planning Board. The forecast occupation year is 2031.
- 1.1.3 Ramboll Hong Kong Limited is commissioned by the Client to conduct this Water Supply Impact Assessment (WSIA) for the said residential development. Architectural drawings of the Proposed Commercial Development are provided by the project architect.

### 1.2 The Application Site and its Environs

- 1.2.1 The Application Site is bounded by Kam Pok Road to its immediate west, Fung Chuk Road to its immediate north, Ha Chuk Yuen Road to its immediate east and Ha San Wai Road to its south. Existing Ngau Tam Mei Channel is located to its farther west separated by Kam Pok Road. A "Village Type Development" ("V") zone (covering Ha San Wai Tsuen, Chuk Yuen Tsuen and Hang Fook Garden) and a Commercial/Residential ("C/R") zone are located to its farther southeast. Further to the west, north-west and south-west of the site across the said drainage channel, Yau Pok Road temporary light public housing zones and Fairview Park are located in the recreation ("REC") zone and residential ("R(C)") zone respectively.
- 1.2.2 **Figure 1.1** shows the location of the Application Site and its environs.

### 1.3 The Proposed Development

- 1.3.1 The proposed scheme is a medium-density residential development. With a proposed domestic plot ratio of 1.5, the proposed scheme comprises five residential blocks (namely Tower 1, Tower 2, Tower 3, Tower 5, and Tower 6) with 16 residential storeys and a maximum building height of +59.85 mPD, and one 2-storey facility compound block containing a 6-classroom kindergarten, clubhouse and one EAC. Ancillary facilities such as a basement carpark, outdoor swimming pool, E&M facilities, and sewage pumping station (SPS) are also planned. The mean site formation level proposed under the proposed scheme is about +5.4 mPD.
- 1.3.2 The Master Layout Plan (MLP) and section plan of the Proposed Development are shown in **Appendix 1.1**. The details of the Proposed Development schedule are summarized in **Table 1.1** below.

**Table 1.1 Development Schedule**

Major Development Parameters	Proposed Scheme
Application Site Area (m <sup>2</sup> )	~37,870
Domestic GFA (m <sup>2</sup> )	~56,805
Non-domestic GFA (m <sup>2</sup> )	~930 <sup>(1)</sup>
No. of Units	1,303
Domestic population	3,519
Non-domestic population	316

Remark:

(1) Include kindergarten (~380m<sup>2</sup>) and EAC (~550m<sup>2</sup>).

## 2. WATER SUPPLY IMPACT ASSESSMENT

### 2.1 Scope of Work

2.1.1 The aim of this study is to assess whether the capacity of the existing water supply facilities serving the Application Site are sufficient to cope with the water demands from the Proposed Development. Data and record plans from Water Supplies Department (WSD) were obtained to facilitate the Water Supply Impact Assessment (WSIA).

### 2.2 Existing Water Main

2.2.1 As shown in **Appendix 2.1**, there is currently one dia 200mm freshwater main serving the Application Site along Kam Pok Road and along Ha Chuk Yuen Road. There are no saltwater mains in the vicinity of the Application Site.

### 2.3 Assessment Criteria and Methodology

2.3.1 The Application Site is located within the freshwater supply zone of Ngau Tam Mei Fresh Water Primary Service Reservoir (NTMFWPSR), which currently has a capacity of about 40,750m<sup>3</sup>. The NTMFWPSR will be expanded by 2031, which will gain an additional capacity of 54,000m<sup>3</sup>. There is no existing or planned saltwater reservoir serving the Application Site.

2.3.2 The water demand of the Proposed Development will be mainly originated from the future domestic population, clubhouse, kindergarten, EAC and fire-fighting services.

2.3.3 The daily unit water demand for various classes of consumer is referenced to the Water Service Department’s Departmental Instruction 1309 (WSD DI 1309). The adopted water unit demand are summarized in **Table 2.1**.

**Table 2.1 Adopted Freshwater and Flushing Water Demand**

Development Type	Unit	Freshwater Daily Unit Demand	Flushing water Daily Unit Demand	Reference
Residential R2	m <sup>3</sup> /head/day	0.34 <sup>(1)</sup>	0.104	DI No. 1309
Fire service	m <sup>3</sup> /day	6,000	-	DI No. 1309

Remark:

(1) Service trade of 40 L/head/day (Yuen Long) is adopted. Service trade consumption includes the water demand from clubhouse, kindergarten, and EAC.

2.3.4 The calculations for the water demands of the Proposed Development is indicated in **Appendix 2.2**.

### 2.4 Assessment of Water Supply Impact

#### Freshwater Supply System

2.4.1 Currently there is no saltwater main in the vicinity of the Application Site, it is assumed that freshwater will be supplied for toilet flushing within the site.

2.4.2 According to the calculation shown in **Appendix 2.2**, the future daily freshwater (including flushing water) demand for the Proposed Development is estimated to be 1562.4 m<sup>3</sup>/day, which is less than 4% of the existing NTMFWPSR’s current capacity. Given that the contribution is insignificant and that the capacity at NTMFWPSR will be further expanded by the time of operation of Proposed Development, there should be


adequate capacity at NTMFWPSR and the Proposed Development would unlikely pose any adverse impact on NTMFWPSR.

- 2.4.3 The Application Site is currently connected with a 200mm dia. freshwater main along Kam Pok Road. However, it does not have enough capacity to serve the Proposed Development. It is understood the existing water main is reserved for fire-fighting service for the surrounding developments. As the nearby existing freshwater main cannot cater the demand for the Proposed Development, it is proposed to draw supply from the existing 300mm diameter freshwater main located along Castle Peak Road, near Fairview Park Boulevard. A 200mm dia. freshwater main is then proposed to be constructed along Kam Pok Road and Ha San Wai Road to connect an existing 150mm diameter freshwater main, and the connection between existing 300mm diameter and 150mm diameter freshwater main near the Fairview Park Boulevard. The proposed water main will serve both freshwater and flushing water demand for the Proposed Development.
- 2.4.4 The alignment of the proposed freshwater main is shown in **Figure 2.1**. The proposed freshwater main, which is communal, will be handed over to the HKSAR Government for maintenance.
- 2.4.5 The above estimation is preliminary only, which is subject to later on detailed design stage. Similarly, the size of water main for fire-fighting system will be subject to detailed design stage. The Applicant will be responsible for all costs related to the proposed waterworks outside the Application Site boundary for the purpose of supplying water to the lot. The works shall be designed and implemented to the satisfaction of WSD.

### 3. OVERALL CONCLUSION

- 3.1.1 The potential water supply impact has been quantitatively addressed.
- 3.1.2 The future daily freshwater (including flushing water) demand for the Proposed Development is less than 4% of the existing freshwater service reservoir's current capacity at NTMFWPSR. Therefore, NTMFWPSR have adequate capacity to cater the water demand of the Proposed Development. No adverse water supply impact is anticipated due to the Proposed Development.
- 3.1.3 As the nearby existing freshwater main cannot cater the demand for the Proposed Development, a new 200mm dia. freshwater main to be constructed along Kam Pok Road and Ha San Wai Road with connection to the existing 150mm dia. freshwater at Ha San Wai Road, as well as the connection between the existing 300mm diameter and 150mm diameter freshwater main near Fairview Park Boulevard, are thus proposed to serve the Proposed Development.

## Figures

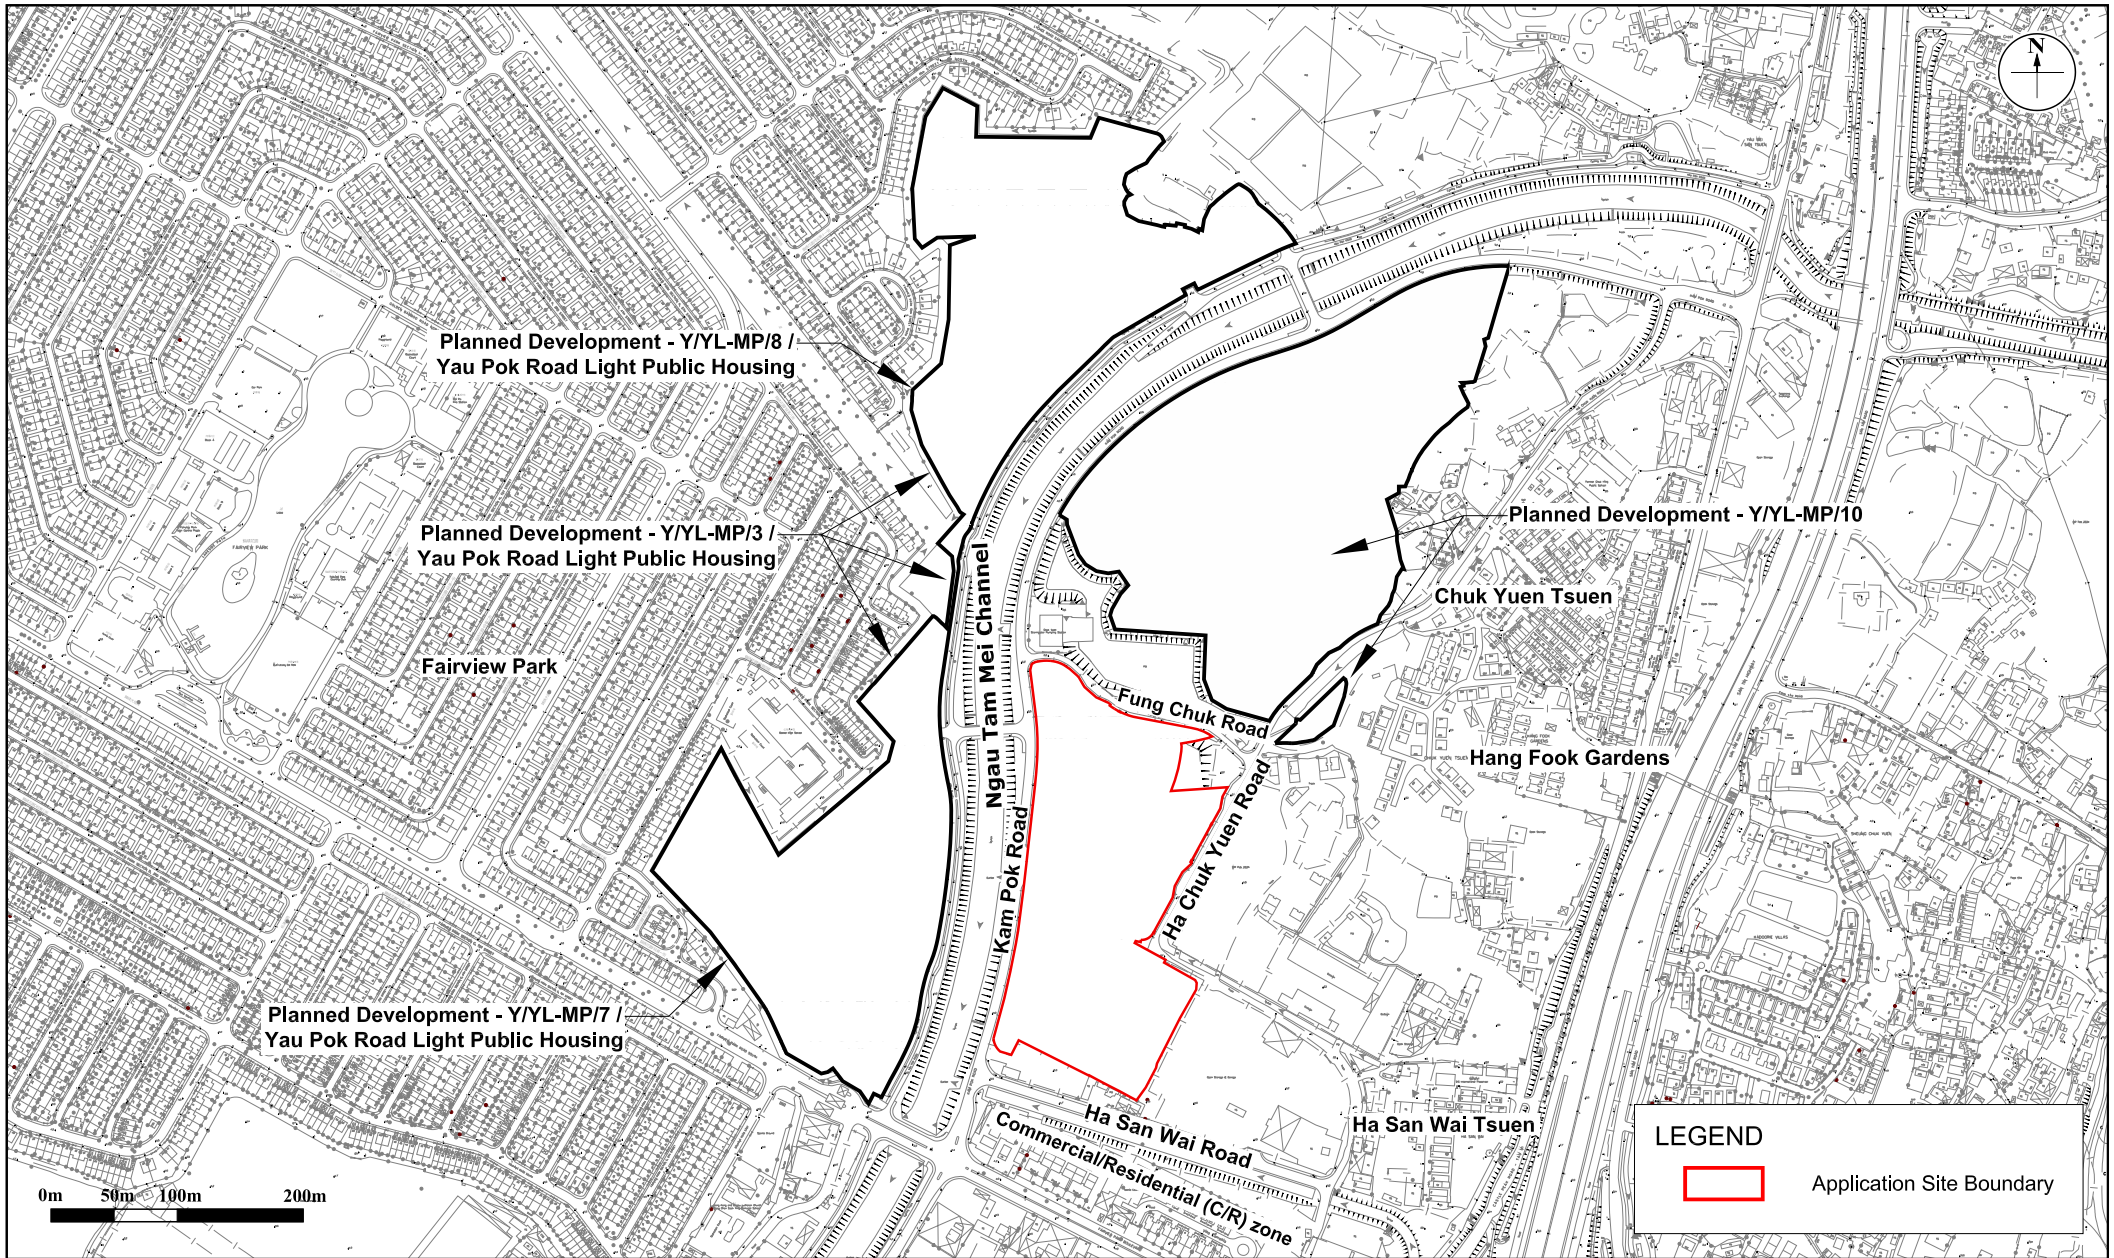

**Figure:** 1.1

**Title:** Location of the Application Site and its Environs

**Project:** Rezoning Application from "Residential (Group D)" to "Residential (Group C)2" Zone at Lot 4822 in D.D. 104 and Adjoining Government Land, East of Kam Pok Road, Mai Po, Yuen Long, New Territories


**RAMBOLL**

Drawn by: EC

Checked by: HN

Rev.: 1.0

Date: Nov 2025

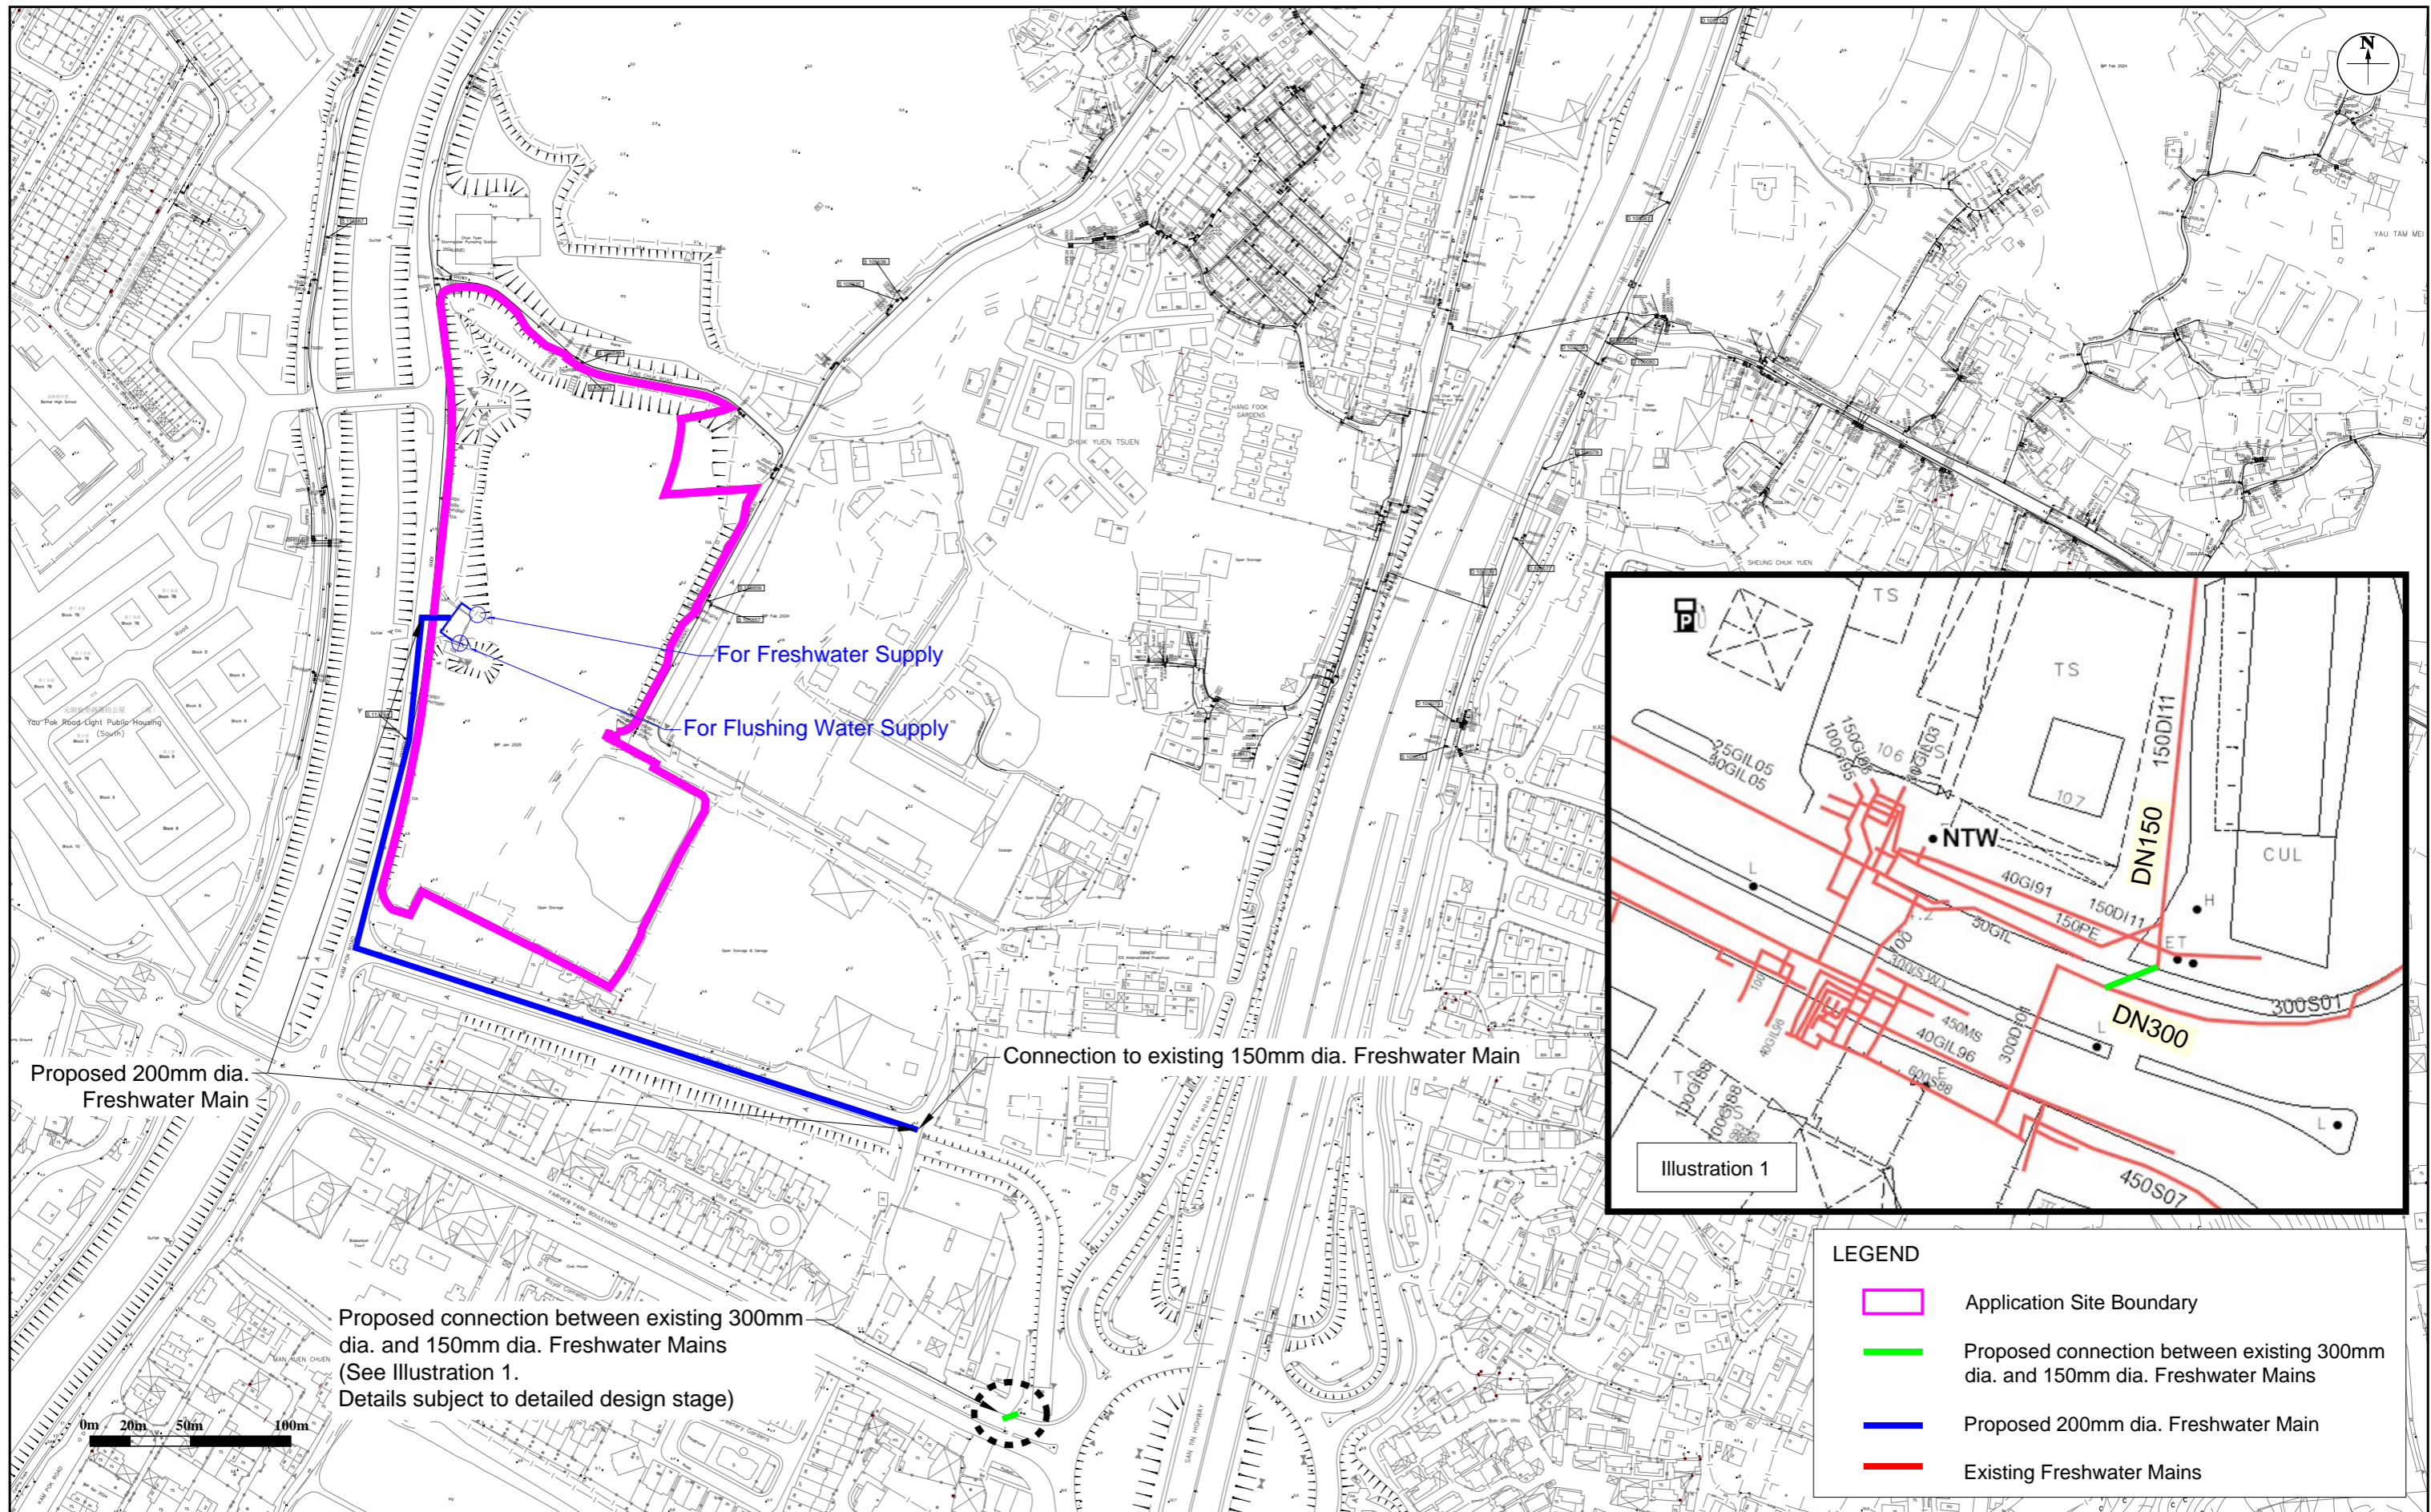

**Figure:** 2.1  
**Title:** Proposed Freshwater Main Alignment

**Project:** Rezoning Application from "Residential (Group D)" to "Residential (Group C)2" Zone at Lot 4822 in D.D. 104 and Adjoining Government Land, East of Kam Pok Road, Mai Po, Yuen Long, New Territories

**RAMBOLL**

Drawn by: EC

Checked by: HN

Rev.: 2.1


Date: Apr 2026

**Appendix 1.1 Indicative MLP of the Proposed Development**

**LEGEND**

- APPLICATION SITE BOUNDARY
- FENCE WALL (2.5mH)
- ▨ SWIMMING POOL

Remark : 1. All spot levels marked on building structures (including towers and clubhouse) refer to the main roof levels.

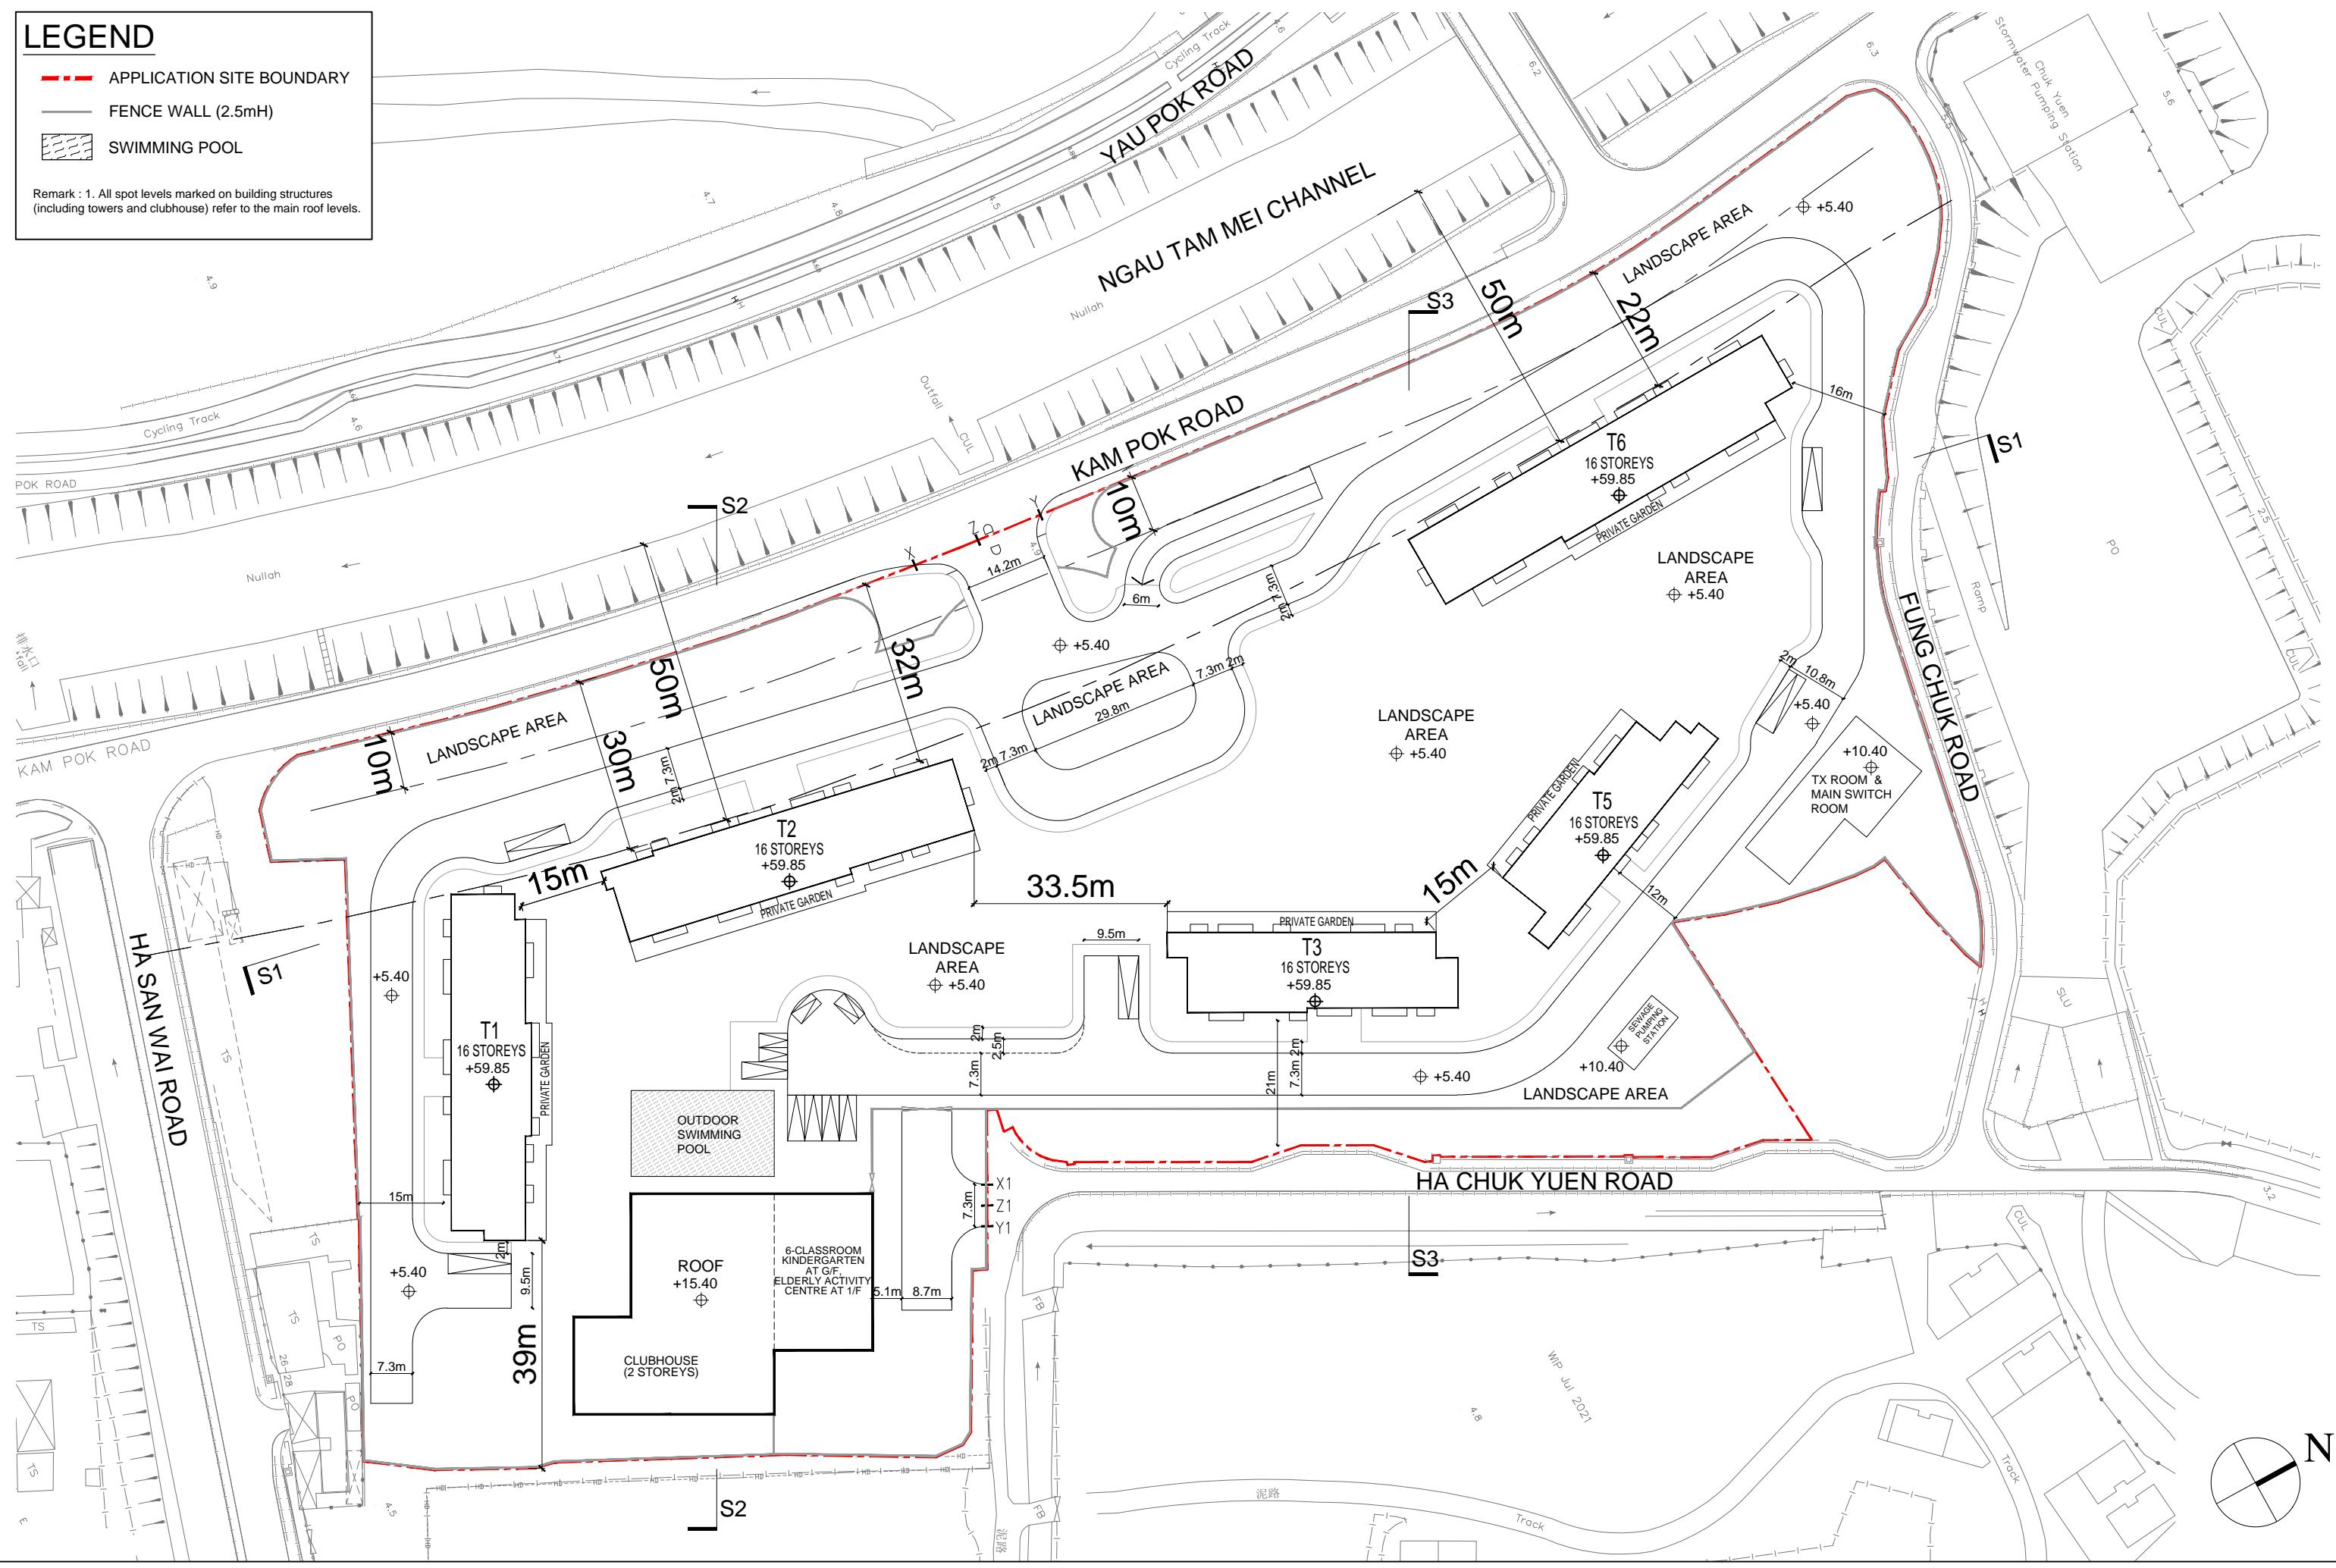


Lot 4822 IN D.D.104, Kam Pok Road, Mai Po, Yuen Long

INDICATIVE MASTER LAYOUT PLAN


0 10 20 30m

DATE : 27/01/2026

R:\6177\DESIGN\Progress\20250402\_TPO Section 12A\20260126\20260126\_MLP.dwg, 1/27/2026 4:12:37 PM, DWG To PDF.pc3

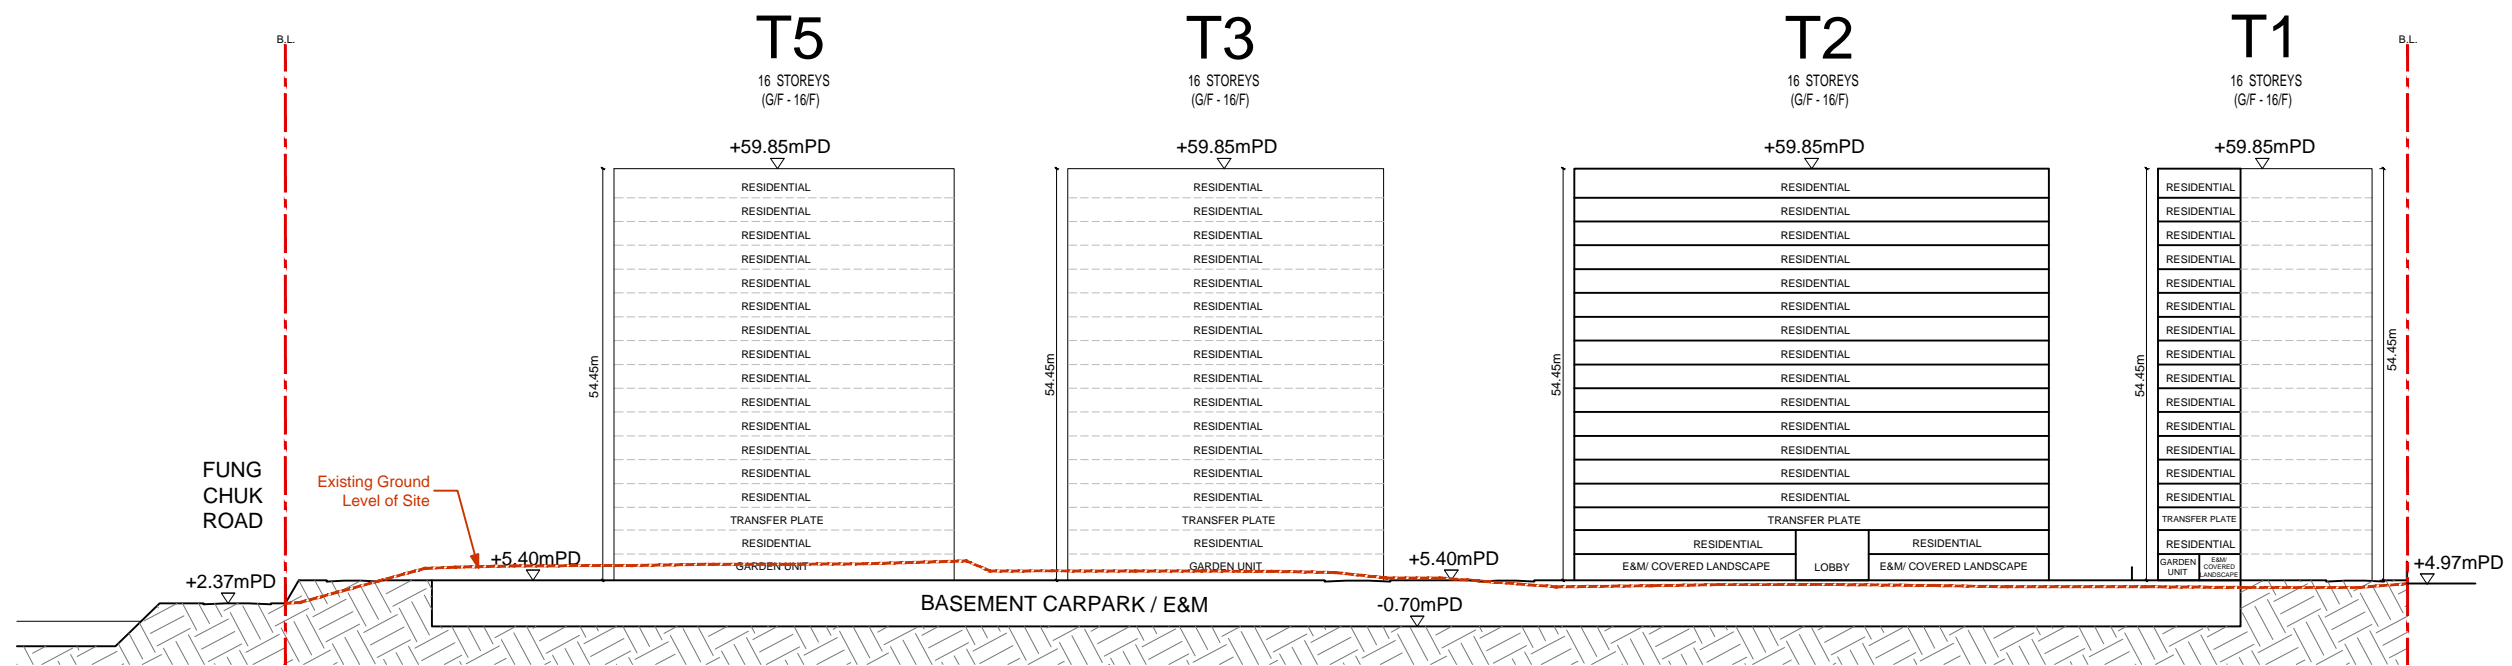

SECTION S1-S1

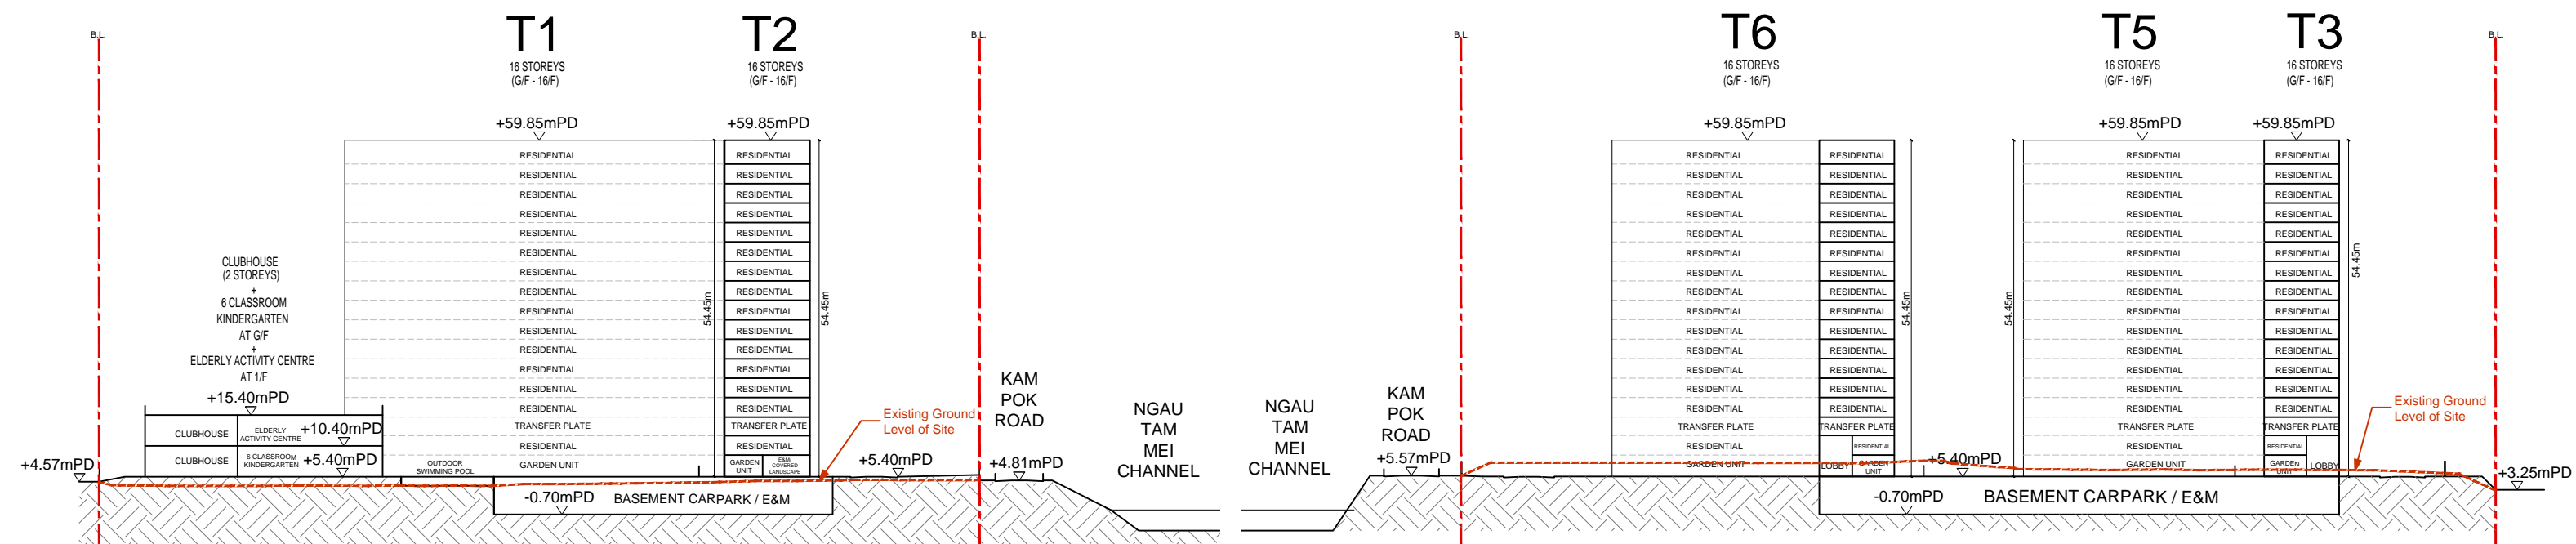

SECTION S2-S2

SECTION S3-S3



**Appendix 2.1    Records obtained from Water Supplies Department**

INSET 'A'

INSET 'B'


INSET 'C'

INSET 'D'

INSET 'E'

INSET 'F'

2-SE-16B

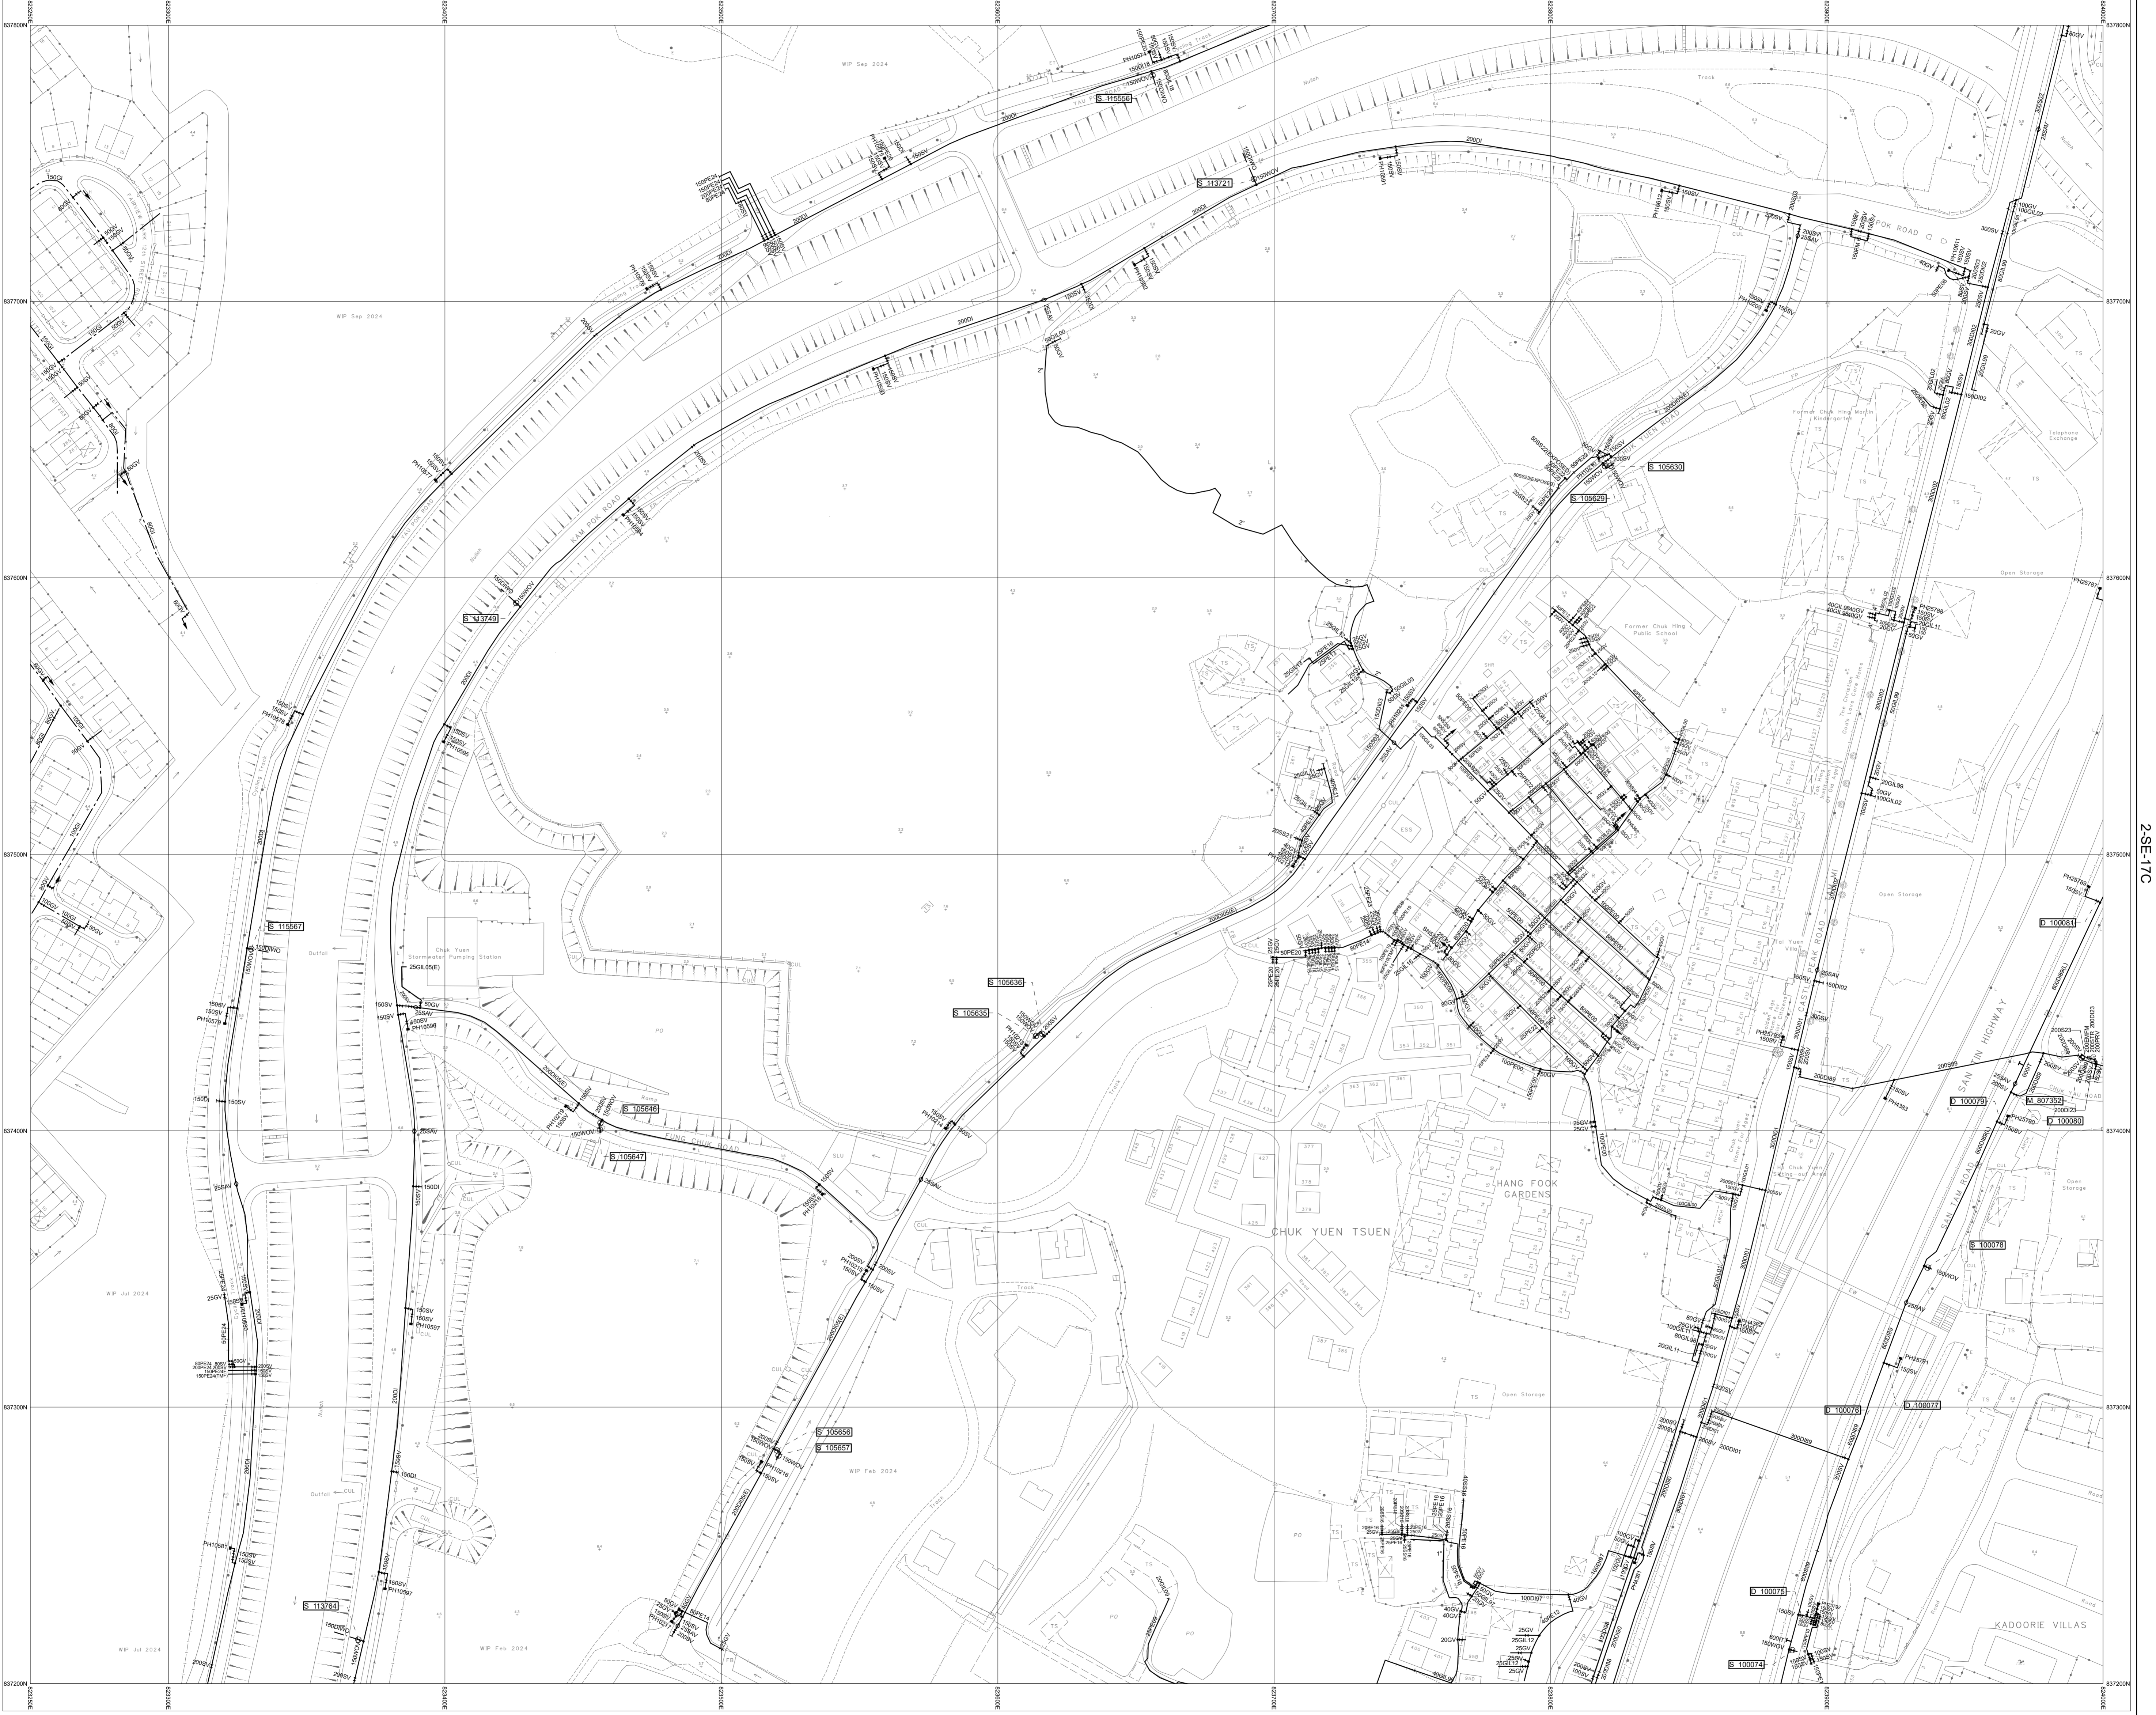

2-SE-21B

- NOTES:
1. FOR MAINS RECORDS SIGN CONVENTIONS AND DESIGNATIONS SEE SKETCH NO.3988.
  2. DIMENSIONS OF MAINS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
  3. ALL LEVELS ARE IN METRES ABOVE PRINCIPAL DATUM.

### FRESH WATER MAINS RECORD PLAN

CASTLE PEAK ROAD - TAM MI, CHUK YUEN TSUEN

THIS IS A COMPUTER PRINTOUT.  
NO SIGNATURE IS REQUIRED.

COPYRIGHT RESERVED



DATE REVISED : 06/11/2025

DRAWING NO.

W67880/ 2-SE-16D

SIGNED K.C. KONG  
CE/MNW

DATE: 15/12/1998

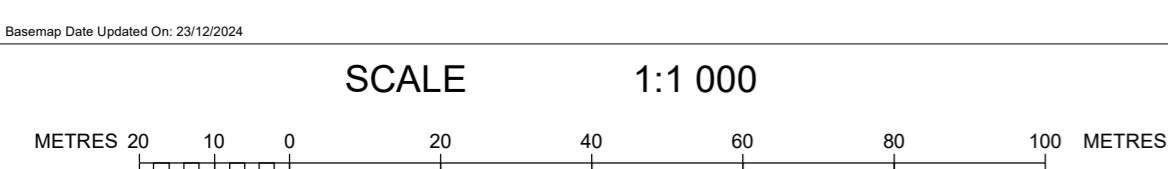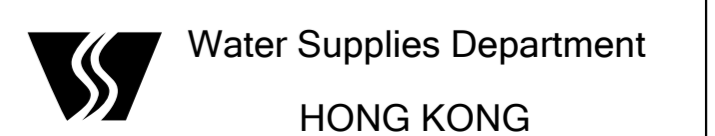

INSET 'A'

INSET 'B'

INSET 'C'

INSET 'D'

INSET 'E'

INSET 'F'

2-SE-17A



2-SE-22A

- NOTES:
1. FOR MAINS RECORDS SIGN CONVENTIONS AND DESIGNATIONS SEE SKETCH NO.3988.
  2. DIMENSIONS OF MAINS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
  3. ALL LEVELS ARE IN METRES ABOVE PRINCIPAL DATUM.

### FRESH WATER MAINS RECORD PLAN

NGAU TAM MEI ROAD, YAU TAM MEI TSUEN

THIS IS A COMPUTER PRINTOUT.  
NO SIGNATURE IS REQUIRED.

COPYRIGHT RESERVED


DATE REVISED : 06/11/2025


DRAWING NO.

W67880/ 2-SE-17C

SIGNED K.C. KONG  
CE/MNW

DATE: 15/12/1998

 Water Supplies Department  
HONG KONG

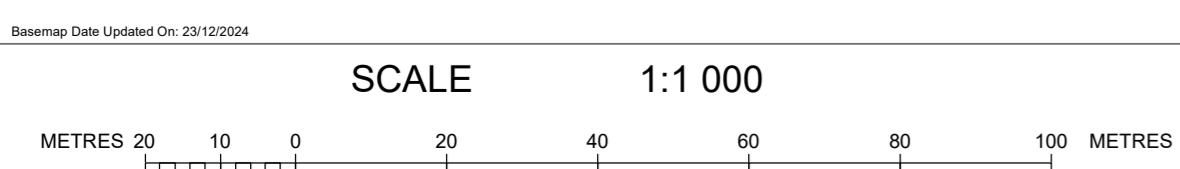

## **Appendix 2.2 Water Demand Calculations for the Proposed Development**

**Appendix 2.2a Future Daily Water Demands of the Proposed Development**

Type of Use	Population (head)	Freshwater		Flushing Water	
		Daily Unit Demand (m <sup>3</sup> /head/day) <sup>[1]</sup>	Daily Demand (m <sup>3</sup> /day)	Daily Unit Demand (m <sup>3</sup> /head/day) <sup>[1]</sup>	Daily Demand (m <sup>3</sup> /day)
Residential R2	3,519	0.340	1196.46	0.104	365.98
<b>TOTAL</b>			<b>1196.46</b>		<b>365.98</b>

**Total Freshwater Demand (including flushing water) (m<sup>3</sup>/day) = 1562.4**

Note:

[1] The daily unit demand rate is referenced to the WSD Departmental Instruction 1309 (DI 1309).

Remark:

1. Since there is no salt water main in the vicinity of the site, the water demand (both fresh and flushing) will be supported by the fresh water mains.
2. The non-domestic demand for freshwater is not included in this assessment as it is count as service trade allowance.