

Appendix 5: Drainage Impact Assessment



DRAINAGE IMPACT ASSESSMENT

To Amend the Notes of the “Comprehensive Development to include Wetland Restoration Area” Zone for a Proposed Comprehensive Development at Wo Shang Wai, Yuen Long, Lots 77 and 50 S.A in DD101

(REVISION 1)

DATE: 20 JANURARY 2025

WSP (ASIA) LTD.
7/F ONE KOWLOON
1 WANG YUEN STREET
KOWLOON BAY, HONG KONG


PHONE: +852 2579-8899
FAX: +852 2856-9902
WSP.COM

Quality Management

Issue/revision	0	1	2	3
Remarks				
Date	08 Aug. 2024	20 Jan. 2025		
Prepared by	Jinxuan Xu	Jinxuan Xu		
Signature	<i>Jinxuan Xu</i>	<i>Jinxuan Xu</i>		
Checked by	Connie Chan	Connie Chan		
Signature				
Authorised by	Kau, Paul	Kau, Paul		
Signature				
Project number				
Report number	0	1	2	3

Signatures

Prepared by



Jinxuan Xu
Assistant Consultant

Reviewed by

Connie Chan
Senior Associate

This report was prepared by WSP (Asia) Ltd. (WSP) for the account of Profit Point Enterprises Ltd, in accordance with the professional services agreement. The disclosure of any information contained in this report is the sole responsibility of the intended recipient. The material in it reflects WSP's best judgement in light of the information available to it at the time of preparation. Any use which a third party makes of this report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. WSP accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this report. This limitations statement is considered part of this report.

The original of the technology-based document sent herewith has been authenticated and will be retained by WSP for a minimum of ten years. Since the file transmitted is now out of WSP's control and its integrity can no longer be ensured, no guarantee may be given to by any modifications to be made to this document.

CONTENTS

1	INTRODUCTION	1
2	OBJECTIVES OF THIS DRAINAGE IMPACT ASSESSMENT REPORT	3
3	EXISTING DRAINAGE CHARACTERISTICS	4
4	POTENTIAL ADVERSE DRAINAGE IMPACTS.....	6
5	METHODOLOGY FOR ASSESSMENT	7
6	DESIGN ASSUMPTIONS AND PARAMETERS	11
7	PROPOSED CHANGES TO THE DRAINAGE CHARACTERISTICS	12
8	PROPOSED DRAINAGE ARRANGEMENT AND MITIGATION MEASURES	17
9	ASSESSMENT ON DRAINAGE IMPACT.....	20
10	TEMPORARY DRAINAGE ARRANGEMENT	23
11	MAINTENANCE RESPONSIBILITIES.....	24
12	SUMMARY AND CONCLUSIONS	25

LIST OF TABLES

TABLE 1-1 KEY DATA FOR THE APPLICATION SITE	2
TABLE 5-1 DESIGN TIDE LEVEL AT TSIM BEI TSUI	9
TABLE 5-2 SUMMARY OF ASSESSMENT SCENARIOS	10
TABLE 6-1 SURFACE'S ROUGHNESS COEFFICIENT	11
TABLE 7-1 CN VALUES OF PRE & POST DEVELOPMENTS FOR THE APPLICATION SITE	12
TABLE 7-2 CN VALUES APPLIED FOR THE PRE-DEVELOPMENT MODEL.....	14
TABLE 7-3 CN VALUES APPLIED FOR THE POST-DEVELOPMENT MODEL.....	15
TABLE 9-1 CHANGE IN PEAK DISCHARGE FROM THE APPLICATION SITE	20
TABLE 9-2 CHANGE IN TOTAL RUNOFF FROM THE APPLICATION SITE	20
TABLE 9-3 CHANGE IN WATER LEVEL ALONG MAI PO RIVER AND MAI PO TRIBUTARY UNDER 50YR ARI	20

1 INTRODUCTION

1.1 BACKGROUND AND PREVIOUS APPROVED DIAS

1.1.1 WSP (Asia) Limited (hereinafter “WSP”) was commissioned by Profit Point Enterprises Limited to carry out a Drainage Impact Assessment (DIA) for the proposed Comprehensive Residential Development at Wo Shang Wai, Yuen Long.

1.1.2 This application is made under section 12A of the Town Planning Ordinance, to rezone the Application Site on the draft Mai Po and Fairview Park Outline Zoning Plan (“OZP”) No. S/YL-MP/8. The rezoning application aims to increase the plot ratio (“PR”) from 0.4 (i.e. maximum permissible PR on the OZP) to 1.3, with a maximum building height (“BH”) adjusted to not more than 10-storeys and not exceeding +42mPD by amending the Notes of the current “Other Specified Uses (Comprehensive Development to include Wetland Restoration Area)” (“OU(CDWRA)”) zone.

1.1.3 The Applicant, Profit Point Enterprises Limited, proposes to increase the development intensity, and revise the layout and form of the housing developments in the Application Site, in response to the drastic changes in the development site context and planning circumstances of the area.

1.1.4 The Application Site is located at Wo Shang Wai, Yuen Long. It is generally bounded by Castle Peak Road – Mai Po and San Tin Highway to the east, fishponds to the north, residential developments, namely Royal Palms and Palm Springs to the south, and Wo Shang Wai Village to the southeast, as shown in **Figure 1**.

1.1.5 Under the approval condition (d) of the approved Section 16 Planning Application (Planning Application No. A/YL-MP/229) for proposed comprehensive development at Wo Shang Wai, DIAs were considered to have satisfactorily discharged the condition requirement in Town Planning Board’s letters dated 13 March 2015, 12 May 2021 and 1 March 2024 (**Appendix A**).

1.1.6 The proposed comprehensive residential development comprises a revised mixture of residential buildings and ancillary residential facilities including swimming pools, car parks, club house and landscaped open spaces. The total site area is approximately 20.74ha. The revised MLP of the development is shown in **Appendix B**.

1.1.7 According to the latest MLP, the key data for the proposed development on the Application Site is summarized in **Table 1-1** below.

Table 1-1 Key Data for the Application Site

1. Site Data	
Application Site Area	207,408 m ² (approx..)
Paved Area plus Pool Area (53.6%) [incl. Residential Houses, Club House & Roads]	111,292 m ²
As-Built Restored Wetland (22.9%)	47,400 m ²
Vegetated Area +(23.5%) [incl. Amenity Planting & Garden]	48,716 m ²
2. Residential Development	
Domestic Plot Ratio	1.28
Domestic GFA	265,847 m ²

2 OBJECTIVES OF THIS DRAINAGE IMPACT ASSESSMENT REPORT

2.1.1 The purpose of this DIA is to review the previous approved DIAs with respect to the revised MLP and the previous agreed drainage mitigation measures. This DIA also includes the followings:

- a) Review the existing drainage condition and flooding susceptibility of the Application Site, which is a requirement introduced subsequent to the previous approval.
- b) Outline the methodology for the assessment.
 - Susceptibility to flooding of neighbouring areas of the Application Site;
 - Exacerbation to existing flooding issue during the construction period;
 - Exacerbation to existing flooding issue upon completion of the development; and
 - Effect on existing drainage conditions.
- c) Outline changes to the drainage characteristics and potential drainage impacts in the following aspects.
- d) Propose drainage impact mitigation measures, if necessary, to mitigate the potential drainage impact due to the revision of the MLP.
- e) Discuss the responsibility of the maintenance aspects of the proposed drainage system and drainage impact mitigation measures.

3 EXISTING DRAINAGE CHARACTERISTICS

3.1 EXISTING DRAINAGE CONDITION WITHIN THE APPLICATION SITE

3.1.1 The Application Site is located at two drainage basins, namely San Tin Basin and Ngau Tam Mei Basin as shown in **Figure 2**. However, as concluded in the previous approved DIAs, the runoff generated from the Application Site is discharged merely to San Tin Basin through a ditch along the Application Site's perimeter and thus no runoff is discharged to Ngau Tam Mei Basin. In this regard, the drainage impact to Ngau Tam Mei Basin will not be assessed.

3.1.2 An existing ditch around the western peripheral of the Application Site collects runoff from Wo Shang Wai Village and the Application Site before discharging to a tributary of Mai Po River (thereafter named as Mai Po Tributary). According to topographic data, the Mai Po Tributary is trapezoidal in shape with average dimensions of 2m deep by 10m base width. Mai Po Tributary joins Mai Po River at its downstream end. Mai Po River further merges with Shenzhen River and then discharges into Deep Bay.

3.1.3 There is another ditch at the eastern portion of the Application Site. In addition to the site runoff, the drainage ditch serves conveying runoff from the vacant lots between Castle Peak Road and Royal Palms as shown in **Figure 3**.

3.1.4 San Tin basin is characterized by flat agricultural land with a large amount of fishponds at the downstream portion with some village developments along San Tin Highway. Hilly vegetated areas exist on the upland in the basin. The existing drainage features and the overland flow path within the Application Site are shown in **Figure 3**.

3.2 EXISTING FLOW PATH THROUGH THE APPLICATION SITE – WO SHANG WAI VILLAGE

3.2.1 To the south of the Application Site is Wo Shang Wai Village (i.e. sub-catchment MP02A-a4 as shown in **Figure 4**). Wo Shang Wai Village is a low-lying area with ground level ranges from 2.4mPD to 2.8mPD. It is surrounded by Royal Palms, Palm Springs and the Application Site. According to drainage record plans and building record plans, runoff from Royal Palms and Palm Springs are intercepted and discharged to Ngau Tam Mei Basin. Runoff from the surroundings developments will not drain into Wo Shang Wai Village therefore it is independent from the surrounding developments.

3.2.2 Drainage of Wo Shang Wai Village is currently achieved by an existing flood storage pond and an associated pumping system. The pump lifts and discharges the stormwater to the western ditch within the Application Site via two 250mm dia pipes.

3.3 EXISTING FLOW PATH THROUGH THE APPLICATION SITE – VACANT LOTS BETWEEN CASTLE PEAK RD & ROYAL PALMS

3.3.1 The vacant lots between Castle Peak Road and Royal Palms would drain to the Application Site via 3 x 1350mm dia. pipes while runoff from the northern portion of Royal Palms is discharged to Ngau Tam Mei Basin. The runoff from the said vacant lots eventually discharges into Mai Po Tributary via the eastern ditch across the Application Site.

3.4 EXISTING FLOW PATH THROUGH THE APPLICATION SITE – NORTH-EASTERN SIDE OF THE APPLICATION SITE

3.4.1 Based on the topographical survey information, the southern portion of the area (i.e., sub-catchment MP02A-a7 as shown in **Figure 4**) dips toward the existing eastern ditch along the northeast boundary of the Application Site. On the other hand, the northern portion of the area (i.e., MP02A-a8) dips northward and is discharged directly to Mai Po Tributary.

3.5 FLOODING BLACKSPOTS AROUND THE APPLICATION SITE

3.5.1 According to the Drainage Services Department (DSD) – Location of DSD Flooding Blackspots in **Appendix C**, no flooding blackspots exists in the sub-catchment of the Mai Po River for which the Application Site is located in. The nearest flooding blackspot in the same basin as the proposed development is at Shek Wu Wai (ID No.1) of San Tin which was recorded to be a medium¹ flooding blackspot. Moreover, this village is located within the “San Tin Western Drainage Channel” catchment, which is independent from Mai Po Tributary and Mai Po River, therefore it will not be discussed in this DIA.

¹ Definition of Medium as per DSD - affecting area of more than 10 hectares or resulting in significant property damage or serious traffic disruption

4 POTENTIAL ADVERSE DRAINAGE IMPACTS

4.1.1 The potential adverse drainage impacts incurred by the proposed development in relation to the previous approved DIAs which have addressed the following:

- Loss in flood storage volume due to filling up the Application Site;
- Increase in total runoff and peak discharge due to change in land use and the corresponding increase in CN value; and
- Blockage of existing drainage flow paths through the Application Site.

4.1.2 The proposed mitigation measures recommended in the previous approved DIAs are detailed in **Section 8** of this report and the adequacy of the previous agreed mitigation measures is discussed in **Section 9**.


5 METHODOLOGY FOR ASSESSMENT

5.1 OVERVIEW OF METHODOLOGY

5.1.1 This DIA is carried out in accordance with the requirements of “Advice Note No. 1 – Application of the Drainage Impact Assessment Process to Private Sector Projects” issued by DSD, as well as the Stormwater Drainage Manual - Fifth Edition (SDM).

5.1.2 The methodology for the hydrological and hydraulic assessment has been established and agreed in the previous approved DIAs. In this regard, the same methodology and principle are adopted in this assessment for the sake of consistency.

5.1.3 The logic flow of the analysis which agreed in the previous approved DIAs is illustrated by the following flow chart diagram:

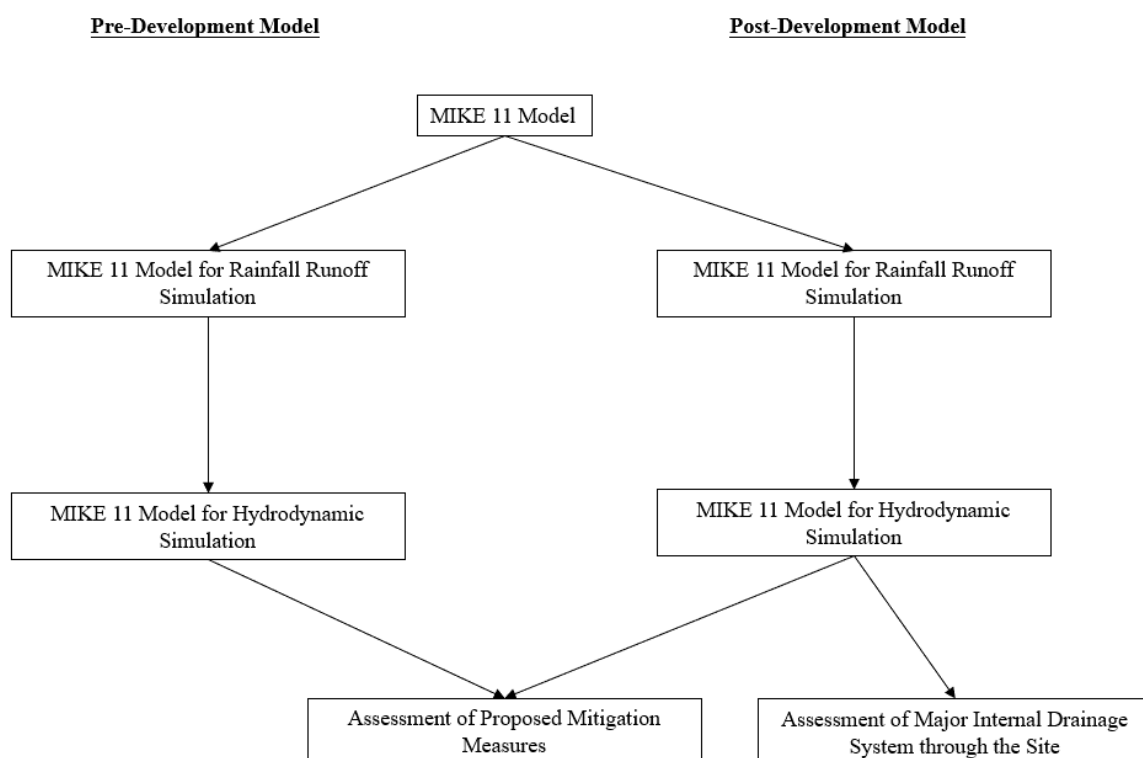

5.2 UPDATE THE MODEL SETTING

5.2.1 This assessment follows the approach of the previous approved DIAs, takes the previous approved model as a basis and refines to facilitate hydraulic assessment for the proposed development in the San Tin Basin.

5.2.2 Having reviewed the aerial photos and property information of San Tin Basin, the land use of this area is almost unchanged from last approved DIA in March 2024. The areas in the

Santin Basin, such as Wo Shang Wai, Rolling Hills, Noble Villas, Maple Gardens, Mai Po San Tsuen and Mai Po Lo Wai, are mostly developed 20 years ago, which is much earlier than the approval of last DIA. Meanwhile, the developments in the San Tin Basin mostly are low-density, which suggests the minor changes in runoff generation between pre-development and post-development. In addition, there should not be many changes to the Mai Po Tributary and Mai Po River since last approved DIA which was completed this year. Thus, the previous approved model is still reliable for this drainage impact assessment.

5.2.3 The catchment boundary with sub-catchment delineation for the pre-development and post-development scenarios are shown in **Figure 4** and **Figure 5**, respectively. Sub-catchments MP02A-a2 and MP02A-a3 under pre-development as shown in are delineated to MP02A-a9, MP02A-aa, -ab, -ac, -ad and -ae to simulate the drainage condition of the proposed development under post-development scenario. The sub-catchments under post-development scenario are refined based on the land use change within the Application Site as mentioned in the **Section 7** and **Appendix B**.

5.2.4 To simulate the flood plains, the approved assessment model used virtual side branches which have connections to river courses. The virtual side branches and the connections were named STS and STW in their prefixes, respectively.

5.2.5 For the pre-development model, due to the existing topography, the Application Site would become a flood plain under extreme rainfall and tidal events. To reflect the flood storage characteristics of the Application Site, the virtual side branches mentioned above is extended and connections are made to ch690 and ch490 in the pre-development model. These side branches and the connections at ch490 and ch690 are removed in the post-development scenario since the Application Site will be filled up by the proposed development and therefore will not be characterized as a flood plain.

5.3 RAINFALL – RUNOFF SIMULATION

5.3.1 In this DIA, a 4-hr synthetic rainfall profile, as shown in **Appendix D** was updated using the formulation mentioned in Section 4.3.5(b) in the DSD-SDM with parameters specified for HKO area referring to the Table 3a in the Stormwater Drainage Manual-Corrigendum No. 1/2024.

5.3.2 In addition, the potential drainage impact will consider the climate change effects up to end of 21st century. Referring to the Table 28 and 31 in the Stormwater Drainage Manual-Corrigendum No. 1/2022, 28.1 % rainfall increase due to climate change, including 16% rainfall increase and 12.1% design allowance, has been added into the 4-hr synthetic rainfall profiles.

5.3.3 The catchment MP02A-a2 and a3 under the pre-development scenario is re-delineated for the purpose of this development to develop the pre-development scenario to incorporate the latest information as mentioned below.

5.3.4 The increase in CN value due to the proposed development is reflected in the post-development model.

5.4 HYDRODYNAMIC SIMULATION

5.4.1 The hydrodynamic model performs the hydrodynamic run to assess the hydraulic performance of river courses and drains.

5.4.2 The boundary condition (i.e. Tide level) adopted in this assessment is referred to the Table 8, Table 29, Table 30b and Table 31 in the Stormwater Drainage Manual- Corrigendum No. 1/2022, as shown in the following table:

Table 5-1 Design Tide level at Tsim Bei Tsui

Return period (Years)	Design extreme sea level (mPD)	Mean Sea Level Rise due to Climate Change (mPD)	Storm Surge Increase in End of 21st century (mPD)	Design Allowance in End of 21st century (mPD)	Design extreme sea level considering climate change effect (mPD)
	A	B	C	D	E=A+B+C+D
2	3.07	0.47	0.09	0.20	3.83
10	3.52	0.47	0.15	0.23	4.37
50	4.09	0.47	0.20	0.25	5.01
200	4.78	0.47	0.26	0.27	5.78

5.5 SCENARIOS FOR IMPACT ASSESSMENT

5.5.1 It is confirmed in the previous approved DIAs that the impacts to river courses other than Mai Po Tributary and Mai Po River are very minimal and therefore only the impacts to Mai Po Tributary and Mai Po River are assessed in this assessment.

5.5.2 Both the High and Low antecedent moisture conditions (AMC2² and AMC3³ are adopted in this assessment model in consistency with the previous approved DIAs. The worst-case scenario amongst the two conditions will be used in the analysis for the proposed mitigation measures.

² AMC2 = average condition

³ AMC3 = heavy rainfall occurred within last 5 days; saturated soil

5.5.3 Hydraulic impact incurred by rainfall profiles with areal reduction factors of 0.82 and 1.0 are analysed in consistency with the previous approved DIAs. Areal reduction factor of 1.0 was used for the San Tin Basin to estimate peak flood levels for all areas in the San Tin Basin. Whilst an aerial reduction factor of 0.82 was used for the entire Shenzhen River Basin including the catchments draining from Chinese Mainland to estimate peak flood levels for the Shenzhen River. The worst-case scenario from the two conditions will be used in the analysis for the proposed mitigation measures.

5.5.4 Hydraulic performance for 2, 10, 50 and 200yr ARI events for the Application Site, Mai Po Tributary and Mai Po River will be assessed in accordance with the requirement stipulated in the Advice Note No.1. A, B and C scenarios under respective ARI event are simulated according to the following table:

Table 5-2 Summary of Assessment Scenarios

ARI Event	Abbreviation	Areal Reduction Factor	Rainfall	Tide Level
2	2A	0.82	2 yr	2 yr
	2C	1.00	2 yr	2 yr
10	10A	0.82	10 yr	2 yr
	10B	0.82	2 yr	10 yr
	10C	1.00	10 yr	2 yr
50	50A	0.82	50 yr	10 yr
	50B	0.82	10 yr	50 yr
	50C	1.00	50 yr	10 yr
200	200A	0.82	200 yr	10 yr
	200B	0.82	10 yr	200 yr
	200C	1.00	200 yr	10 yr

Note: same as the previous approved DIAs

6 DESIGN ASSUMPTIONS AND PARAMETERS

6.1.1 Design assumptions and parameters agreed in the previous approved DIAs would be adopted in this assessment. The rationale of adopting the set of parameters in the assessment is reiterated in the sections below.

6.1.2 The manning's n to be adopted in this assessment is referred to the previously approved DIAs while the Colebrook White K_s roughness is referred to DSD-SDM. The surface roughness coefficients adopted in this assessment are summarized in:

Table 6-1 Surface's Roughness Coefficient

Surface Type	Manning's n	CW's k_s
Engineered channels (Smooth Concrete surfacing)	0.015	N/A
Engineered channels (Rough Concrete surfacing)	0.020	N/A
Engineered channels (Smooth Natural bed)	0.020	N/A
Engineered channels (Rough Natural bed)	0.025	N/A
Natural Channel	0.035	0.6
One culvert system with rough natural bed in MAI PO River CH1625	0.040	1.5
Concrete Pipe (Fair Condition)	0.015	N/A
Concrete Pipe (Bad Condition)	0.016	3.0

Note: same as the previous approved DIAs

7 PROPOSED CHANGES TO THE DRAINAGE CHARACTERISTICS

7.1 CHANGES IN LAND USE

7.1.1 The Application Site is a vacant lot with a combination of greenfield, access road and other impervious areas. The approved developments will lead to increase in paved surface and thus the CN value. The current amendment scheme will largely maintain the impervious and pervious coverage. The CN value for the Application Site under post-development scenario is estimated to be 90. The land use coverage and the corresponding CN values are detailed in **Table 7-1**.

Table 7-1 CN Values of Pre & Post Developments for the Application Site

Land Use	Area (m ²)	CN Value
Pre-Development		
Vacant Lot (Northern portion of Application Site – MP02A-a2)	47,400	100
Wetland Restoration Area	98,000	85
Vacant Lot	145,400	90
- Sub-total		
Vacant Lot (Southern Portion of Application Site – MP02A-a3)	62,000	85
Total	207,400	88.4
Post-Development (Previous Approved DIA in 2015)		
Wetland Restoration Area (MP02A-a9)		
Open Water Surface	34,500	100
Vegetated Area	12,900	100
- Sub-total	47,400	100
Residential Area (MP02A-aa, ab, ac, ad and ae)		
Paved Area	82,700	95
Vegetated Area	74,300	80
Pool Area	3,000	100
- Sub-total	160,000	88
Total	207,400	90.8
Post-Development (Previous Approved DIA in 2021)		
Wetland Restoration Area (MP02A-a9)		

Open Water Surface	34,500	100
Vegetated Area	12,900	100
- Sub-total	47,400	100
Residential Area (MP02A-aa, ab, ac, ad and ae)		
Paved Area	83,098	95
Vegetated Area	71,475	80
Pool Area	5,435	100
- Sub-total	160,008	88
Total	207,408	91.1
Post-Development (Previous Approved DIA in March 2024)		
Wetland Restoration Area (MP02A-a9)		
Open Water Surface	34,500	100
Vegetated Area	12,900	100
- Sub-total	47,400	100
Residential Area (MP02A-aa, ab, ac, ad and ae)		
Paved Area	97,776	95
Vegetated Area	62,232	80
Pool Area	730	100
- Sub-total	160,008	90
Total	207,408	92
Post-Development (Current Arrangement)		
Wetland Restoration Area (MP02A-a9)		
Open Water Surface	34,500	100
Vegetated Area	12,900	100
- Sub-total	47,400	100
Residential Area (MP02A-aa, ab, ac, ad and ae)		
Paved Area	106,189	95
Vegetated Area	48,716	80
Pool Area	5,103	100
- Sub-total	160,008	91
Total	207,408	93

7.1.2 CN value of abandoned ponds adopted in both the pre-development and post-development models is revised to 100 to reflect its hydrological characteristic. **Table 7-2 and**

Table 7-3 present the detailed CN values applied for both the pre- and post-development model.

Table 7-2 CN Values Applied for the Pre-Development Model

Catchment ID	Land Use	Percentage of Full Catchment	Area(m²)	CN Value
MP02A-a1	Abandoned Ponds	48.5%	373,800	100
MP02A-a2	Vacant Lot and Wetland Restoration Area – Northern Portion of proposed Development	18.8%	145,400	90
MP02A-a3	Vacant Lot – Southern Portion of proposed Development	8.1%	62,000	85
MP02A-a4	WSW Village	1.8%	13,700	90
MP02A-a5	Vacant Lots between Castle Peak Rd & Royal Palms	10.8%	82,800	85
MP02A-a6	Vacant Lots between Castle Peak Rd & Royal Palms	2.2%	17,100	85
MP02A-a7	Vacant Lot	2.7%	20,800	85
MP02A-a8	Vacant Lot	2.7%	20,800	85
Revised MP02A-a	Total	100.0%	770,300	93.4

Table 7-3 CN Values Applied for the Post-Development Model

Catchment ID	Land Use	Percentage of Full Catchment	Area(m²)	CN Value
MP02A-a1	Abandoned Ponds	48.5%	373,800	100
MP02A-a4	WSW Village	1.8%	13,700	90
MP02A-a5	Vacant Lots between Castle Peak Rd & Royal Palms	10.8%	82,800	85
MP02A-a6	Vacant Lots between Castle Peak Rd & Royal Palms	2.2%	17,100	85
MP02A-a7	Vacant Lot	2.7%	20,800	85
MP02A-a8	Vacant Lot	2.7%	20,800	85
MP02A-a9	Wetland Restoration Area	6.2%	47,400	100
MP02A-aa	Western Residential Portion of the Application Site	3.6%	27,580	91
MP02A-ab	Southern Residential Portion of the Application Site	7.8%	60,139	91
MP02A-ac	Mid-Western Residential Portion of the Application Site	2.8%	21,776	91
MP02A-ad	Mid-Eastern Residential Portion of the Application Site	2.7%	20,825	91
MP02A-ae	Eastern Residential Portion of the Application Site	3.9%	29,698	91
Revised MP02A-a	Total	100.0%	770,300	95

Note: The land-use information for post-development is the same as the previous approved DIAs

7.1.3 The model network illustrating the chainage along Mai Po River is shown in **Figure 1**. The hydrological model parameters for the re-delineated MP02A-a for both the pre- and post-development models is attached in **Appendix E**.

8 PROPOSED DRAINAGE ARRANGEMENT AND MITIGATION MEASURES

8.1 OVERVIEW OF PROPOSED DRAINAGE ARRANGEMENT AND MITIGATION MEASURES

8.1.1 Following the previous approved DIAs, the proposed drainage system will mainly comprise of an approximate 300m long 3.5m(W) x 2.5m(H) box culvert and a drainage pipe network of pipe size ranging from 1050mm to 2100mm dia as shown in **Figure 6**. The box culvert will drain the eastern portion of the Application Site (MP02A-ae) as well as the runoff from the vacant lots between Castle Peak Road and Royal Palms while the pipe network will convey the runoff from Wo Shang Wai Village (MP02A-a4) and western and central portions of the Application Site (MP02A-aa, ab and ac). The runoff from catchment MP02A-ad within the Application Site will be drained via the 1350mm drainage pipe next to the 2100mm pipe.

8.1.2 All these drains will be discharged to Mai Po Tributary at the northern site boundary. This drainage arrangement within the Application Site is indicated in **Figure 6**.

8.2 DETENTION BY THE AS-BUILT WETLAND RESTORATION AREA

8.2.1 Wetland Restoration Area has been constructed, in accordance with the town planning approvals. It will attenuate the discharge from the proposed development to mitigate the potential adverse drainage impact due to loss in flood storage volume and increase in CN values. The drainage system of Wetland Restoration Area (i.e.MP02A-a9) is totally independent from the drainage system of the residential areas of the development.

8.2.2 The Wetland Restoration Area only collects runoff generated within itself. No runoff generated from residential areas of development is discharged to WRA or vice versa even during the severe rainstorm event.

8.2.3 To attenuate the discharge from Wetland Restoration Area, it is designed to be a large detention pond. The attenuation effect of the Wetland Restoration Area has been achieved by its large buffer volume in conjunction with the outlet structures that control the discharge flow rate.

8.2.4 The outlet structures compose of twin 225mm pipes and a 4m wide emergency bypass spillway with invert level at 4.2mPD and 4.65mPD respectively. The twin 225mm pipes are for control of normal water level and the spillway is for relieving excessive flow. The rating curves for outlet structures and discharge hydrographs under various scenarios are shown in **Appendix F**. As illustrated on the hydrographs, the runoff from Wetland Restoration Area has been significantly attenuated and the peak discharges from WRA will be trimmed to about 10% of the peak inflow.

8.2.5 According to the assessment result, the freeboards of Wetland Restoration Area (i.e., measured from the embankment level at 5.0mPD) under 50yr and 200yr ARI events are both more than 200mm.

8.2.6 After passing of a 50yr ARI rainstorm, it would take approximate 1 day to drain back to normal water level which is at 4.2mPD. Penstocks will be installed, so that the drain-off process can speed up if necessary.

8.3 RE-PROVISION OF DRAINAGE PATH – WO SHANG WAI VILLAGE

8.3.1 The runoff within WSW Village is currently discharged to the Application Site via a storage pond and pumping system maintained by the local villagers, then discharges to Mai Po Tributary through the western ditch in the Application Site, as shown in **Figure 3**. Upon completion of the development, the existing western ditch will be backfilled and a designated drain with diameter 1050mm to 2100mm will be re-provided for conveying the flow from the outlets of the pump to Mai Po Tributary. This drainage pipe will also convey the runoff from western and central portions of the Application Site (MP02A-aa, ac and ad). The arrangements of the inlets and outlets are the same as the previous approved DIAs.

8.3.2 The discharge from WSW Village will be collected by an inlet chamber within the Application Site. Openings will be provided at the existing invert level of the discharge pipes, which is at +4.2mPD, for connection. The runoff will be conveyed to Mai Po Tributary by a designated drainage system mentioned above. Therefore, the proposed development would not change the discharge pattern of Wo Shang Wai Village drainage system as approved.

8.3.3 Consideration is also given to the scenario that the existing pumps at Wo Shang Wai Village become malfunction during severe rainstorm event. Under such scenario, runoff from Wo Shang Wai Village cannot discharge to the surrounding area and will be cumulated within the village. According to Table 4 of Stormwater Drainage Manual, a total of 446mm depth of rainfall will be incurred under a 200yr return period 4-hour rainfall event. In this connection, the water level at Wo Shang Wai Village will reach approximately +3.3mPD. However, the water will not overflow to the Application Site as there is a bund at the northern boundary of Wo Shang Wai Village which at the level of +3.7mPD. In this regard, a 1.7m wide emergency bypass channel with invert level of +3.6mPD would be provided at the boundary of WSW Village and connected to the proposed inlet chamber. The emergency bypass channel serves to collect discharge from other emergency pumps that operated under the abovementioned emergency scenario. This arrangement is the same as the previous approved DIAs.

8.3.4 A flap valve will be installed at the outfall of the designated pipe to prevent backwater effect from Mai Po Tributary. Since no proposed measures will be carried out in Wo Shang Wai Village, the existing pumping configuration from WSW Village will be unchanged.

8.4 RE-PROVISION OF DRAINAGE PATH - VACANT LOTS BETWEEN CASTLE PEAK RD & ROYAL PALMS, SAME AS PREVIOUS APPROVED DIAS

8.4.1 Since the existing eastern ditch and the 2x2m dia pipes will be backfilled by the previous approved development, a 3.5m(W) x 2.5m(H) box culvert is proposed in the previous approved DIAs to convey the runoff from the area between Royal Palms and Castle Peak Road – Mai Po (MP02A-a5), a section south of Royal Palms (MP02A-a6) and parts of the Application Site. The box culvert will have a larger hydraulic capacity than the existing ditch.

8.4.2 The box culvert is sized for the 1 in 50-year design return period according to the recommendation in Table 10 of the DSD-SDM. The box culvert has been designed to capture the discharge from the existing triple 1.35m diameter culvert as discussed in **Section 3.3**. This arrangement is the same as the previous approved DIAs. A trash grille and outlet will be provided at the final discharge point of the box culvert that connects to Mai Po Tributary.

8.5 MISCELLANEOUS, SAME AS PREVIOUS APPROVED DIAS

8.5.1 Bank protection measures will be provided at the outfalls of the proposed drainage system to minimize the risk of scouring and erosion of the riverbed.

9 ASSESSMENT ON DRAINAGE IMPACT

9.1 ASSESSMENT OF MAI PO TRIBUTARY AND MAI PO RIVER

9.1.1 With the incorporation of the proposed mitigation measures stipulated in **Section 8** following the previous approved DIAs, hydraulic performance of the Application Site, Mai Po Tributary and Mai Po River is assessed according to the methodology stipulated in **Section 5**. The results of peak runoff, total runoff and max water level under 50ARI event are summarized in **Table 9-1**, **Table 9-2** and **Table 9-3**, respectively.

Table 9-1 Change in Peak Discharge from the Application Site

Rainfall return-periods (Yr)	Pre-development peak discharge (m ³ /s)	Post-development peak discharge (m ³ /s)	Change in peak discharge (m ³ /s)	Change in peak discharge (%)
2yr	9.76	9.98	0.23	2.32%
10yr	12.78	12.98	0.20	1.57%
50yr	14.76	14.95	0.19	1.31%
200yr	16.10	16.29	0.18	1.14%

Note: Values based on scenario C, AMC 3

Table 9-2 Change in Total Runoff from the Application Site

Rainfall return-periods (Yr)	Total Runoff from Pre-Developed Application Site (m ³)	Total Runoff from Post-Developed Application Site (m ³)	Change in Total Runoff (m ³)	Change in Total Runoff (%)
2yr	34,456	35,899	1,443	4.19%
10yr	55,381	56,876	1,495	2.70%
50yr	73,530	75,050	1,520	2.07%
200yr	89,269	90,805	1,537	1.72%

Note: Values based on scenario C, AMC 3

Table 9-3 Change in Water Level along Mai Po River and Mai Po Tributary under 50yr ARI

River chainage (m)	Water level(mPD) Pre-development			Water level(mPD) Post-development			Change in water level(m)		
	50A	50B	50C	50A	50B	50C	50A	50B	50C
0	3.778	3.934	3.835	3.771	3.934	3.833	-0.007	0.000	-0.002
690	3.772	3.929	3.827	3.763	3.928	3.823	-0.009	-0.001	-0.004

980	3.767	3.926	3.822	3.759	3.926	3.818	-0.008	0.000	-0.004
1150	3.757	3.922	3.812	3.747	3.922	3.807	-0.010	0.000	-0.005
1620	3.750	3.927	3.809	3.739	3.927	3.804	-0.011	0.000	-0.005
1880	3.574	3.890	3.657	3.560	3.890	3.647	-0.014	0.000	-0.010

9.1.2 The change in water level along Mai Po Tributary and Mai Po River under 2yr, 10yr, 50yr and 200yr ARI events are summarized in **Appendix H**.

9.1.3 Although there will be loss in flood storage and increase in CN value, by the detention effect of the as-built Wetland Restoration Area at the northern part of the Application Site independent from the drainage system of the residential areas, the peak discharge and total runoff from the Application Site will be slightly increased and there will be no adverse drainage impacts to the Application Site, Mai Po Tributary and Mai Po River under 50yr ARI event. This arrangement is the same as the previous approved DIAs.

9.1.4 The water level at Mai Po River and Mai Po Tributary would not increase due to the change. The simulation results indicated a slight decrease in water level under the post-development scenarios under case 50A, B and C, as shown in **Table 9-3**. It is concluded that the recommendation made in the previous approved DIAs is adequate to mitigate the potential drainage impact due to the revised master layout.

9.2 ASSESSMENT OF DESIGNATED DRAIN FOR WESTERN PORTION

9.2.1 As revealed by the model simulation results in **Appendix I**, the water level at the outlet of the designated drain for Wo Shang Wai is much lower than the ground level of the Application Site (7.4mPD). In this regard, the designated drain will not incur adverse impact to the Application Site.

9.3 ASSESSMENT OF PROPOSED 3.5M(W) X 2.5M(H) BOX CULVERT

9.3.1 Since the current proposal following the previous approved DIAs will have a larger hydraulic capacity than the existing ditch, there will be no adverse drainage impact to Application Site. The freeboard of the box culvert at the outlet is shown in **Appendix J**.

9.4 ASSESSMENT OF IMPACT OF ADDITIONAL TREATED EFFLUENTS

9.4.1 Under an optional scenario as proposed in the Sewage Impact Assessment to manage the sewage generation from the proposed development, 3,732.04m³/day of treated water after tertiary treatment of Membrane Bioreactor process by a temporary on-site sewage treatment plant which will be discharged to Mai Po Tributary. Assume the worst case that this water will be discharged to Mai Po Tributary in 4 hours per day (same as the rainfall duration under assessment), so the additional flow rate of the treated water is 0.26m³/s. The flow rate of the treated water from the on-site sewage treatment plant will only increase by about 1.7% of the peak flow rate from Application Site under 50-year return period, which has insignificant impact on assessment results mentioned in **Section 9.1** and water level of Mai Po River.

10 TEMPORARY DRAINAGE ARRANGEMENT

10.1.1 Due to previous XRL project developed by MTRC, the existing ditch along the eastern boundary of the Application Site together with the portion of the Application Site was diverted. The completed diversion channel continues to collect the runoff from the Application Site and the area to the south of the Application Site. The proposal for the Temporary Drainage Diversion Scheme has been submitted to DSD in May 2009 and has since been approved by DSD/MN on the 11 June 2009 with no further comment. Please refer to **Appendix K** for the proposed temporary drainage diversion scheme.

10.1.2 The runoff from Mai Po Lo Wai and Mai Po San Tsuen was collected by the existing 1350mm diameter and 600mm diameter pipes and discharged to Mai Po Tributary via the aforesaid ditch (**Appendix K**). Currently, the aforesaid ditch had been filled up. As confirmed with MTRCL, some temporary drainages were constructed by them to divert the flow bypassing the ditch to the Mai Po Tributary.

11 MAINTENANCE RESPONSIBILITIES

11.1.1 Following the previous approved DIAs, the Applicant will be responsible for the maintenance of all surface channels, underground drainage system and stormwater retention facilities within the Application Site, including designated drainage facilities for conveying runoff generated from Wo Shang Wai Village and the area between Royal Palms and Castle Peak Road – Mai Po.

11.1.2 The designated drainage system serving Wo Shang Wai Village within the Application Site will be maintained by the Applicant while the storage pond and the pumps within Wo Shang Wai Village will be maintained by the villagers.

11.1.3 The maintenance responsibility of all drainage facilities outside the Application Site will remain unchanged.

12 SUMMARY AND CONCLUSIONS

12.1.1 The previous approved residential development comprises of residential buildings, a communal garden area, a restored wetland and residential facilities. The total site area is approximately 207,408m².

12.1.2 To offset the loss in storage volume after development, a Wetland Restoration Area has been built, which has a sufficient detention effect to mitigate the potential drainage impacts. The drainage system of the Wetland Restoration Area (i.e.MP02A-a9) is totally independent on the drainage system of the residential areas of the proposed development.

12.1.3 The permanent drainage system for the proposed development will comprise of an approximately 300m (L) x 2.5m(H) x 3.5m(W) box culvert and a drainage pipe network of pipe sizes ranging from 1050mm to 2100mm in diameter. The box culvert will drain the eastern portion of the Application Site (MP02A-ae) and the runoff from the vacant lots between Castle Peak Road and Royal Palms, while the pipe network will convey the runoff from Wo Shang Wai Village (MP02A-a4) and western and central portions of the Application Site (MP02A-aa, ac and ad). The runoff from catchment MP02A-ab within the Application Site will be drained via a 1350mm drainage pipe next to a 2100mm pipe.

12.1.4 The DIA for the previously approved Section 16 Planning Application was approved for all the ground work. The mitigation measures outlined in **Section 8** above are in line with the previous approved DIAs. Subsequent to the currently proposed revision of the Master Layout Plan, the DIA has been updated and the same mitigation measures are incorporated. These proposed mitigation measures are sufficient to mitigate the potential drainage impacts of the change in master layout. It is concluded that the completion of the proposed development will not aggravate the flooding conditions around the Application Site.

12.1.5 Under an optional scenario as proposed in the Sewage Impact Assessment to manage the sewage generation from the proposed development, 3,732.04m³/day of treated water from a temporary on-site sewage treatment plant within the Application Site will be discharged to Mai Po Tributary. Even under the worst case that this water will be discharged to Mai Po Tributary in 4 hours per day, the flow rate of the treated water of 0.26m³/s from the on-site sewage treatment plant will only increase by about 1.7% of the peak discharge from Application Site under 50-year return period, which has insignificant impact on assessment results and water level of Mai Po River.


12.1.6 Temporary drainage arrangement within the site will be implemented during construction stage to avoid imposing unacceptable flood risk to the adjacent areas.

12.1.7 Temporary drainage diversion of the existing ditch channel trespasses through the Application Site had been completed out to cater for the existing discharge from area between Royal Palms and Castle Peak Road. The runoff from the above-mentioned area and the runoff collected by the existing channel along the southern side of the Application Site will be

completely intercepted into the proposed temporary drainage system before discharging into the Mai Po Tributary.

12.1.8 The Applicant will take up the maintenance responsibilities for the proposed drainage system inside the Application Site including the proposed main trunk box-culvert and designated drainage system for WSW Village and its outfall structure.

Figures

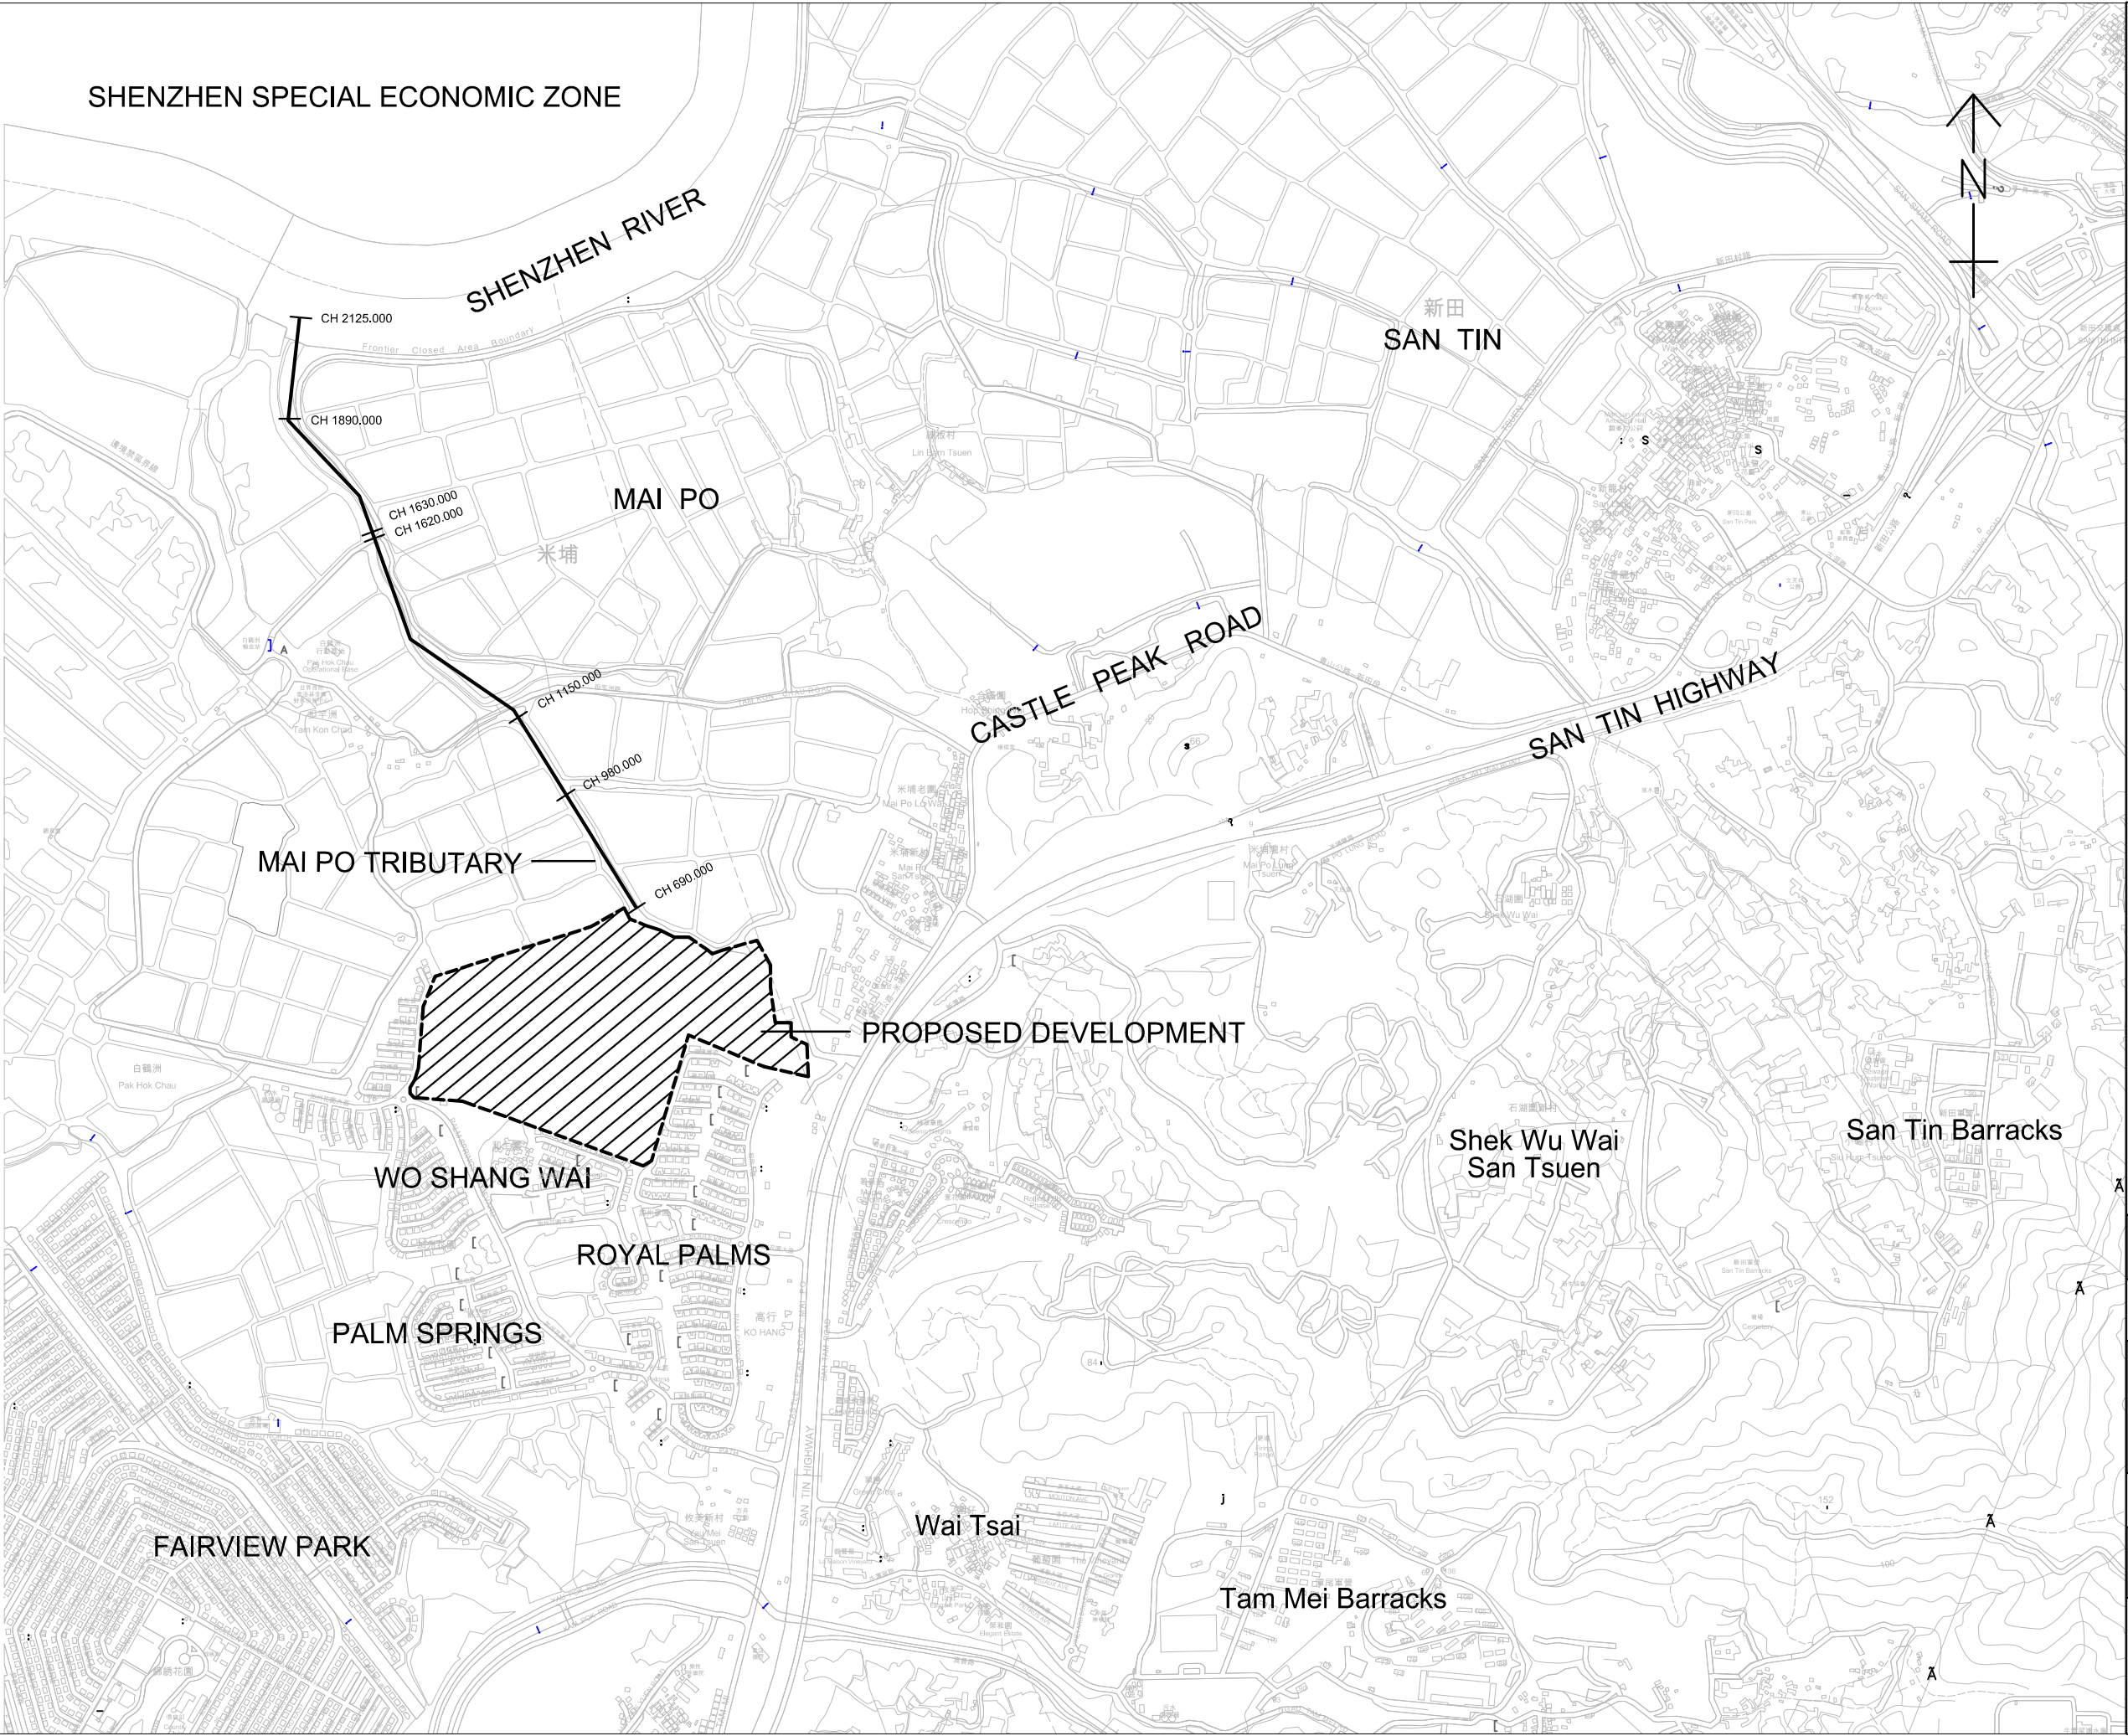

LEGEND




PROPOSED DEVELOPMENT

CH690

RIVER CHAINAGE OF MAI PO RIVER DEFINED IN MIKE 11 MODEL

WSP HONG KONG LIMITED
PROPOSED COMPREHENSIVE DEVELOPMENT AT WO SHANG WAI, YUEN LONG
LOCATION PLAN OF PROPOSED DEVELOPMENT
FIGURE 1

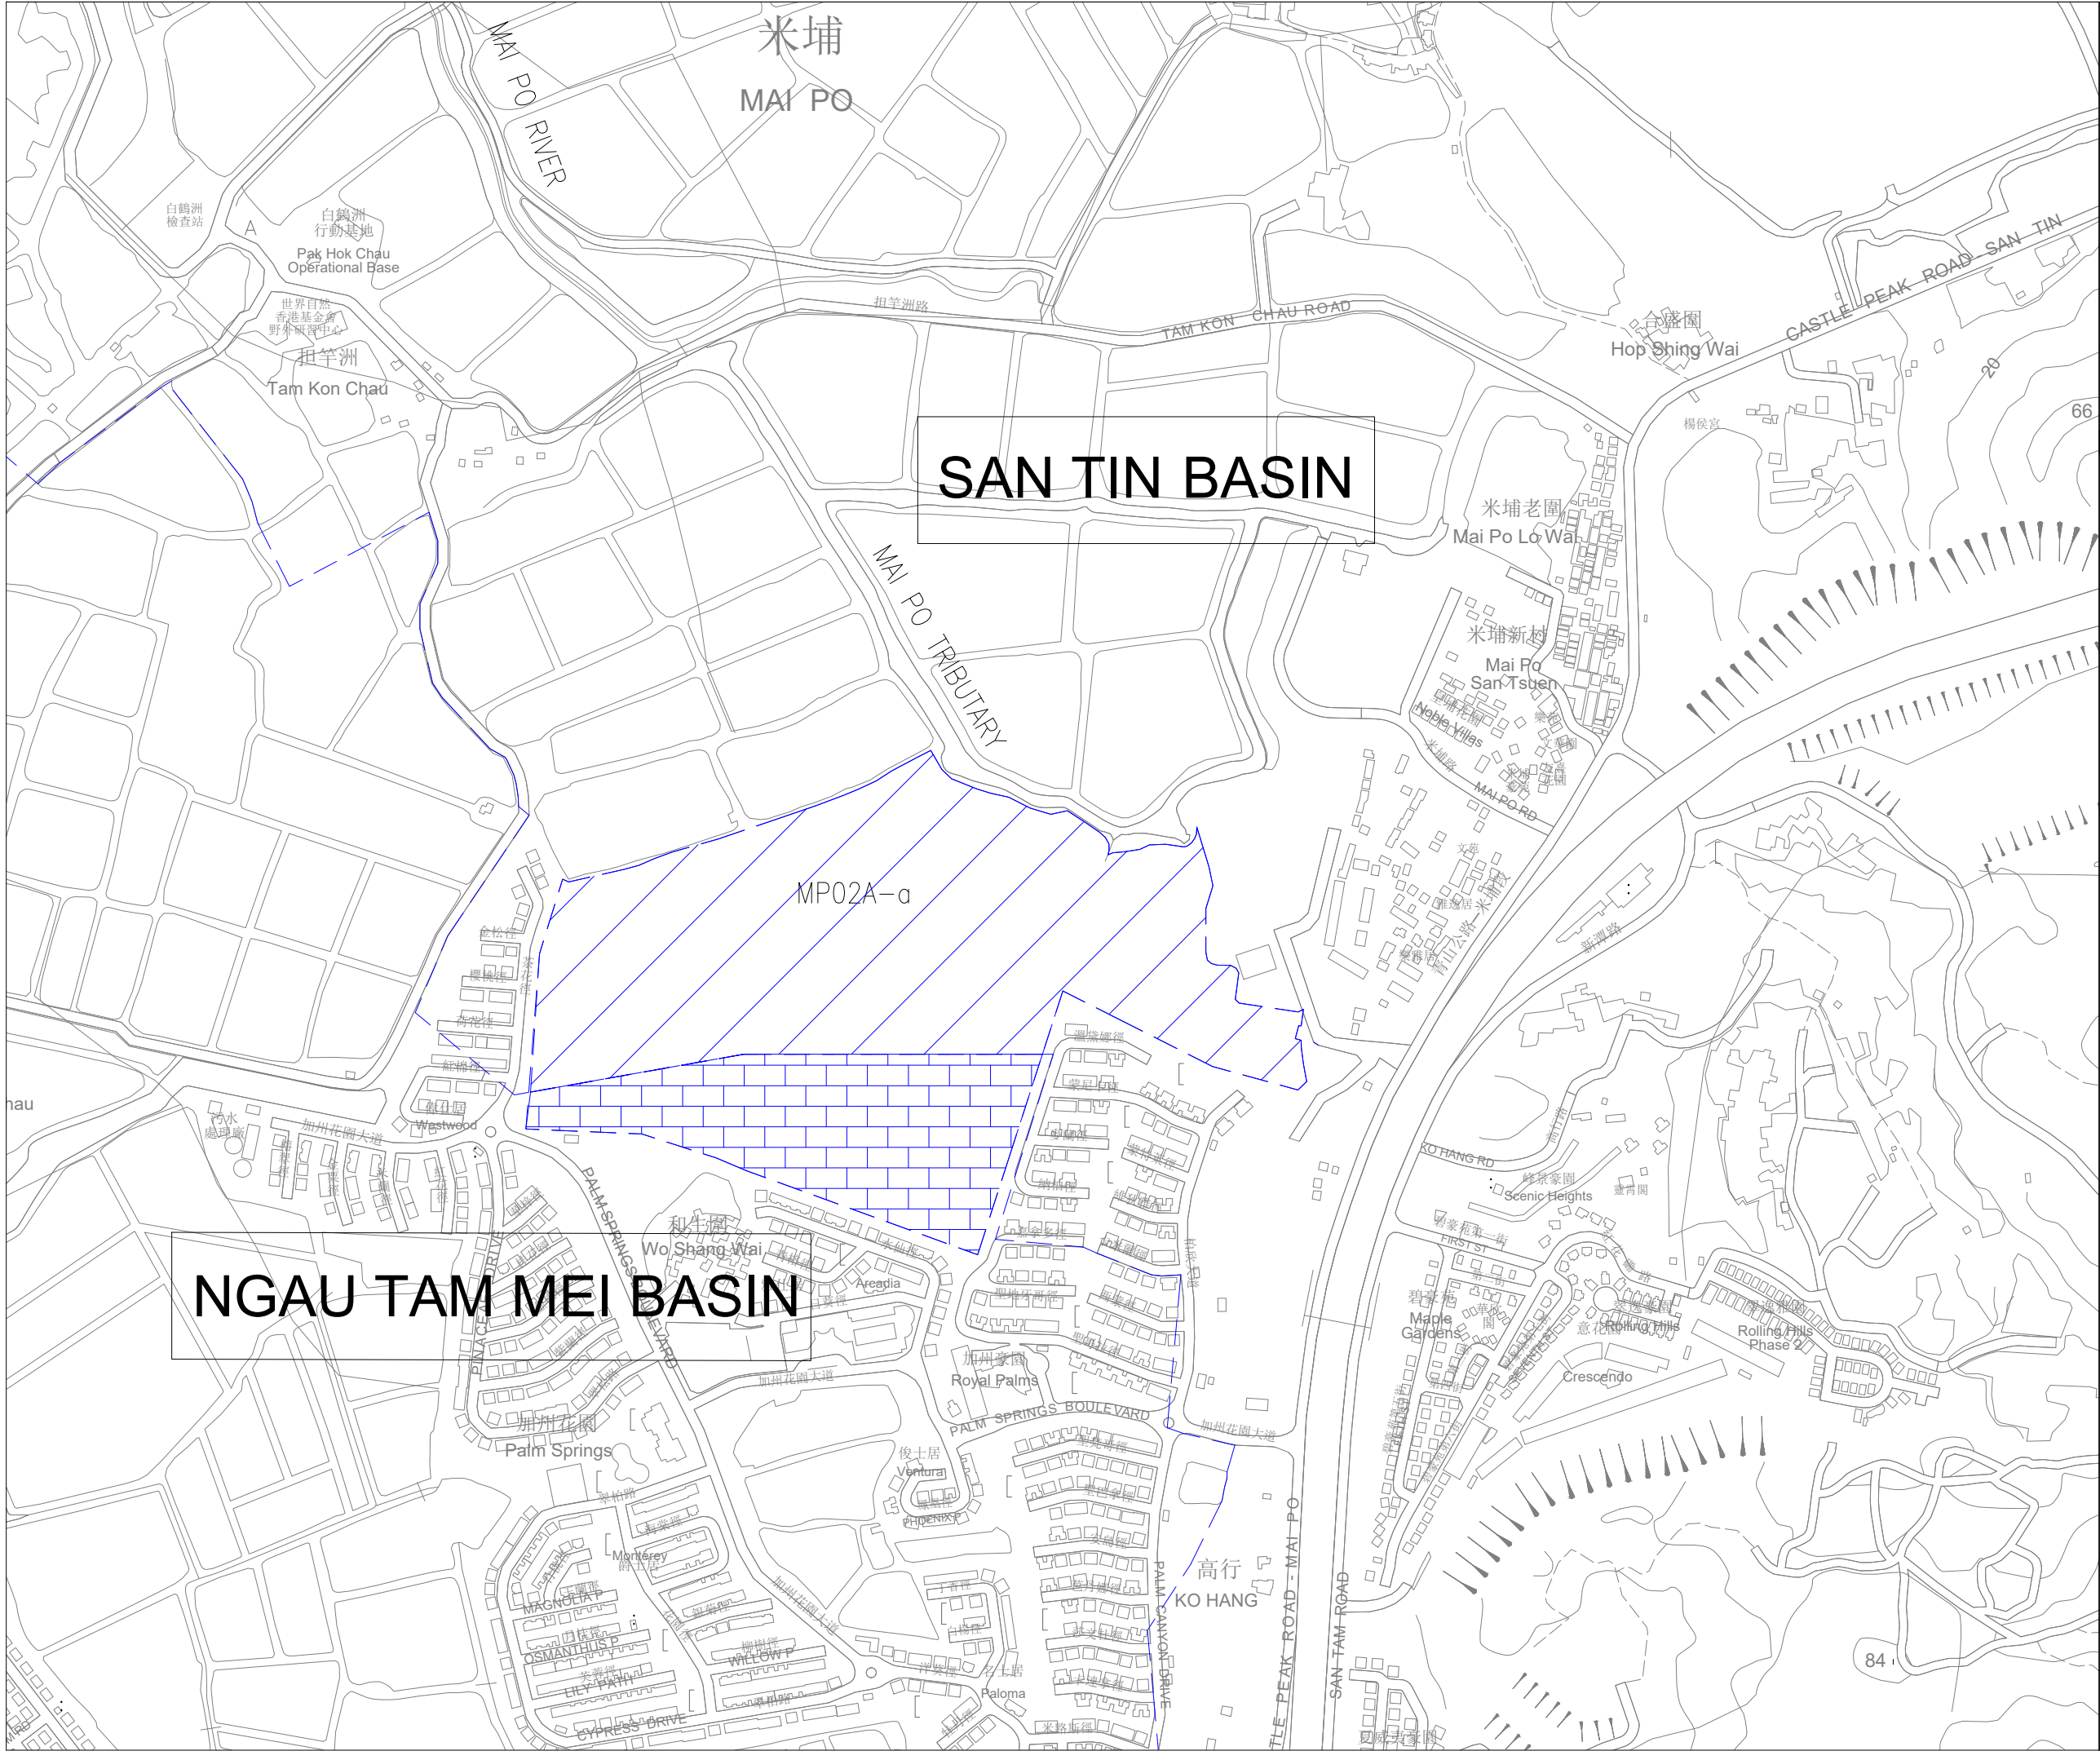

LOCATION PLAN

LEGENDS:


SUB-CATCHMENT MP02A-α
AS PER NORTHERN NEW
TERRITORY DRAINAGE MASTER
PLAN

APPLICATION SITE WITHIN SAN
TIN BASIN

APPLICATION SITE WITHIN
NGAU TAM MEI BASIN

Rev	Description	By	Date
Consultant			
Project title			
DRAINAGE IMPACT ASSESSMENT			
To Amend the Notes of the "Comprehensive Development to include Wetland Restoration Area" Zone for a Proposed Comprehensive Development at Wo Shang Wai, Yuen Long, Lots 77 and 50 S.A in DD101			
Drawing title			
SUB-CATCHMENT PLAN OF MP02A-α			
Drawing no.		Rev.	
Figure 2		0	
Drawn	Date	Checked	Approved
JX	AUG2024	-	-
Scale	1:3000	Status	

© COPYRIGHT RESERVED

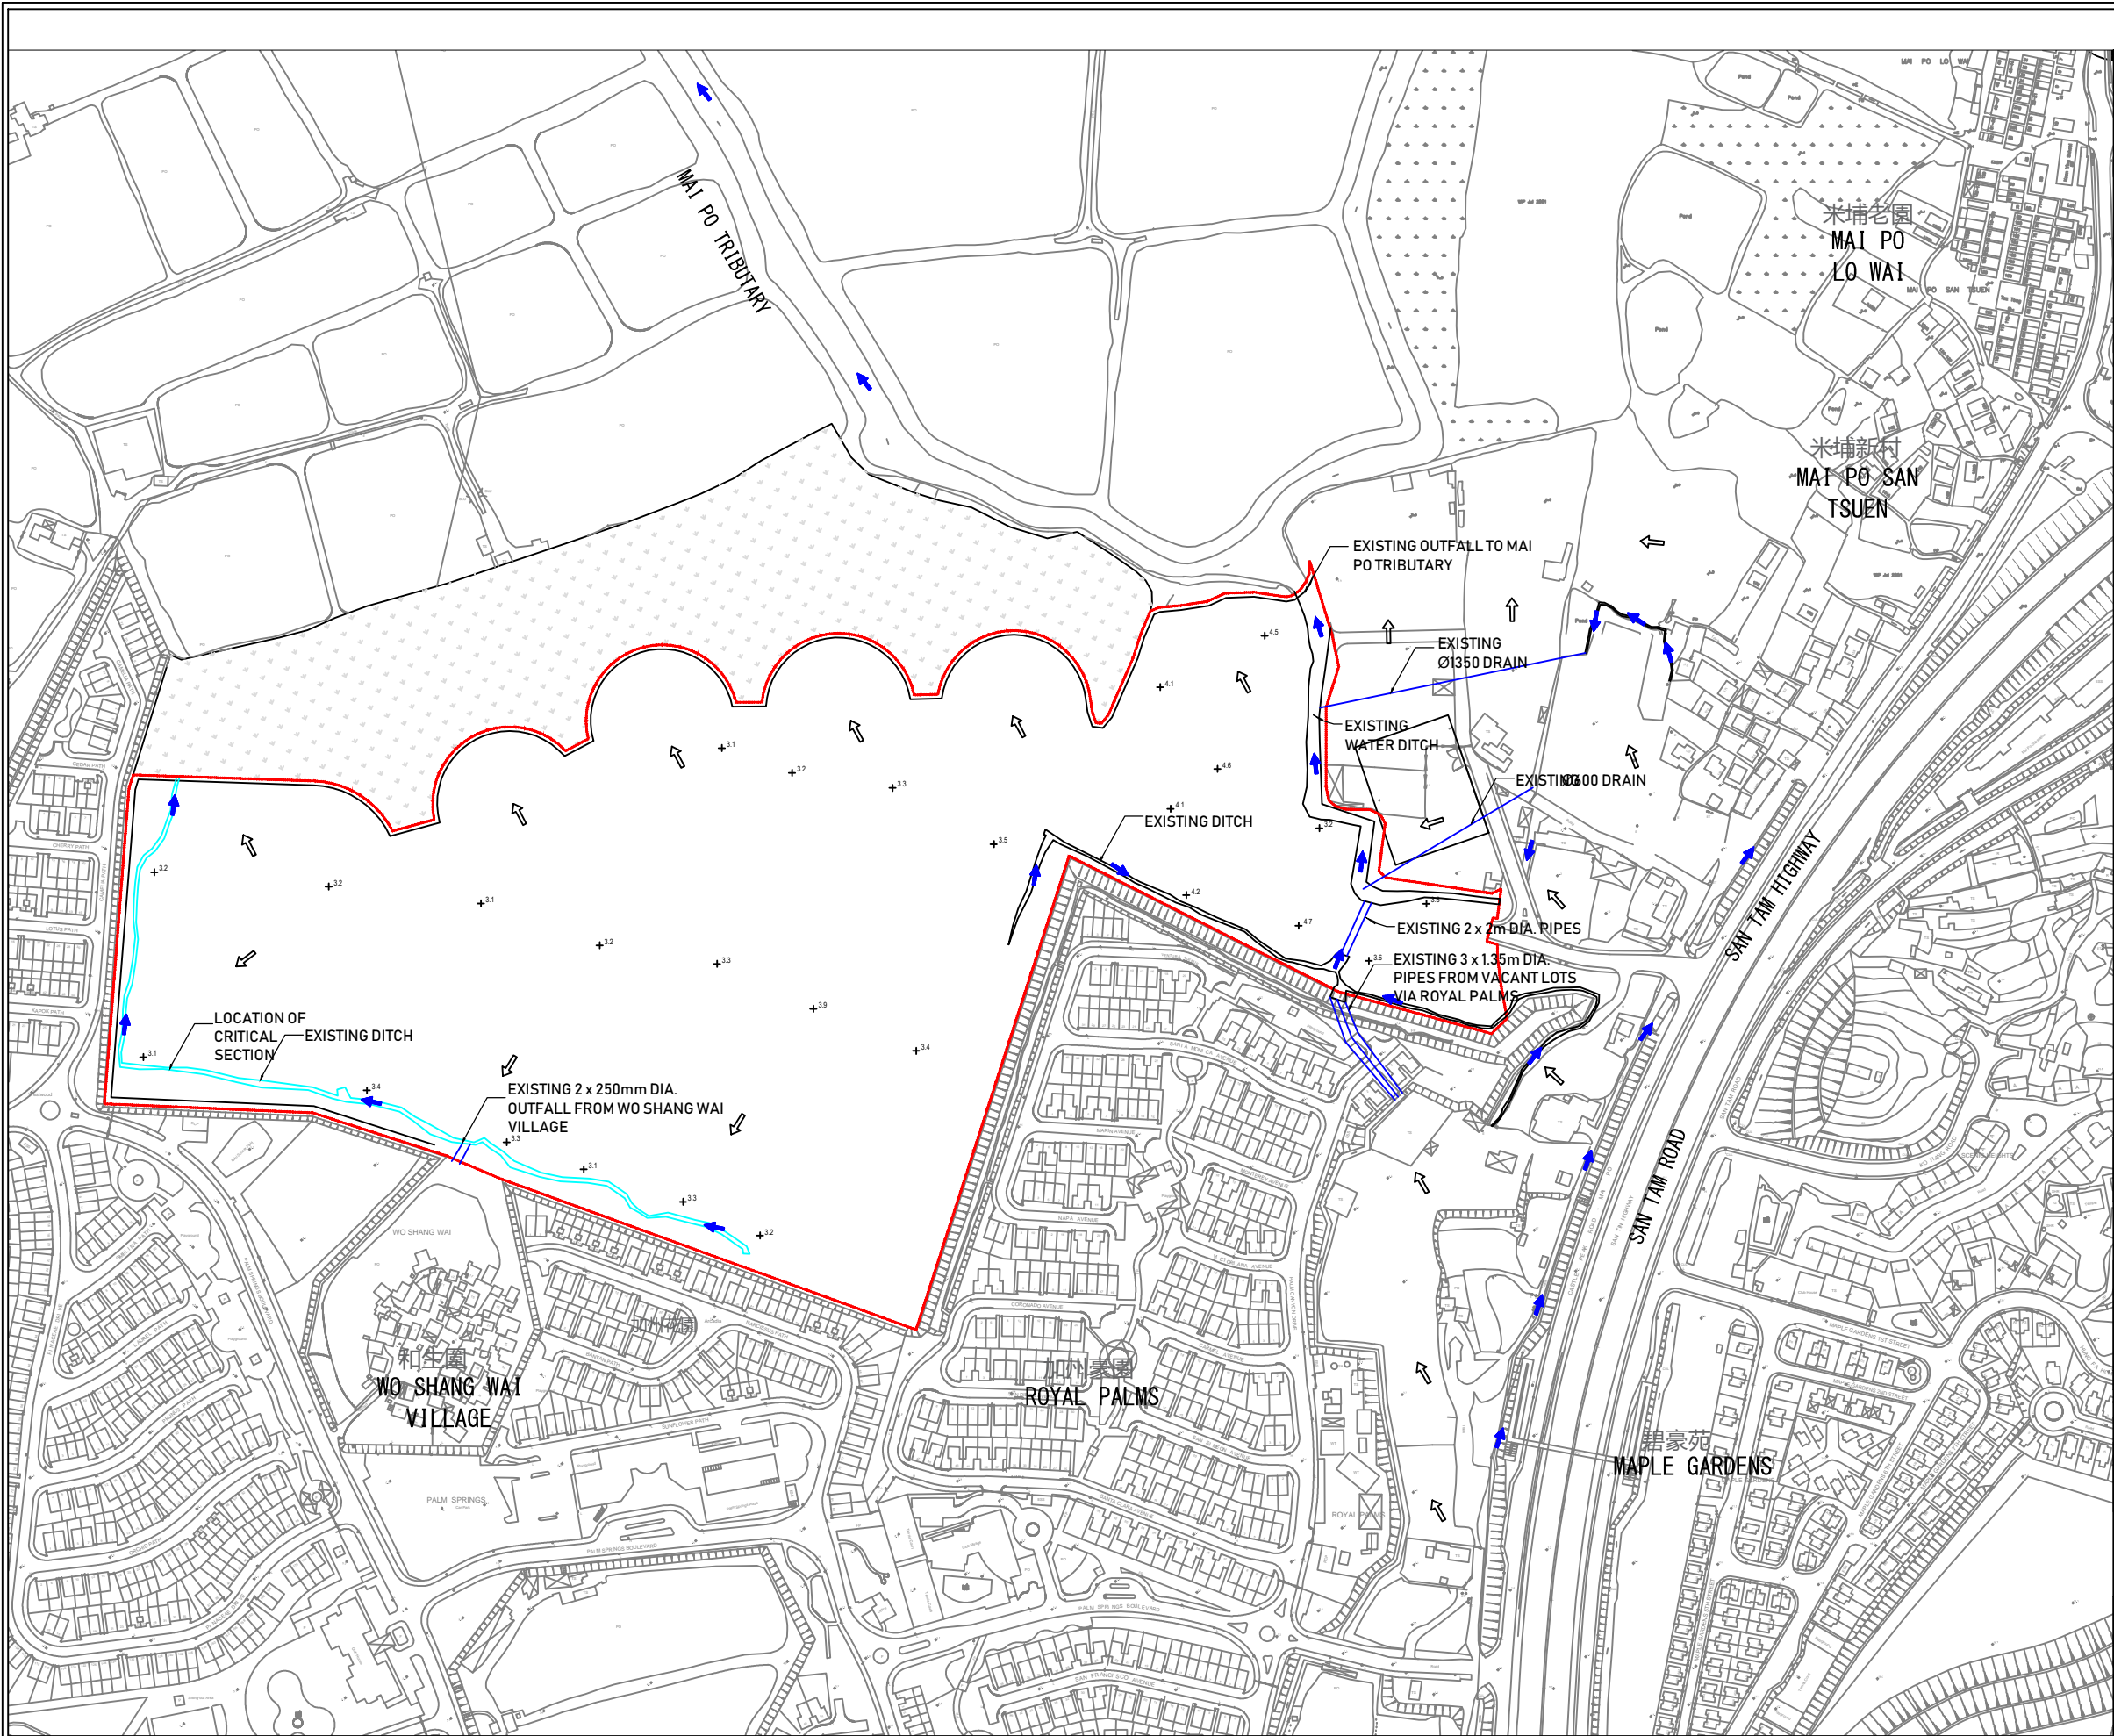

LEGEND

- PROPOSED DEVELOPMENT SITE
- EXISTING OVERLAND FLOW PATH
- EXISTING OPEN CHANNEL
- CHANNEL/DITCH FLOW DIRECTION
- EXISTING GROUND LEVEL
- EXISTING PIPE

WSP HONG KONG LIMITED

PROPOSED COMPREHENSIVE DEVELOPMENT AT WO SHANG WAI, YUEN LONG

EXISTING DRAINAGE IN THE VICINITY OF THE PROPOSED DEVELOPMENT



FIGURE 3


DRG. NO.
圖紙編號

CLIENT :

DRAWN BY
繪圖

APPROVED
批准人

SCALE
比例

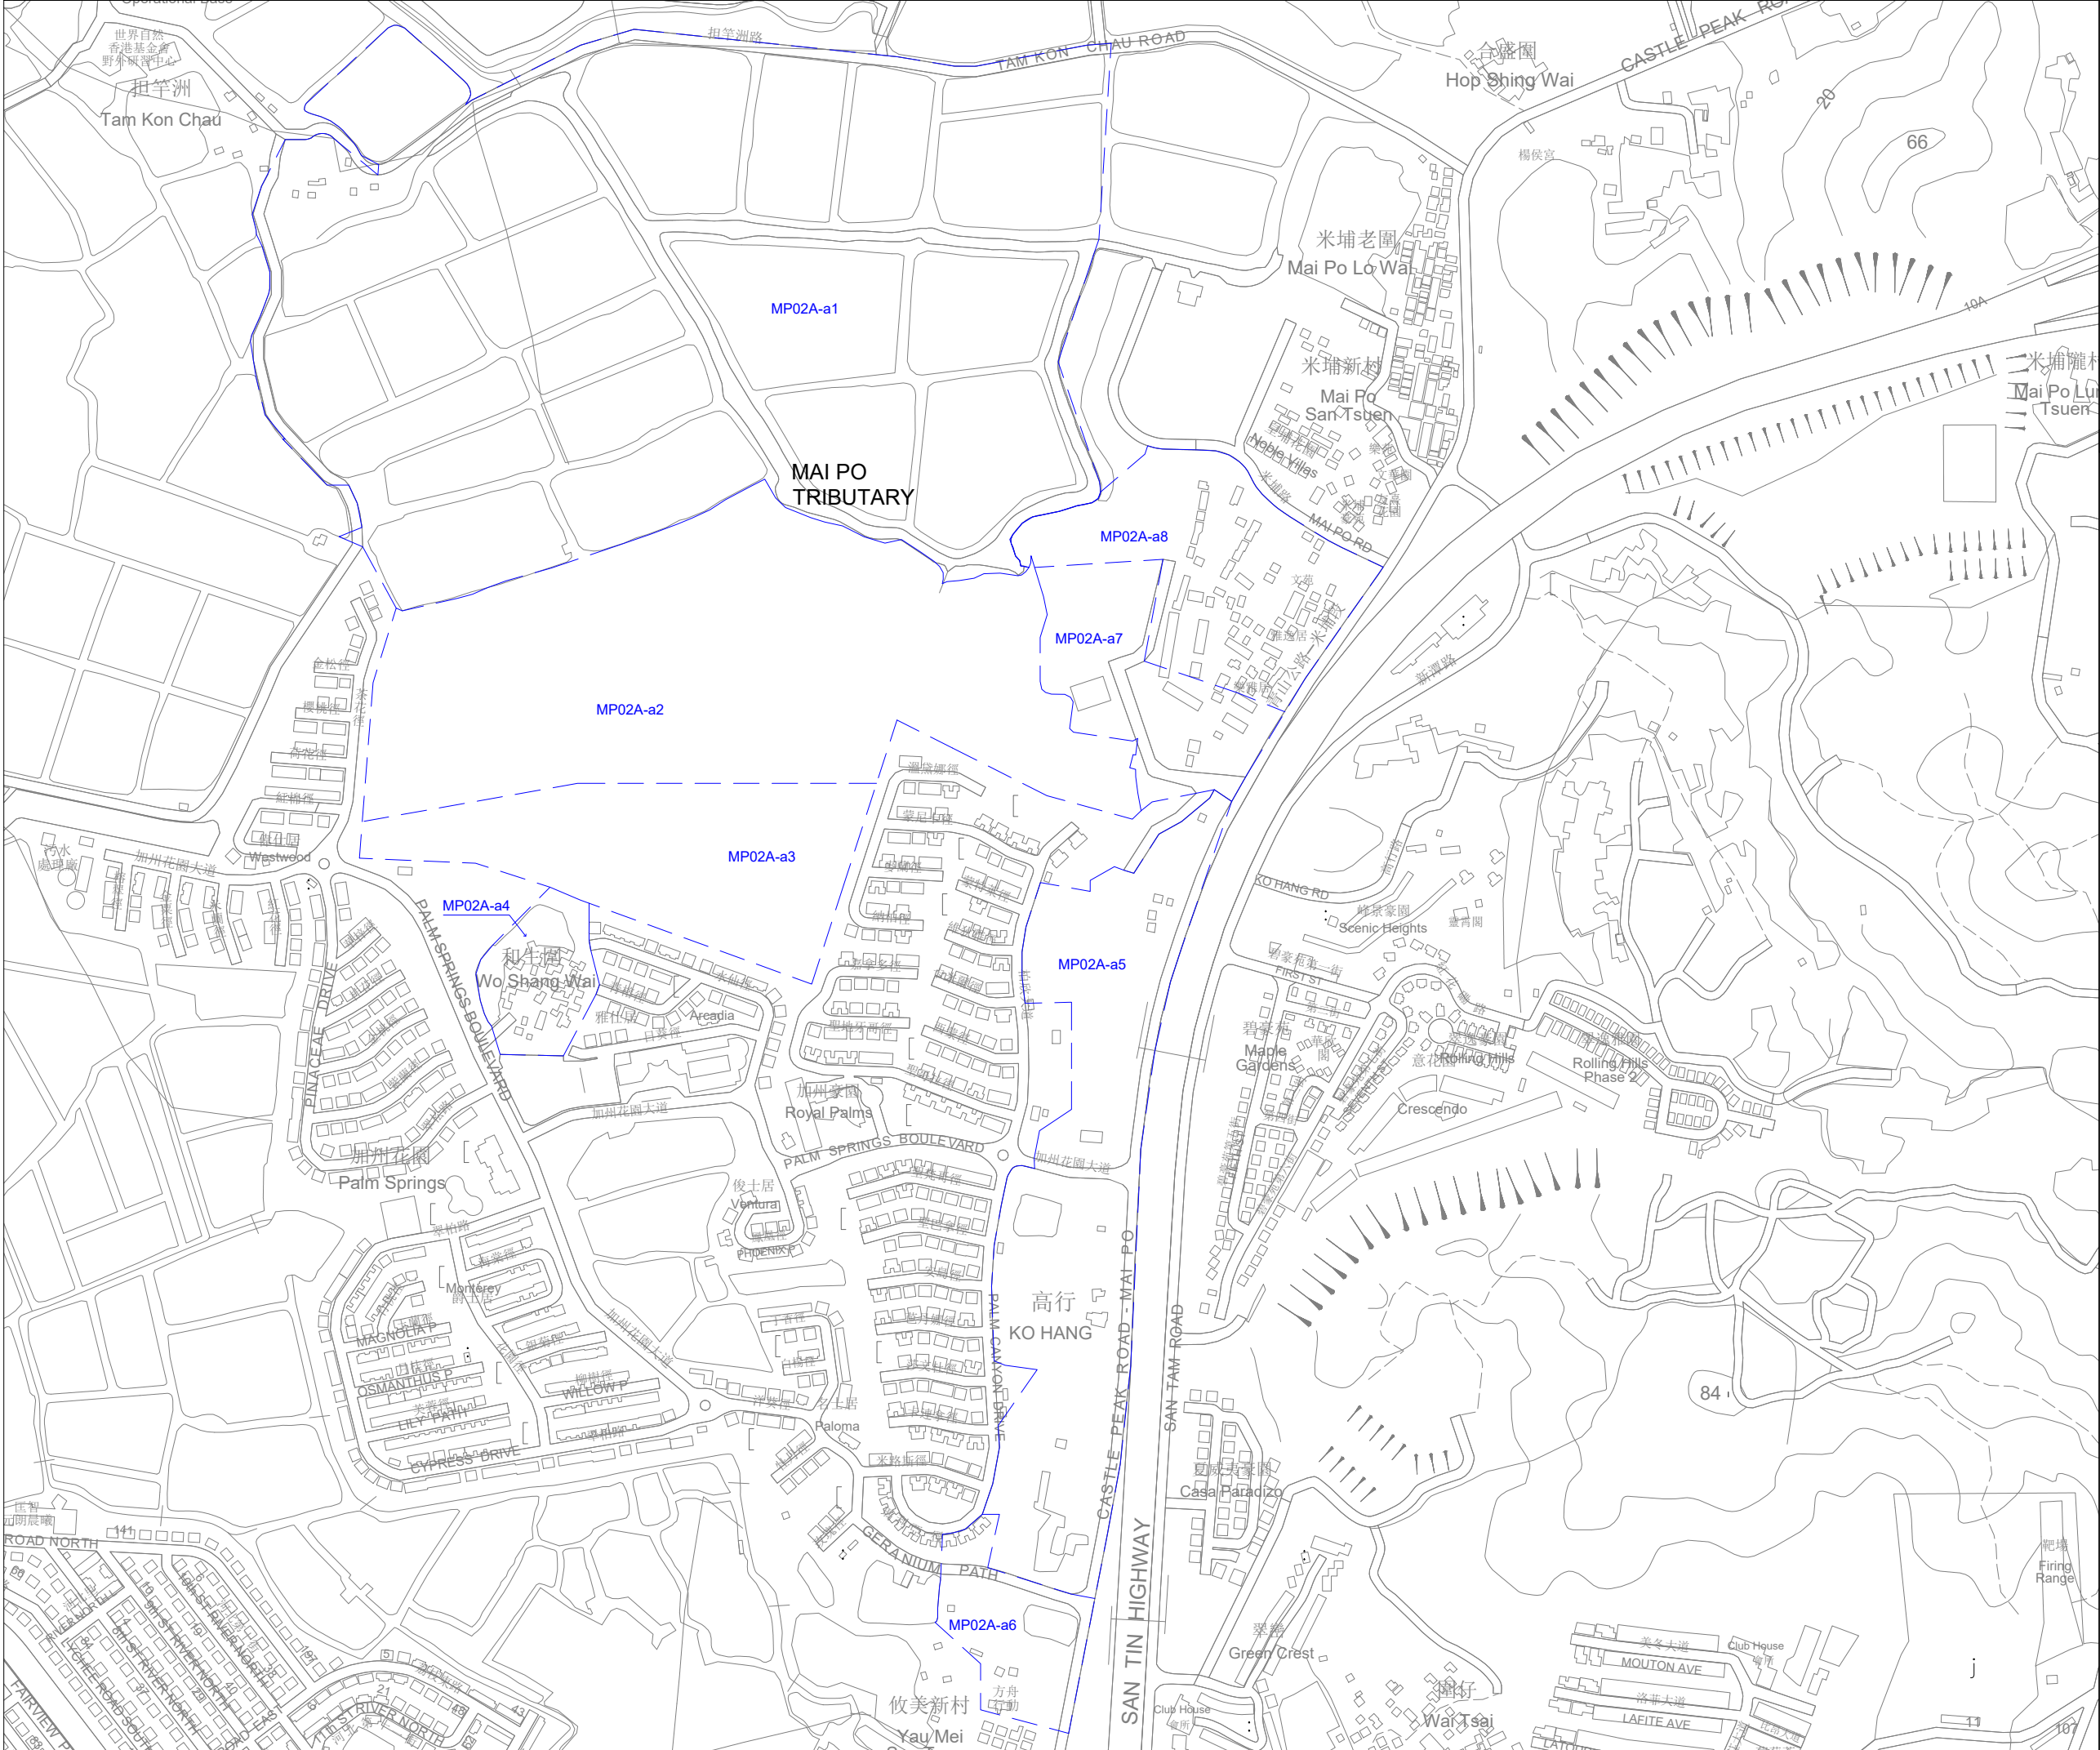


LOCATION PLAN

LEGENDS:

SUB-CATCHMENT BOUNDARY

Rev	Description	By	Date
Consultant			
Project title			
DRAINAGE IMPACT ASSESSMENT			
To Amend the Notes of the "Comprehensive Development to include Wetland Restoration Area" Zone for a Proposed Comprehensive Development at Wo Shang Wai, Yuen Long, Lots 77 and 50 S.A in DD101			
Drawing title			
SUB-CATCHMENT PLAN OF MP02A-a FOR PRE-DEVELOPMENT MODEL			
Drawing no.		Rev.	
Figure 4		0	
Drawn	Date	Checked	Approved
JX	AUG2024	-	-
Scale	1:3000	Status	

© COPYRIGHT RESERVED

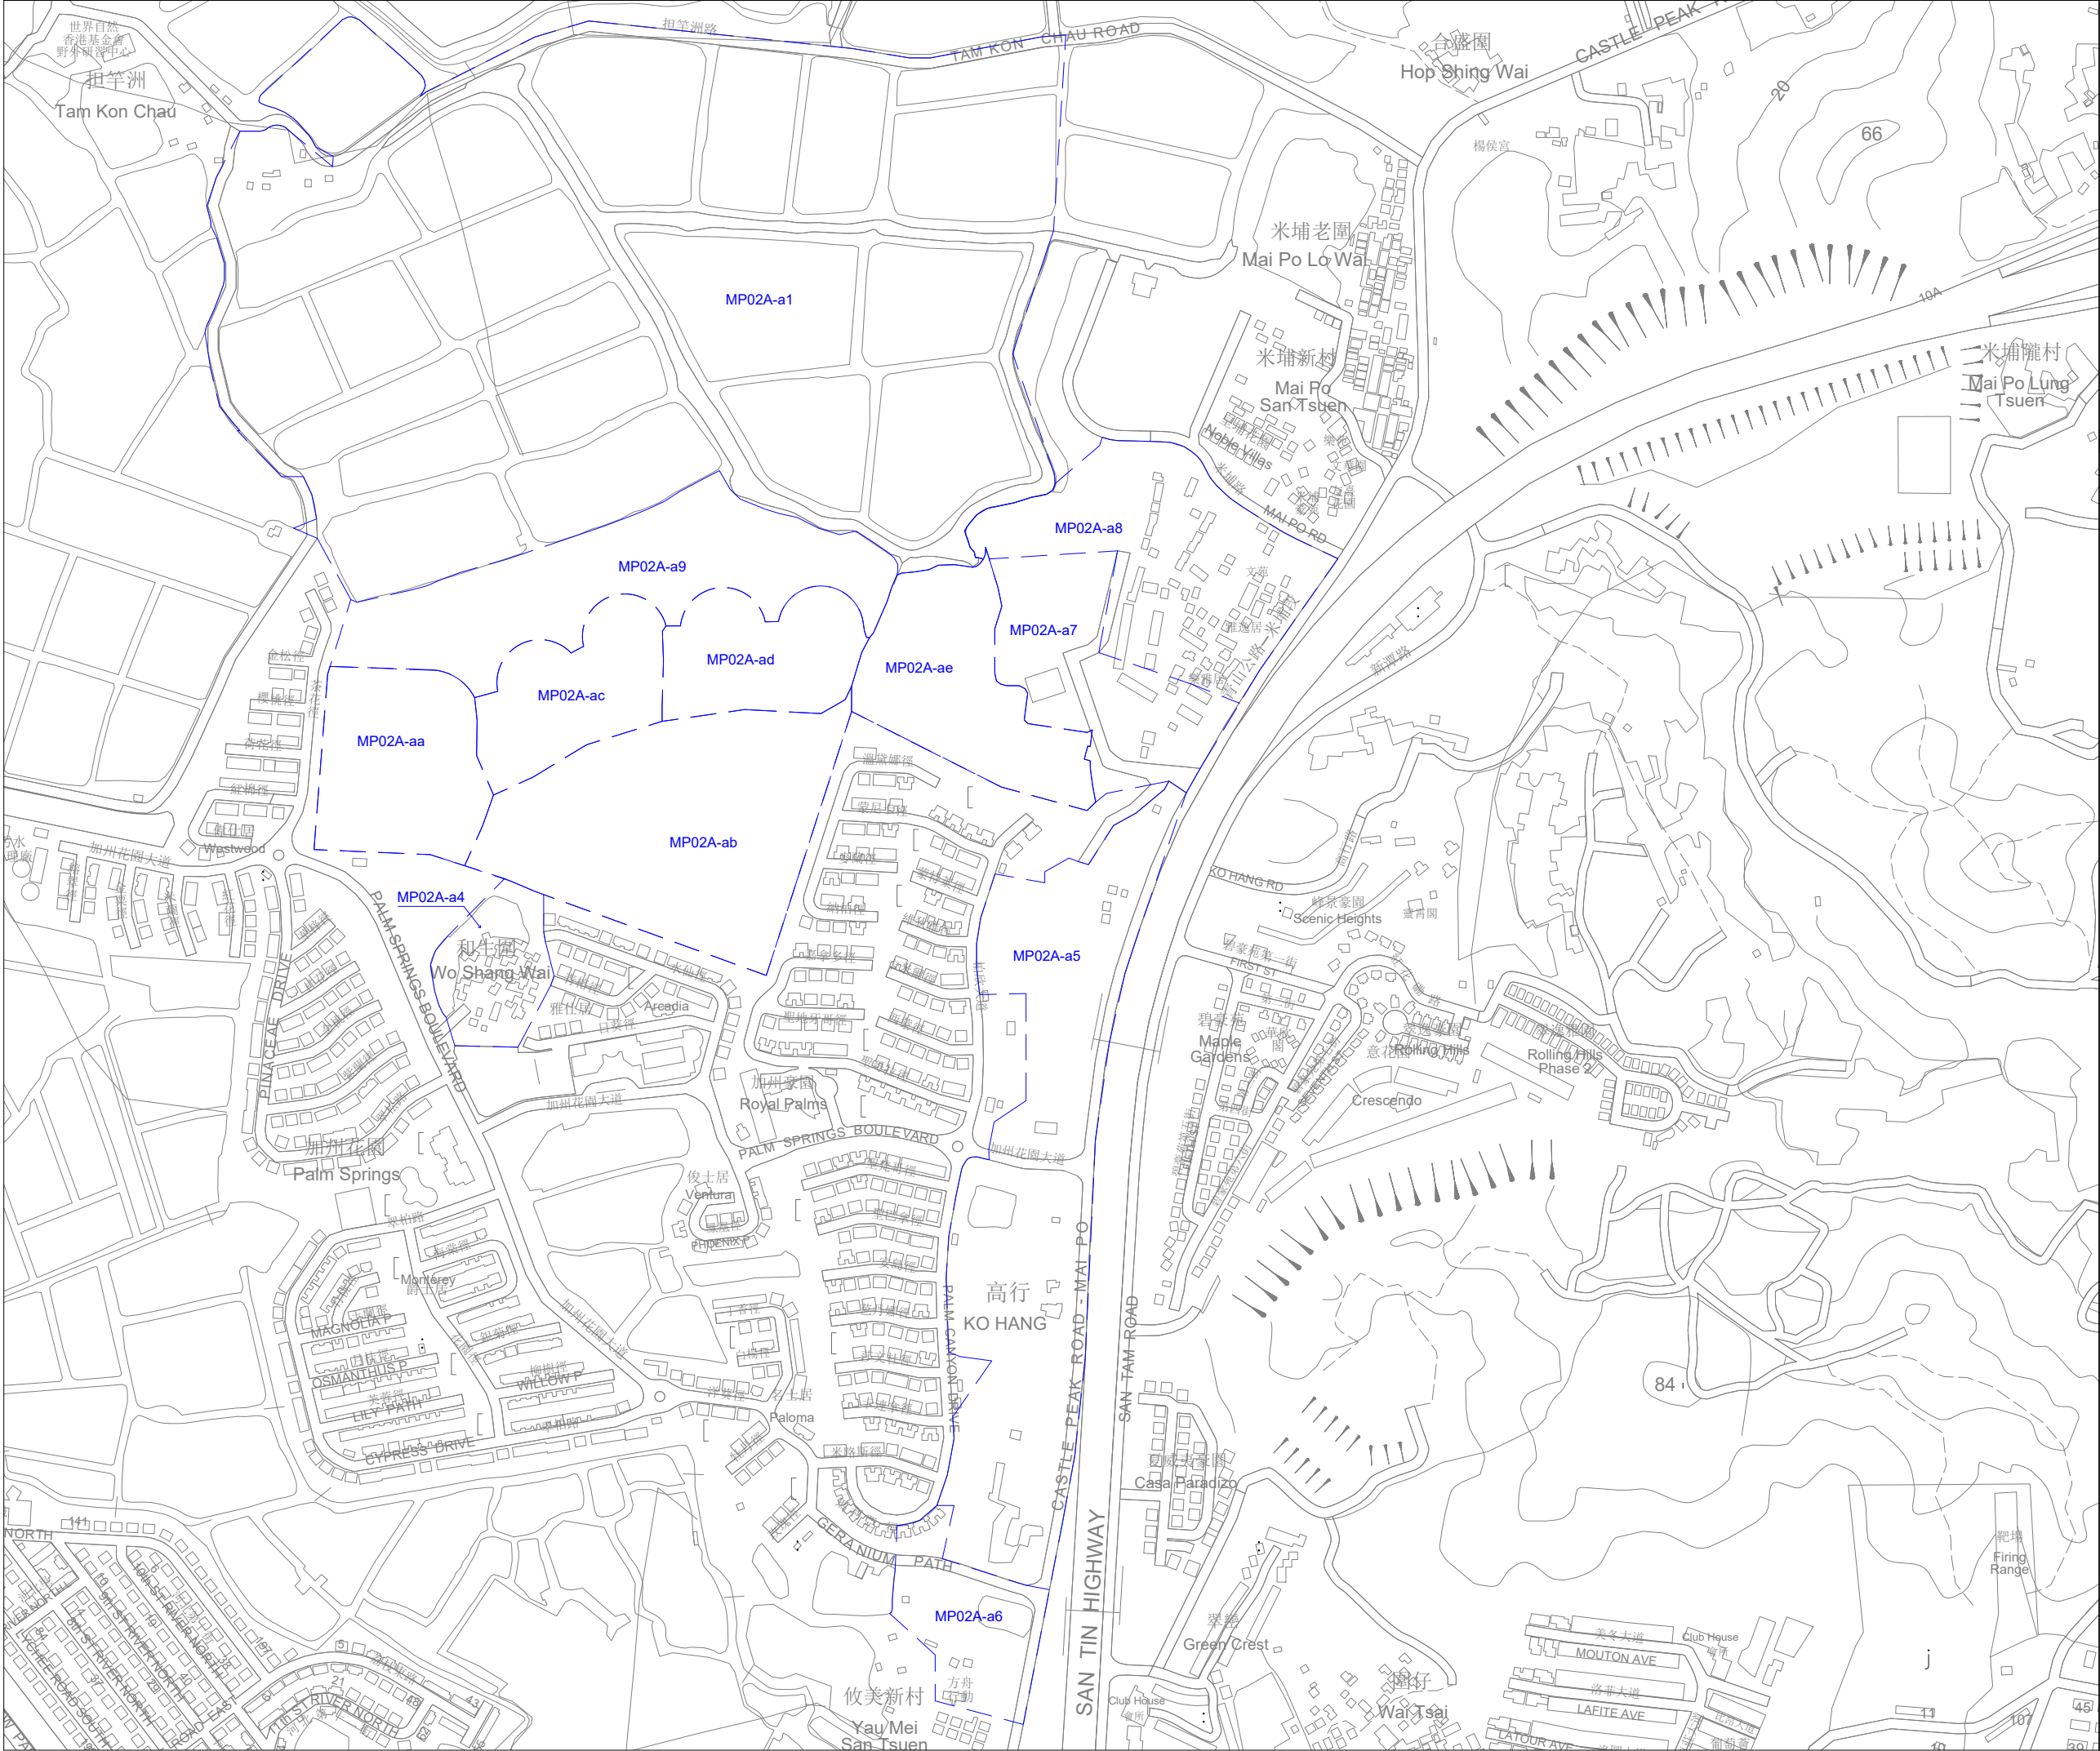



LOCATION PLAN

LEGENDS:

SUB-CATCHMENT BOUNDARY

Rev	Description	By	Date
Consultant			
Project title			
DRAINAGE IMPACT ASSESSMENT			
To Amend the Notes of the "Comprehensive Development to include Wetland Restoration Area" Zone for a Proposed Comprehensive Development at Wo Shing Wai, Yuen Long, Lots 77 and 50 S.A in DD101			
Drawing title			
SUB-CATCHMENT PLAN OF MP02A-a FOR POST-DEVELOPMENT MODEL			
Drawing no.		Rev.	
Figure 5		-	
Drawn	Date	Checked	Approved
JX	-	-	-
Scale	1:3000	Status	


© COPYRIGHT RESERVED

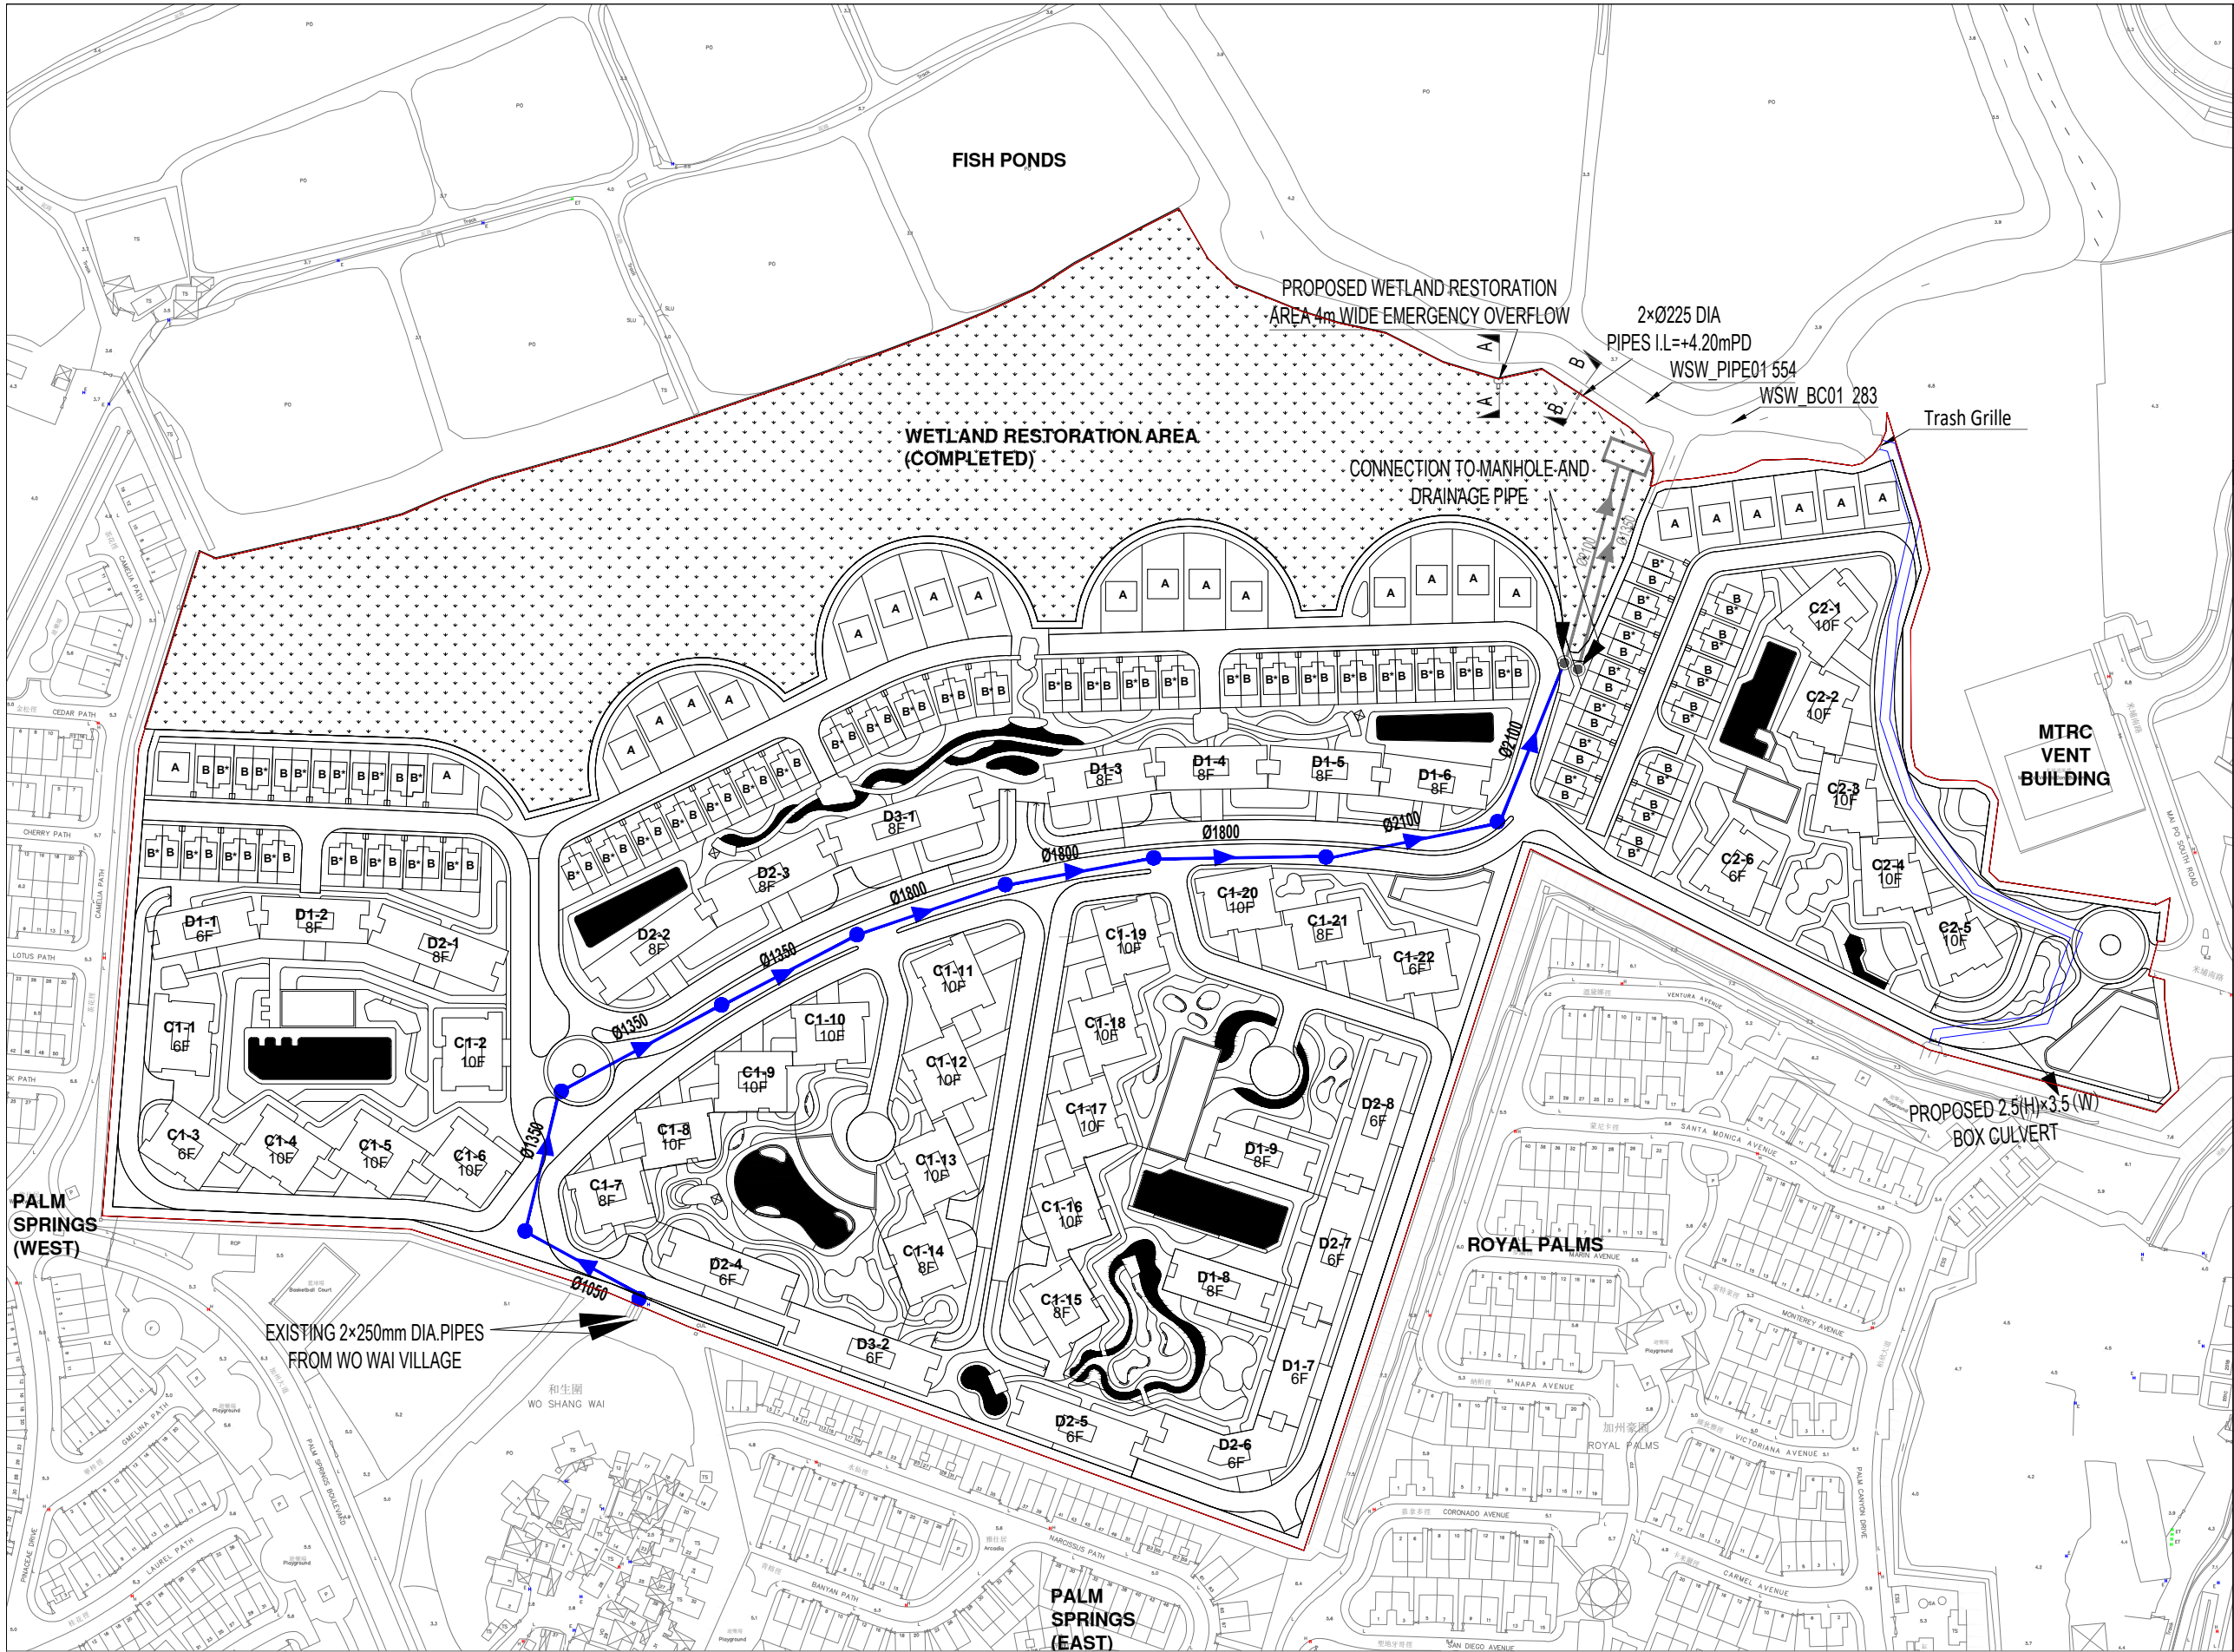


LOCATION PLAN


LEGENDS:

- APPLICATION SITE BOUNDARY
- EXISTING MANHOLE
- PROPOSED MANHOLE
- Ø1800 PROPOSED DRAINAGE SYSTEM
- PROPOSED 2.5(H)x3.5(W) BOX CULVERT
- Ø2100 DRAINAGE SYSTEM

Rev	Description	By	Date
Consultant			
			
Project title			
DRAINAGE IMPACT ASSESSMENT			
To Amend the Notes of the "Comprehensive Development to include Wetland Restoration Area" Zone for a Proposed Comprehensive Development at Wo Shang Wai, Yuen Long, Lots 77 and 50 S.A in DD101			
Drawing title			
PROPOSED DRAINAGE			
Drawing no.			Rev.
Figure 6			
Drawn	Date	Checked	Approved
Scale	Status		
1:1200			

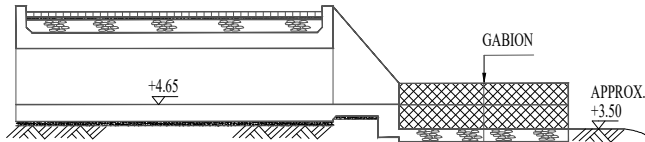

SECTION A-A

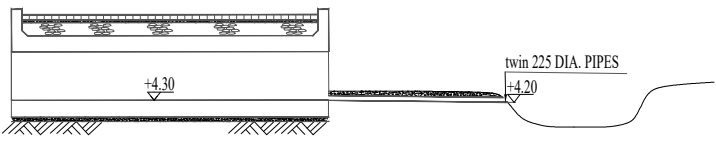

SECTION B-B

Appendices

Appendix A
Approval Letters of Previous DIAs
in 2015, 2021 and 2024

規 劃 署

粉嶺、上水及元朗東規劃處
新界沙田上禾輦路 1 號
沙田政府合署 12 樓



By Post and Fax (2587 7068)
Planning Department

Fanling, Sheung Shui &
Yuen Long East
District Planning Office
12/F., Sha Tin Government Offices,
1 Sheung Wo Che Road, Sha Tin, N.T.

本函檔號 Your Reference
本署檔號 Our Reference () in TPB/A/YL-MP/229
電話號碼 Tel. No. : 2158 6284
傳真機號碼 Fax No. : 3105 0057

17 December 2015

Masterplan Limited
Room 3516B, 35/F
China Merchants Tower, Shun Tak Centre
200 Connaught Road Central
Hong Kong
(Attn.: Mr. Ian Brownlee)

Dear Sir,

Planning Application No. A/YL-MP/229
Compliance with Approval Condition (d)

I refer to your submissions dated 13.4.2015, 6.7.2015 and 10.7.2015 for compliance with the approval condition (d) of the captioned application on “the submission of a revised Drainage Impact Assessment (DIA), including flood relief mitigation measures, to the satisfaction of the Director of Drainage Services or of the Town Planning Board”. The relevant departments have been consulted on your submission. Your submission is considered:

- ☒ Acceptable. The captioned condition **has been complied with**. Please find detailed comments of the Chief Engineer/Mainland North, Drainage Services Department (CE/MN, DSD), District Lands Officer/Yuen Long, Lands Department (DLO/YL, LandsD), Director of Agriculture, Fisheries and Conservation (DAFC) and Director of Environmental Protection (DEP) at **Appendix**.
- ☐ Acceptable. Since the captioned condition requires both the submission and implementation of the proposal, it **has not been fully complied with**. Please proceed to implement the accepted proposal for full compliance with the approval condition.
- ☐ Not acceptable. The captioned condition **has not been complied with**.

Should you have any queries on the comments, please contact Mr. Simon CHEUNG (Tel: 2158 6289) direct.

Yours faithfully,

(K.T. NG)

for District Planning Officer/
Fanling, Sheung Shui and Yuen Long East
Planning Department

Encl.

城市規劃委員會

香港北角渣華道三百三十三號
北角政府合署十五樓

TOWN PLANNING BOARD

15/F., North Point Government Offices
333 Java Road, North Point,
Hong Kong.

傳 真 Fax: 2877 0245 / 2522 8426

電 話 Tel: 2231 4810

來函檔號 Your Reference:

覆函請註明本會檔號

In reply please quote this ref.: TPB/A/YL-MP/229

By Registered Post & Fax (2587 7068)

13 March 2015

Masterplan Ltd.
Rm 3516B, 35/F, China Merchants Tower
Shun Tak Centre
200 Connaught Road Central
Hong Kong
(Attn.: I.T. Brownlee)

Dear Sir/Madam,

**Proposed Filling and Excavation of Land for House
Development with Wetland Habitat in "Other Specified Uses" annotated
"Comprehensive Development to include Wetland Restoration Area" zone,
Lots No. 43 S.A RP, 50 S.A and 50 RP in D.D. 101, Wo Shang Wai, Mai Po, Yuen Long**

I refer to my letter to you dated 20.1.2015.

After giving consideration to the application, the Town Planning Board (the TPB) approved the application for permission under section 16 of the Town Planning Ordinance on the terms of the application as submitted to the TPB. The permission shall be valid until 27.2.2019; and after the said date, the permission shall cease to have effect unless before the said date, the development permitted is commenced or the permission is renewed. The permission is subject to the following conditions :

- (a) the submission and implementation of a revised Master Layout Plan to take into account conditions (b) to (q) below to the satisfaction of the Director of Planning or of the TPB;
- (b) the interface arrangement for the Express Rail Link (XRL) project in terms of the permanent land take for Express Rail Link tunnels and structures and temporary land take for related construction to the satisfaction of the Director of Highways or of the TPB;
- (c) the submission and implementation of a revised Landscape Master Plan including a tree preservation proposal to the satisfaction of the Director of Planning or of the TPB;
- (d) the submission of a revised Drainage Impact Assessment (DIA), including flood relief mitigation measures, to the satisfaction of the Director of Drainage Services or of the TPB;
- (e) in relation to (d) above, the implementation of a drainage proposal and other necessary flood relief mitigation measures identified in the revised DIA to the satisfaction of the Director of Drainage Services or of the TPB;

- 2 -

- (f) the implementation of mitigation measures identified therein in the revised Ecological Impact Assessment to the satisfaction of the Director of Agriculture, Fisheries and Conservation or of the TPB;
- (g) the submission and implementation of a maintenance and management plan which covers implementation details and the estimated annual recurrent costs with breakdown required for maintaining the restored wetland area to the satisfaction of the Director of Agriculture, Fisheries and Conservation or of the TPB;
- (h) the submission and implementation of a funding arrangement proposal for ensuring the long-term maintenance and management of the restored wetland area to the satisfaction of the Director of Environmental Protection and the Director of Agriculture, Fisheries and Conservation, or of the TPB;
- (i) as proposed by you, land exchange and/or lease modification for the proposed development if considered and approved by the Director of Lands, should not be executed prior to the compliance with condition (h) to the satisfaction of the Director of Environmental Protection and the Director of Agriculture, Fisheries and Conservation, or of the TPB;
- (j) the design and provision of improvement measures at the junction of Palm Springs Boulevard and Castle Peak Road – Mai Po section to the satisfaction of the Commissioner for Transport or of the TPB;
- (k) the design and provision of vehicle parking, motorcycle parking and loading/unloading facilities for the proposed development to the satisfaction of the Commissioner for Transport or of the TPB;
- (l) the design and provision of the access connection between the development and the public road to the satisfaction of the Commissioner for Transport or of the TPB;
- (m) the provision of emergency vehicular access, water supplies for fire-fighting and fire service installations to the satisfaction of the Director of Fire Services or of the TPB;
- (n) the design and provision of mitigation measures to alleviate the visual impact of the noise barriers to the satisfaction of the Director of Planning or of the TPB;
- (o) the submission of a revised Sewerage Impact Assessment (SIA) to the satisfaction of the Director of Environmental Protection or of the TPB;
- (p) the implementation of mitigation measures identified in the revised SIA to the satisfaction of the Director of Environmental Protection or of the TPB; and
- (q) the implementation of sewage disposal arrangement including the interim on-site sewerage treatment plant, the reuse of treated effluent and the irrigation system, as proposed by you, to the satisfaction of the Director of Environmental Protection or of the TPB.

The TPB also agreed to advise you of the following:

- (a) to note the suggestion of Members on the provision of a tree belt at the interface of the development portion and the wetland restoration area of the scheme to create a buffer area in between. As part of the Landscape Master Plan, you should liaise with the Planning Department regarding the design and implementation of the tree belt;
- (b) the approval of the application does not imply that the proposed building design elements can fulfil the requirements under the Sustainable Building Design Guidelines and the relevant requirements under the lease, and that the proposed gross floor area (GFA) concession for the proposed development will be approved/granted by the Building Authority (BA). You should approach the Buildings Department (BD) and the Lands Department (LandsD) direct to obtain the necessary approval. If the building design elements and the GFA concession are not approved/granted by the BA and the Lands Authority and major changes to the current scheme are required, a fresh planning application to the TPB may be required;
- (c) to note the comments of the District Lands Officer/Yuen Long, LandsD that with reference to Figure A3 of the Wetland Restoration and Creation Scheme, the Wetland Restoration Area boundary is modified. A proposed land exchange is being processed for the lots within the site based on the previous Application No. A/YL-MP/185. Should the TPB approve the application which cause amendments to the proposed land exchange, you are required to apply to LandsD for the proposed development in current scheme. However, there is no guarantee that such application (including the granting of any additional government land (GL)) will be approved. Such application will be dealt with by his department acting in the capacity as the landlord at his discretion, and if it is approved under such discretion, the approval would be subject to such terms and conditions including among others, the payment of premium and administrative fee as may be imposed by his department. The proposed storm water drain will connect to outfall beyond the site boundary. Should such drains encroach upon private land and GL, you should clearly indicate the whole alignment of such storm water drain connection, in particular the one connecting the existing outfall to Mai Po Tributary, and then obtain prior approval/consent from the relevant authorities before carrying out of the works. According to the layout plan of the preliminary interim sewage system design, there is no GL involved. However, you should consult his department if there is any works to be carried out on GL, if unavoidable;
- (d) to note the comments of the Director of Environmental Protection (DEP) that this is a revised residential development scheme different from the layout shown in the Environmental Permit No. EP-311/2008/D issued under the Environmental Impact Assessment Ordinance (EIAO) (Cap. 499). The proposed on-site wastewater treatment does not conform with Condition 5.13 of the Environmental Permit. You should be reminded to go through the statutory EIAO process should the current development scheme goes ahead;

- (e) to note the comments of the Commissioner for Transport that you should take account of the segregation of vehicles and pedestrian in the detailed design during submission of the general building plan stage. He has no objection to the proposed basement carpark but the Transport Department's comment will be provided at the detailed design stage;
- (f) to note the comments of the Chief Engineer/Railway Development, Railway Development Office, Highways Department that the site, in particular the site portion within Lot 43 S.A RP in D.D. 101, falls within the railway protection boundary of the Hong Kong Section of the XRL, which is now under construction. You should consult MTR Corporation Limited on the full details of the proposal and comply with their requirements with respect to the construction, operation, maintenance and safety of the XRL;
- (g) to note the comments of the Chief Building Surveyor/New Territories West, BD that the access road linking the site and the Castle Peak Road shall be completed before the Occupation Permit application. In view of the size of the site, any internal streets/roads required under the Buildings Ordinance (BO) s.16(1)(p) may have to be deducted from site area for plot ratio/site coverage calculations under the BO. Recreational facilities and the proposed noise barriers, unless exempted, are accountable for GFA calculation under the BO. Filtration plant rooms for swimming pool at private houses are accountable for GFA calculation under the BO. Each phase of the proposed development should be self-sustainable under the BO. Your attention is drawn to the requirements on the provision of emergency vehicle access to all buildings to be erected on the site under Building (Planning) Regulations (B(P)R) 41D. The proposed open space should not be less than the requirements as stipulated in the second schedule of B(P)R. Application for exemption of carparking spaces from GFA calculation under the BO will be considered on the basis of the PNAP APP-2 during plan submission stage. The new quality and sustainable built environment (QBE) requirements are applicable to the site. In accordance with the Government's committed policy to implement building design to foster a QBE, the sustainable building design requirements (including building separation, building setback and greenery coverage) should be included, where possible, in the planning approval;
- (h) to note the comments of the Chief Engineer/Mainland North, Drainage Services Department that he would reserve his comments until specific drainage proposal is submitted. You should be reminded that the SIA for the current application needs to meet the full satisfaction of DEP;
- (i) to note the comments of the Chief Town Planner/Urban Design and Landscape, Planning Department (PlanD) that regarding communal open space calculation, you should be advised that the ancillary pedestrian route should be "within" the open space to be counted as part of the open space as per the Hong Kong Planning Standards and Guidelines (HKPSG). You should maximize the provision of greening, especially at-grade tree and shrub planting along roadside and clubhouses to improve the landscape and visual amenity of the development;

- 5 -

- (j) to note the comments of the Chief Engineer/Development (2), Water Supplies Department (WSD) that for the provision of water supply to the development, you may need to extend your inside services to the nearest suitable government water mains for connection. You shall resolve any land matter (such as private lots) associated with the provision of water supply and shall be responsible for the construction, operation and maintenance of the inside services within the private lots to WSD's standard. Fresh water from government mains shall not be used for watering plant nurseries or landscape features purposes except with the written consent of the Water Authority. Consent to use fresh water from the mains for such purposes may be given on concessionary supply basis if an alternative supply is impracticable and evidence to that effect is offered to and accepted by the Water Authority. Such permission will be withdrawn if in the opinion of the Water Authority the supply situation requires it; and
- (k) to note the comments of the Director of Electrical and Mechanical Services that for electricity safety, you shall approach the electricity supplier for the requisition of cable plans to find out whether there is any underground cable (and/or overhead line) within or in the vicinity of the site. For the site within the preferred working corridor of high voltage overhead lines at transmission voltage level 132kV and above as stipulated in the HKPSG published by PlanD, prior consultation and arrangement with the electricity supplier is necessary. Prior to establishing any structure within the site, you and/or your contractors shall liaise with the electricity supplier and, if necessary, ask the electricity supplier to divert the underground cable (and/or overhead line) away from the vicinity of the proposed structure. The "Code of Practice on Working near Electricity Supply Lines" established under the Electricity Supply Lines (Protection) Regulation shall be observed by you and your contractors when carrying out works in the vicinity of the electricity supply lines. For town gas safety, there is a high pressure town gas pipeline running along San Tin Highway and the site is in close proximity to the existing high pressure gas pipeline. He considers that given the application is a low density residential development (i.e. plot ratio is 0.4) and the minimum proximity distance of the proposed houses to the concerned gas pipeline is about 150m, it should not be a mandatory requirement for you to submit a risk assessment. Nevertheless, given that there is a town gas pipeline near to the proposed development, the project proponent should maintain liaison/coordination with the Hong Kong and China Gas Company Limited in respect of the exact location of existing or planned gas pipe routes/gas installations in the vicinity of the proposed works area and the minimum setback distance away from the gas pipes/gas installations if any excavation work is required during the design and construction stages of the development. The project proponent shall also note the requirements of the Electrical and Mechanical Services Department's 'Code of Practice on Avoiding Danger from Gas Pipes'.

If you wish to seek an extension of the validity of this permission, you may submit an application to the TPB for renewal of the permission no less than six weeks before its expiry. This is to allow sufficient time for processing of the application in consultation with the concerned departments. The TPB will not consider any application for renewal of permission if the time limit for commencement of development specified in the permission has already

- 6 -

expired at the time of consideration by the TPB. Please refer to the TPB Guidelines No. 35B and 36A for details. The Guidelines and application forms are available at the TPB's website (www.info.gov.hk/tpb/), the Planning Enquiry Counters of the Planning Department (Hotline : 2231 5000) at 17/F, North Point Government Offices, 333 Java Road, North Point; 14/F, Sha Tin Government Offices, 1 Sheung Wo Che Road, Sha Tin; and the Secretariat of the TPB at 15/F, North Point Government Offices.

For amendments to the approved scheme that may be permitted with or without application under section 16A, please refer to TPB Guidelines No. 36A for details.


A copy of the TPB Paper in respect of the application (except the supplementary planning statement/technical report(s), if any) and the relevant extract of minutes of the TPB meeting held on 27.2.2015 are enclosed herewith for your reference.

Under section 17(1) of the Town Planning Ordinance, an applicant aggrieved by a decision of the TPB may apply to the TPB for a review of the decision. If you wish to seek a review, you should inform me within 21 days from the date of this letter (on or before 8.4.2015). I will then contact you to arrange a hearing before the TPB which you and/or your authorized representative will be invited to attend. The TPB is required to consider a review application within three months of receipt of the application for review. Please note that any review application will be published for three weeks for public comments.

This permission by the TPB under section 16 of the Town Planning Ordinance should not be taken to indicate that any other government approval which may be needed in connection with the development, will be given. You should approach the appropriate government departments on any such matter.

If you have any queries regarding this planning permission, please contact Mr. K.T. Ng of Fanling, Sheung Shui & Yuen Long East District Planning Office at 2158 6284. In case you wish to consult the relevant Government departments on matters relating to the above approval conditions, a list of the concerned Government officers is attached herewith for your reference.

Yours faithfully,



(Michael CHIU)

for Secretary, Town Planning Board

規 劃 署

粉嶺、上水及元朗東規劃處
新界荃灣青山公路 388 號
中染大廈 22 樓 2202 室



By Fax (2587 7068) and Post
Planning Department

Fanling, Sheung Shui &
Yuen Long East
District Planning Office
Unit 2202, 22/F, CDW Building,
388 Castle Peak Road, Tsuen Wan, N.T.

本函檔號 Your Reference
本署檔號 Our Reference () in TPB/A/YL-MP/291
電話號碼 Tel. No.: 3168 4072
傳真機號碼 Fax No.: 3168 4074

12 May 2021

Masterplan Limited
Room 3516B, 35/F, China Merchants Tower
Shun Tak Centre, 200 Connaught Road Central
Hong Kong
(Attn: Mr. Ian BROWNLEE)

Dear Mr. BROWNLEE,

**Proposed Comprehensive House and Wetland Habitat Development with Filling and
Excavation of Land (Amendments to an Approved Scheme) in "Other Specified Uses"
annotated "Comprehensive Development to include Wetland Restoration Area" zone,
Lots 43 S.A RP, 50 S.A and 50 RP in D.D.101, Wo Shang Wai, Mai Po, Yuen Long
(Planning Application No. A/YL-MP/291)
Compliance with Approval Condition (c)**

I refer to your submission dated 27.4.2021 for compliance with the captioned approval condition regarding the submission of a revised Drainage Impact Assessment (DIA). The relevant department has been consulted on your submission. Your submission is considered:

- ☐ Acceptable. The captioned condition has been complied with.
- ☒ Acceptable. Since the captioned condition requires both the submission and implementation of the proposal, it has not been fully complied with. Please proceed to implement and maintain the flood mitigation measures and provision of drainage facilities identified in the DIA for full compliance with the approval condition.
- ☐ Not acceptable. The captioned condition has not been complied with.

Should you have any queries on the comments, please contact Mr. Joshua YUEN (Tel: 2300 1235) of DSD directly.

Yours sincerely,


(Anthony LUK)

District Planning Officer/
Fanling, Sheung Shui and Yuen Long East
Planning Department

- 2 -

c.c.

CE/MN, DSD
CTP/TPB(2)

(Attn: Mr. Joshua YUEN)

Internal

Site Record

AL/AC/AP

城市規劃委員會

香港北角渣華道三百三十三號
北角政府合署十五樓

TOWN PLANNING BOARD

15/F., North Point Government Offices
333 Java Road, North Point,
Hong Kong.

傳 真 Fax: 2877 0245 / 2522 8426

電 話 Tel: 2231 4810

來函檔號 Your Reference:

By Post & Fax (2587 7068)

覆函請註明本會檔號

In reply please quote this ref.: TPB/A/YL-MP/344

1 March 2024

Masterplan Ltd.
Room 3516B, 35/F, China Merchants Tower
Shun Tak Centre
200 Connaught Road Central
Hong Kong
(Attn.: Benson Poon)

Dear Sir/Madam,

Proposed Comprehensive House and Wetland Habitat Development with Filling and Excavation of Land (Amendments to an Approved Scheme) in "Other Specified Uses" annotated "Comprehensive Development to include Wetland Restoration Area" Zone, Lots 50 S.A and 77 in D.D.101, Wo Shang Wai, Mai Po, Yuen Long

I refer to my letter to you dated 15.2.2024.

After giving consideration to the application, the Town Planning Board (TPB) approved the application for permission under section 16 of the Town Planning Ordinance on the terms of the application as submitted to the TPB. The permission shall be valid until 16.2.2028, and after the said date, the permission shall cease to have effect unless before the said date, the development permitted is commenced or the permission is renewed. The permission is subject to the following conditions :

- (a) the submission and implementation of a revised Master Layout Plan to take into account conditions (b) to (i) below to the satisfaction of the Director of Planning or of the TPB;
- (b) the submission and implementation of a Landscape Master Plan to the satisfaction of the Director of Planning or of the TPB;
- (c) the implementation of drainage proposal identified in the accepted Drainage Impact Assessment to the satisfaction of the Director of Drainage Services or of the TPB;
- (d) the implementation of the mitigation measures identified in the Ecological Impact Assessment to the satisfaction of the Director of Agriculture, Fisheries and Conservation or of the TPB;
- (e) the design and provision of vehicular access, parking and loading/unloading facilities for the proposed development to the satisfaction of the Commissioner for Transport or of the TPB;

- (f) the design and provision of improvement measures at the junction of Castle Peak Road - San Tin and Shek Wu Wai Road before the occupation of the proposed development to the satisfaction of the Commissioner for Transport or of the TPB;
- (g) the design and provision of improvement measures at the junction of Fairview Park Interchange, if deemed required by Transport Department, before the occupation of the proposed development to the satisfaction of the Commissioner for Transport or of the TPB;
- (h) the submission of a revised Sewerage Impact Assessment (SIA) to the satisfaction of the Director of Environmental Protection or of the TPB; and
- (i) the implementation of sewage disposal arrangement identified in the revised SIA including the on-site sewerage treatment plant and the reuse of treated effluent, as proposed by you, to the satisfaction of the Director of Environmental Protection or of the TPB.

The TPB also agreed to advise you to note the advisory clauses as set out at the Appendix attached.

Regarding the determination on commencement of an approved development, please refer to TPB Guidelines No. 35D for details. If you wish to seek an extension of the validity of this permission, you may submit an application under 16A of the Town Planning Ordinance to the TPB no less than six weeks before its expiry. This is to allow sufficient time for processing of the application in consultation with the concerned departments. The TPB will not consider the application if the time limit for commencement of development specified in the permission has already expired at the time of consideration by the TPB. Please refer to the TPB Guidelines No. 35D and 36C for details. The Guidelines and application forms are available at the TPB's website (<https://www.tpb.gov.hk/en/resources/index.html>), the Planning Enquiry Counters of the Planning Department (Hotline : 2231 5000) at 17/F, North Point Government Offices, 333 Java Road, North Point; 14/F, Sha Tin Government Offices, 1 Sheung Wo Che Road, Sha Tin; and the Secretariat of the TPB at 15/F, North Point Government Offices.

For amendments to the approved development that may be permitted with or without application under section 16A, please refer to TPB Guidelines No. 36C for details.

The TPB Paper in respect of the application (except the supplementary planning statement/technical report(s), if any) is available at this link (https://www.tpb.gov.hk/en/meetings/RNTPC/Agenda/736_rnt_agenda.html) and the relevant extract of minutes of the TPB meeting held on 16.2.2024 is enclosed herewith for your reference.

Under section 17(1) of the Town Planning Ordinance, an applicant aggrieved by a decision of the TPB may apply to the TPB for a review of the decision. If you wish to seek a review, you should inform me within 21 days from the date of this letter (on or before 22.3.2024). I will then contact you to arrange a hearing before the TPB which you and/or your authorized representative will be invited to attend. The TPB is required to consider a review application within three months of receipt of the application for review. Please note that any review application will be published for three weeks for public comments.

This permission by the TPB under section 16 of the Town Planning Ordinance should not be taken to indicate that any other government approval which may be needed in connection with the development, will be given. You should approach the appropriate government departments on any such matter.

If you have any queries regarding this planning permission, please contact Mr. Kimson Chiu of Fanling, Sheung Shui & Yuen Long East District Planning Office at 3168 4033. In case you wish to consult the relevant Government departments on matters relating to the above approval conditions, a list of the concerned Government officers is attached herewith for your reference.

Yours faithfully,



(Leticia LEUNG)
for Secretary, Town Planning Board

List of Government Department Contacts

(Application No. A/YL-MP/344)

部門 Department	辦事處 Office	聯絡人姓名 Name of Contact Person	電話號碼 Telephone No.	傳真號碼 Facsimile No.
漁農自然護理署 Agriculture, Fisheries and Conservation Department	自然護理組(元朗) Nature Conservation Section (Yuen Long)	黃金欣博士 Dr. WONG Kam Yan, Azaria	2150 6932	2377 4427
渠務署 Drainage Services Department	新界北渠務部 Mainland North Division	梁長政先生 Mr. LEONG Cheung Ching	2300 1432	2770 4761
環境保護署 Environmental Protection Department	環境評估科 Environmental Assessment Division	陳麗薇女士 Ms. CHAN Lai Mei, Jolitta	2835 1112	2591 0558
運輸署 Transport Department	交通工程(新界西)部 Traffic Engineering (NTW) Division	梁志江先生 Mr. LEUNG Chi Kong, Donald	2399 2778	2381 3799

Appendix B

Master Layout Plan of the Proposed Development

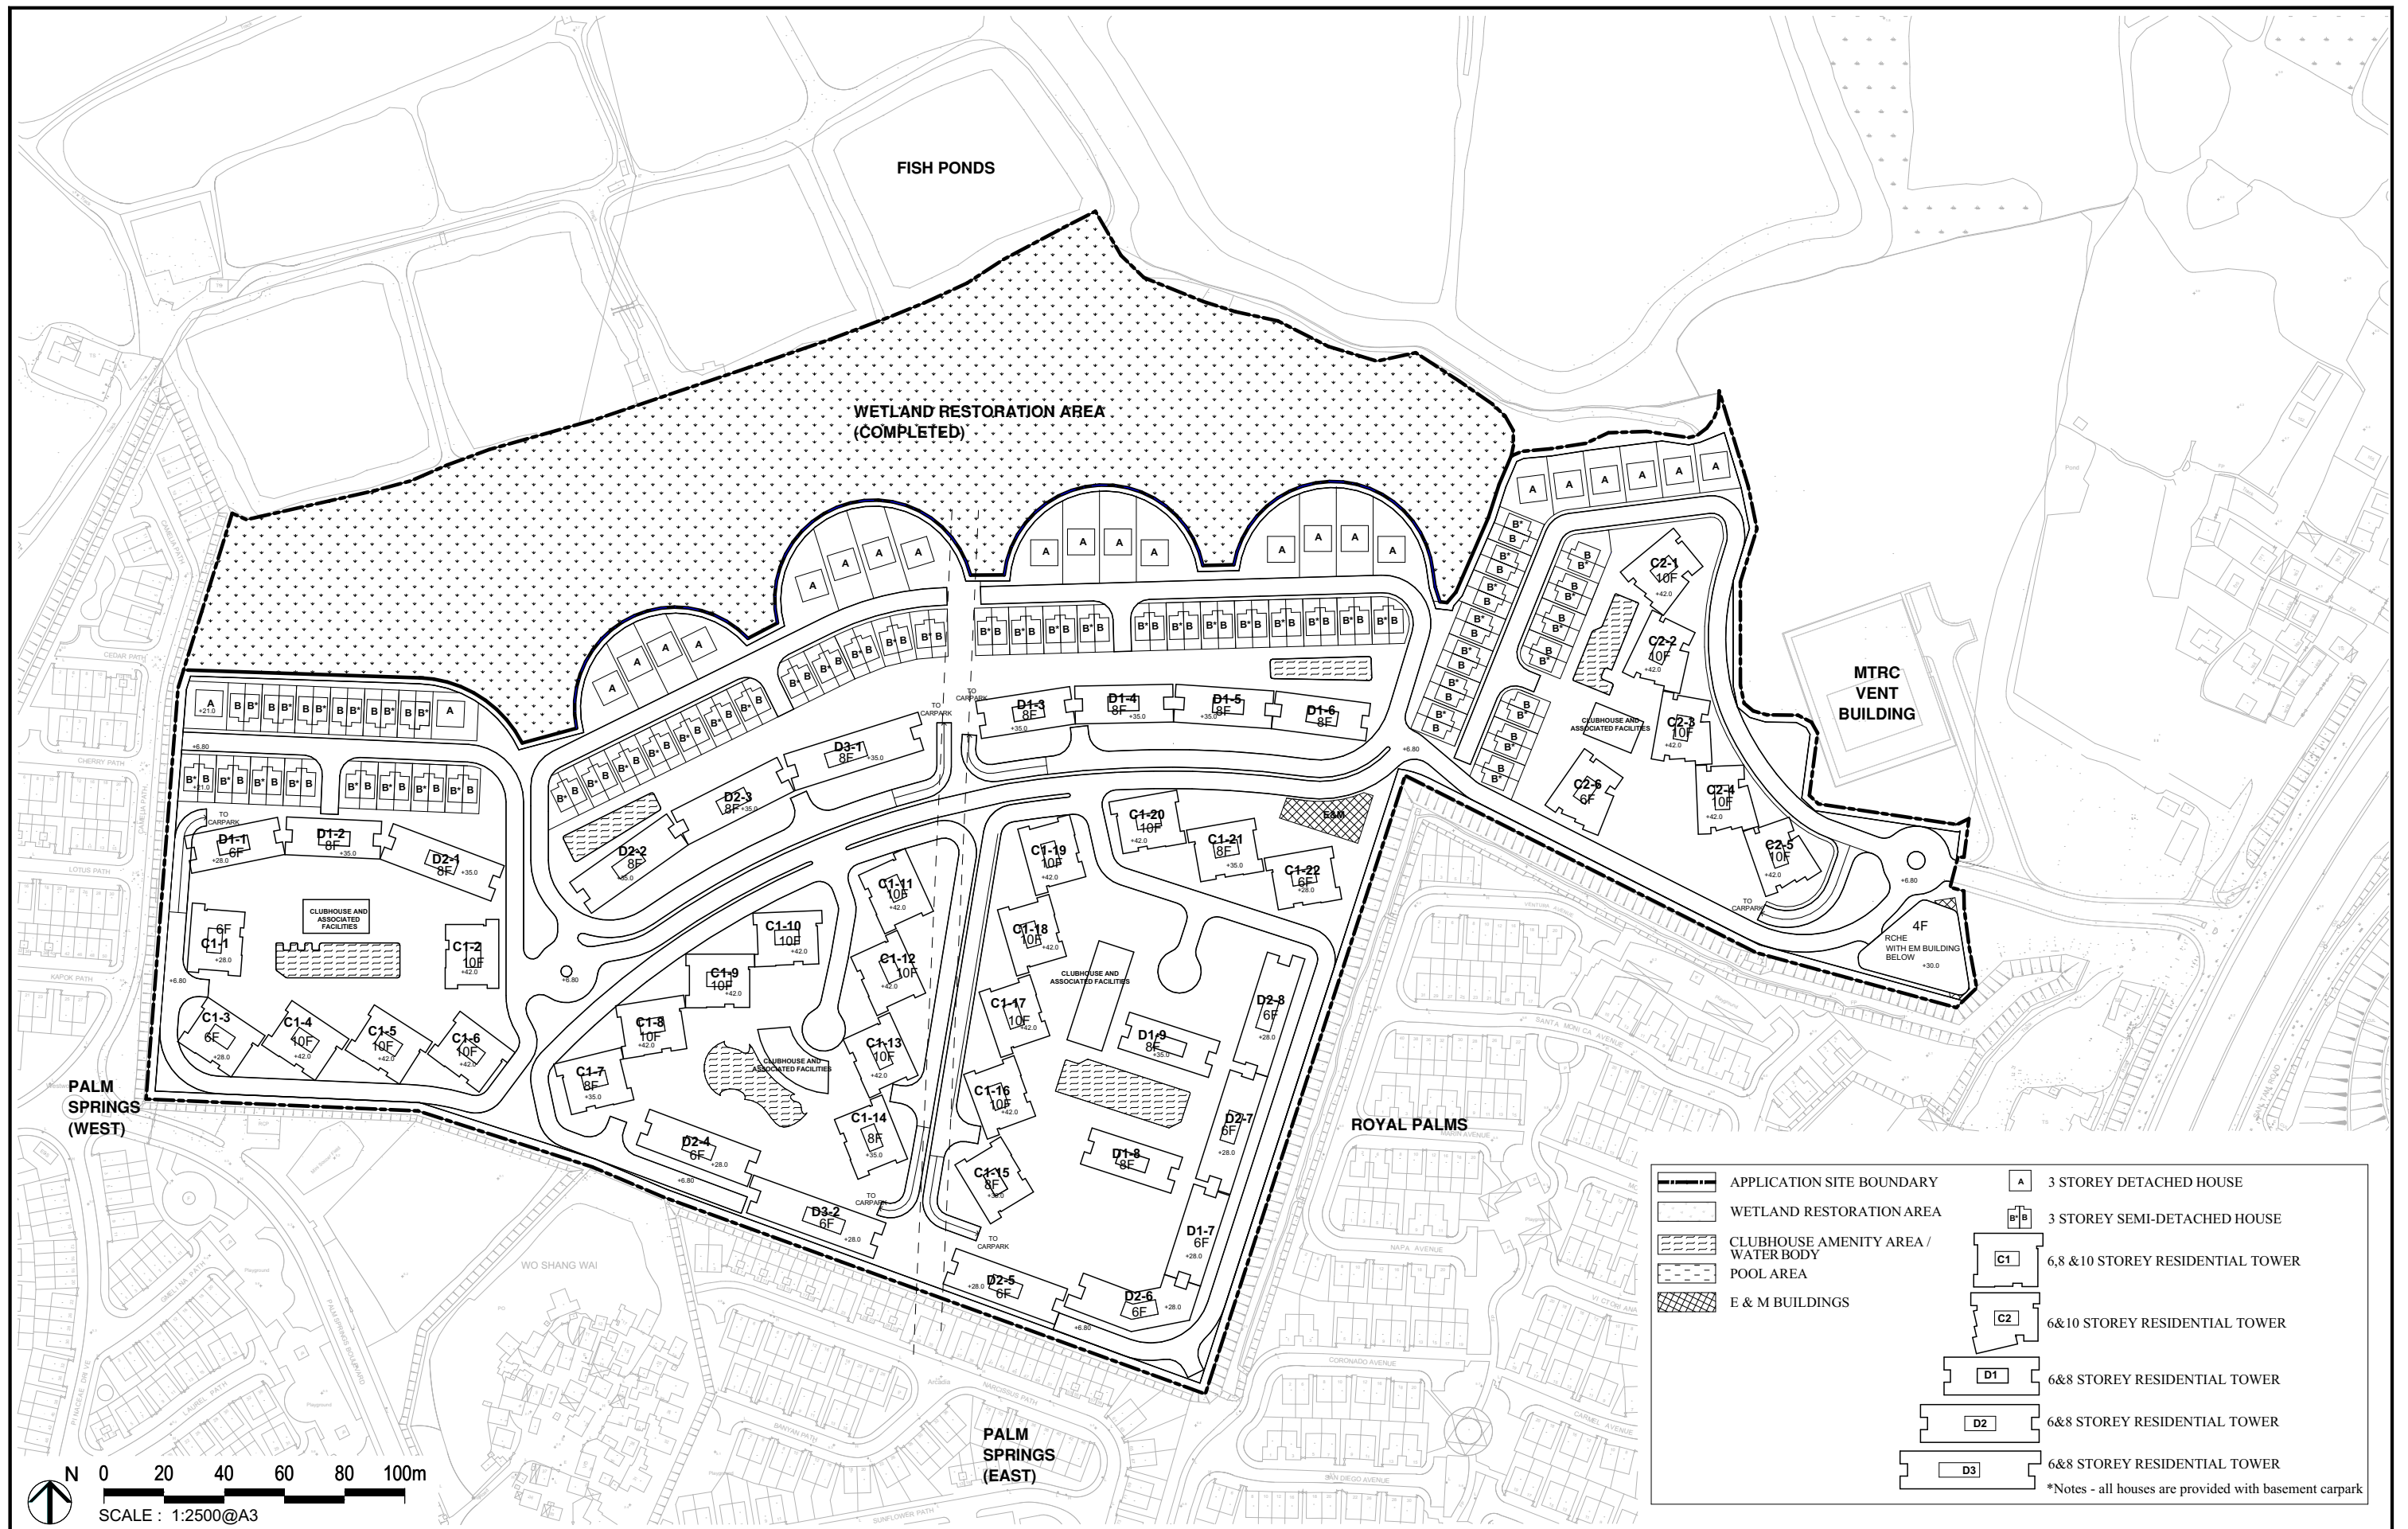


Figure 3: Revised Master Layout Plan in this Amendment Application

Appendix C



Location of DSD Flooding Blackspots
(Information Extracted from DSD Website)

LEGEND :

圖例：

- Major Flooding Blackspot
嚴重水浸黑點
- Medium Flooding Blackspot
中程度水浸黑點
- Small Flooding Blackspot
小程度水浸黑點
- Minor Flooding Blackspot
輕微水浸黑點

N

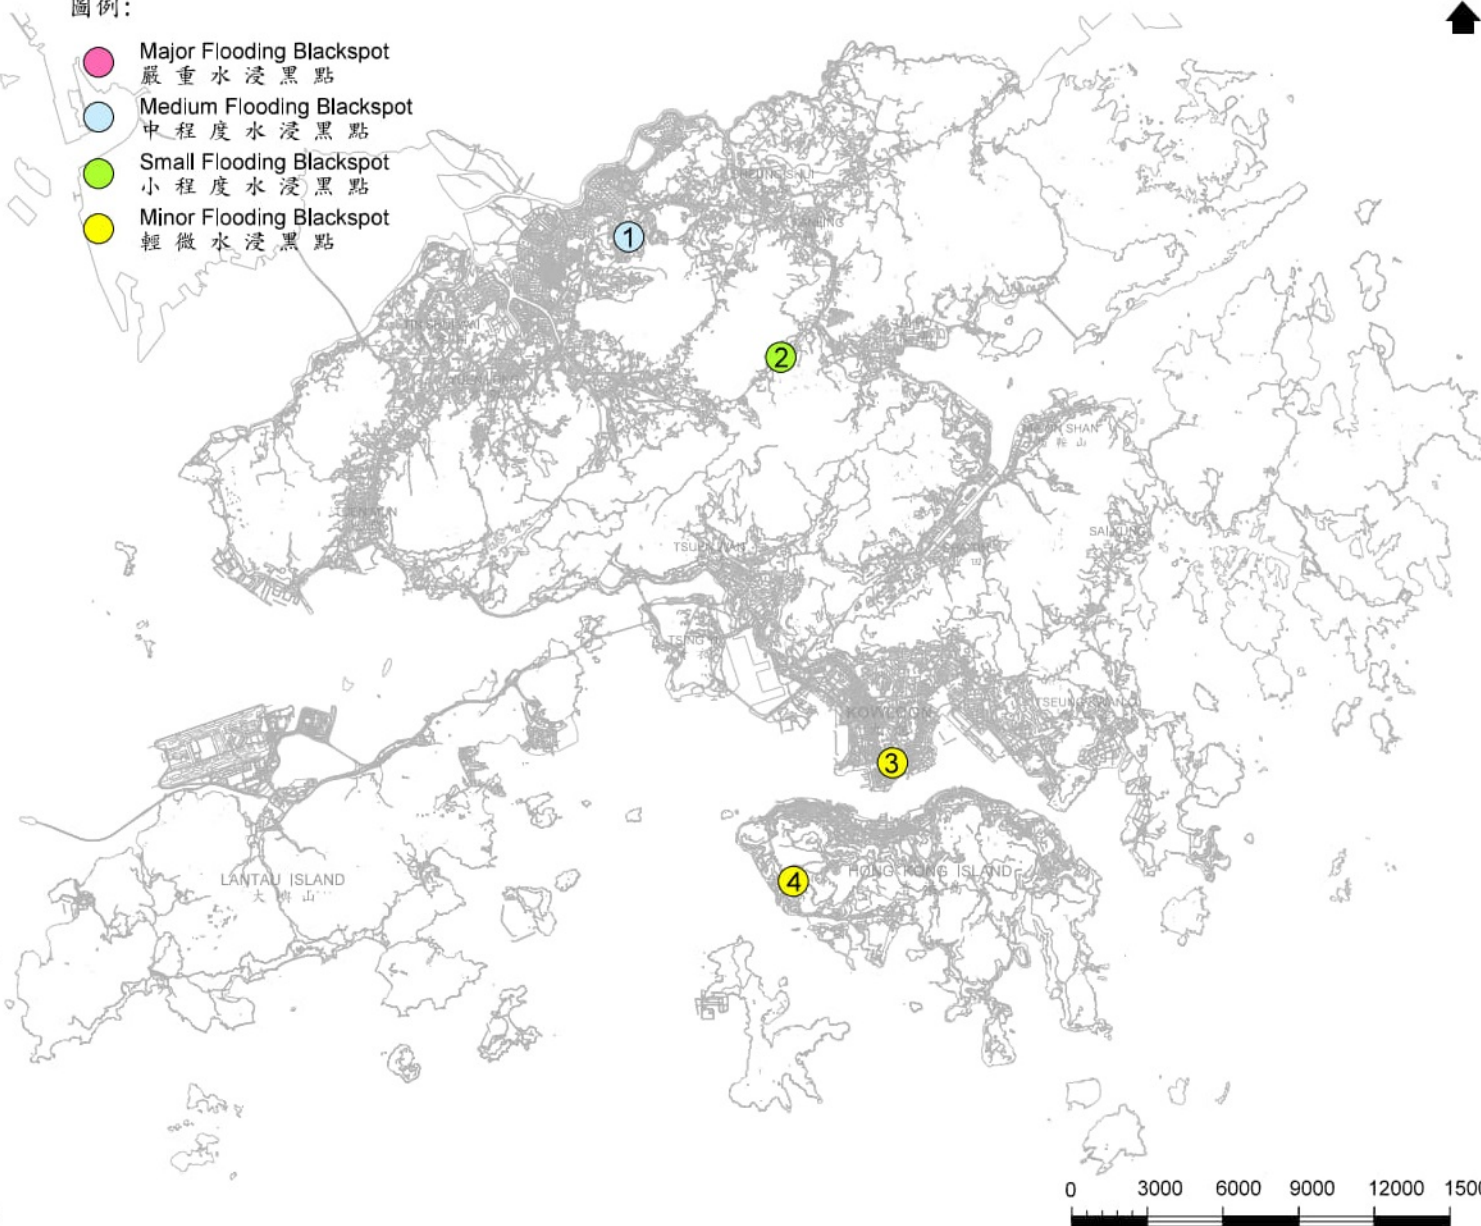

Flooding Blackspots

水浸黑點

No. 編號	Location 地點
1	Shek Wu Wai, San Tin 新田石湖圍
2	Lam Tsuen Valley Basin 林村谷盆地
3	Chatham Road South (Granville Road to Austin Avenue) 漆咸道南 (加連威老道和柯士甸路之間)
4	Pok Fu Lam Village 薄扶林村

Remarks :


The DSD blackspots list and location map are produced based on previous flooding records and complaints received by DSD for monitoring the maintenance and mitigation measures to alleviate flooding at the blackspots. Locations susceptible to flooding problems dominated by tidal influence were not included. The blackspots list and maps should not be used as an indication of the actual or hidden flood risk at any particular location in Hong Kong.

備註：

渠務署水浸黑點名單及位置圖是根據我們以往的水浸記錄及收到的水浸投訴編制而成，用以監察該地點維修及防洪措施的進展，一些純粹因潮漲引發水浸的地點並未包括在內。水浸黑點名單及位置圖並不適用於顯示本港任何地方的實際或隱藏水浸風險。

Flooding Blackspots as at March 2023

水浸黑點 (2023 年 3 月 情況)

Drawing no. DLD 4012C	Scale A4 (1:300000)	Date Mar 2023
Office LAND DRAINAGE DIVISION		 DRAINAGE SERVICES DEPARTMENT HONG KONG

Appendix D

Synthetic Rainfall Profile and Its Calculation Example

Design 4-hr Rainfall Profile

Rainfall intensity is calculated according to Section 4.3.5 of SDM as below

<div>Rain Storm Return Period Storm Constant¹</div>	2yr	10yr	50yr	200yr
a=	446.1	485	505.5	508.6
b=	3.38	3.11	3.29	3.38
c=	0.463	0.397	0.355	0.338

Rainfall Intensity(mm/hr)

$$F(t) = \begin{cases} \frac{a(b + 2(t - c))}{(2t + b)^{c+1}} & , \quad 0 \leq t \leq \frac{t_d}{2} \\ F(-t) & , \quad -\frac{t_d}{2} \leq t \leq 0 \end{cases}$$


Rainfall Depth (mm) =28.1%*[Rainfall Intensity/60]

t	Time Series	Rainfall Depth (mm)				t	Time Series	Rainfall Depth (mm)				t	Time Series	Rainfall Depth (mm)				t	Time Series	Rainfall Depth (mm)				t	Time Series	Rainfall Depth (mm)			
		2yr	10yr	50yr	200yr			2yr	10yr	50yr	200yr			2yr	10yr	50yr	200yr			2yr	10yr	50yr	200yr			2yr	10yr	50yr	200yr
120	0:00:00	0.41	0.71	1.00	1.26	70	0:50:00	0.52	0.88	1.21	1.51	20	1:40:00	0.95	1.47	1.90	2.27	30	2:30:00	0.78	1.24	1.64	1.99	80	3:20:00	0.49	0.84	1.15	1.44
119	0:01:00	0.41	0.71	1.00	1.27	69	0:51:00	0.53	0.89	1.22	1.51	19	1:41:00	0.98	1.50	1.94	2.31	31	2:31:00	0.77	1.23	1.62	1.96	81	3:21:00	0.49	0.83	1.15	1.44
118	0:02:00	0.41	0.72	1.00	1.27	68	0:52:00	0.53	0.89	1.22	1.52	18	1:42:00	1.00	1.53	1.98	2.35	32	2:32:00	0.76	1.21	1.60	1.94	82	3:22:00	0.49	0.83	1.14	1.43
117	0:03:00	0.41	0.72	1.01	1.27	67	0:53:00	0.53	0.90	1.23	1.53	17	1:43:00	1.03	1.57	2.02	2.39	33	2:33:00	0.75	1.20	1.59	1.92	83	3:23:00	0.48	0.82	1.14	1.42
116	0:04:00	0.41	0.72	1.01	1.28	66	0:54:00	0.54	0.90	1.24	1.53	16	1:44:00	1.06	1.61	2.07	2.44	34	2:34:00	0.74	1.18	1.57	1.91	84	3:24:00	0.48	0.82	1.13	1.42
115	0:05:00	0.41	0.72	1.01	1.28	65	0:55:00	0.54	0.91	1.24	1.54	15	1:45:00	1.10	1.65	2.11	2.50	35	2:35:00	0.73	1.17	1.55	1.89	85	3:25:00	0.48	0.82	1.13	1.41
114	0:06:00	0.42	0.73	1.02	1.28	64	0:56:00	0.55	0.92	1.25	1.55	14	1:46:00	1.13	1.70	2.17	2.55	36	2:36:00	0.72	1.15	1.54	1.87	86	3:26:00	0.48	0.81	1.12	1.41
113	0:07:00	0.42	0.73	1.02	1.29	63	0:57:00	0.55	0.92	1.26	1.56	13	1:47:00	1.18	1.75	2.23	2.62	37	2:37:00	0.71	1.14	1.52	1.85	87	3:27:00	0.47	0.81	1.12	1.40
112	0:08:00	0.42	0.73	1.02	1.29	62	0:58:00	0.55	0.93	1.26	1.57	12	1:48:00	1.22	1.81	2.30	2.69	38	2:38:00	0.70	1.13	1.51	1.84	88	3:28:00	0.47	0.81	1.11	1.40
111	0:09:00	0.42	0.73	1.03	1.30	61	0:59:00	0.56	0.93	1.27	1.57	11	1:49:00	1.28	1.88	2.37	2.76	39	2:39:00	0.69	1.12	1.49	1.82	89	3:29:00	0.47	0.80	1.11	1.39
110	0:10:00	0.42	0.74	1.03	1.30	60	1:00:00	0.56	0.94	1.28	1.58	10	1:50:00	1.34	1.95	2.45	2.85	40	2:40:00	0.68	1.11	1.48	1.81	90	3:30:00	0.47	0.80	1.11	1.39
109	0:11:00	0.43	0.74	1.03	1.30	59	1:01:00	0.57	0.95	1.29	1.59	9	1:51:00	1.41	2.04	2.55	2.95	41	2:41:00	0.67	1.10	1.47	1.79	91	3:31:00	0.46	0.79	1.10	1.38
108	0:12:00	0.43	0.74	1.04	1.31	58	1:02:00	0.57	0.95	1.29	1.60	8	1:52:00	1.49	2.14	2.66	3.07	42	2:42:00	0.67	1.08	1.45	1.78	92	3:32:00	0.46	0.79	1.10	1.38
107	0:13:00	0.43	0.74	1.04	1.31	57	1:03:00	0.58	0.96	1.30	1.61	7	1:53:00	1.59	2.26	2.80	3.21	43	2:43:00	0.66	1.07	1.44	1.76	93	3:33:00	0.46	0.79	1.09	1.37
106	0:14:00	0.43	0.75	1.04	1.32	56	1:04:00	0.58	0.97	1.31	1.62	6	1:54:00	1.72	2.41	2.96	3.37	44	2:44:00	0.65	1.06	1.43	1.75	94	3:34:00	0.46	0.78	1.09	1.37
105	0:15:00	0.43	0.75	1.05	1.32	55	1:05:00	0.59	0.97	1.32	1.63	5	1:55:00	1.87	2.60	3.16	3.58	45	2:45:00	0.65	1.05	1.42	1.74	95	3:35:00	0.45	0.78	1.08	1.36
104	0:16:00	0.43	0.75	1.05	1.32	54	1:06:00	0.59	0.98	1.33	1.64	4	1:56:00	2.08	2.84	3.42	3.84	46	2:46:00	0.64	1.05	1.41	1.73	96	3:36:00	0.45	0.78	1.08	1.36
103	0:17:00	0.44	0.76	1.05	1.33	53	1:07:00	0.60	0.99	1.34	1.65	3	1:57:00	2.38	3.18	3.77	4.19	47	2:47:00	0.63	1.04	1.40	1.71	97	3:37:00	0.45	0.77	1.08	1.35
102	0:18:00	0.44	0.76	1.06	1.33	52	1:08:00	0.60	1.00	1.35	1.66	2	1:58:00	2.83	3.69	4.29	4.71	48	2:48:00	0.63	1.03	1.39	1.70	98	3:38:00	0.45	0.77	1.07	1.35
101	0:19:00	0.44	0.76	1.06	1.34	51	1:09:00	0.61	1.00	1.36	1.67	1	1:59:00	3.62	4.58	5.17	5.55	49	2:49:00	0.62	1.02	1.38	1.69	99	3:39:00	0.44	0.77	1.07	1.35
100	0:20:00	0.44	0.76	1.06	1.34	50	1:10:00	0.61	1.01	1.37	1.68	0	2:00:00	5.42	6.60	7.07	7.28	50	2:50:00	0.61	1.01	1.37	1.68	100	3:40:00	0.44	0.76	1.06	1.34
99	0:21:00	0.44	0.77	1.07	1.35	49	1:11:00	0.62	1.02	1.38	1.69	1	2:01:00	3.62	4.58	5.17	5.55	51	2:51:00	0.61	1.00	1.36	1.67	101	3:41:00	0.44	0.76	1.06	1.34
98	0:22:00	0.45	0.77	1.07	1.35	48	1:12:00	0.63	1.03	1.39	1.70	2	2:02:00	2.83	3.69	4.29	4.71	52	2:52:00	0.60	1.00	1.35	1.66	102	3:42:00	0.44	0.76	1.06	1.33
97	0:23:00	0.45	0.77	1.08	1.35	47	1:13:00	0.63	1.04	1.40	1.71	3	2:03:00	2.38	3.18	3.77	4.19	53	2:53:00	0.60	0.99	1.34	1.65	103	3:43:00	0.44	0.76	1.05	1.33
96	0:24:00	0.45	0.78	1.08	1.36	46	1:14:00	0.64	1.05	1.41	1.73	4	2:04:00	2.08	2.84	3.42	3.84	54	2:54:00	0.59	0.98	1.33	1.64	104	3:44:00	0.43	0.75	1.05	1.32
95	0:25:00	0.45	0.78	1.08	1.36	45	1:15:00	0.65	1.05	1.42	1.74	5	2:05:00	1.87	2.60	3.16	3.58	55	2:55:00	0.59	0.97	1.32	1.63	105	3:45:00	0.43	0.75	1.05	1.32
94	0:26:00	0.46	0.78	1.09	1.37	44	1:16:00	0.65	1.06	1.43	1.75	6	2:06:00	1.72	2.41	2.96	3.37	56	2:56:00	0.58	0.97	1.31	1.62	106	3:46:00	0.43	0.75	1.04	1.32
93	0:27:00	0.46	0.79	1.09	1.37	43	1:17:00	0.66	1.07	1.44	1.76	7	2:07:00	1.59	2.26	2.80	3.21	57	2:57:00	0.58	0.96	1.30	1.61	107	3:47:00	0.43	0.74	1.04	1.31
92	0:28:00	0.46	0.79	1.10	1.38	42	1:18:00	0.67	1.08	1.45	1.78	8	2:08:00	1.49	2.14	2.66	3.07	58	2:58:00	0.57	0.95	1.29	1.60	108	3:48:00	0.43	0.74	1.04	1.31
91	0:29:00	0.46	0.79	1.10	1.38	41	1:19:00	0.67	1.10	1.47	1.79	9	2:09:00	1.41	2.04	2.55	2.95	59	2:59:00	0.57	0.95	1.29	1.59	109	3:49:00	0.43	0.74	1.03	1.30
90	0:30:00	0.47	0.80	1.11	1.39	40	1:20:00	0.68	1.11	1.48	1.81	10	2:10:00	1.34	1.95	2.45	2.85	60	3:00:00	0.56	0.94	1.28	1.58	110	3:50:00	0.42	0.74	1.03	1.30
89	0:31:00	0.47	0.80	1.11	1.39	39	1:21:00	0.69	1.12	1.49	1.82	11	2:11:00	1.28	1.88	2.37	2.76	61	3:01:00	0.56	0.93	1.27	1.57	111	3:51:00	0.42	0.73	1.03	1.30
88	0:32:00	0.47	0.81	1.11	1.40	38	1:22:00	0.70	1.13	1.51	1.84	12	2:12:00	1.22	1.81	2.30	2.69	62	3:02:00	0.55	0.93	1.26	1.57	112	3:52:00	0.42	0.73	1.02	1.29
87	0:33:00	0.47	0.81	1.12	1.40	37	1:23:00	0.71	1.14	1.52	1.85	13	2:13:00	1.18	1.75	2.23	2.62	63	3:03:00	0.55	0.92	1.26	1.56	113	3:53:00	0.42	0.73	1.02	1.29</


Appendix E
Catchment Characteristic Input for
MP02A-A1 to A8 and AA-AE
(Information Extracted from Mike11 RR Model)
&
Modelling settings in Mike 11 for Wetland
Restoration Area

Catchment Characteristic Input in Mike 11 Hydraulic Model

Pre-Development Drainage Network

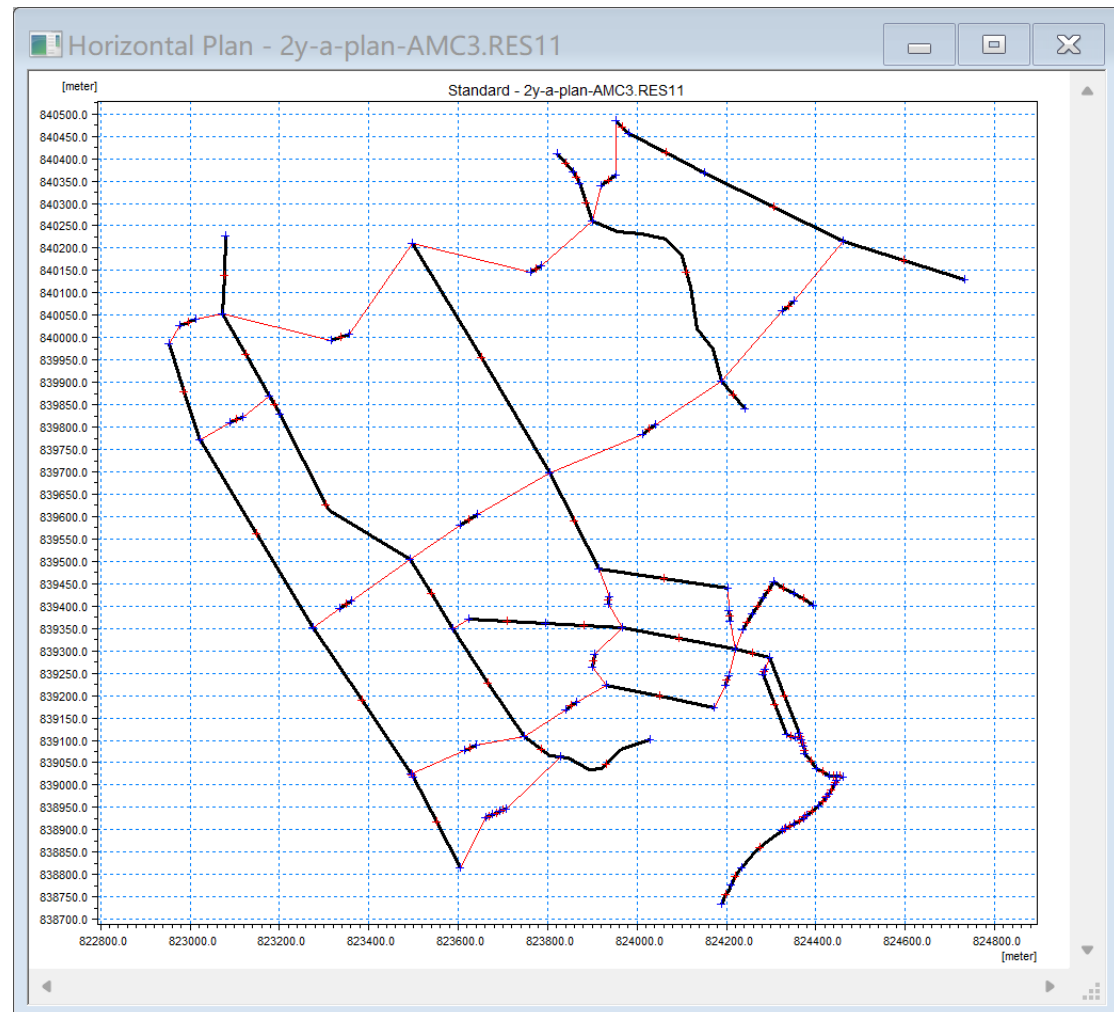

Post-Development Drainage Network

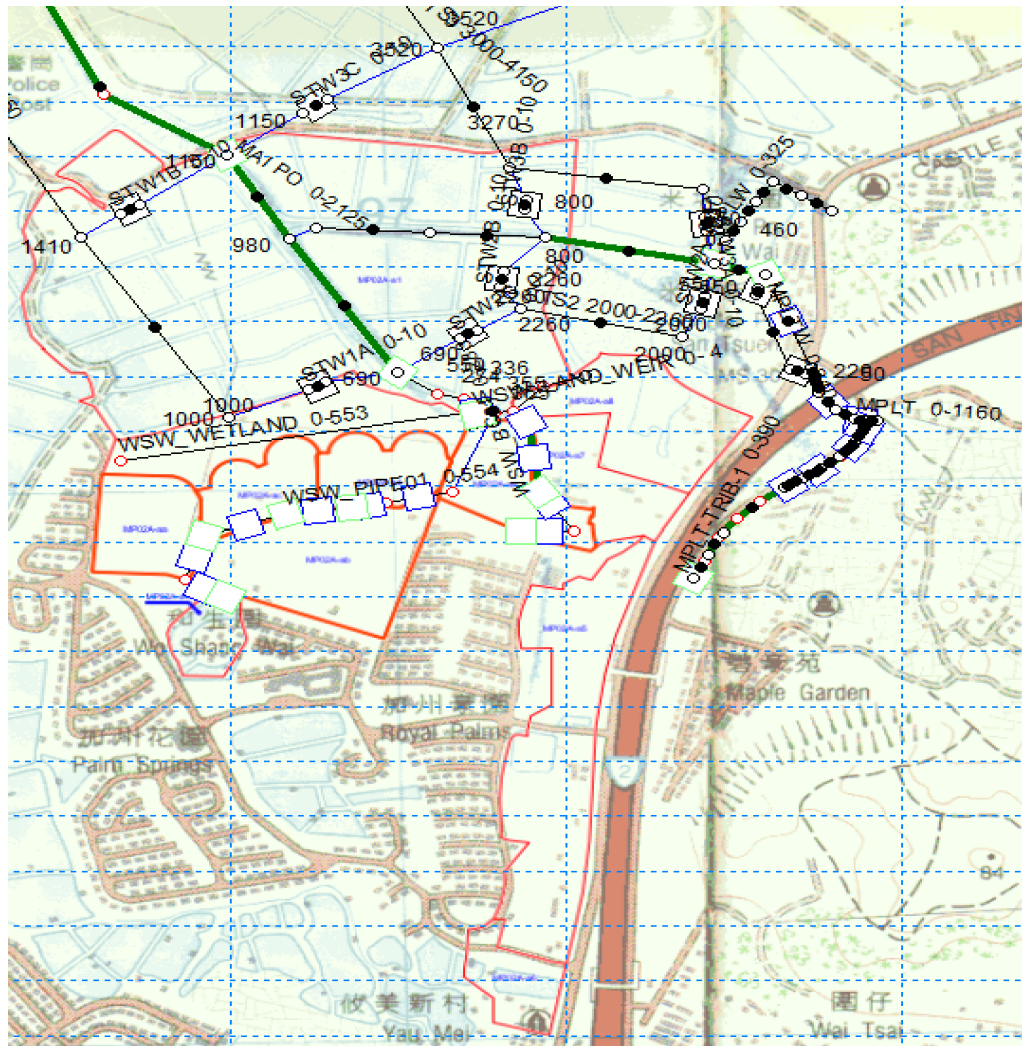

Catchment Characteristic Input in Mike 11 Hydraulic Model

Pre-Development Condition of Catchment MP02A-A1 to A8

(Areal reduction factors of 0.82 and AMC 3 as example)

MIKE Zero - [Plan2011-81rf-AMC3_2y - Modified]

File Edit Grid View Parameters Layers Basin Work Area Window Help

Catchments NAM UHM SMAP Urban FEH DRift Timeseries

B01A-A

Adjustment and Baseflow

Area adjustment 0.82

Baseflow 0

Hydrograph

SCS dimensionless

Enlargement and Loss Model

SCS method Curve 62

Initial 3

Lag Time

Curve number method Lag Time Calculate 0.55

Hydraulic 2.45

Slope 25

Curve 62

Overview

	Name	Method	AreaAF	Baseflow	InitLoss	ConstLos	RunoffC	LossCurv	InitialAM	LagTime	HLength	Slope	LagCurve	Rainfall	Effective	Basin
211	SWS4	SCS di	0.82	0	0	0	0.75	43	3	2.52	5	10	2	0	0	0
212	SWS5	SCS di	0.82	0	0	0	0.75	43	3	4.47	8.91	8	4	0	0	0
213	SWS6	SCS di	0.82	0	0	0	0.75	56	3	5.89	5.2	1	5	0	0	0
214	SWS7	SCS di	0.82	0	0	0	0.75	74	3	4.99	4.95	0.5	4	0	0	0
215	SWS8	SCS di	0.82	0	0	0	0.75	79	3	8.89	6.9	0.2	8	0	0	0
216	SWS9	SCS di	0.82	0	0	0	0.75	49	3	6.81	5	1	6	0	0	0
217	I01A-C	SCS di	0.82	0	0	0	0.75	67	3	0.43	1.78	19	0	0	0	0
218	MP02A-A1	SCS di	0.82	0	0	0	0.75	100	3	0.3	0.44	0.34	0	0	0	0
219	MP02A-A4	SCS di	0.82	0	0	0	0.75	90	3	4.18	1.03	0.02	4	0	0	0
220	MP02A-A5	SCS di	0.82	0	0	0	0.75	85	3	1.48	0.94	0.2	1	0	0	0
221	MP02A-A6	SCS di	0.82	0	0	0	0.75	85	3	1.94	1.1	0.15	1	0	0	0
222	MP02A-A7	SCS di	0.82	0	0	0	0.75	85	3	0.52	0.48	0.55	0	0	0	0
223	MP02A-A8	SCS di	0.82	0	0	0	0.75	85	3	0.68	0.53	0.38	0	0	0	0
224	MP02A-A2	SCS di	0.82	0	0	0	0.75	90	3	0.0942	0.16	2	90	0	0	0
225	MP02A-A3	SCS di	0.82	0	0	0	0.75	85	3	0.114	0.16	2	85	0	0	0

Catchment Characteristic Input in Mike 11 Hydraulic Model

Post-Development Condition of Catchment MP02A-AA to AE

(Areal reduction factors of 0.82 and AMC 3 as example)

MIKE Zero - [Plan2011-81rf-AMC3_200y - Modified]

File Edit Grid View Parameters Layers Basin Work Area Window Help

Catchments NAM UHM SMAP Urban FEH DRIFT Timeseries

B01A-A

Adjustment and Baseflow

Area adjustment 0.82

Baseflow 0

Hydrograph

SCS dimensionless

Enlargement and Loss Model

SCS method Curve 62

Initial 3

Lag Time

Curve number method Lag Time Calculate 0.55

Hydraulic 2.45

Slope 25


Curve 62

Overview

	Name	Method	AreaAF	Baseflow	InitLoss	ConstLos	RunoffC	LossCurv	InitialAM	LagTime	HLength	Slope	LagCurve	Rainfall	Effective	Basin	Basin	Time of	f1	Rsa
224	MP02A-A9	SCS di	0.82	0	0	0	0.75	100	3	0.09	0.01	0.01	0	0	0	0	0	0	0	0
225	MP02A-AA	SCS di	0.82	0	0	0	0.75	91	3	0.0903	0.16	2	91	0	0	0	0	0	0	0
226	MP02A-AB	SCS di	0.82	0	0	0	0.75	91	3	0.0903	0.16	2	91	0	0	0	0	0	0	0
227	MP02A-AC	SCS di	0.82	0	0	0	0.75	91	3	0.0903	0.16	2	91	0	0	0	0	0	0	0
228	MP02A-AD	SCS di	0.82	0	0	0	0.75	91	3	0.0903	0.16	2	91	0	0	0	0	0	0	0
229	MP02A-AE	SCS di	0.82	0	0	0	0.75	91	3	0.0298	0.04	2	91	0	0	0	0	0	0	0

Modelling settings in Mike 11 for Wetland Restoration Area

Wetland Network

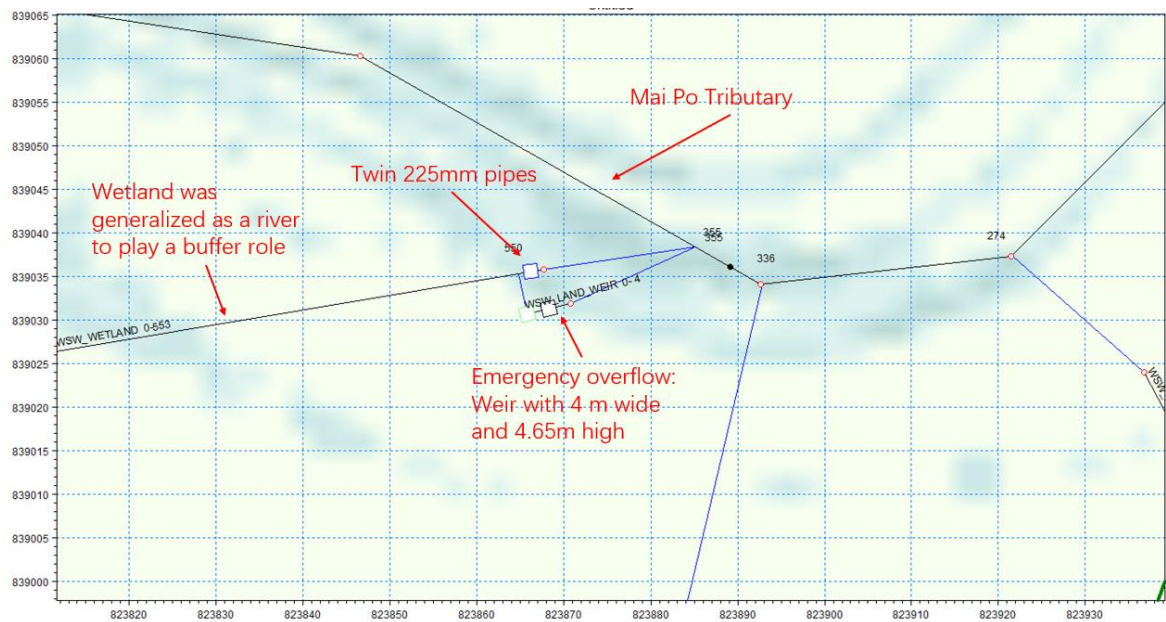

Modelling settings in Mike 11 for Wetland Restoration Area

a. Twin 225mm pipes

Branch Name: WSW_WETLAN Chainage: 551.5 ID:

Type: Regular Edit reservoir storage...

Attributes:

- Upstream Invert: 4.2
- DownStr. Invert: 4.1
- Length: 3
- Manning's n: 0.015
- No. of Culverts: 2
- Valve Regulation: None
- Section Type: Closed

Head Loss Factor:

	Inflow	Out Flow	Free Overflow	Bends
Positive Flow	0.5	1	1	0
Negative Flow	0.5	1	1	0

Geometry:

Type: Circular

Irregular:

	Depth	Width
1		

Circular:

Diameter: 0.225

Rectangular:

Width: 0

Height: 0

Graphic:

Horizontal offset from marker 2: 2 Plot...

Flow Conditions:

Q-h relations Hydraulic Parameters Orifice Flow Coefficients

	y	Qc	Type
1	0	0	No Flow
2	0.002	6.198	Inlet C

	y	Qc	Type
1	0.099	0	No Flow
2	0.102	6.198	Outlet C

No of Q/h-relations: 40 Calculate Qh...

	Branch	Chain.	ID	Upstream Invert	Downstream Invert	Length	Manningsn	No. of Culverts	Valve Regulation	Section type	Geometry ty
15	WSW_BC01	276	BC4	1.736	1.71	14	0.015	1	None	Closed	Rectangular
16	WSW_PIPE0	37.5		3.1	2.93	80	0.015	1	None	Closed	Circular
17	WSW_PIPE0	123		2.93	2.68	120	0.015	1	None	Closed	Circular
18	WSW_PIPE0	267.5		2.68	2.58	65	0.015	1	None	Closed	Circular
19	WSW_PIPE0	374		2.58	2.43	80	0.015	1	None	Closed	Circular
20	WSW_PIPE0	436		2.43	1.92	200	0.015	1	None	Closed	Circular
21	WSW_PIPE0	521		1.92	1.83	57	0.015	1	Only Positive Flow	Closed	Circular
22	WSW_PIPE0	15		1.962	1.919	30	0.015	1	None	Closed	Circular
23	WSW_PIPE0	80		1.919	1.831	70	0.015	1	None	Closed	Circular
24	WSW_PIPE0	137		1.831	1.721	74	0.015	1	None	Closed	Circular
25	WSW_WETL	551.5		4.2	4.1	3	0.015	2	None	Closed	Circular

b. Emergency Overflow: Weir

Location:

River Name: WSW_LAND_WEI Chainage: 2 ID:

Type: Regular Edit reservoir...

Attributes:

- Type: Broad Crested Weir
- Valve: None

Head Loss Factor:

	Inflow	OutFlow	Free Overflow
Positive Flow	0.5	1	1
Negative Flow	0.5	1	1

Graphic:

Horizontal offset from marker 2: 2 Plot...

Geometry:

Type: Level-Width

Datum: 0

	Level	Width
1	4.65	4

Free Overflow Q/h-relations:

No of Q/h-relations: 20 Calculate Q/h-relations

	Q	H-Pos	H-Neg	H-Weir	Width	Area
1	0	4.65	4.65	4.65	4	0
2	0.786042	4.91372	4.91372	4.80789	4	0.631579
3	2.22326	5.15954	5.15954	4.96579	4	1.26316
4	4.08439	5.39473	5.39473	5.12368	4	1.89474
5	6.28833	5.6229	5.6229	5.28158	4	2.52631
6	8.78821	5.84579	5.84579	5.43947	4	3.15789

Overview:


	River	Chain.	ID	Type	Valve	LPI	LPO	LPF	LNi	LNi
11	STW3D	5		Broad Crested Weir	None	0.5	1	1	0.5	1
12	STW3E	5		Broad Crested Weir	None	0.5	1	1	0.5	1
13	STW3F	5		Broad Crested Weir	None	0.5	1	1	0.5	1
14	STW4B	5		Broad Crested Weir	None	0.5	1	1	0.5	1
15	STW4D	5		Broad Crested Weir	None	0.5	1	1	0.5	1
16	MPLTW	5		Broad Crested Weir	None	0.5	1	1	0.5	1
17	MPLTW	205		Broad Crested Weir	None	0.5	1	1	0.5	1
18	MPLT	140		Broad Crested Weir	None	0.5	1	1	0.5	1
19	MPLT	62		Broad Crested Weir	None	0.5	1	1	0.5	1
20	MPLT-TRIB-	225	ST1-09w	Broad Crested Weir	None	0.5	1	1	0.5	1
21	MPLT-TRIB-	280	ST1-07W	Broad Crested Weir	None	0.5	1	1	0.5	1
22	MPLT-TRIB-	350	ST1-05W	Broad Crested Weir	None	0.5	1	1	0.5	1
23	MPLT-TRIB-	385	ST1-04W(CarB	Broad Crested Weir	None	0.5	1	1	0.5	1
24	WSW_LAND	2		Broad Crested Weir	None	0.5	1	1	0.5	1

Appendix F

Hydrograph of Wetland Restoration Area


Hydrograph of Wetland Restoration Area

2yr Rainstorm Event, AMC3, RF=1.0

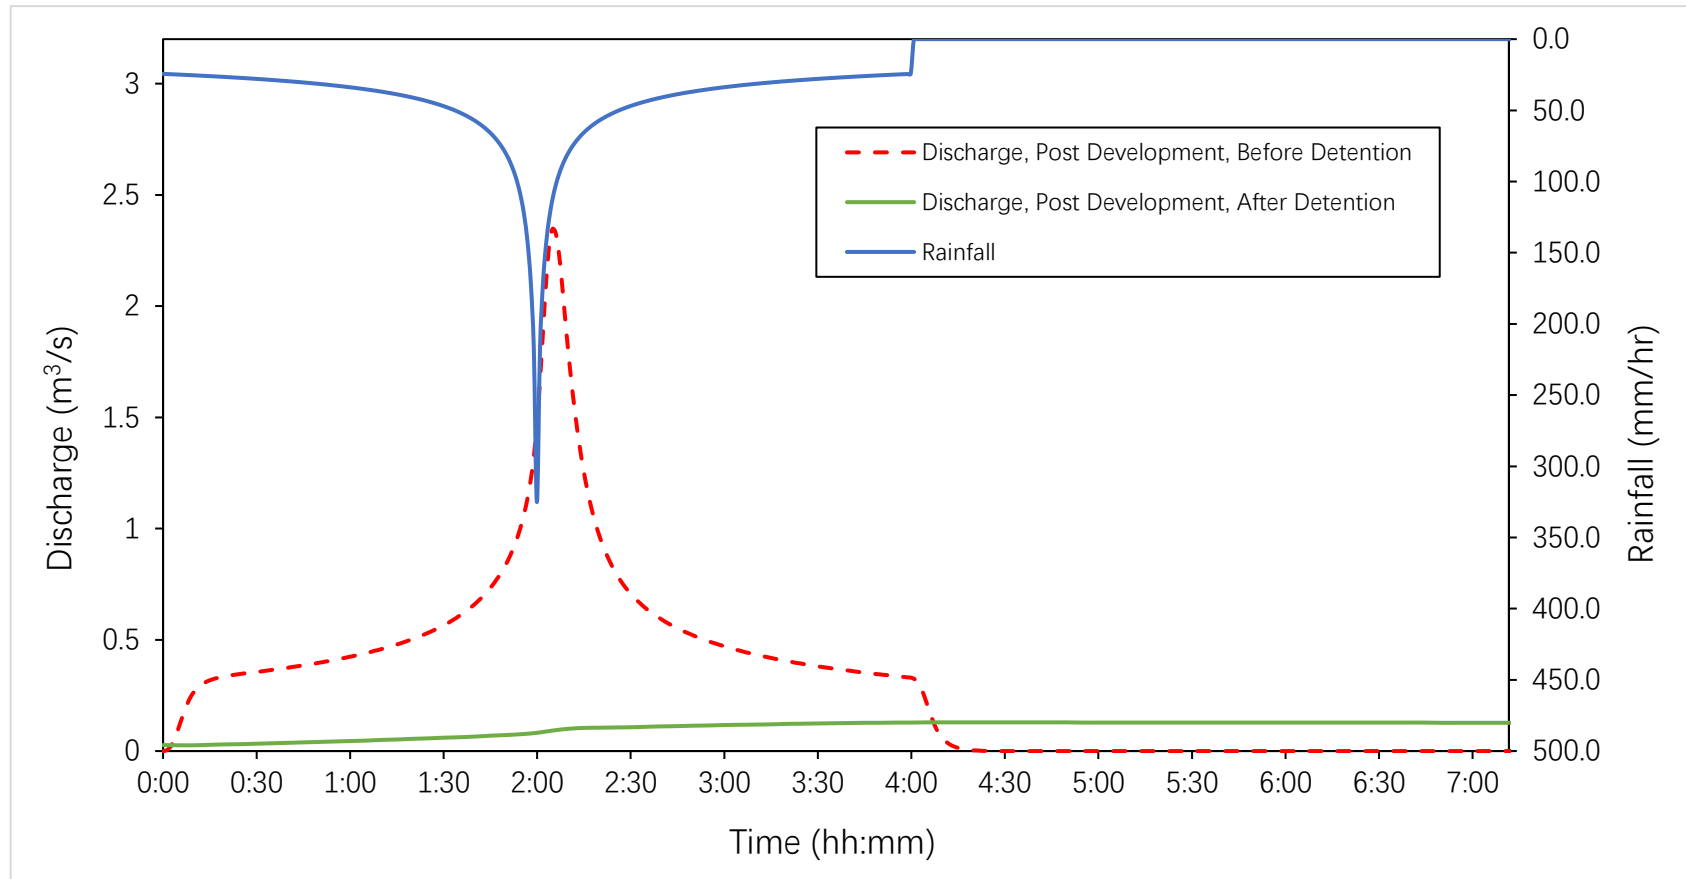


Hydrograph of Wetland Restoration Area

10yr Rainstorm Event, AMC3, RF=1.0

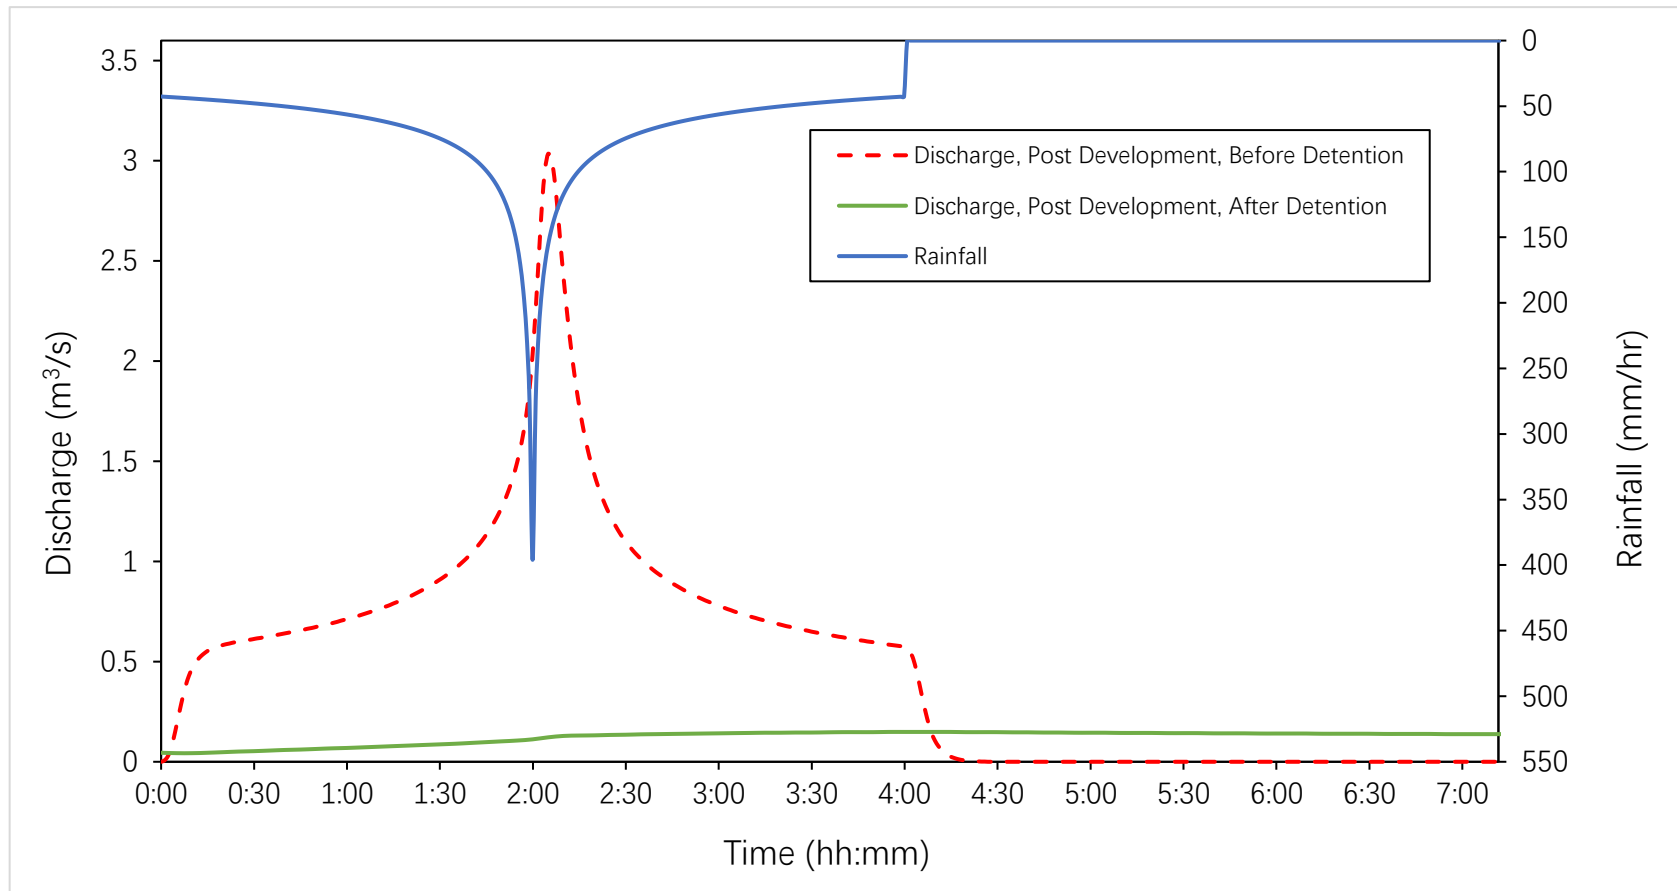


Hydrograph of Wetland Restoration Area

50yr Rainstorm Event, AMC3, RF=1.0

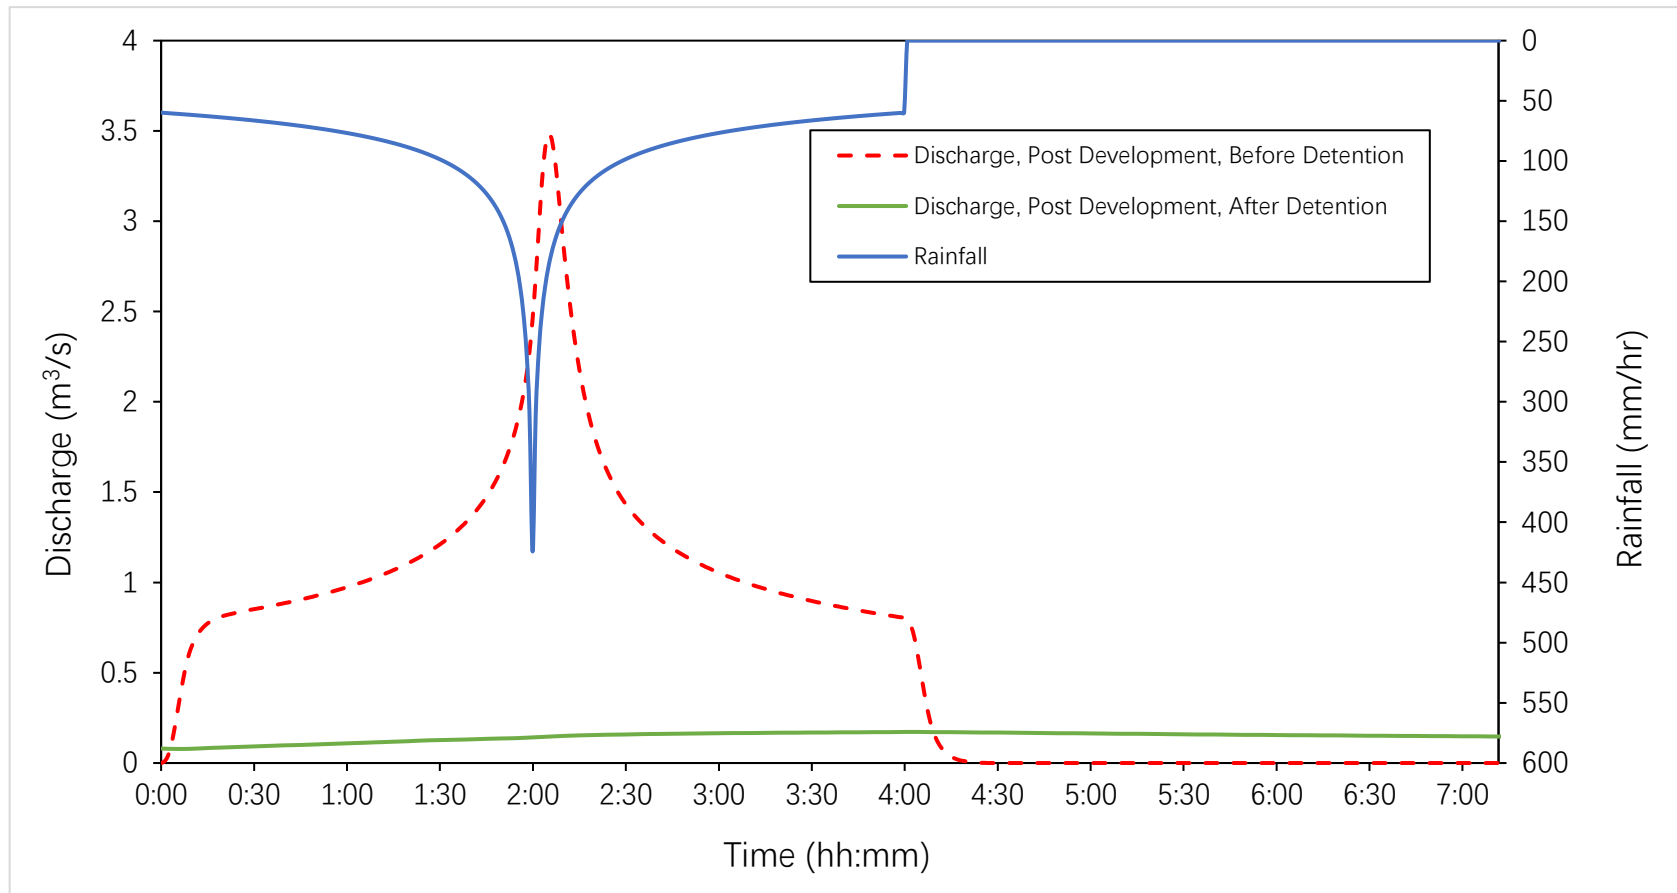

Hydrograph of Wetland Restoration Area

200yr Rainstorm Event, AMC3, RF=1.0

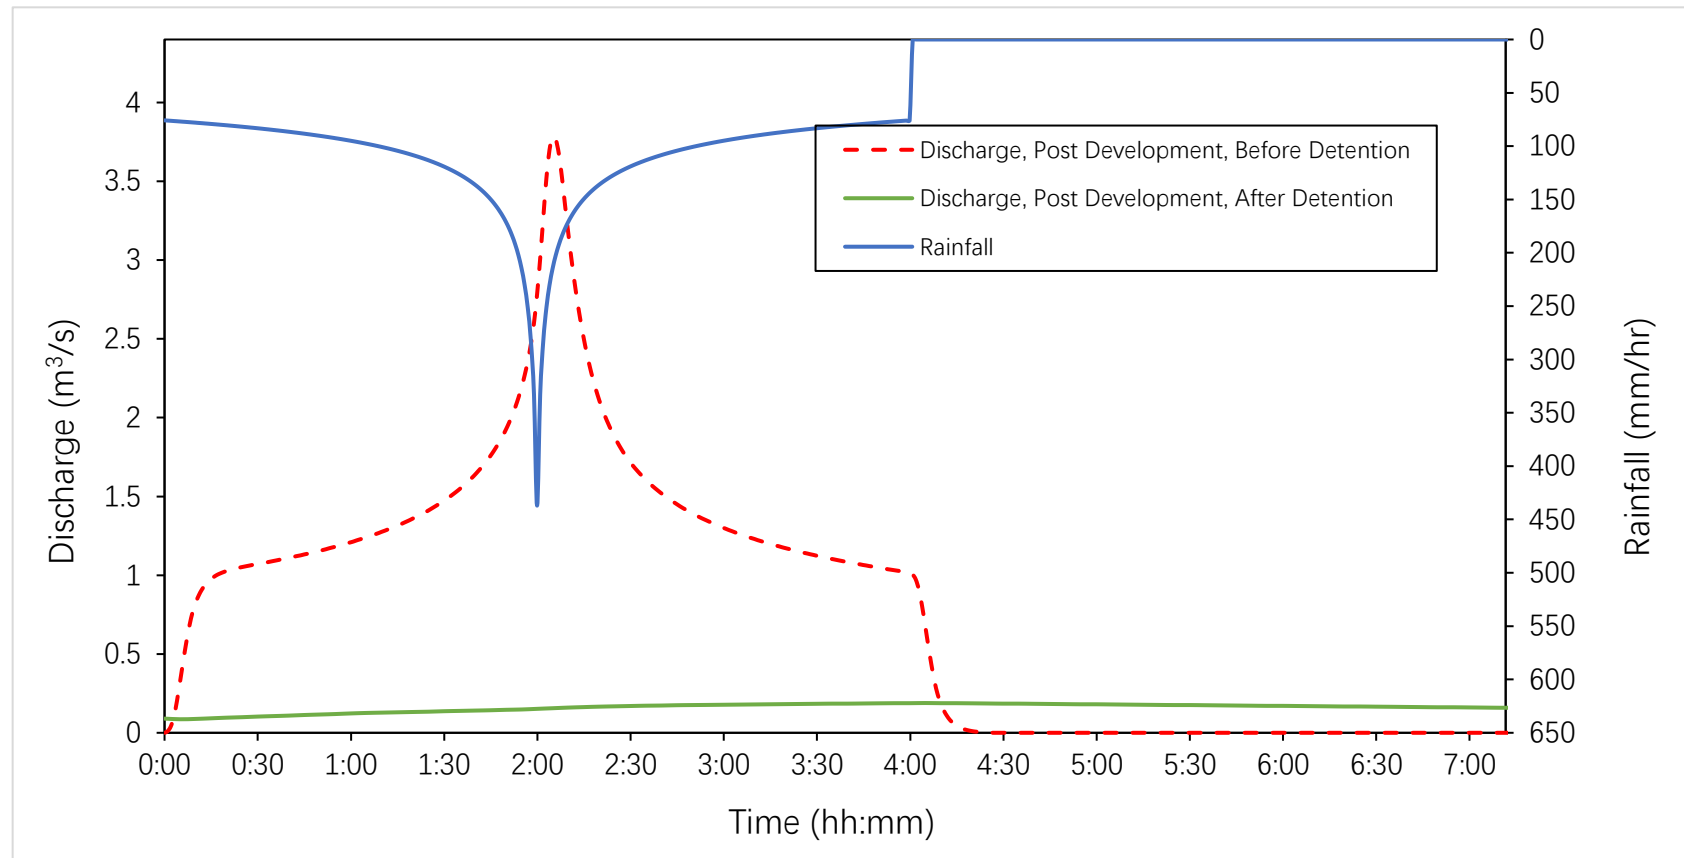


Appendix G

Hydrograph of the Proposed Development


Hydrograph of Proposed Development

2yr Rainstorm Event, AMC3, RF=1.0

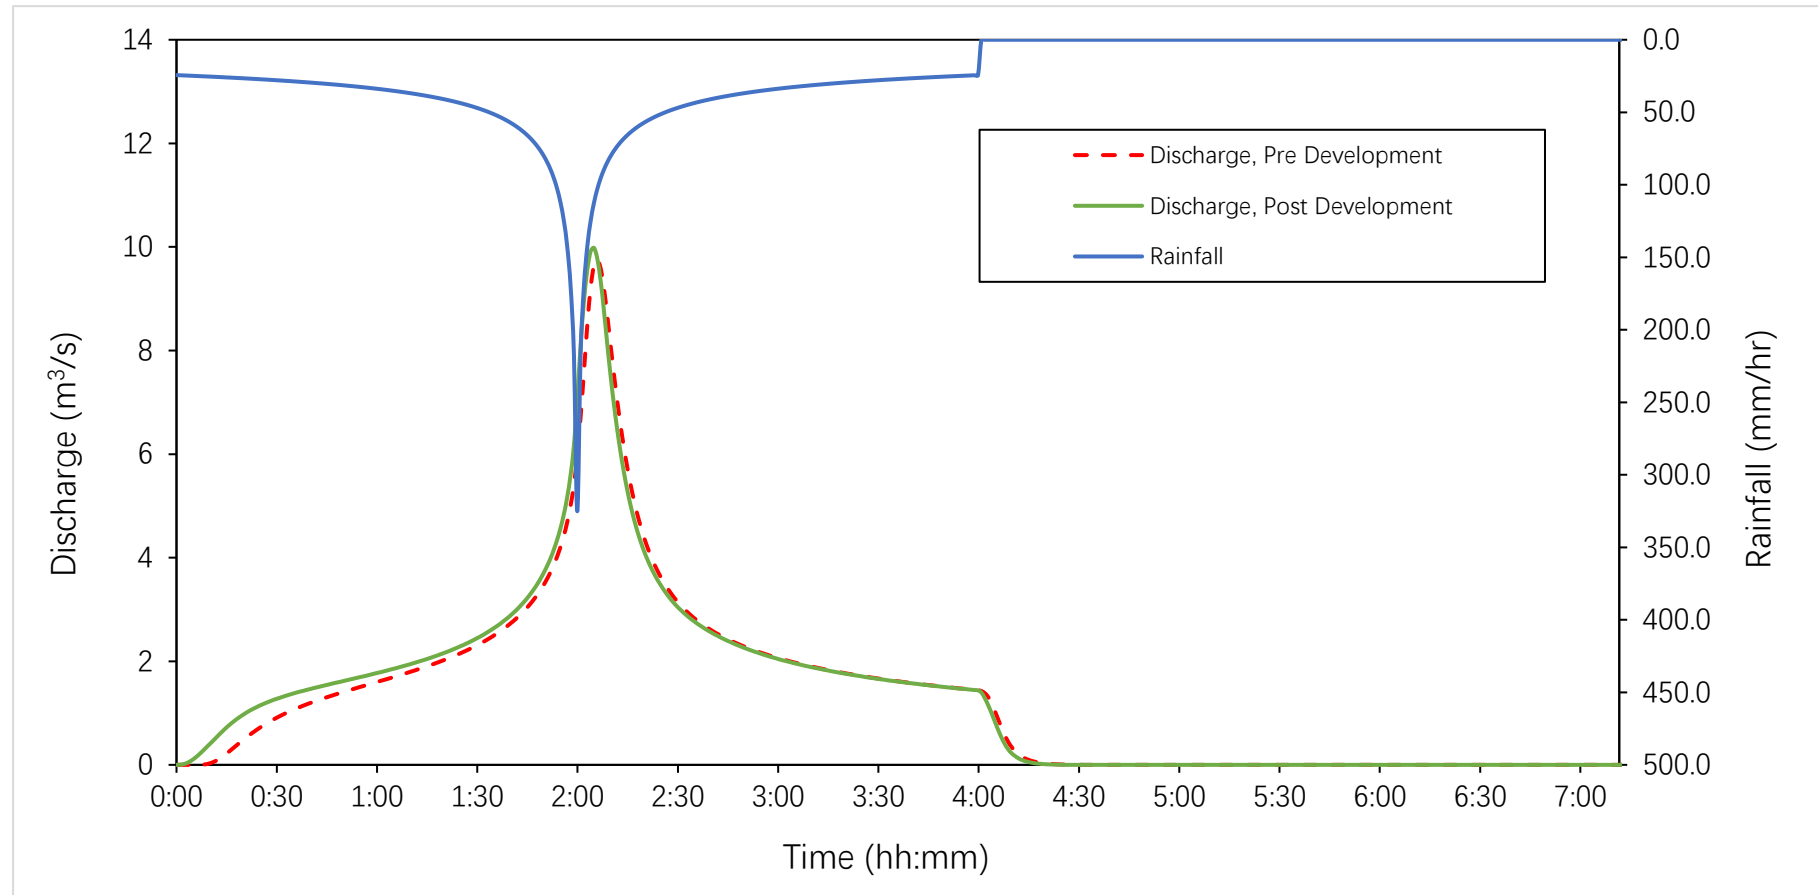


Hydrograph of Proposed Development

10yr Rainstorm Event, AMC3, RF=1.0

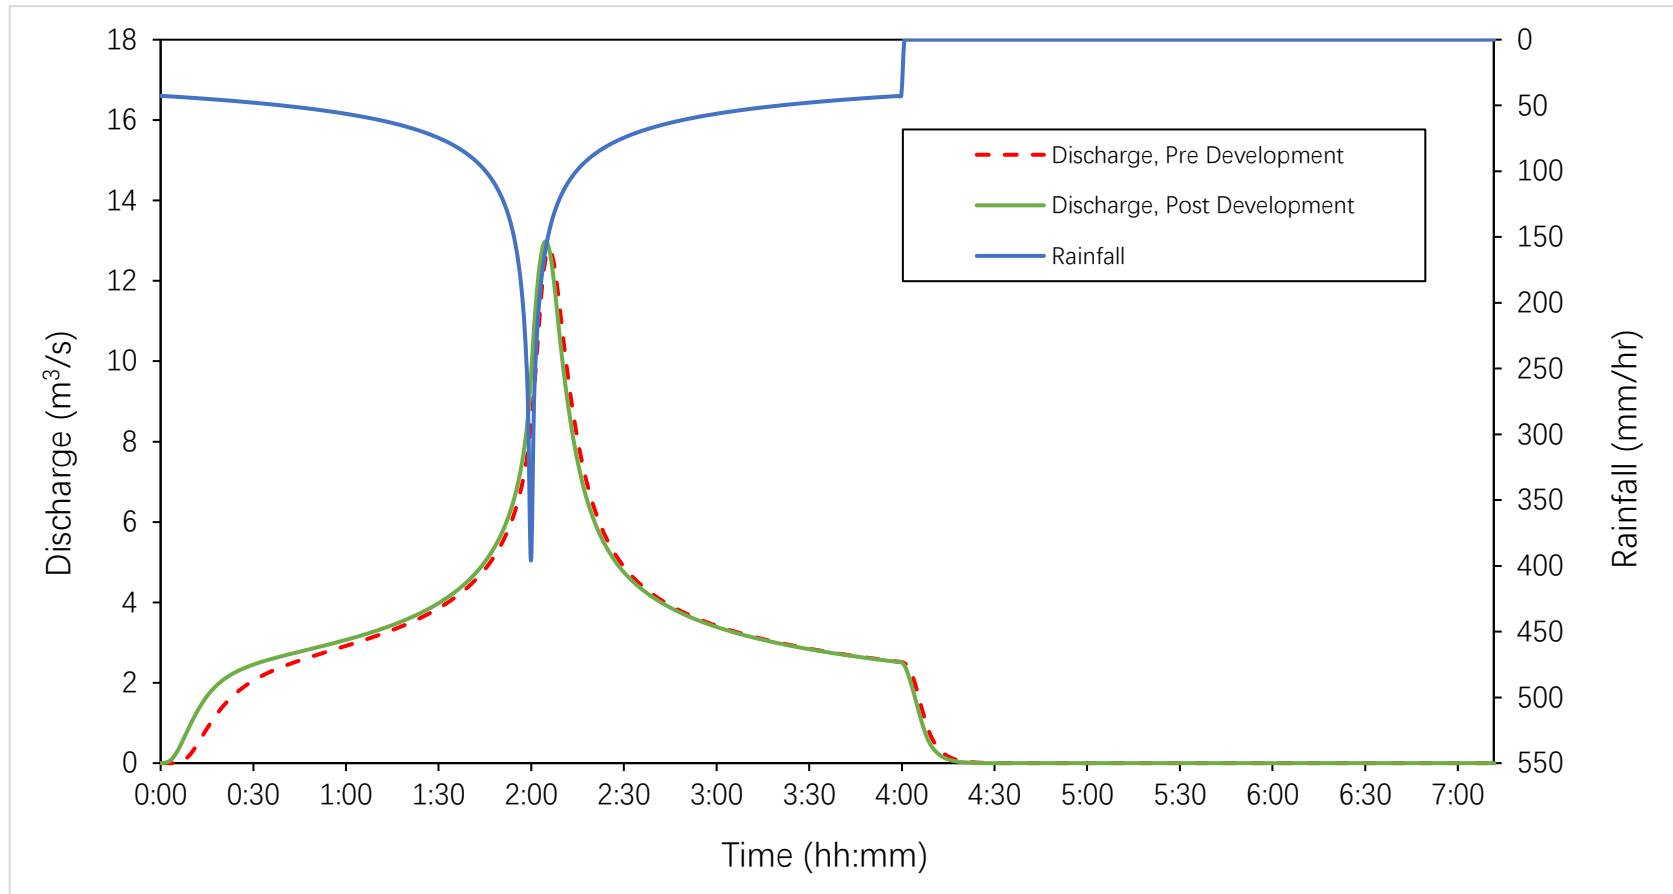


Hydrograph of Proposed Development

50yr Rainstorm Event, AMC3, RF=1.0

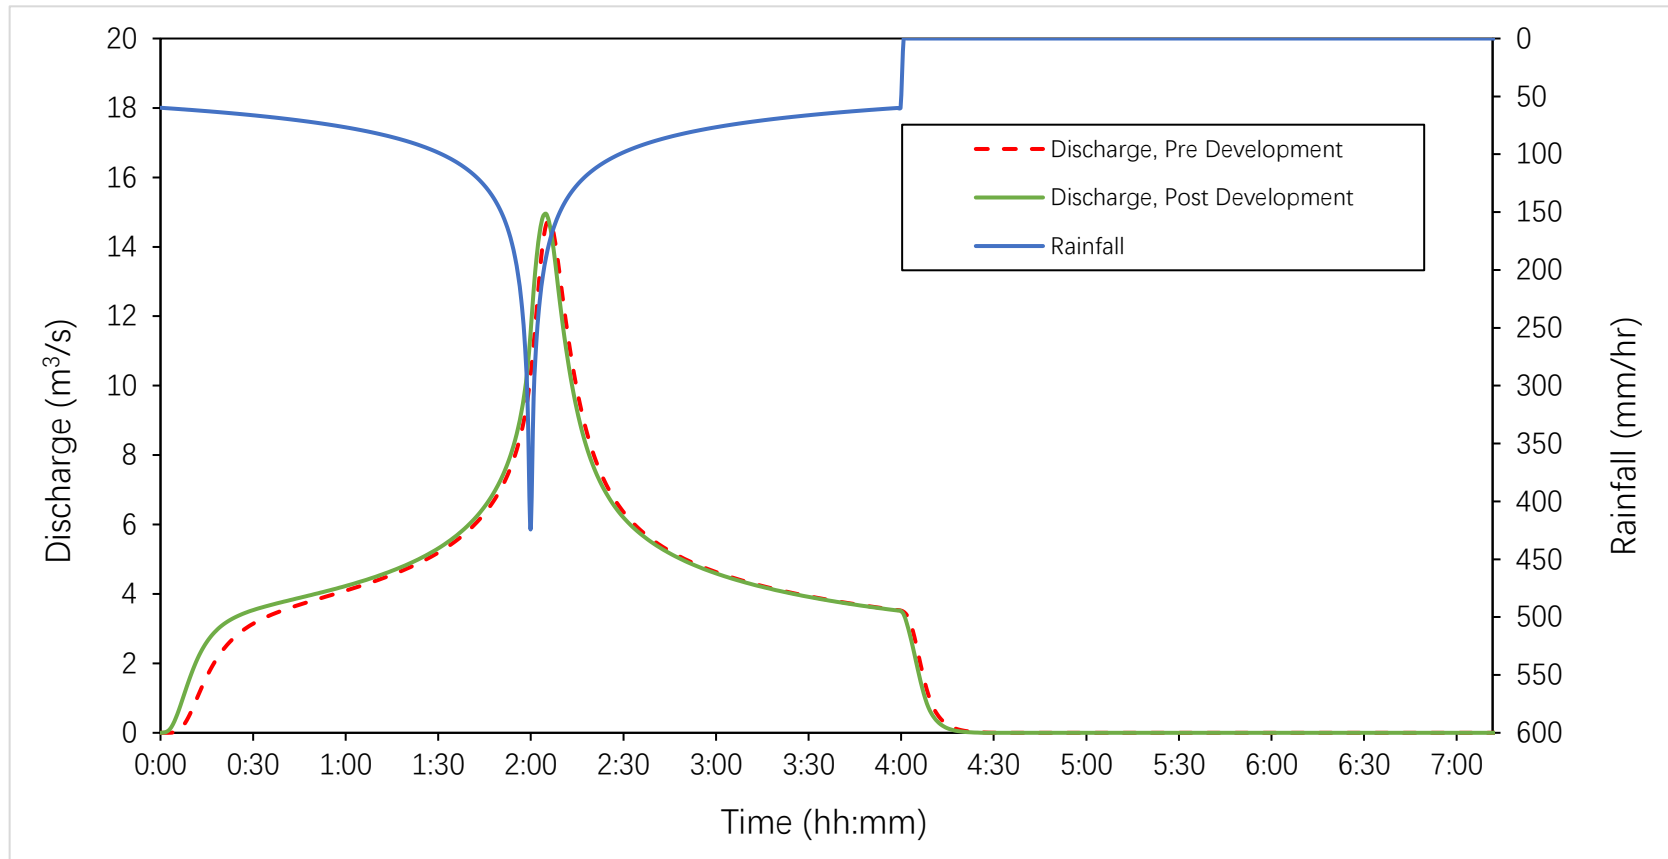

Hydrograph of Proposed Development

200yr Rainstorm Event, AMC3, RF=1.0

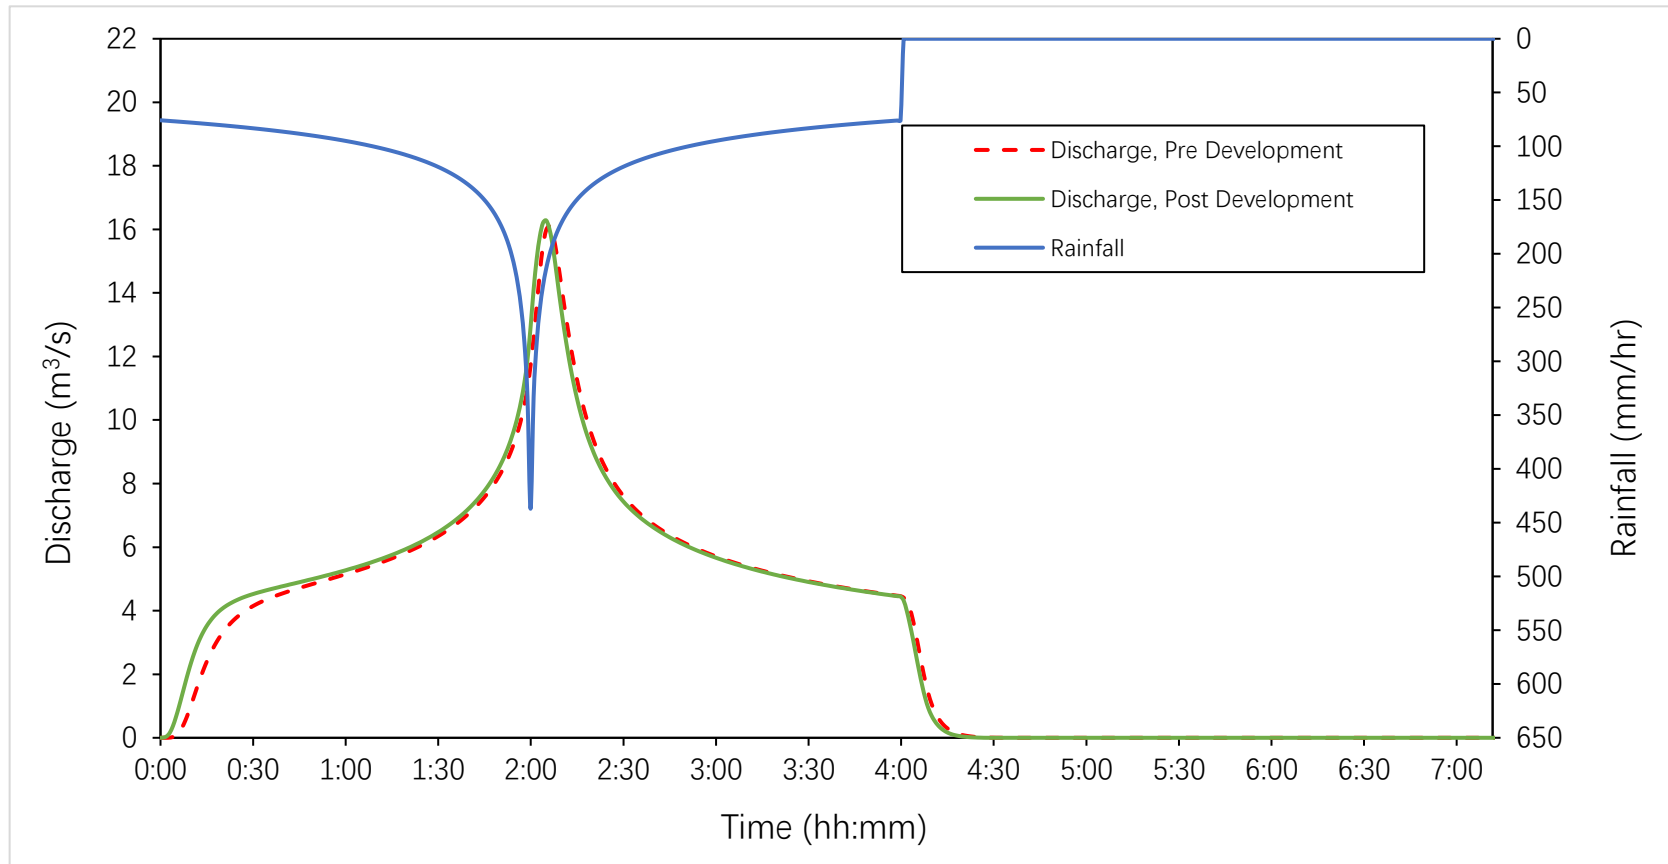

Appendix H

Summary of Hydrodynamic Modelling Results
(AMC3, Scenario C)

Pre-Development (AMC3)								
River Chainage/ Max Water Level (m)	2c (mPD)	Freeboard for 2c(m)	10c (mPD)	Freeboard for 10c(m)	50c (mPD)	Freeboard for 50c(m)	200c (mPD)	Freeboard for 200c(m)
MAI PO 0	3.569	4.571	3.742	4.398	3.835	4.305	3.890	4.250
MAI PO 490	3.563	4.577	3.738	4.402	3.830	4.310	3.883	4.257
MAI PO 490	3.563	4.577	3.738	4.402	3.830	4.310	3.883	4.257
MAI PO 690	3.562	4.578	3.734	4.406	3.827	4.313	3.880	4.260
MAI PO 690	3.562	4.578	3.734	4.406	3.827	4.313	3.880	4.260
MAI PO 980	3.557	4.583	3.730	4.410	3.822	4.318	3.875	4.265
MAI PO 980	3.557	4.583	3.730	4.410	3.822	4.318	3.875	4.265
MAI PO 1150	3.522	4.618	3.716	4.424	3.812	4.328	3.865	4.275
MAI PO 1150	3.522	4.618	3.716	4.424	3.812	4.328	3.865	4.275
MAI PO 1620	3.281	4.859	3.687	4.453	3.809	4.331	3.867	4.273
MAI PO 1630	3.040	5.100	3.445	4.695	3.726	4.414	3.818	4.322
MAI PO 1630	3.040	5.100	3.445	4.695	3.726	4.414	3.818	4.322
MAI PO 1880	2.737	5.403	3.307	4.833	3.657	4.483	3.756	4.384
MAI PO 1180	2.737	5.403	3.307	4.833	3.657	4.483	3.756	4.384
MAI PO 2125	2.366	5.774	3.098	5.042	3.396	4.744	3.400	4.740

Post-Development (AMC3)								
River Chainage/ Max Water Level (m)	2c (mPD)	Freeboard for 2c (m)	10c (mPD)	Freeboard for 10c(m)	50c (mPD)	Freeboard for 50c(m)	200c (mPD)	Freeboard for 200c(m)
MAI PO 0	3.546	4.594	3.736	4.404	3.833	4.307	3.888	4.252
MAI PO 274	3.546	4.594	3.739	4.401	3.833	4.307	3.890	4.250
MAI PO 274	3.546	4.594	3.739	4.401	3.833	4.307	3.890	4.250
MAI PO 336	3.545	4.595	3.735	4.405	3.832	4.308	3.888	4.252
MAI PO 336	3.545	4.595	3.735	4.405	3.832	4.308	3.888	4.252
MAI PO 355	3.545	4.595	3.735	4.405	3.832	4.308	3.887	4.253
MAI PO 355	3.545	4.595	3.735	4.405	3.832	4.308	3.887	4.253
MAI PO 690	3.543	4.597	3.727	4.413	3.823	4.317	3.876	4.264
MAI PO 690	3.543	4.597	3.727	4.413	3.823	4.317	3.876	4.264
MAI PO 980	3.535	4.605	3.723	4.417	3.818	4.322	3.871	4.269
MAI PO 980	3.535	4.605	3.723	4.417	3.818	4.322	3.871	4.269
MAI PO 1150	3.420	4.720	3.707	4.433	3.807	4.333	3.860	4.280
MAI PO 1150	3.420	4.720	3.707	4.433	3.807	4.333	3.860	4.280
MAI PO 1620	3.282	4.858	3.673	4.467	3.804	4.336	3.862	4.278
MAI PO 1630	3.039	5.101	3.424	4.716	3.716	4.424	3.804	4.336
MAI PO 1630	3.039	5.101	3.424	4.716	3.716	4.424	3.804	4.336
MAI PO 1880	2.736	5.404	3.282	4.858	3.647	4.493	3.744	4.396
MAI PO 1880	2.736	5.404	3.282	4.858	3.647	4.493	3.744	4.396
MAI PO 2125	2.366	5.774	3.098	5.042	3.396	4.744	3.400	4.740

Note:

- 1) The Lowest Levee Level from River Chainage from MAI PO 0 to MAIPO 2125 is 8.14mPD.
- 2) Freeboard = The Lowest Levee Level - Max Water Level

Appendix I

Hydraulic Analysis of the Proposed Drainage Pipe Network

Hydraulic Analysis of the Proposed Drainage Pipe Network at WSW_PIPE01

554 (the location is shown in Figure 6)

Extracted from MIKE11 model

Freeboard of Drainage Pipe at WSW_PIPE01 554

Design ARI Events	Max water level (mPD)	Freeboard (m)
2A	3.503	3.897
2C	3.545	3.855
10A	3.684	3.716
10B	3.715	3.685
10C	3.735	3.665
50A	3.770	3.630
50B	3.935	3.465
50C	3.832	3.568
200A	3.825	3.575
200B	4.145	3.255
200C	3.888	3.512

Note:

- 1) The average ground level of the drainage manhole is approximate 7.4mPD.
- 2) Freeboard = Ground Level - Max Water Level

Appendix J

Hydraulic Analysis of the Proposed 3.5m(W) x 2.5m(H) Box Culvert

**Hydraulic Analysis of the Proposed 3.5m(W) × 2.5m(H) Box Culvert at
WSW_BC01 283 (the location is shown in Figure 6)**

Extracted from MIKE11 model

Freeboard of Box Culvert at WSW_BC01 283


Design ARI Events	Max water level (mPD)	Freeboard (m)
2A	3.503	2.997
2C	3.546	2.954
10A	3.684	2.816
10B	3.715	2.785
10C	3.739	2.761
50A	3.771	2.729
50B	3.935	2.565
50C	3.833	2.667
200A	3.825	2.675
200B	4.145	2.355
200C	3.890	2.610

Note:

- 1) The average ground level of the box culvert is approximate 6.5mPD.
- 2) Freeboard = Ground Level - Max Water Level

Appendix K

Proposed Temporary Drainage Diversion

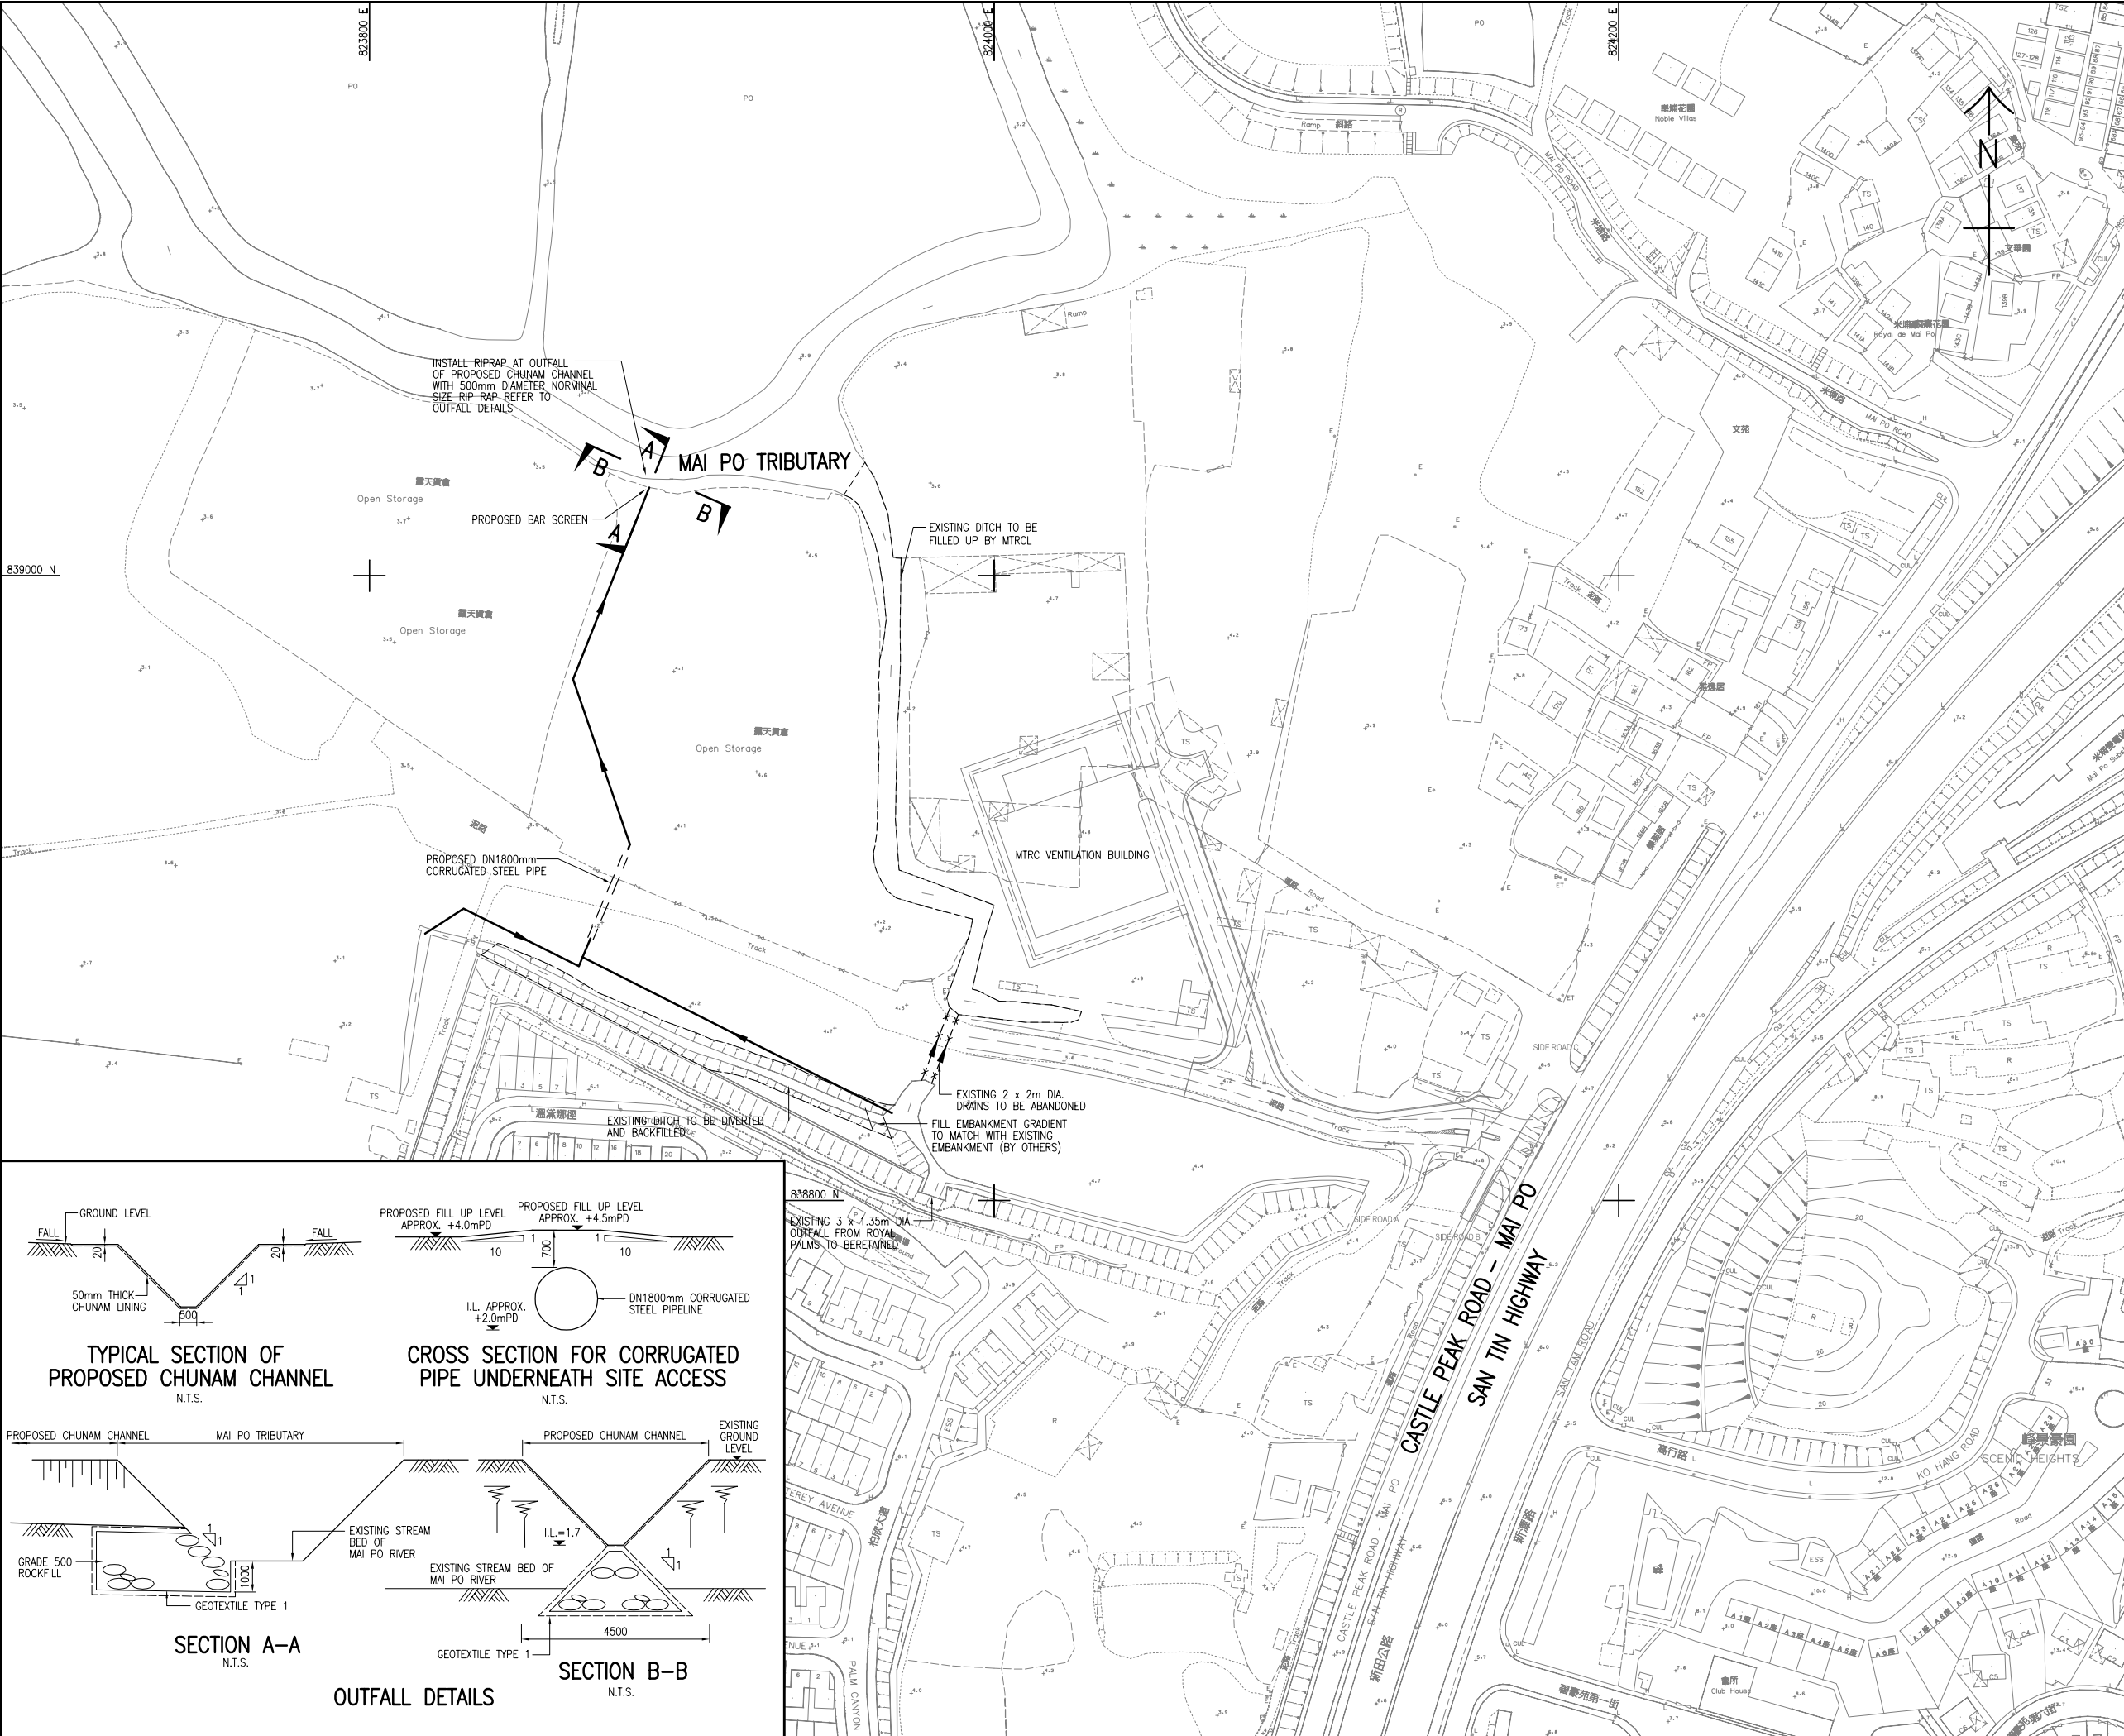

LEGEND:

- ===== PROPOSED CORRUGATED STEEL PIPE
- > PROPOSED CHUNAM CHANNEL
- ✕ —> ✕ EXISTING DRAINAGE PIPE TO BE ABANDONED

REV.	DESCRIPTION	DATE
1	PROFIT POINT ENTERPRISE LIMITED	
2	PROPOSED COMPREHENSIVE RESIDENTIAL DEVELOPMENT AT WO SHANG WAI	
3	PROPOSED TEMPORARY DRAINAGE DIVERSION	

FIGURE 9

DESIGNED BY	CONTRACT NO.	P. 21P- APPROVED
DRW BY	STATUS	批准人
SCALE	A1 1:1000	
DIMENSIONS ARE IN	METER	© COPYRIGHT RESERVED