


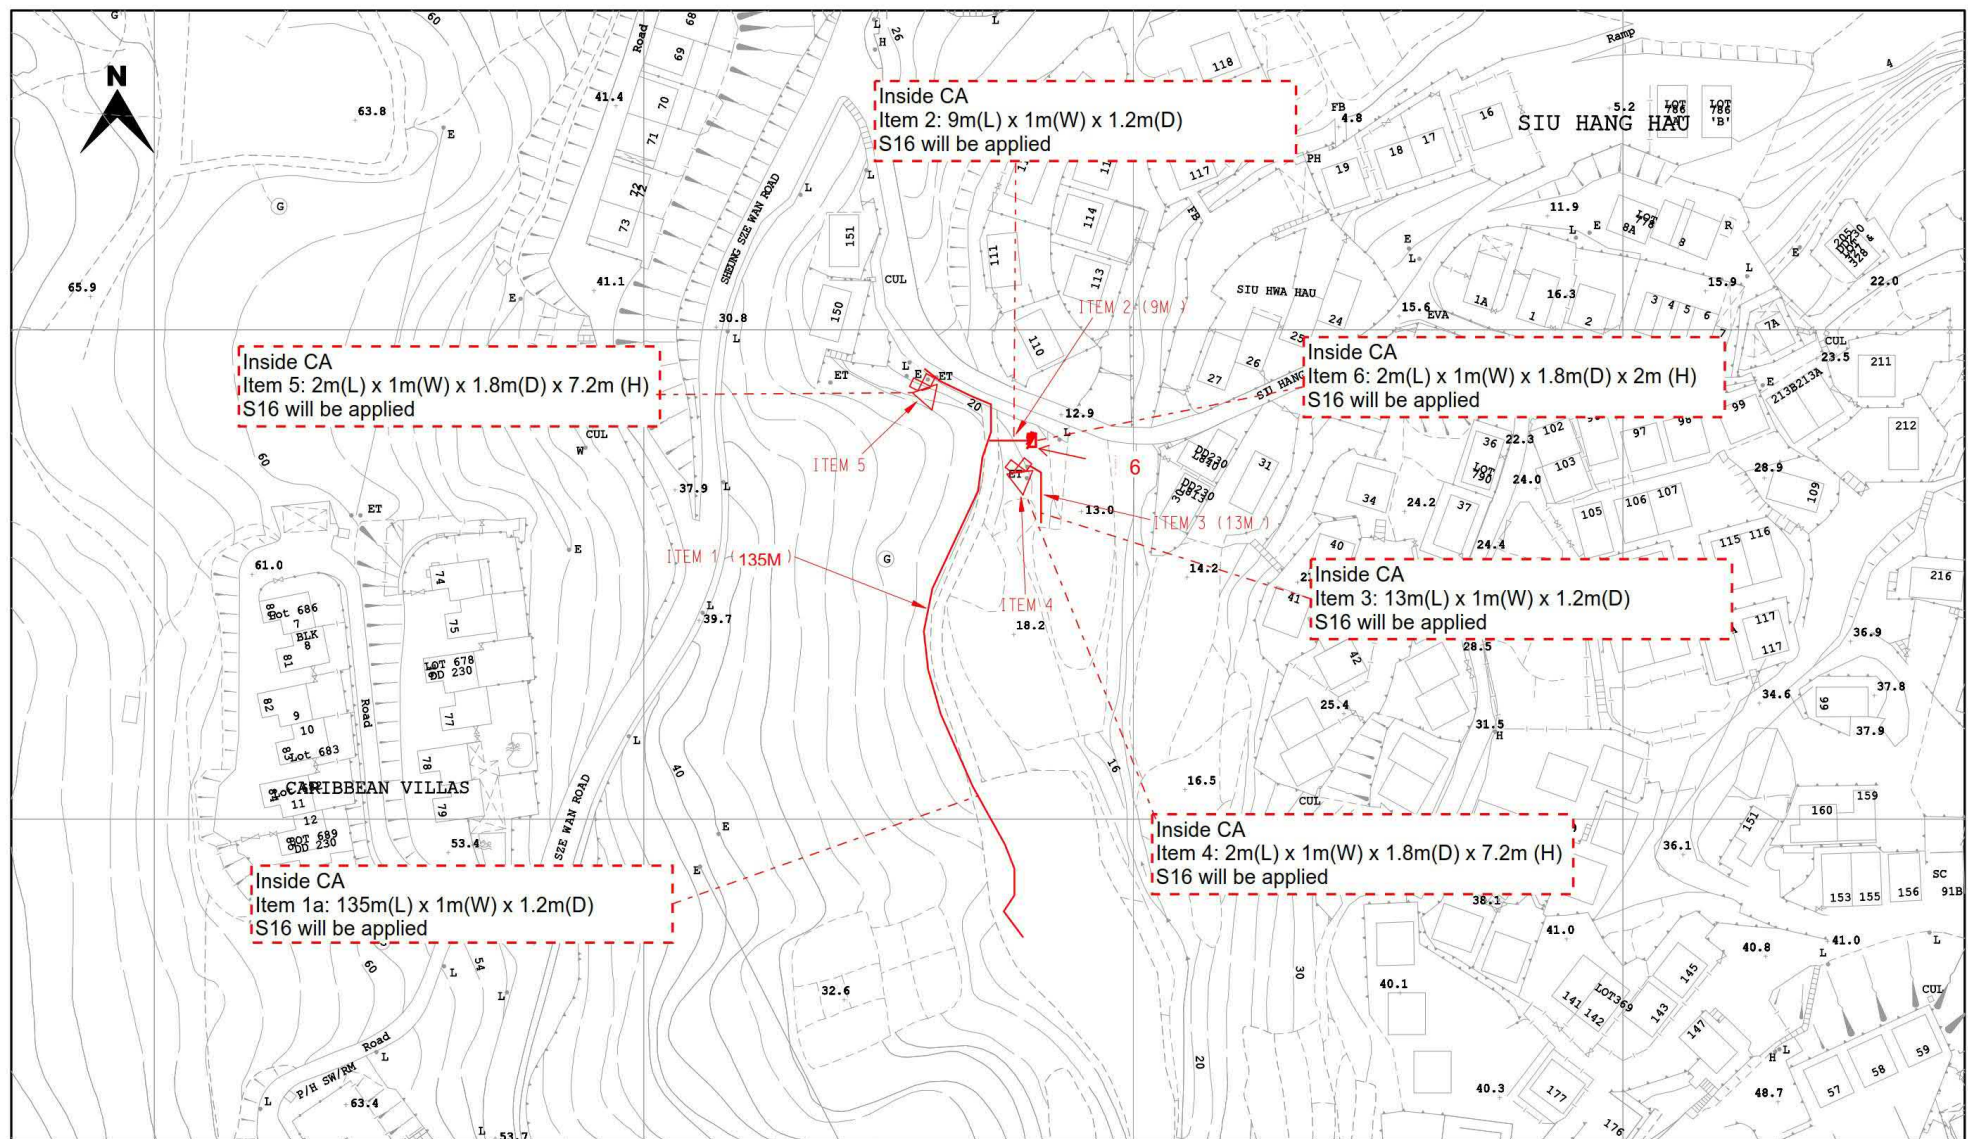

LEGEND :

- | | | | |
|--|--|--|--|
| | PROPOSED TRENCH FOR LAYING / RECOVERING CABLE | | EXISTING OVERHEAD LINE & POLE |
| | PROPOSED TRENCH FOR LAYING DUCTS | | PROPOSED 11kV, L.V., O.H.L. OF STEEL / WOODEN POLE |
| | PROPOSED CABLE THROUGH EXISTING DUCTS | | OVERHEAD LINE & POLE TO BE REMOVED |
| | EXISTING PILLAR | | PROPOSED TREE TRIMMING / CUTTING |
| | PROPOSED PILLAR 1.6m x 0.6m x 0.75m / CUTOUT BOX | | EXISTING POLE MOUNTED TRANSFORMER |
| | EXCAVATION FOR JOINTING / REPAIRING / INSPECTING CABLE | | PROPOSED POLE MOUNTED TRANSFORMER |
| | PROPOSED 3.6m(L) x 3.32m(W) x 2.7m(H) HV PILLAR | | PROPOSED STAY / STAY POLE |

CLP 中電

TITLE : 11KV CABLE LAYING, POLE ERECTION
AT SIU HANG HAU ROAD
SIU HANG HAU
SAI KUNG

SCALE

DRAWN : H.Y. WONG

DATE : 04-12-2023

CHECKED :

REGION : WE

O.C. : SK

E/O NO :

MAP NO : 12NW22D, 12NW23C

PROJECT REF. : SK2021-0020


PLAN REF. : WSK2021-0020-02

Map data reproduced with permission of the Director of Lands. (C) Hong Kong
Information Classification: PROPRIETARY

(資料來源：申請人於 28.04.2025 呈交的資料)
(Source : Applicant's Submission of 28.04.2025)

參考編號
REFERENCE No.
A/SK-CWBS/51

繪圖
DRAWING
A-1

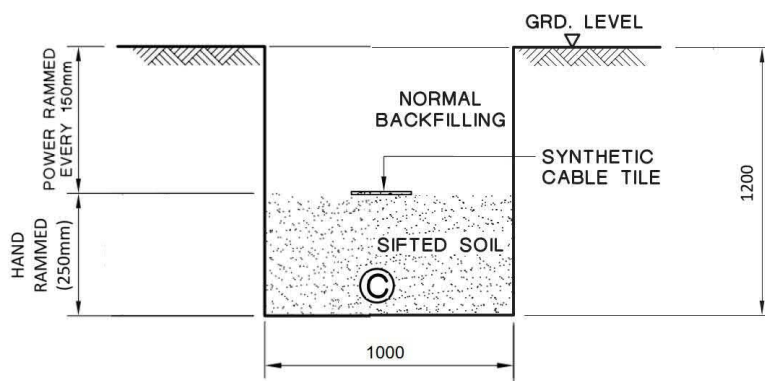

TYPICAL CABLE TRENCH FOR SINGLE CABLE

LEGEND :

③ CABLE

NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.

C GENERAL REVISION				B GENERAL REVISION				A SYNTHETIC CABLE TILE SPECIFIED											
CLP 中電								REVS.	16-2-04	18-6-07	28-6-07								
									A	B	C	D	E	F	G	H	J	K	L
								INITIAL	C.Y.IP	W.B.LEE	Y.K.MAN								
								TITLE :											
								TYPICAL CABLE TRENCH											
								Item 1a, 2, 3, 4											
DRAWN: S.C.T.																			
CHECKED: K. K. LEUNG				APPROVED: W. B. LEE															
SCALE:				SHEET(S) IN SET: 1				PROJECT NO.						CONTRACT NO.					
ASSET MANAGEMENT								DRG. NO. T G E N 2 5 5 0 0 D E 3 3 0 0 0 2 0 1 C A											


ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

(資料來源：申請人於 06.01.2025 呈交的資料)
(Source : Applicant's Submission of 06.01.2025)


參考編號 REFERENCE No. A/SK-CWBS/51	繪圖 DRAWING A-2
---------------------------------------	----------------------

NOMINAL POLE LENGTH

9m



VIEW A'

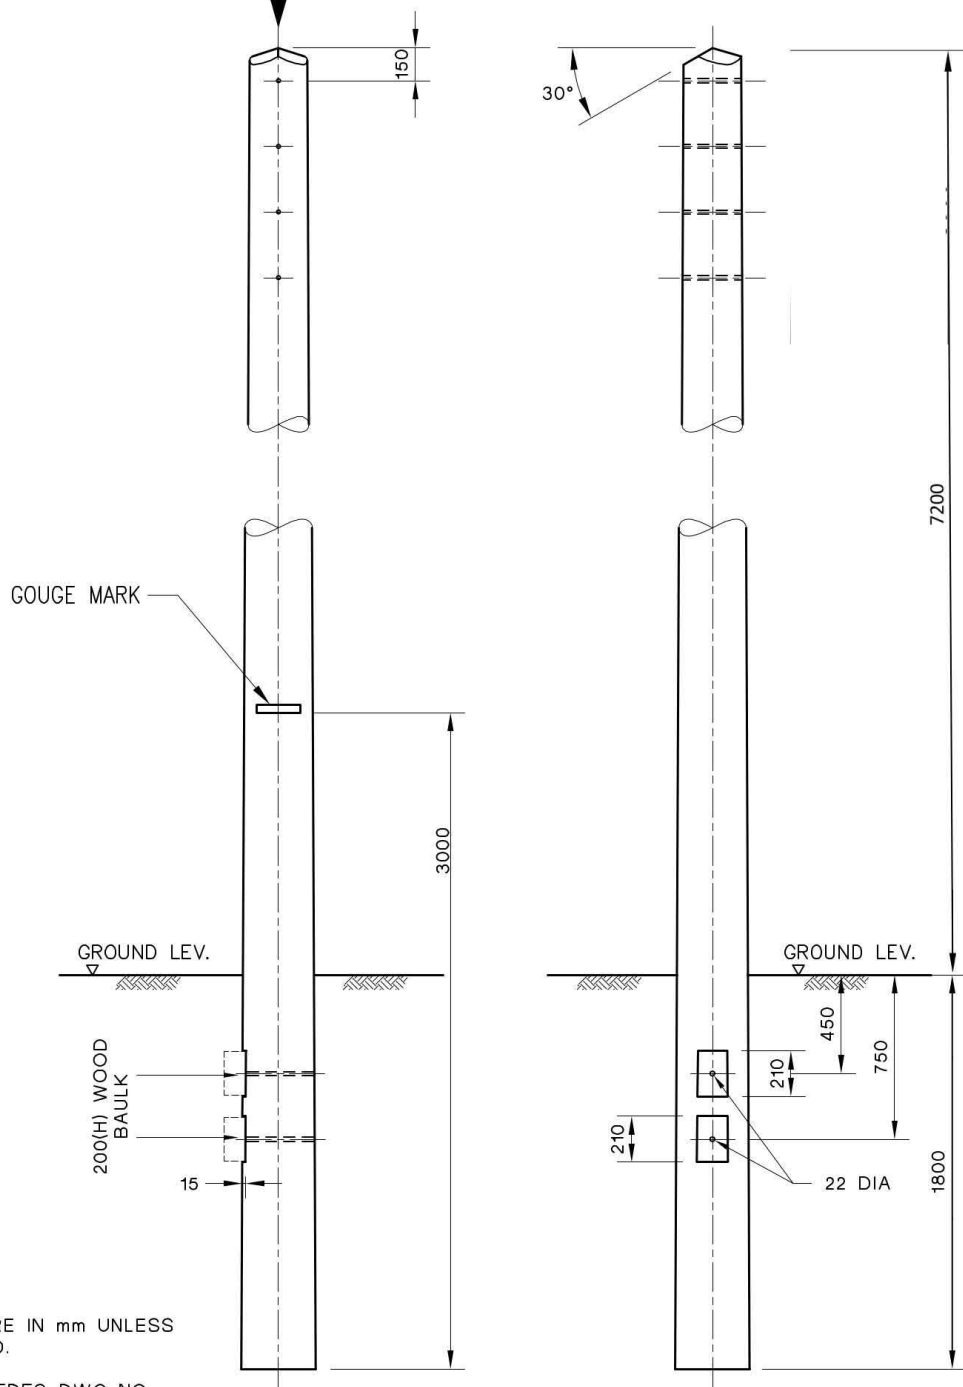

NOTE:
ALL DIMENSIONS ARE IN mm UNLESS
OTHERWISE STATED.

THIS DWG. SUPERSEDES DWG NO.
ESC/G/96-69

G GOUGE MARK UPDATED TO 3m

F ADDITIONAL BAULK, GOUGE MARK
MEASUREMENT INCREASED

CLP 中電

REVS.	28.10.02	28.1.03	8.10.04	30.09.15	05.08.16	13.03.17	01.06.17				
	A	B	C	D	E	F	G	H	J	K	L
INITIAL	HCCHOW	HCCHOW	F.C.	S.K.LAU	K.L.CHAN	K.L.CHAN	K.L.CHAN				

TITLE :

OHL WOOD POLE
Item 4, 5

DRAWN: S.C.T.

CHECKED: Y.N.S.

APPROVED:

SCALE: N.T.S.

SHEET(S) IN SET: 1

PROJECT NO.

CONTRACT NO.

ASSET MANAGEMENT

DRG. NO. T G E N 5 1 2 0 D E 3 3 0 0 2 4 0 1 G A

INFORMATION CLASS: PROPRIETARY

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

(資料來源：申請人於 06.01.2025 呈交的資料)
(Source : Applicant's Submission of 06.01.2025)

參考編號
REFERENCE No.
A/SK-CWBS/51


繪圖
DRAWING
A-3

CATEGORY "I"
APPROVED


Date **26 AUG 2011**

This approval does not relieve the responsibility of manufacturer in ensuring correctness of all data on this drawing

Signed by: *[Signature]*

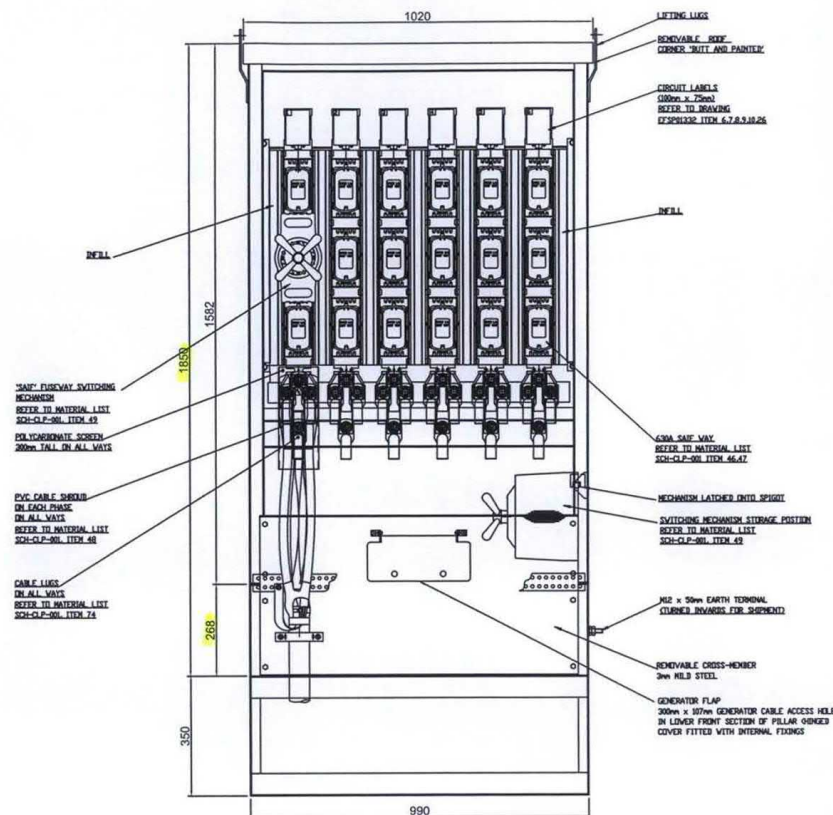

FRONT ELEVATION WITH DOORS REMOVED

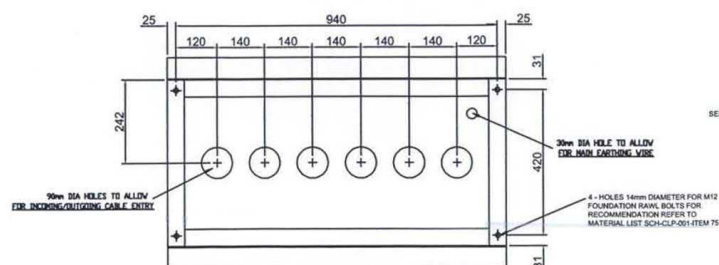


PLAN VIEW

SHOWN WITH TOP COVER FUSEWAYS & SUPPORT TRAY REMOVED

FEEDER PILLARS TO COMPLY WITH IEC 60439-1

WEIGHT : 600 KG


SEE DRAWING EWS01-GA-3 FOR SUGGESTED FOUNDATION DETAILS

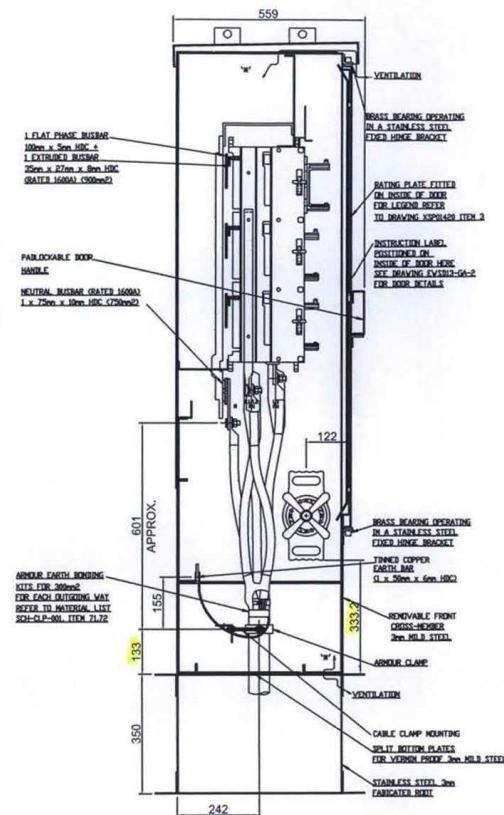

SECTION SHOWING TYPE
630A SAIF OUTGOING WAY

SYSTEM: 415 VOLTS, 3 PHASE, 4 WIRE 50Hz
BUSBAR RATING: 1000A TRIP
COLOUR FINISH: DARK ALUMINUM GREY RAL 5010
DEGREE OF PROTECTION IP20 WITH DOOR(S) CLOSED, IP2X IN ACCORDANCE WITH
IEC60439-1 (IP20) WITH DOOR(S) OPEN

VENTILATION THROUGH TOP & BOTTOM AS INDICATED



Item 6

Schneider Electric

CLP 中電

DRAWING No. EWS03-GA

GENERAL ARRANGEMENT OF 1600A
6 WAY 'SAIF' STREET PILLAR (AT 45°C)
WITH 1850mm HEIGHT


CONTRACT NO. 1600A

參考編號
REFERENCE No.
A/SK-CWBS/51

繪圖
DRAWING
A-4


(資料來源：申請人於 06.01.2025 呈交的資料)
(Source : Applicant's Submission of 06.01.2025)

Existing power cable
11KV and 380V cable drawing

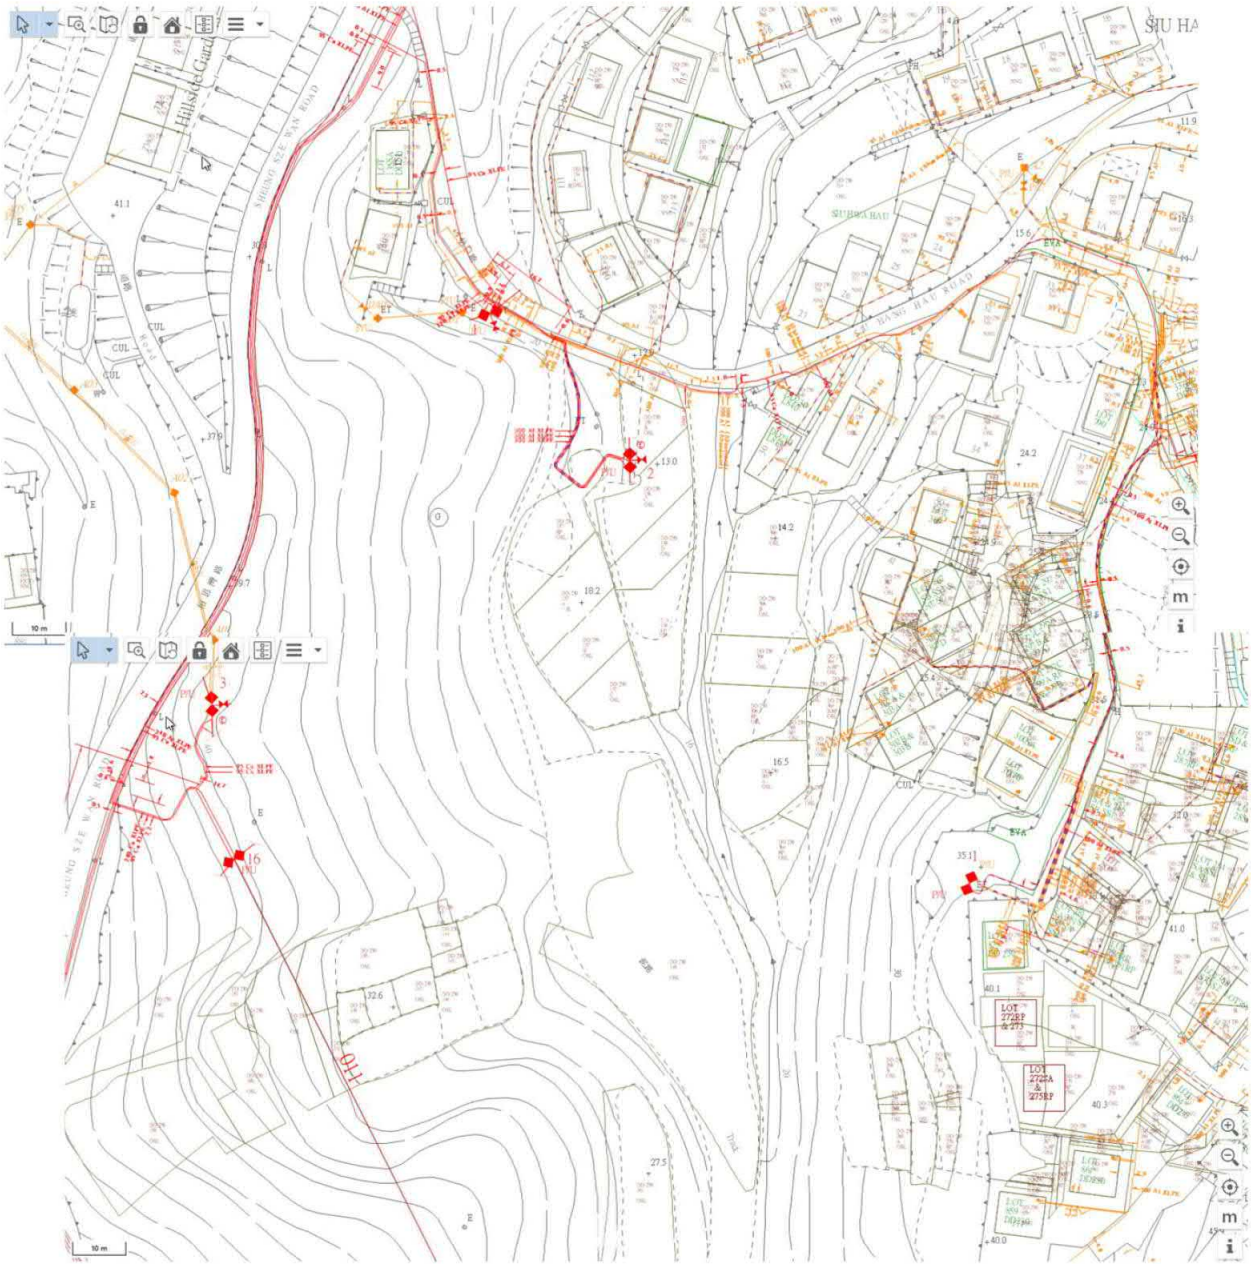

(資料來源：申請人於 28.04.2025 呈交的資料)
(Source : Applicant's Submission of 28.04.2025)

參考編號 REFERENCE No. A/SK-CWBS/51	繪圖 DRAWING A-5
---------------------------------------	----------------------

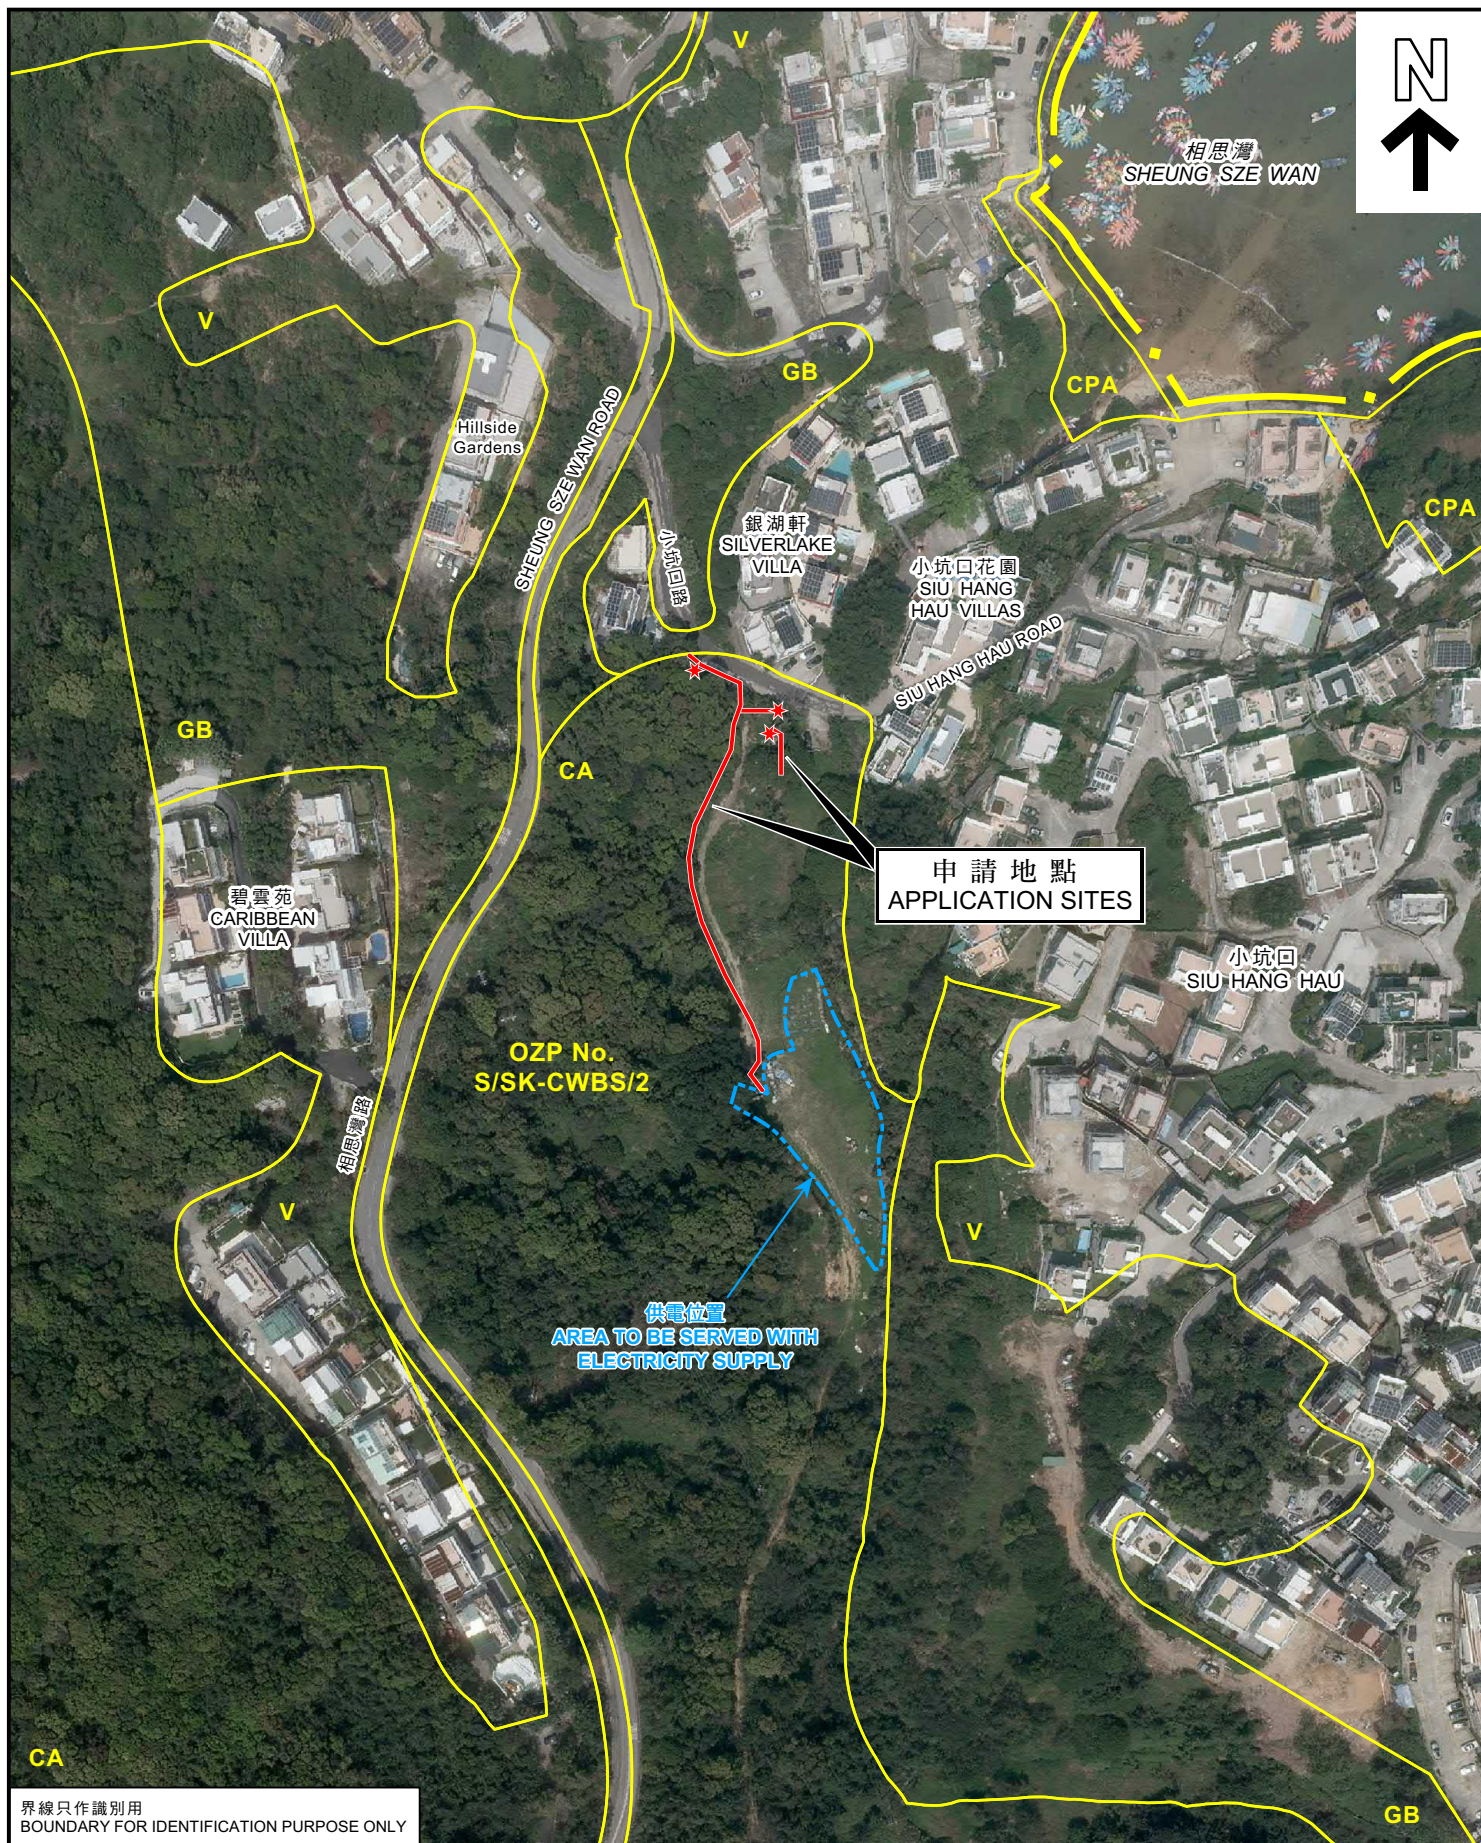

界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

本摘要圖於2025年6月12日擬備，所根據的資料為地政總署於2024年3月20日拍得的航攝照片編號E220331C
EXTRACT PLAN PREPARED ON 12.6.2025
BASED ON AERIAL PHOTO No. E220331C
TAKEN ON 20.3.2024
BY LANDS DEPARTMENT

航攝照片 AERIAL PHOTO

擬議公用事業設施裝置（地底電纜、配電箱和電線杆）和相關挖土工程
西貢相思灣近小坑口路的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(UNDERGROUND CABLES, ELECTRICAL PILLAR AND POLES)
AND ASSOCIATED EXCAVATION OF LAND
GOVERNMENT LAND NEAR SIU HANG HAU ROAD
SHEUNG SZE WAN, SAI KUNG


規劃署
PLANNING
DEPARTMENT




參考編號
REFERENCE No.
A/SK-CWBS/51

圖 PLAN
A-3

1

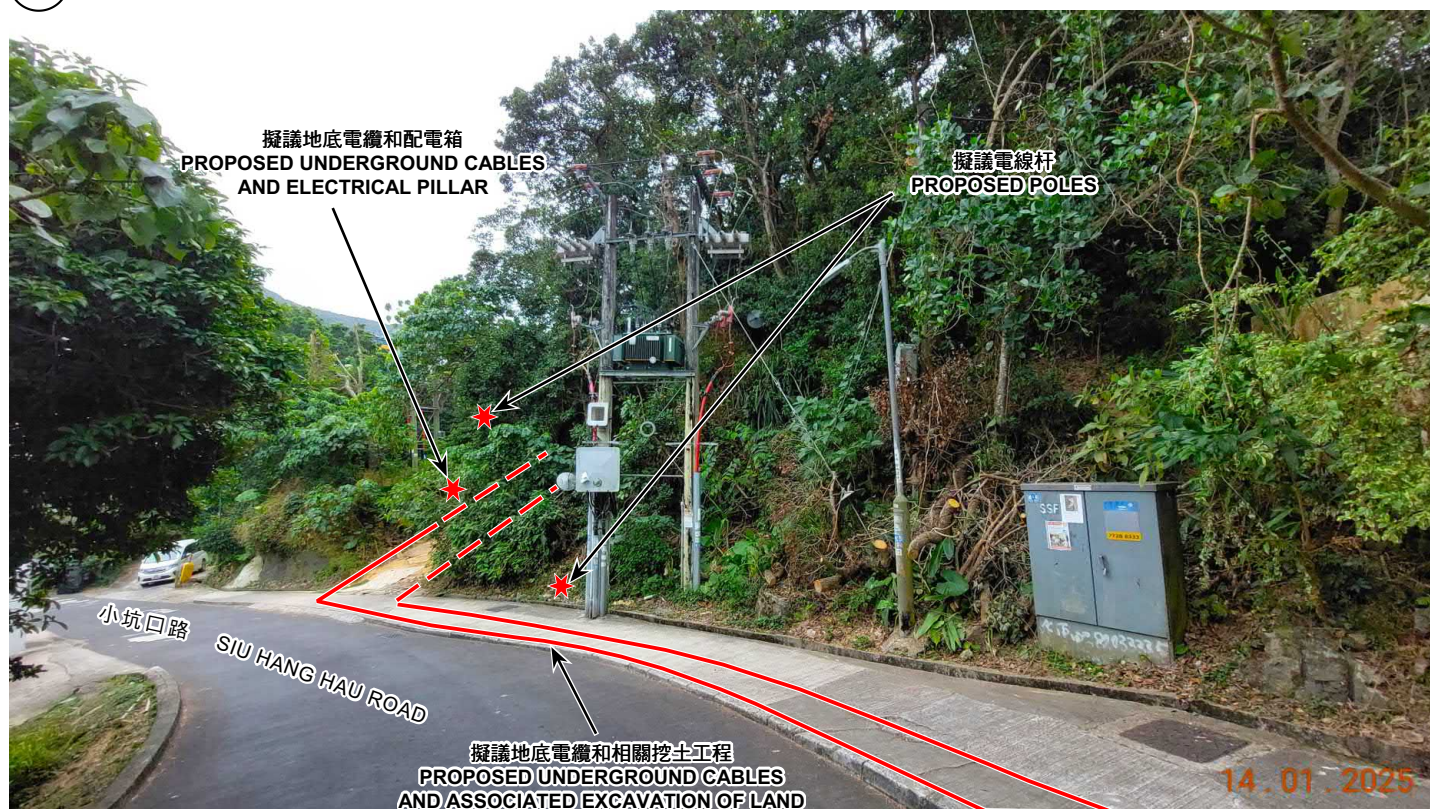

2

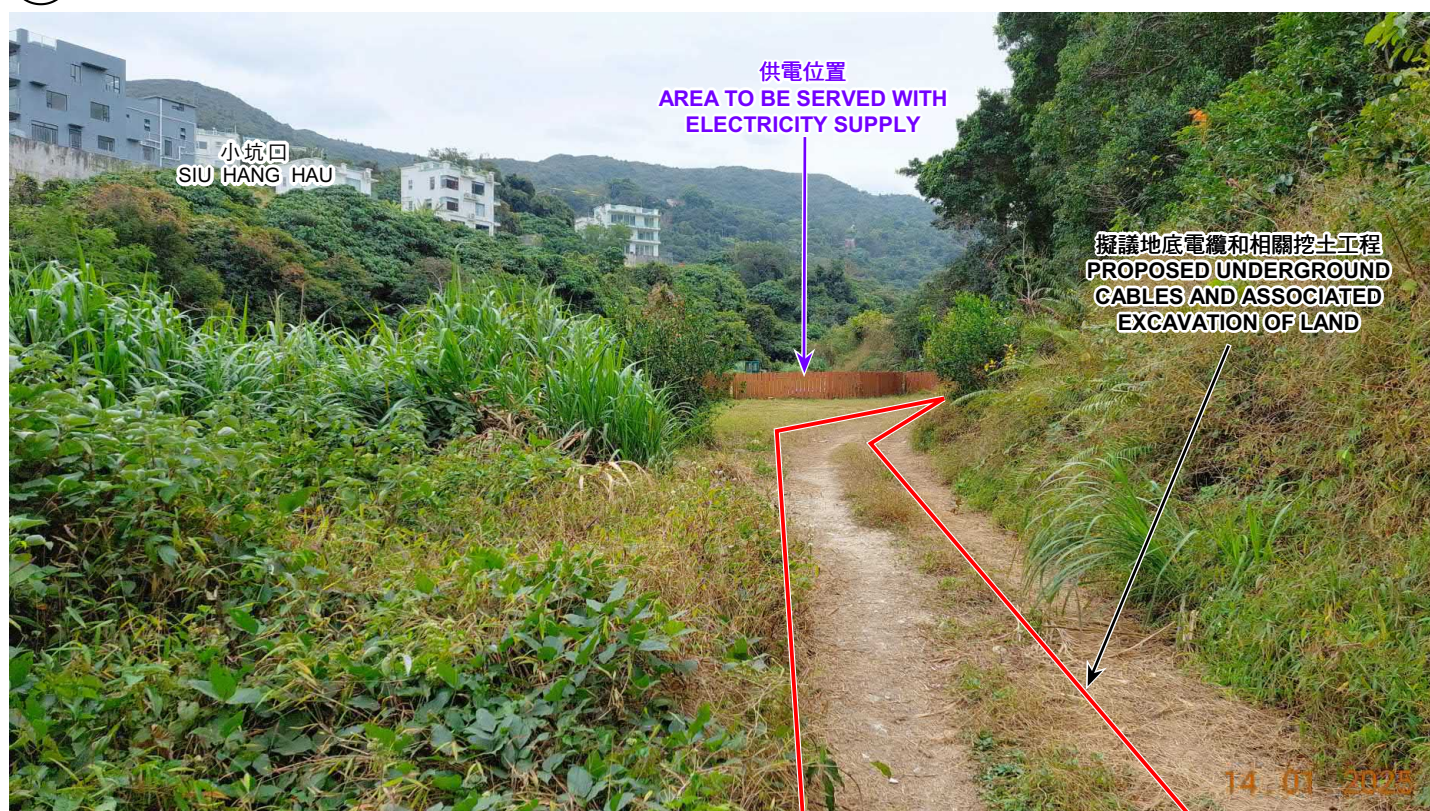

界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTO

本圖於2025年6月12日擬備，所根據的資料
為攝於2025年1月14日的實地照片
PLAN PREPARED ON 12.6.2025
BASED ON SITE PHOTOS
TAKEN ON 14.1.2025

擬議公用事業設施裝置（地底電纜、配電箱和電線杆）和相關挖土工程
西貢相思灣近小坑口路的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(UNDERGROUND CABLES, ELECTRICAL PILLAR AND POLES)
AND ASSOCIATED EXCAVATION OF LAND
GOVERNMENT LAND NEAR SIU HANG HAU ROAD
SHEUNG SZE WAN, SAI KUNG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-CWBS/51

圖 PLAN
A-4a

3



a



界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTO

擬議公用事業設施裝置 (地底電纜、配電箱和電線杆) 和相關挖土工程
SHEUNG SZE WAN, SAI KUNG
PROPOSED PUBLIC UTILITY INSTALLATION
(UNDERGROUND CABLES, ELECTRICAL PILLAR AND POLES)
AND ASSOCIATED EXCAVATION OF LAND
GOVERNMENT LAND NEAR SIU HANG HAU ROAD

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-CWBS/51

圖 PLAN
A-4b

本圖於2025年6月12日擬備，所根據的資料
為攝於2025年1月14日的實地照片(上圖)及攝於
2025年2月4日的無人駕駛航拍照片(下圖)
PLAN PREPARED ON 12.6.2025 BASED ON
SITE PHOTO TAKEN ON 14.1.2025 (UPPER
PHOTO) AND BASED ON UNMANNED
AERIAL VEHICLE (UAV) PHOTO
TAKEN ON 4.2.2025 (LOWER PHOTO)