

Urgent Return receipt Expand Group Restricted Prevent Copy

[REDACTED]

寄件者: [REDACTED]
寄件日期: 2026年2月16日星期一 上午 12:53
收件者: Sheldon Ming Sum NG/PLAND
副本: [REDACTED]
主旨: RE: [Departmental Comments] Planning Application No. A/I-TCV/28
附件: Plan_P2___20260216.pdf

FYI

如有疑問，請電： [REDACTED] 陳先生

From: [REDACTED]
Sent: Tuesday, February 10, 2026 12:26 PM
To: [REDACTED]
Cc: [REDACTED]
Subject: [Departmental Comments] Planning Application No. A/I-TCV/28

Dear Mr CHAN,

I refer to your further information (FI) submission dated 2.2.2026.

Please find attached Fire Services Department's comment on the submitted FI. Please let us have your response by **13.2.2026 (Fri)**.

[See attachment "20260210_Departmental Comments_FSD.doc"]

Regards,
Sheldon NG
TP/Is6
Sai Kung & Islands District Planning Office
Planning Department
[REDACTED]


Floor Plan(B1)

手提滅火筒
(水劑式)

For enclosed structure with gross floor area not exceeding 230m², only fire extinguisher and Stand-alone Fire Detector shall be provided;

In relation to i. above, where two or more Stand-alone Fire Detectors are installed in an enclosed structure, all stand-alone detectors shall be interconnected (either wired or wirelessly) such that when one of the stand-alone fire detector is triggered, all connected Stand-alone Fire Detectors shall sound an alarm simultaneously;

The Stand-alone Fire Detector shall be provided in accordance with the "Stand-alone Fire Detector General Guidelines on Purchase, Installation & Maintenance [Sep 2021]";

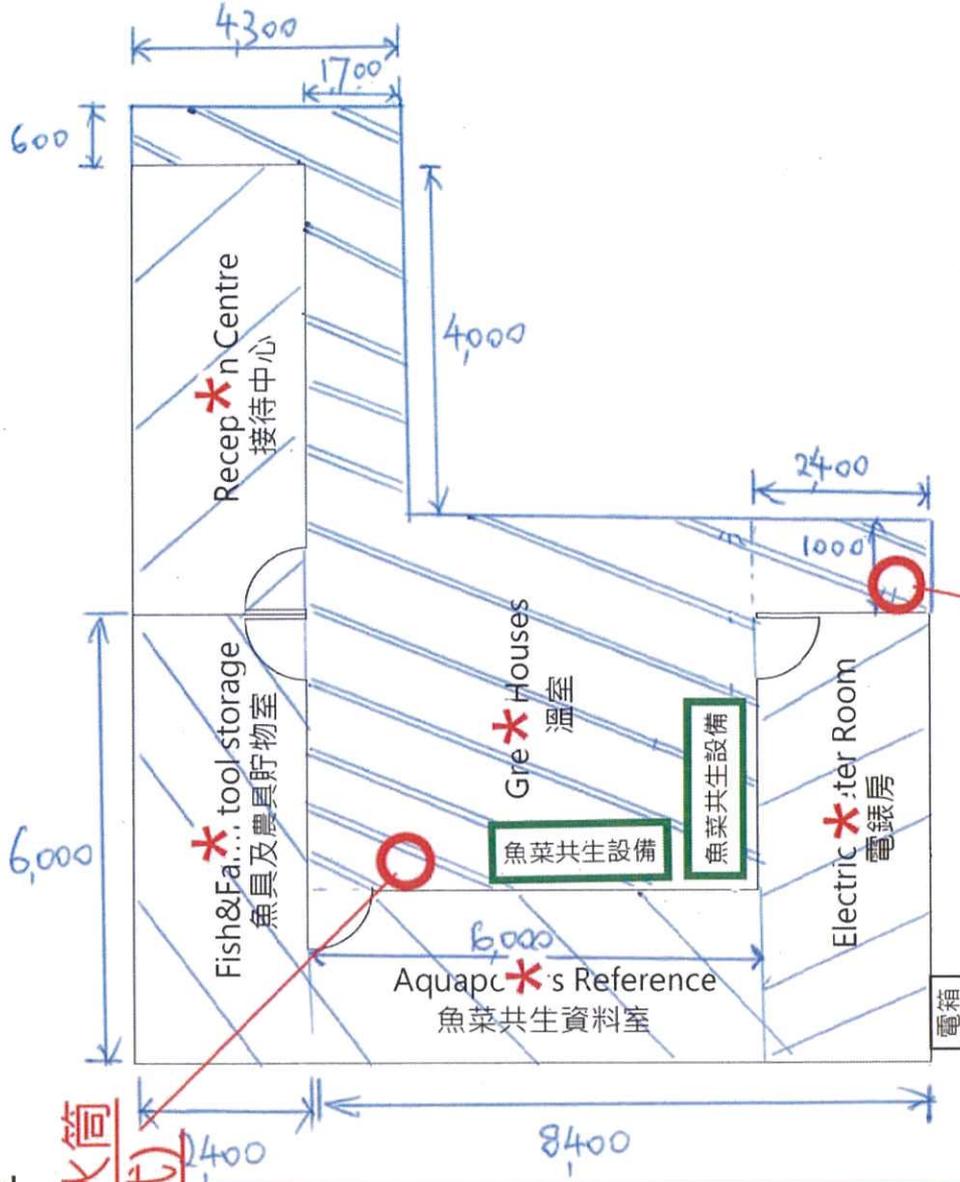

COVER AREA : ~98.2m²

* Stand-alone Fire Detectors (wirelessly)

○ Fire extinguisher

手提滅火筒
(乾粉式)