

LOCATION OF THE APPLICATION SITE

APPLICATION SITE AREA : 2,478m² (ABOUT)

ACCESSIBLE FROM FROM PING HA ROAD VIA SHEK PO ROAD AND A LOCAL ACCESS

ACCESSIBLE FROM FROM PING HA ROAD VIA SHEK PO ROAD AND A LOCAL ACCESS

PING HA ROAD

Tin Shing Court



Sha Chau Lei

SHA CHAU LEI ROAD

HUNG TIN ROAD

KIU CHEONG ROAD

APPLICATION SITE

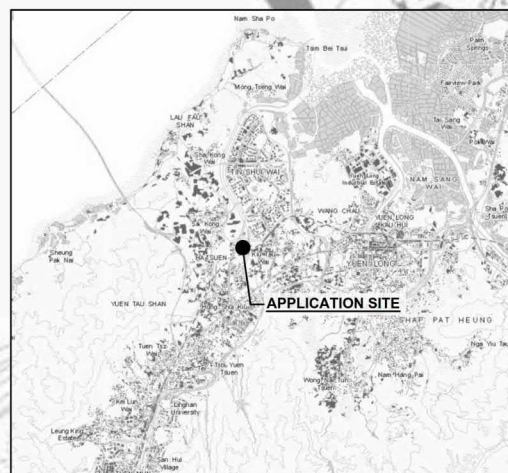

LEGEND



APPLICATION SITE

Drawing No.	Ver.
P01	01
Project	
TEMPORARY WAREHOUSE FOR STORAGE OF PROVISIONS FOR A PERIOD OF 3 YEARS	
LOTS 629 AND 631 IN D.D. 124, LOT 2002 IN D.D. 125, HUNG SHUI KIU	
Drawing Title	
LOCATION PLAN	
Scale of A4	
1 : 4000	
Drawn	Date
	12.6.2023
Revised	Date

(摘錄自申請人於 19. 6. 2023 呈交的申請書)
(Extract from Applicant's Submission of 19.6.2023)



參考編號
REFERENCE No.
A/HSK/471

繪圖 DRAWING
A-1

DEVELOPMENT PARAMETERS OF THE APPLICATION SITE

APPLICATION SITE AREA	: 2,478m ² (ABOUT)
COVERED AREA	: 1,515m ² (ABOUT)
UNCOVERED AREA	: 963m ² (ABOUT)
PLOT RATIO	: 0.6 (ABOUT)
SITE COVERAGE	: 61% (ABOUT)
NO. OF STRUCTURE	: 4
DOMESTIC GFA	: NOT APPLICABLE
NON-DOMESTIC GFA	: 1,515m ² (ABOUT)
BUILDING HEIGHT	: 3m - 7.5m (ABOUT)
NO. OF STOREY	: 1

STRUCTURE	USE	COVERED AREA	GFA	BUILDING HEIGHT
B1	WAREHOUSE (STORAGE OF PROVISIONS)	1,363m ² (ABOUT)	1,363m ² (ABOUT)	7.5m (ABOUT)(1-STOREY)
B2	SITE OFFICE	44m ² (ABOUT)	44m ² (ABOUT)	3m (ABOUT)(1-STOREY)
B3	FIRE SERVICE WATER TANK	41m ² (ABOUT)	41m ² (ABOUT)	3m (ABOUT)(1-STOREY)
B4	METER ROOM AND STORE ROOM	67m ² (ABOUT)	67m ² (ABOUT)	3m (ABOUT)(1-STOREY)
TOTAL		1,515m ² (ABOUT)	1,515m ² (ABOUT)	

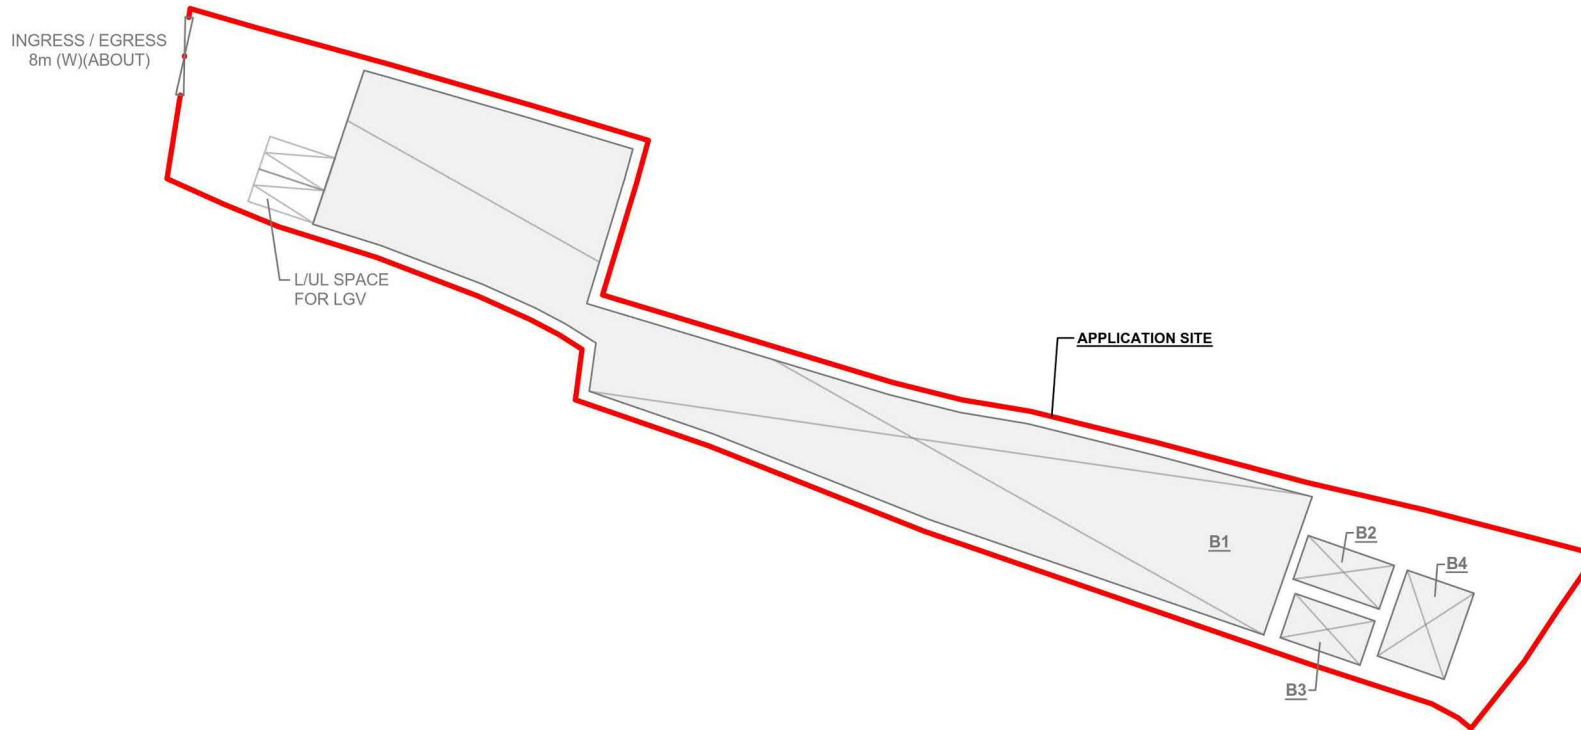

PARKING PROVISIONS

NO. OF L/UL SPACE FOR LIGHT GOODS VEHICLE	: 2
DIMENSION OF L/UL SPACE	: 3.5m (W) X 7m (L)

LEGEND

	ENCLOSED STRUCTURE
	LOADING/UNLOADING SPACE
	INGRESS / EGRESS

Drawing No.	Ver.
P04	01
Project	
TEMPORARY WAREHOUSE FOR STORAGE OF PROVISIONS FOR A PERIOD OF 3 YEARS	
LOTS 629 AND 631 IN D.D. 124, LOT 2002 IN D.D. 125, HUNG SHUI KIU	
Drawing Title	
LAYOUT PLAN	
Scale of A4	
1:700	
Drawn	Date
	12.6.2023
Revised	Date

(摘錄自申請人於 19. 6. 2023 呈交的申請書)
(Extract from Applicant's
Submission of 19.6.2023)

參考編號
REFERENCE No.
A/HSK/471

繪圖 DRAWING
A-2

F.S. NOTES

1. GENERAL

1.1 IN ACCORDANCE WITH THE CODES OF PRACTICE FOR MINIMUM FIRE SERVICE INSTALLATION AND EQUIPMENT 2022, THE HOSE REEL SYSTEM, SPRINKLER SYSTEM, FIRE ALARM SYSTEM, EMERGENCY LIGHTING, EXIT SIGN, PORTABLE HAND OPERATED FIRE FIGHTING EQUIPMENT AND SECONDARY SOURCE OF ELECTRICAL POWER SUPPLY SHALL BE PROVIDED TO THE PROPOSED TEMPORARY WAREHOUSE FOR STORAGE.

2. HOSE REEL SYSTEM

- 2.1 ON-OFF TYPE HOSE REEL NOZZLES HOUSED IN GLASS-FRONTED CABINETS WITH PADLOCKS SHALL BE INSTALLED AT LEVEL NOT HIGHER THAN 1350mm AFTL. HOSE REEL INSTRUCTION PLATES SHALL BE PROVIDED FOR ALL HOSE REELS.
- 2.2 THE LENGTH OF RUBBER HOSES SHALL NOT BE MORE THAN 30m.
- 2.3 DUTY AND STANDBY FIXED FIRE PUMPS SHALL BE PROVIDED FOR THE HOSE REEL SYSTEM.
- 2.4 F.S. CONTROL PANEL SHALL BE PROVIDED AS INDICATED ON G/F FOR FIRE ALARM SIGNALS OF THE HOSE REEL SYSTEM.
- 2.5 THE HOSE REEL BRANCH NOZZLE SHALL HAVE 4.5mm ORIFICE AND BE FITTED WITH A SIMPLE TWO WAY VALVE TO OPEN OR SHUT OFF THE JET. THE VALVE MUST NOT BE SPRING LOADED.
- 2.6 ALL FIRE SERVICE INSTALLATIONS SHALL FULLY COMPLY WITH THE REQUIREMENTS OF THE FIRE SERVICES DEPARTMENT AND THE WATER SUPPLIES DEPARTMENT.
- 2.7 HOSE REEL SYSTEM SHALL COMPLY WITH CLAUSE 5.14(b) OF THE CODE OF PRACTICE FOR MINIMUM FIRE SERVICE INSTALLATIONS AND EQUIPMENT APRIL 2022.
- 2.8 ELECTRICAL CABLES FOR FIRE ALARM BELLS AND POWER SUPPLY FOR FIRE SERVICES PUMPS SHALL BE FIRE RESISTING TYPE CONFORMING TO 556387 CAT. CWZ.
- 2.10 A NEW FIBERGLASS F.S. WATER TANK OF EFFECTIVE STORAGE CAPACITY NOT LESS THAN 2000 LITRES SHALL BE PROVIDED ON G/F FOR THE SYSTEM.

3. FIRE ALARM SYSTEM

- 3.1 FIRE ALARM SYSTEM SHALL BE PROVIDED IN ACCORDANCE WITH BS 5839-1:2017 AND FSD CIRCULAR LETTER NO.6/2021.
- 3.2 ACTUATION OF ANY BREAKGLASS UNIT IN THE WAREHOUSE SHALL START THE FIXED FIRE PUMP AND SOUND ALL THE ALARM BELLS IN THE WAREHOUSE.
- 3.3 THE CAPACITY OF BATTERY SHALL BE SUFFICIENT TO MAINTAIN THE SYSTEM IN NORMAL CONDITION FOR 72 HOURS (AFA SYSTEM) AND IT SHALL BE ABLE TO OPERATE THE SYSTEM AT ALARM CONDITION FOR 30 MINUTES.

4. AUTOMATIC SPRINKLER SYSTEM

- 4.1 SPRINKLER AND F.S. CONTROL PANEL SHALL BE PROVIDED ON G/F AS INDICATED.
- 4.2 SPRINKLER SYSTEM IN ACCORDANCE WITH HAZARD CLASS OH3 AS STIPULATED IN LPC BS EN 12845:2015 AND THE FSD CIRCULAR LETTER NO. 5/2020 SHALL BE PROVIDED TO PROTECT THE WAREHOUSE.
- 4.3 A 135000 LITRES EFFECTIVE STORAGE R.C. SPRINKLER WATER TANK FED BY SINGLE END TOWN MAIN WATER SUPPLY SHALL BE PROVIDED ADJACENT TO SPRINKLER PUMP ROOM AS SHOWN ON PLANS.
- 4.4 ONE SET OF SPRINKLER PUMPS (DUTY/STANDBY/JOCKEY) SHALL BE PROVIDED IN SPRINKLER PUMP ROOM AS INDICATED ON THE LAYOUT PLANS TO SERVE THE SPRINKLER SYSTEM.
- 4.5 SPRINKLER INLET AND SPRINKLER CONTROL VALVE SET ARE TO BE PROVIDED AS SHOWN ON THE LAYOUT PLANS.
- 4.6 UNLESS OTHERWISE STATED, ALL SPRINKLER PIPES SHALL BE DIA. 32MM.
- 4.7 ALL INSTALLED SPRINKLER SHOULD BE PENDENT TYPE AND THE TEMPERATURE RATING OF SPRINKLER HEAD SHALL BE 68°C UNLESS OTHERWISE SPECIFIED.
- 4.8 UNLESS OTHERWISE STATED, ALL SPRINKLER PIPES SHALL BE 32mm DIA.
- 4.9 TYPE OF STORAGE METHOD FOR THE BUILDING IS AS FOLLOW:
- (A) STORAGE CATEGORY: CATEGORY(I)
- (B) STORAGE HEIGHT: NOT EXCEEDING 4m
- (C) STORAGE: ST1
- (D) THE MAXIMUM STORAGE AREA OF A SINGLE BLOCK: 24m²
- (E) THE MINIMUM CLEARANCE AROUND EACH SINGLE STORAGE BLOCK: 2.4m


5. PIPE MATERIALS

- 5.1 ALL WATER PIPES SHALL COMPLY WITH BS1387 MEDIUM GRADE.

6. OTHERS

- 6.1 ALL EXITS AND EXIT ROUTES SHALL COMPLY WITH THE BS 5266-1:2016 AND THE FSD CIRCULAR LETTER NO. 5/2008 AND SHALL BE CLEARLY INDICATED BY ILLUMINATED "EXIT" "HED" SIGN AND DIRECTIONAL SIGNS IN CHINESE AND ENGLISH CHARACTERS OF NOT LESS THAN 125mm HIGH WITH 15mm WIDE STROKES. SUFFICIENT EMERGENCY LIGHTING SHALL BE PROVIDED THROUGH THE ENTIRE BUILDINGS/STRUCTURES IN ACCORDANCE WITH BS 5266-1:2016, BS EN 1838:2013 AND THE FSD CIRCULAR LETTER NO. 4/2021.
- 6.2 PORTABLE FIRE EXTINGUISHER WITH SPECIFIED TYPE AND CAPACITY TO BE PROVIDED AT LOCATIONS AS INDICATED ON PLANS.
- 6.3 NO EMERGENCY GENERATOR TO BE PROVIDED FOR SERVING THE EMERGENCY POWER. DUPLICATED POWER SUPPLIES FOR ALL FIRE SERVICES INSTALLATIONS COMPRISING A CABLE CONNECTED FROM ELECTRICITY MANS DIRECTLY BEFORE MAIN SWITCH. WHEN A VENTILATION/ AIR CONDITIONING CONTROL SYSTEM TO A BUILDING IS PROVIDED, IT SHALL STOP MECHANICAL INDUCED AIR MOVEMENT WITHIN A DESIGNATED FIRE COMPARTMENT.
- 6.4 NO DYNAMIC SMOKE EXTRACTION SYSTEM SHALL BE PROVIDED SINCE FIRE COMPARTMENT EXCEEDING 7000m³ AND THE AGGREGATE AREA OF THE OPENABLE WINDOWS OF THE RESPECTIVE COMPARTMENT EXCEEDS 6.25% OF THE FLOOR AREA OF THAT COMPARTMENT. I.E. 85.2m²(ABOUT). THE PROPOSED AREA OF OPENABLE WINDOWS OF STRUCTURE B1 IS 87m²(ABOUT).

BLOCK PLAN (SCALE: N.T.S.)




F.S. AND SPRINKLER PUMP SCHEDULE				
PUMP CODE	DESCRIPTION	FLOW (l/min)	HEAD (m)	MOTOR RATING(kw)
FP1	FIXED FIRE PUMP (DUTY)	80	60	2.2
FP2	FIXED FIRE PUMP (STANDBY)	80	60	2.2
SP1	SPRINKLER PUMP (DUTY)	1100/1350/2250	39/37/24	18.5
SP2	SPRINKLER PUMP (STANDBY)	1100/1350/2250	39/37/24	18.5
SJP	SPRINKLER JOCKEY PUMP	80	60	1.5


LEGENDS

- FIRE HOSE REEL
- SPR. INLET
- PIPEWORKS/F.S. INSTALLATIONS
- GATE VALVE
- GATE C/W CAP
- NON RETURN VALVE
- WATER CHECK METER POSITION
- BALL FLOAT VALVE
- VENT PIPE
- AUTOMATIC AIR VENT
- PUMP SET
- PRESSURE SWITCH ASSEMBLY (DETAILS REFER TO FIGURE 1 IN THIS DRAWING)
- PRESSURE SWITCH ASSEMBLY (DETAILS REFER TO FIGURE 2 IN THIS DRAWING)
- PRESSURE SWITCH ASSEMBLY (DETAILS REFER TO FIGURE 3 IN THIS DRAWING)
- PRESSURE SWITCH ASSEMBLY (DETAILS REFER TO FIGURE 4 IN THIS DRAWING)
- LEVEL SWITCH
- MFA CALL POINT
- FLASHING LIGHT
- FIRE ALARM BELL
- WEATHERPROOF FIRE ALARM BELL
- 13A FUSED SPUR UNIT
- F.S. CONTROL PANEL
- WEATHERPROOF FIXED FIRE PUMP CONTROL PANEL
- SPRINKLER PUMP CONTROL PANEL
- SPRINKLER CONTROL VALVE C/W WATER ALARM GONG
- PROVING PIPE (PERMANENT)
- FLOW SWITCH
- GATE VALVE C/W MONITORING DEVICE
- SPRINKLER HEAD
- VORTEX INHIBITOR
- STRAINER
- WATER ALARM GONG
- 5kg CO₂ TYPE PORTABLE FIRE EXTINGUISHER
- DRY POWER TYPE PORTABLE FIRE EXTINGUISHER
- EMERGENCY LIGHTING
- ABBREVIATIONS
- AFTL ABOVE FINISHED FLOOR LEVEL
- F/A FROM ABOVE
- F/B FROM BELOW
- T/A TO ABOVE
- T/B TO BELOW
- L/L LOW LEVEL
- M/L MIDDLE LEVEL
- H/L HIGH LEVEL
- F.S. FIRE SERVICES
- SPR. SPRINKLER
- HR FIRE HOSE REEL
- SPI SPRINKLER INLET
- MFA MANUAL FIRE ALARM
- AFA AUTOMATIC FIRE ALARM
- BL BOUNDARY LINE
- MH ACCESS MANHOLE
- VP VENT PIPE
- OF OVERFLOW PIPE


PRESSURE SWITCH ASSEMBLY "P1" DIAGRAM FOR SPRINKLER DUTY/STANDBY PUMPS (SP1/SP2)




PRESSURE SWITCH "P2" ASSEMBLY DIAGRAM FOR SPRINKLER JOCKEY PUMP (SJP)



PRESSURE SWITCH ASSEMBLY "P3" DIAGRAM FOR SPRINKLER SYSTEM




PRESSURE SWITCH ASSEMBLY "P4" DIAGRAM FOR FIXED FIRE PUMPS (FP1/FP2)



STRUCTURE	USE	COVERED AREA	GFA	BUILDING HEIGHT
B1	WAREHOUSE (STORAGE OF PROVISIONS)	1,363m ² (ABOUT)	1,363m ² (ABOUT)	7.5m (ABOUT)(1-STOREY)
B2	SITE OFFICE	44m ² (ABOUT)	44m ² (ABOUT)	3m (ABOUT)(1-STOREY)
B3	FIRE SERVICE WATER TANK	41m ² (ABOUT)	41m ² (ABOUT)	3m (ABOUT)(1-STOREY)
B4	METER ROOM AND STORE ROOM	67m ² (ABOUT)	67m ² (ABOUT)	3m (ABOUT)(1-STOREY)
TOTAL		1,515m ² (ABOUT)	1,515m ² (ABOUT)	

DEVELOPMENT PARAMETERS OF THE APPLICATION SITE

APPLICATION SITE AREA	: 2,478m ² (ABOUT)
COVERED AREA	: 1,515m ² (ABOUT)
UNCOVERED AREA	: 963m ² (ABOUT)
PLOT RATIO	: 0.6 (ABOUT)
SITE COVERAGE	: 61% (ABOUT)
NO. OF STRUCTURE	: 4
DOMESTIC GFA	: NOT APPLICABLE
NON-DOMESTIC GFA	: 1,515m ² (ABOUT)
BUILDING HEIGHT	: 3m - 7.5m (ABOUT)
NO. OF STOREY	: 1

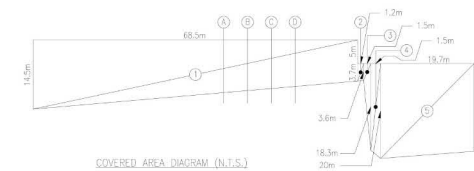


INFORMATION OF ON-SITE STRUCTURES







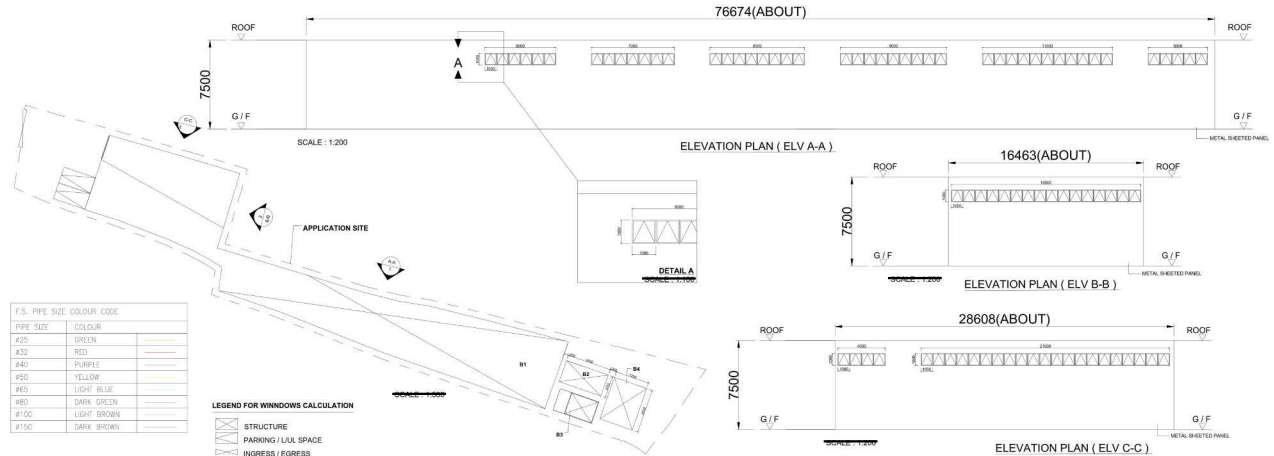

USE	NO. OF STOREY	COVERED AREA (m ²)	GFA AREA (m ²)	HEIGHT OF COMPARTMENT (m)	VOLUME OF COMPARTMENT (m ³)
WAREHOUSE FOR STORAGE	1	1223.3	1223.3	7.5	9174.75

AREA OF	= 1/2 x (14.5+3.7+5) x 68.5 = 794.6 m ²
AREA OF	= 1/2 x (3.7+3.6) x 1.2 = 4.4 m ²
AREA OF	= 1/2 x (5.6+18.3) x 1.5 = 16.4 m ²
AREA OF	= 1/2 x (18.2+20) x 1.5 = 28.9 m ²
AREA OF	= 1/2 x (20+18.3) x 19.7 = 379.2 m ²
TOTAL AREA	= 794.6 + 4.4 + 16.4 + 28.9 + 379.2 = 1223.3 m ²

OPENABLE WINDOW AREA CALCULATION UNDER F.S.D. REQUIREMENT FOR COMPARTMENT EXCEEDING 7000m³

LOCATION	G / F OF STRUCTURE B1
GFA	1,363m ²
OPENABLE WINDOW AREA REQUIRED	1,363m ² X 6.25% = 85.2m ²
OPENABLE WINDOW AREA PROVIDED	REFER TO ELEVATION - (A-A) = 46m ² REFER TO ELEVATION - (B-B) = 16m ² REFER TO ELEVATION - (C-C) = 25m ² TOTAL = 87m ² > 85.2m ²



F.S. PIPE SIZE COLOUR CODE		
PIPE SIZE	COLOUR	
#25	GREEN	
#32	RED	
#40	PURPLE	
#50	YELLOW	
#65	LIGHT BLUE	
#80	DARK GREEN	
#100	LIGHT BROWN	
#150	DARK BROWN	

LEGEND FOR WINDOWS CALCULATION

STRUCTURE

PARKING / LUL SPACE

INGRESS / EGRESS

FD Contractor

基業消防工程有限公司
KEI YIP FIRE ENGINEERING LTD.

REV.	DESCRIPTION	DATE	
A.			
B.			
C.			

Scale	Drawn	Project Ref	Revision
AS SHOWN (B1)	T. L.	K307	2
Date	Checked	Drawing No.	
17 APRIL 2023	C.Y. LI	FS-01	


Project: FIRE SERVICES INSTALLATION WORKS AT TEMPORARY WAREHOUSE FOR STORAGE OF PROVISIONS AT LOT 2002 IN DD125, LOT 629 (PART) AND 631 IN DD124(SHEK PD ROAD), YUEN LONG, N.T.

Drawing Title: F.S. NOTES, LEGENDS, PRESSURE SWITCH ASSEMBLY FOR SPRINKLER DUTY/STANDBY/JOCKEY PUMPS, SPRINKLER SYSTEM, FIXED FIRE PUMPS, ABBREVIATIONS, BLOCK PLAN, F.S. PUMP SCHEDULE, F.S. PIPE SIZE COLOUR CODE, COVERED AREA DIAGRAM & INFORMATION OF ON-SITE STRUCTURES

(摘錄自申請人於 22. 1. 2024 呈交的進一步資料)
(Extract from Applicant's Further
Information Submitted on 22.1.2024)

參考編號
REFERENCE No.
A/HSK/471

繪圖 DRAWING
A-3

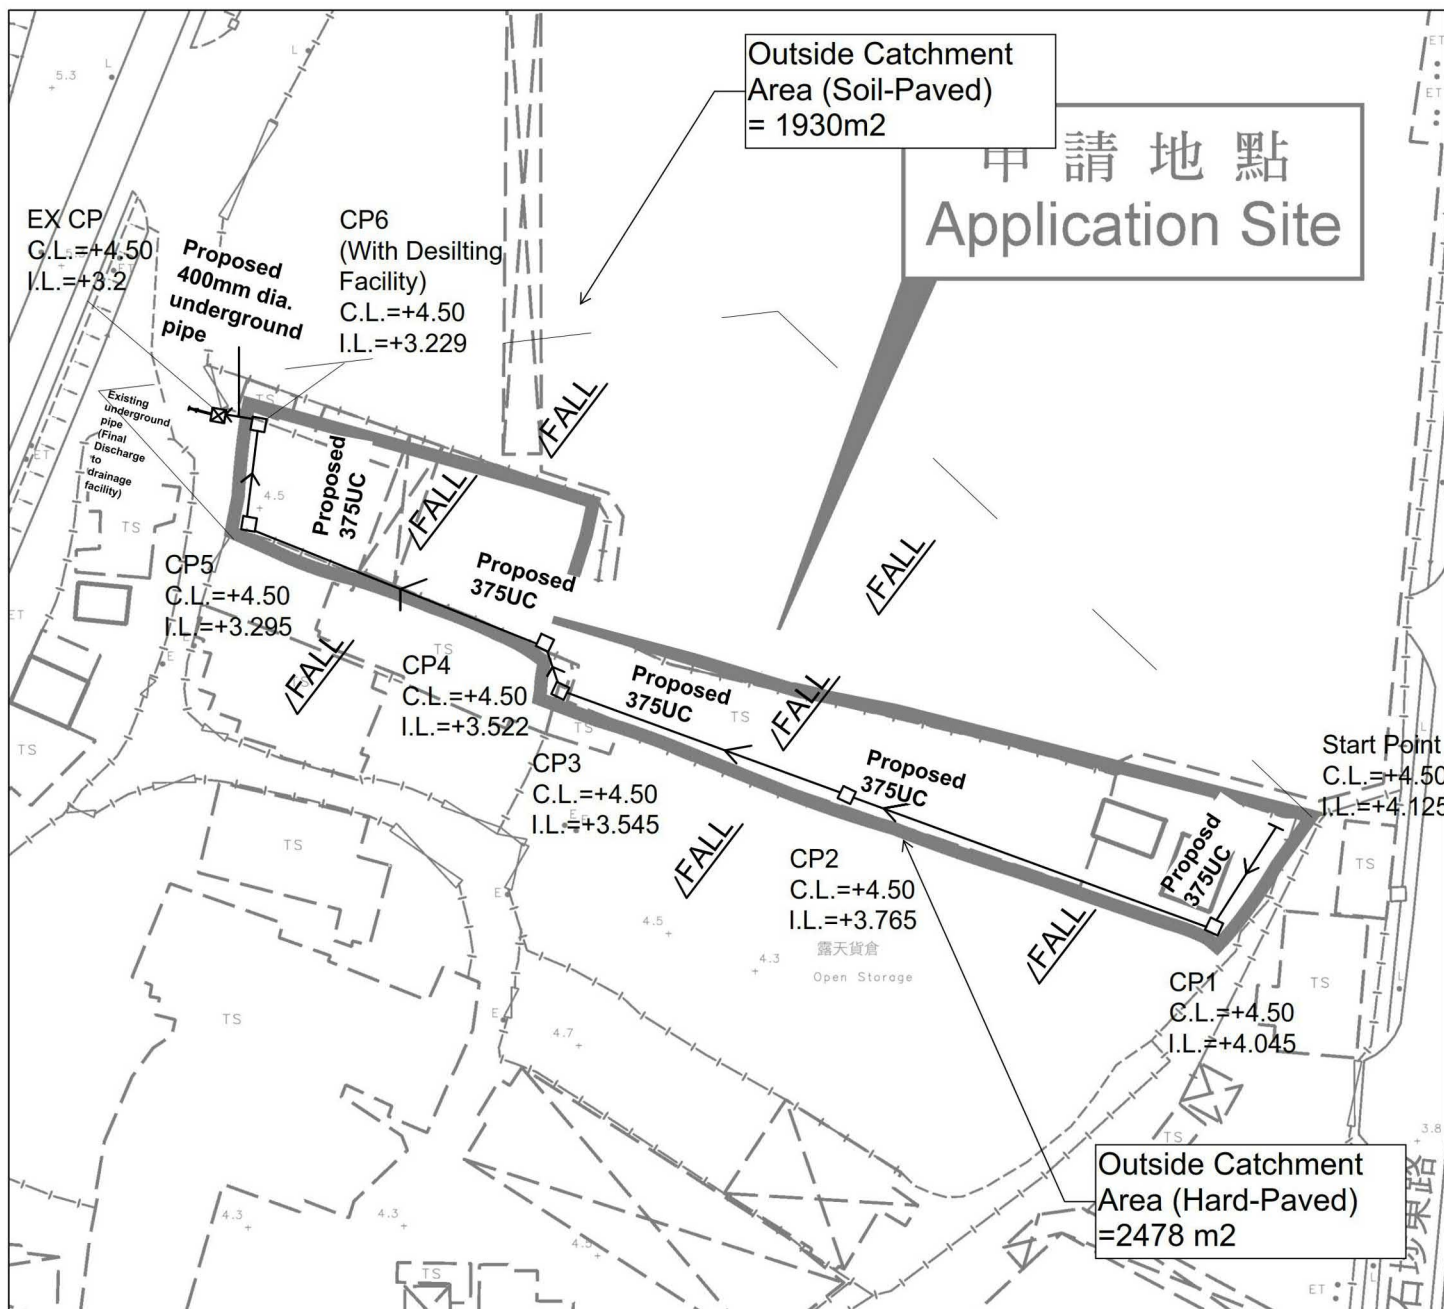


LEGEND

- ☐ CP Proposed CatchPit
- ☐ Proposed UC (1:150) with Cast Iron Cover/UPVC
- ☒ CP Existing CatchPit
- ☐ Existing 225UC/SC

Note:

1. No solid fence wall to be erected.
2. Adjacent Area is occupied (T.S) has their own stormwater collection system so no extra surface runoff flow from adjacent area,
3. Catchpits (CP6) with desilting facility shall follow CEDD standard drawing No. C24061.
4. Catchpit and UC follows Typical Details of Geotechnical Manual for Slope Fig.8.10 and Fig.8.11 respectively.

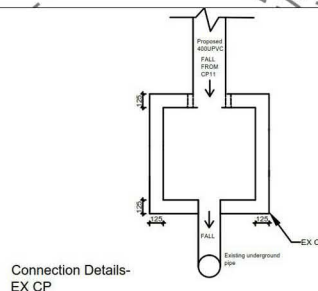

恆協工程有限公司

HANDSHIP ENGINEERING CO. LTD

Title:

Drainage Proposal

A/HSK/260

Drawn by:

DM

Date:

18th Nov 2021

Check by:

DM

Scale:


Project

Proposed Temporary Warehouse for Storage of Provisions for a Period of 3 Years at Lots 629 and 631 in D.D. 124 and Lot 2002 in D.D. 125, Hung Shui Kiu, Yuen Long, New Territories

(摘錄自申請人於 19.6.2023 呈交的申請書)
(Extract from Applicant's Submission of 19.6.2023)

參考編號
REFERENCE No.
A/HSK/471

繪圖 DRAWING
A-4

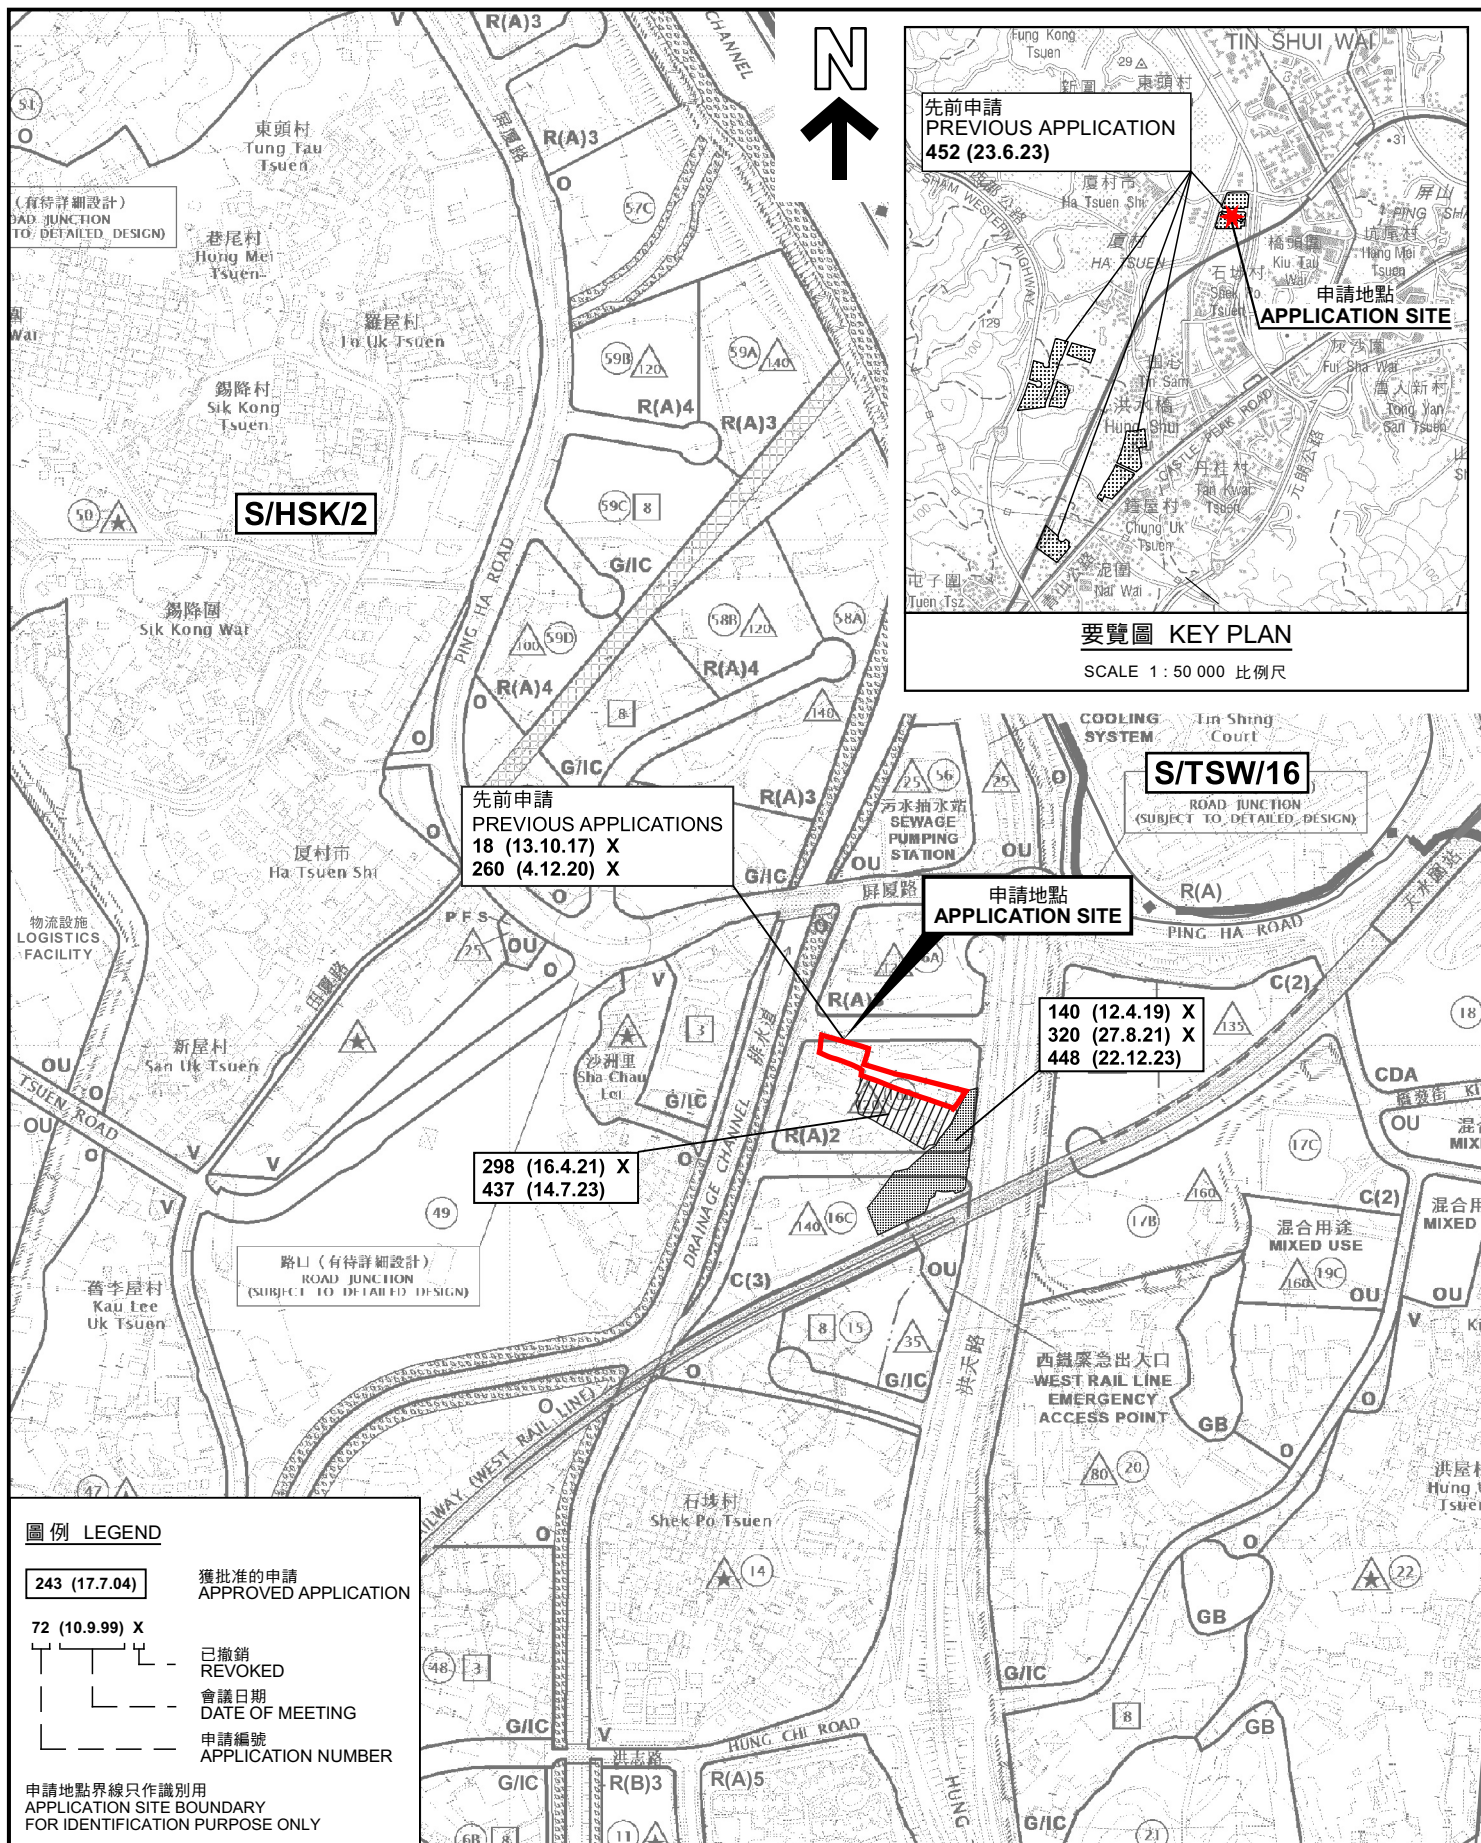

位置圖 LOCATION PLAN

臨時貨倉存放糧油食品(為期3年)
新界元朗洪水橋丈量約份第124約
地段第629號及第631號及第125約地段第2002號
TEMPORARY WAREHOUSE FOR STORAGE OF PROVISIONS
FOR A PERIOD OF 3 YEARS
LOTS 629 AND 631 IN D.D.124, LOT 2002 IN D.D.125,
HUNG SHUI KIU, YUEN LONG, NEW TERRITORIES
SCALE 1:7 500 比例尺

米 100 0 100 200 300 米
METRES


規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/HSK/471

圖 PLAN
A-1

本摘要圖於2024年1月16日擬備，
所根據的資料為於2018年10月16日
核准的分區計劃大綱圖編號 S/HSK/2
EXTRACT PLAN PREPARED ON 16.1.2024
BASED ON OUTLINE ZONING PLAN No.
S/HSK/2 APPROVED ON 16.10.2018

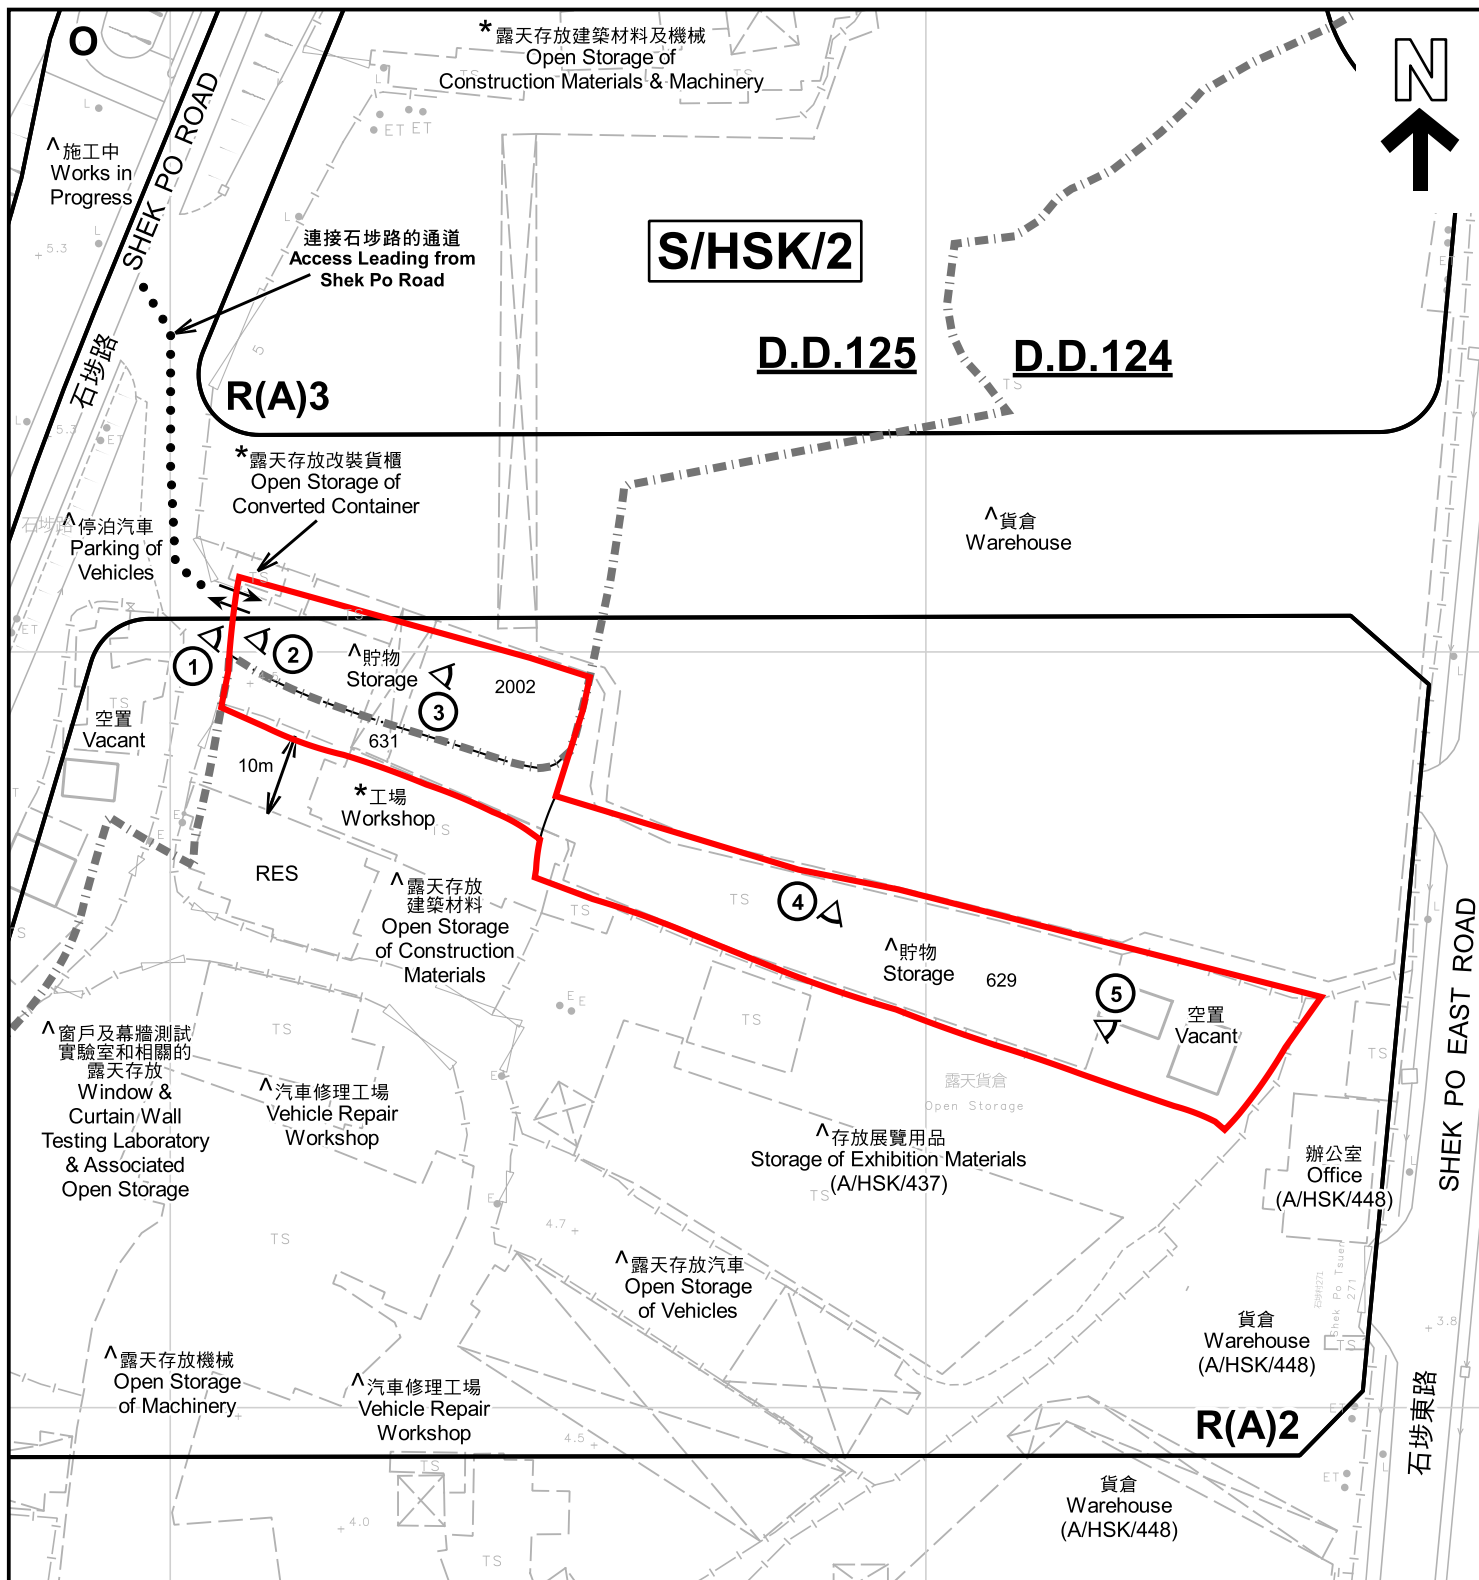

註釋 Notes :

- (1) 2023年7月4日勘測的土地用途
Land uses shown on this plan are in accordance with the land use survey conducted by the Planning Department on 4.7.2023
- (2) * 土地用途跟1992年3月及1993年6月22日勘測的土地用途一致
Indicates that the use is the same as that revealed by the land use survey conducted by the Planning Department in Mar 1992 & 22 Jun 1993
- (3) ^ 土地用途跟1992年3月及1993年6月22日勘測的土地用途有別
Indicates that the use is different from that revealed by the land use survey conducted by the Planning Department in Mar 1992 & 22 Jun 1993

圖例 LEGEND

- 申請地點 (界線只作識別用)
APPLICATION SITE (BOUNDARY FOR IDENTIFICATION PURPOSE ONLY)
- R(A)** 住宅(甲類)
RESIDENTIAL (GROUP A)
- O** 休憩用地
OPEN SPACE
- RES** 住用構築物
RESIDENTIAL STRUCTURES

- ① 實地照片的觀景點
VIEWING POINT OF SITE PHOTO
- 丈量約份界線
D.D. BOUNDARY
- ↔ 入口/出口
INGRESS / EGRESS

平面圖 SITE PLAN

臨時貨倉存放糧油食品(為期3年)
新界元朗洪水橋丈量約份第124約

地段第629號及第631號及第125約地段第2002號
TEMPORARY WAREHOUSE FOR STORAGE OF PROVISIONS
FOR A PERIOD OF 3 YEARS
LOTS 629 AND 631 IN D.D.124, LOT 2002 IN D.D.125,
HUNG SHUI KIU, YUEN LONG, NEW TERRITORIES

SCALE 1 : 1 000 比例尺

米 20 0 20 40 米
METRES

本摘要圖於2023年12月29日擬備，所根據的
資料為測量圖編號 6-NW-7D
EXTRACT PLAN PREPARED ON 29.12.2023
BASED ON SURVEY SHEET No.
6-NW-7D

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/HSK/471

圖 PLAN
A-2



圖例 LEGEND



申請地點(界線只作識別用)
APPLICATION SITE
(BOUNDARY FOR IDENTIFICATION
PURPOSE ONLY)

本摘要圖於2023年12月29日擬備，所根據
的資料為地政總署於2022年4月5日拍得
的航攝照片編號 E157723C
EXTRACT PLAN PREPARED ON 29.12.2023
BASED ON AERIAL PHOTO No.
E157723C TAKEN ON 5.4.2022
BY LANDS DEPARTMENT

航攝照片 AERIAL PHOTO

臨時貨倉存放糧油食品(為期3年)
新界元朗洪水橋丈量約份第124約
地段第629號及第631號及第125約地段第2002號
TEMPORARY WAREHOUSE FOR STORAGE OF PROVISIONS
FOR A PERIOD OF 3 YEARS
LOTS 629 AND 631 IN D.D.124, LOT 2002 IN D.D.125,
HUNG SHUI KIU, YUEN LONG, NEW TERRITORIES

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/HSK/471

圖 PLAN
A-3



實地照片 SITE PHOTOS

本圖於2023年12月29日擬備，所根據的資料為攝於2023年12月29日的實地照片
PLAN PREPARED ON 29.12.2023
BASED ON SITE PHOTOS
TAKEN ON 29.12.2023

臨時貨倉存放糧油食品(為期3年)
新界元朗洪水橋丈量約份第124約
地段第629號及第631號及第125約地段第2002號
TEMPORARY WAREHOUSE FOR STORAGE OF PROVISIONS
FOR A PERIOD OF 3 YEARS
LOTS 629 AND 631 IN D.D.124, LOT 2002 IN D.D.125,
HUNG SHUI KIU, YUEN LONG, NEW TERRITORIES

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/HSK/471

圖 PLAN
A-4a



實地照片 SITE PHOTOS

本圖於2023年12月29日擬備，所根據的資料為攝於2023年12月29日的實地照片
PLAN PREPARED ON 29.12.2023
BASED ON SITE PHOTOS
TAKEN ON 29.12.2023

臨時貨倉存放糧油食品(為期3年)
新界元朗洪水橋丈量約份第124約
地段第629號及第631號及第125約地段第2002號
TEMPORARY WAREHOUSE FOR STORAGE OF PROVISIONS
FOR A PERIOD OF 3 YEARS
LOTS 629 AND 631 IN D.D.124, LOT 2002 IN D.D.125,
HUNG SHUI KIU, YUEN LONG, NEW TERRITORIES

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/HSK/471

圖 PLAN
A-4b