


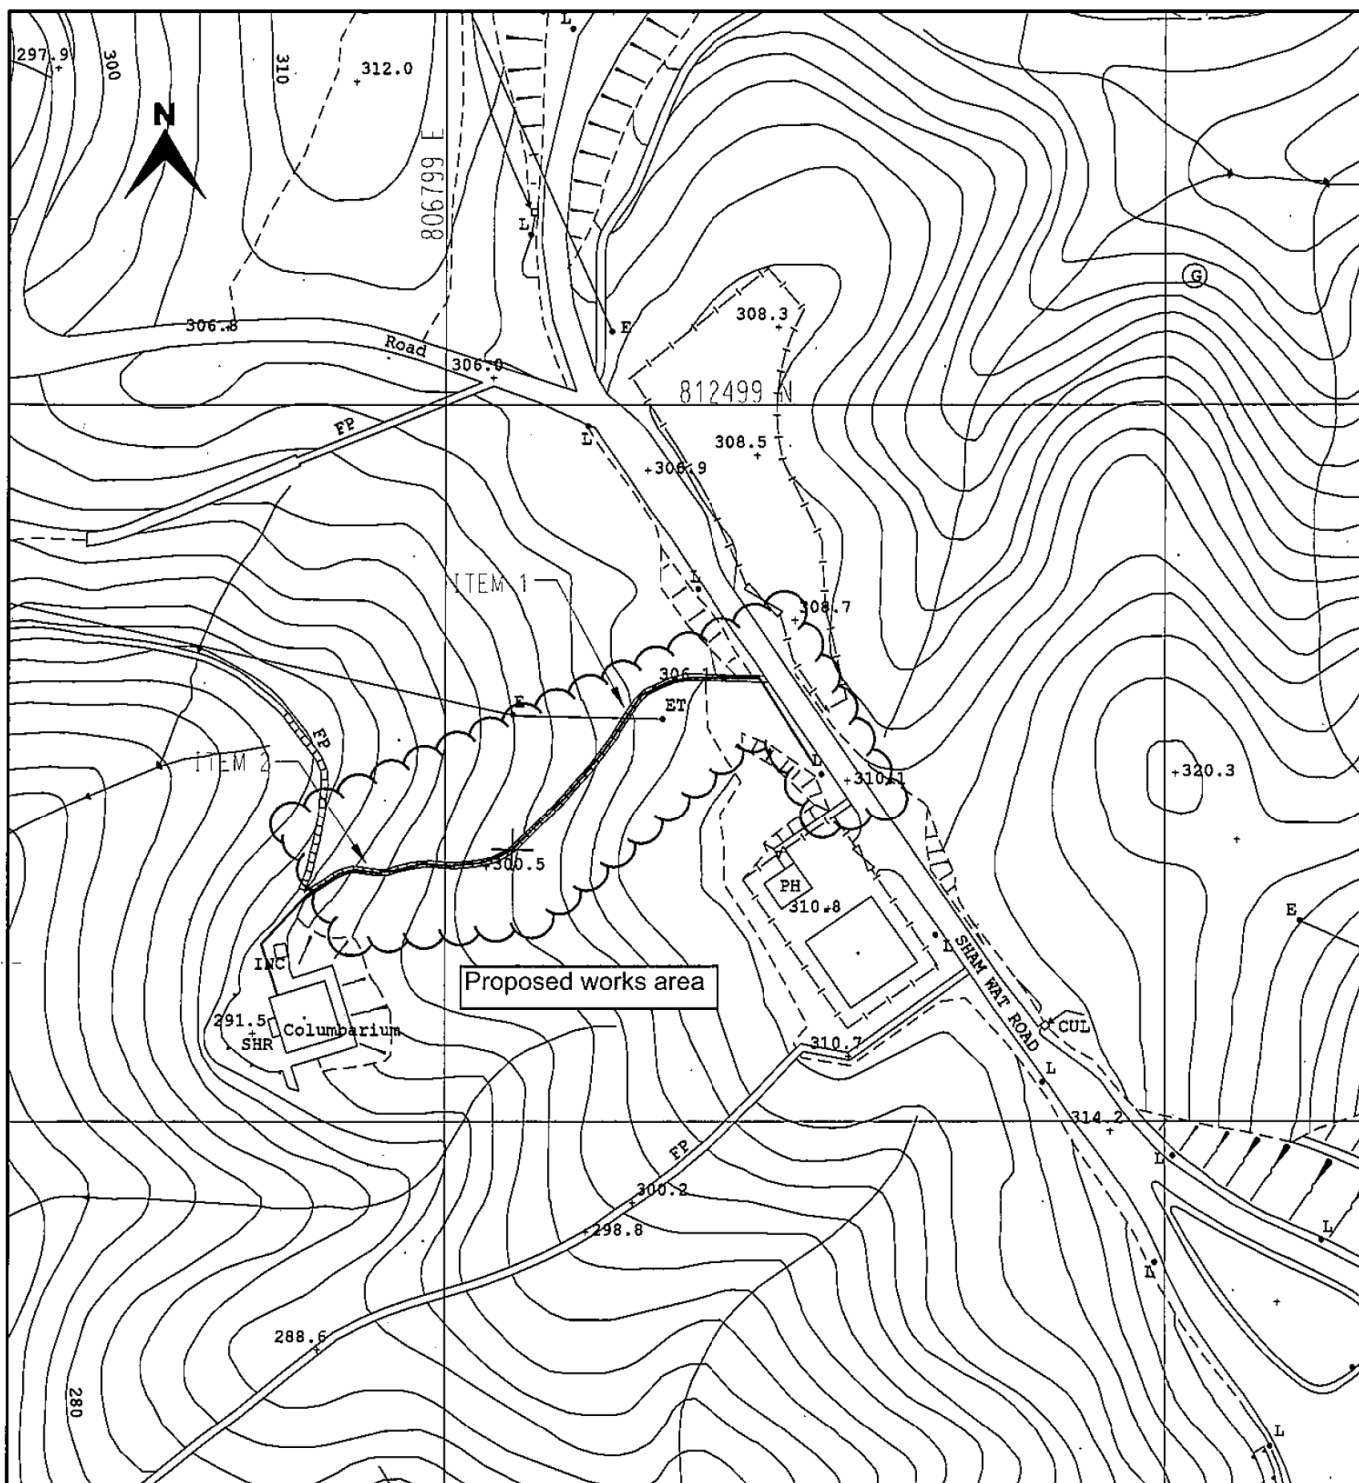

CLP 中電

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- ===== PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX
- × EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- *** OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- ⚡ EXISTING POLE MOUNTED TRANSFORMER
- ⚡ PROPOSED POLE MOUNTED TRANSFORMER
- PROPOSED STAY / STAY POLE
- ⊞ PROPOSED 5.0M(L) x 2.39M(W) x 3.0M(H) PACKAGE SUBSTATION

**TITLE : LV CABLE LAYING AT
SHAM WAT ROAD, LUK WU,
LANTAU**

MAP NO : 09SW25C, 09SW25D


DRAWN : NY CHOI		E/O NO :	
CHECKED : LILY CHEUNG		REGION : WE	O.C. : LT
DATE : 13-04-2021		PROJECT REF. : LT2021-0067	
SCALE : 1:1000		PLAN REF. : WELT2021-0067-01	

Map data reproduced with permission of the Director of Lands, (C) Hong Kong


(來源 : 申請人於2021年8月13日提交)
(SOURCE : SUBMITTED BY APPLICANT ON 13.8.2021)

參考編號
REFERENCE No.
A/I-LWKS/4

繪圖
**DRAWING
A-1**

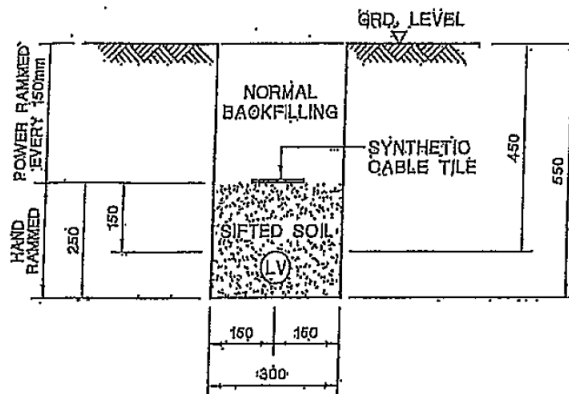

TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

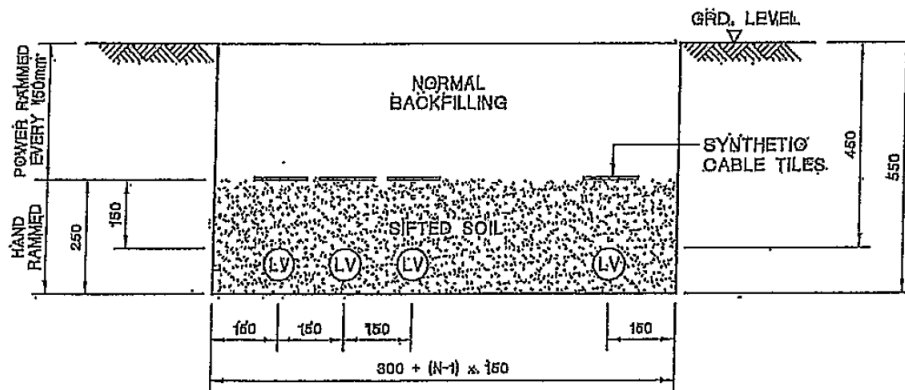

TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES

LEGEND :


- (LV) LV CABLE
N NUMBER OF CABLE CIRCUITS

NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.

C. GENERAL REVISION		B. GENERAL REVISION		A. SYNTHETIC CABLE TILE SPECIFIED															
REV. 16-2-04		REV. 18-8-07		REV. 28-8-07															
INITIAL		O.Y.E		W.B.L.E.E		Y.K.M.A.N													
TITLE :																			
TYPICAL LV CABLE TRENCH																			
DRAWN S.O.T.		DATE: 16 Aug, 2003																	
CHECKED: K. K. LEUNG		APPROVED: W. B. LEE																	
SCALE: 1:10		SHEET(S) IN SET: 1		PROJECT NO.								CONTRACT NO.							
ASSET MANAGEMENT				DRG. NO. T. GEN 25600 D E 63 0002 01 C A															

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

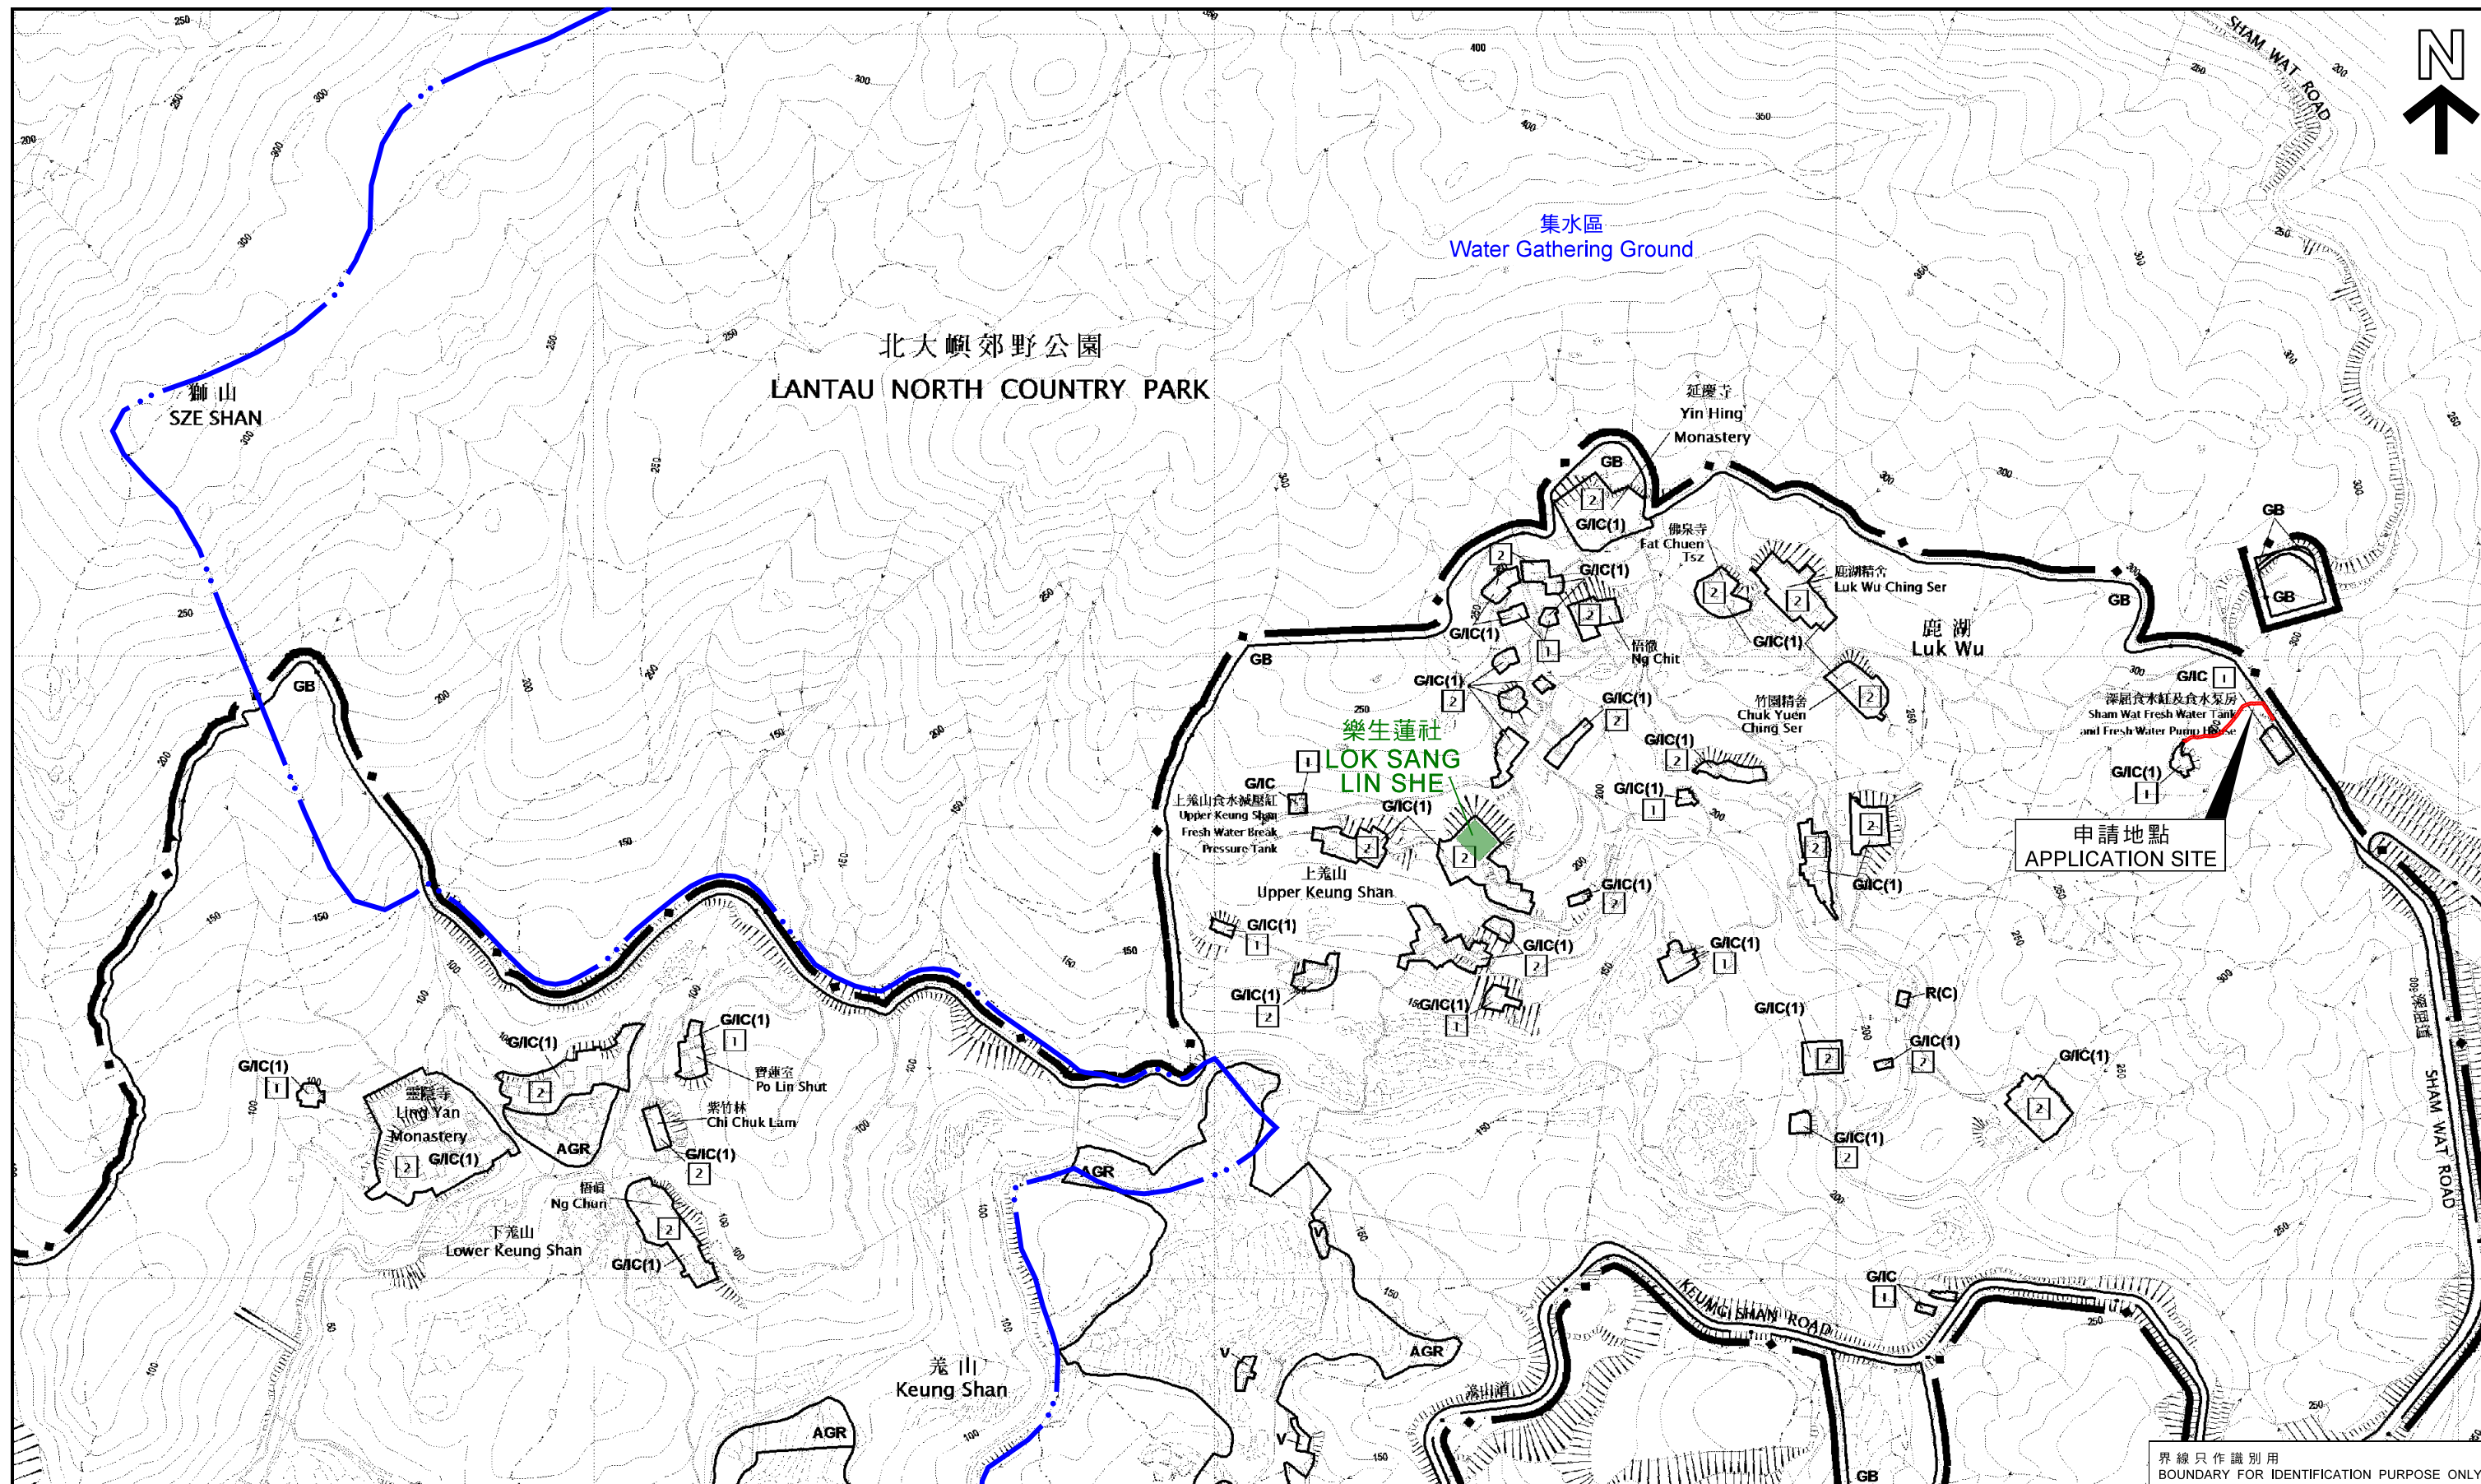

界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

位置圖 LOCATION PLAN

擬議挖土及填土以作准許的公共事業設施管道（地底電纜）
大嶼山大澳鹿湖近深屈道的政府土地
PROPOSED EXCAVATION AND FILLING OF LAND FOR
PERMITTED PUBLIC UTILITY PIPELINE (UNDERGROUND POWER CABLE)
GOVERNMENT LAND NEAR SHAM WAT ROAD, LUK WU, TAI O, LANTAU

SCALE 1:5 000 比例尺
100 0 100 200 300 400 METRES


本摘要圖於2021年9月17日擬備，
所根據的資料為於2015年9月8日
核准的分區計劃大綱圖編號S/I-LWKS/2
EXTRACT PLAN PREPARED ON 17.9.2021
BASED ON OUTLINE ZONING PLAN No.
S/I-LWKS/2 APPROVED ON 8.9.2015

規劃署
PLANNING DEPARTMENT



參考編號
REFERENCE No.
A/I-LWKS/4

圖 PLAN
A-1

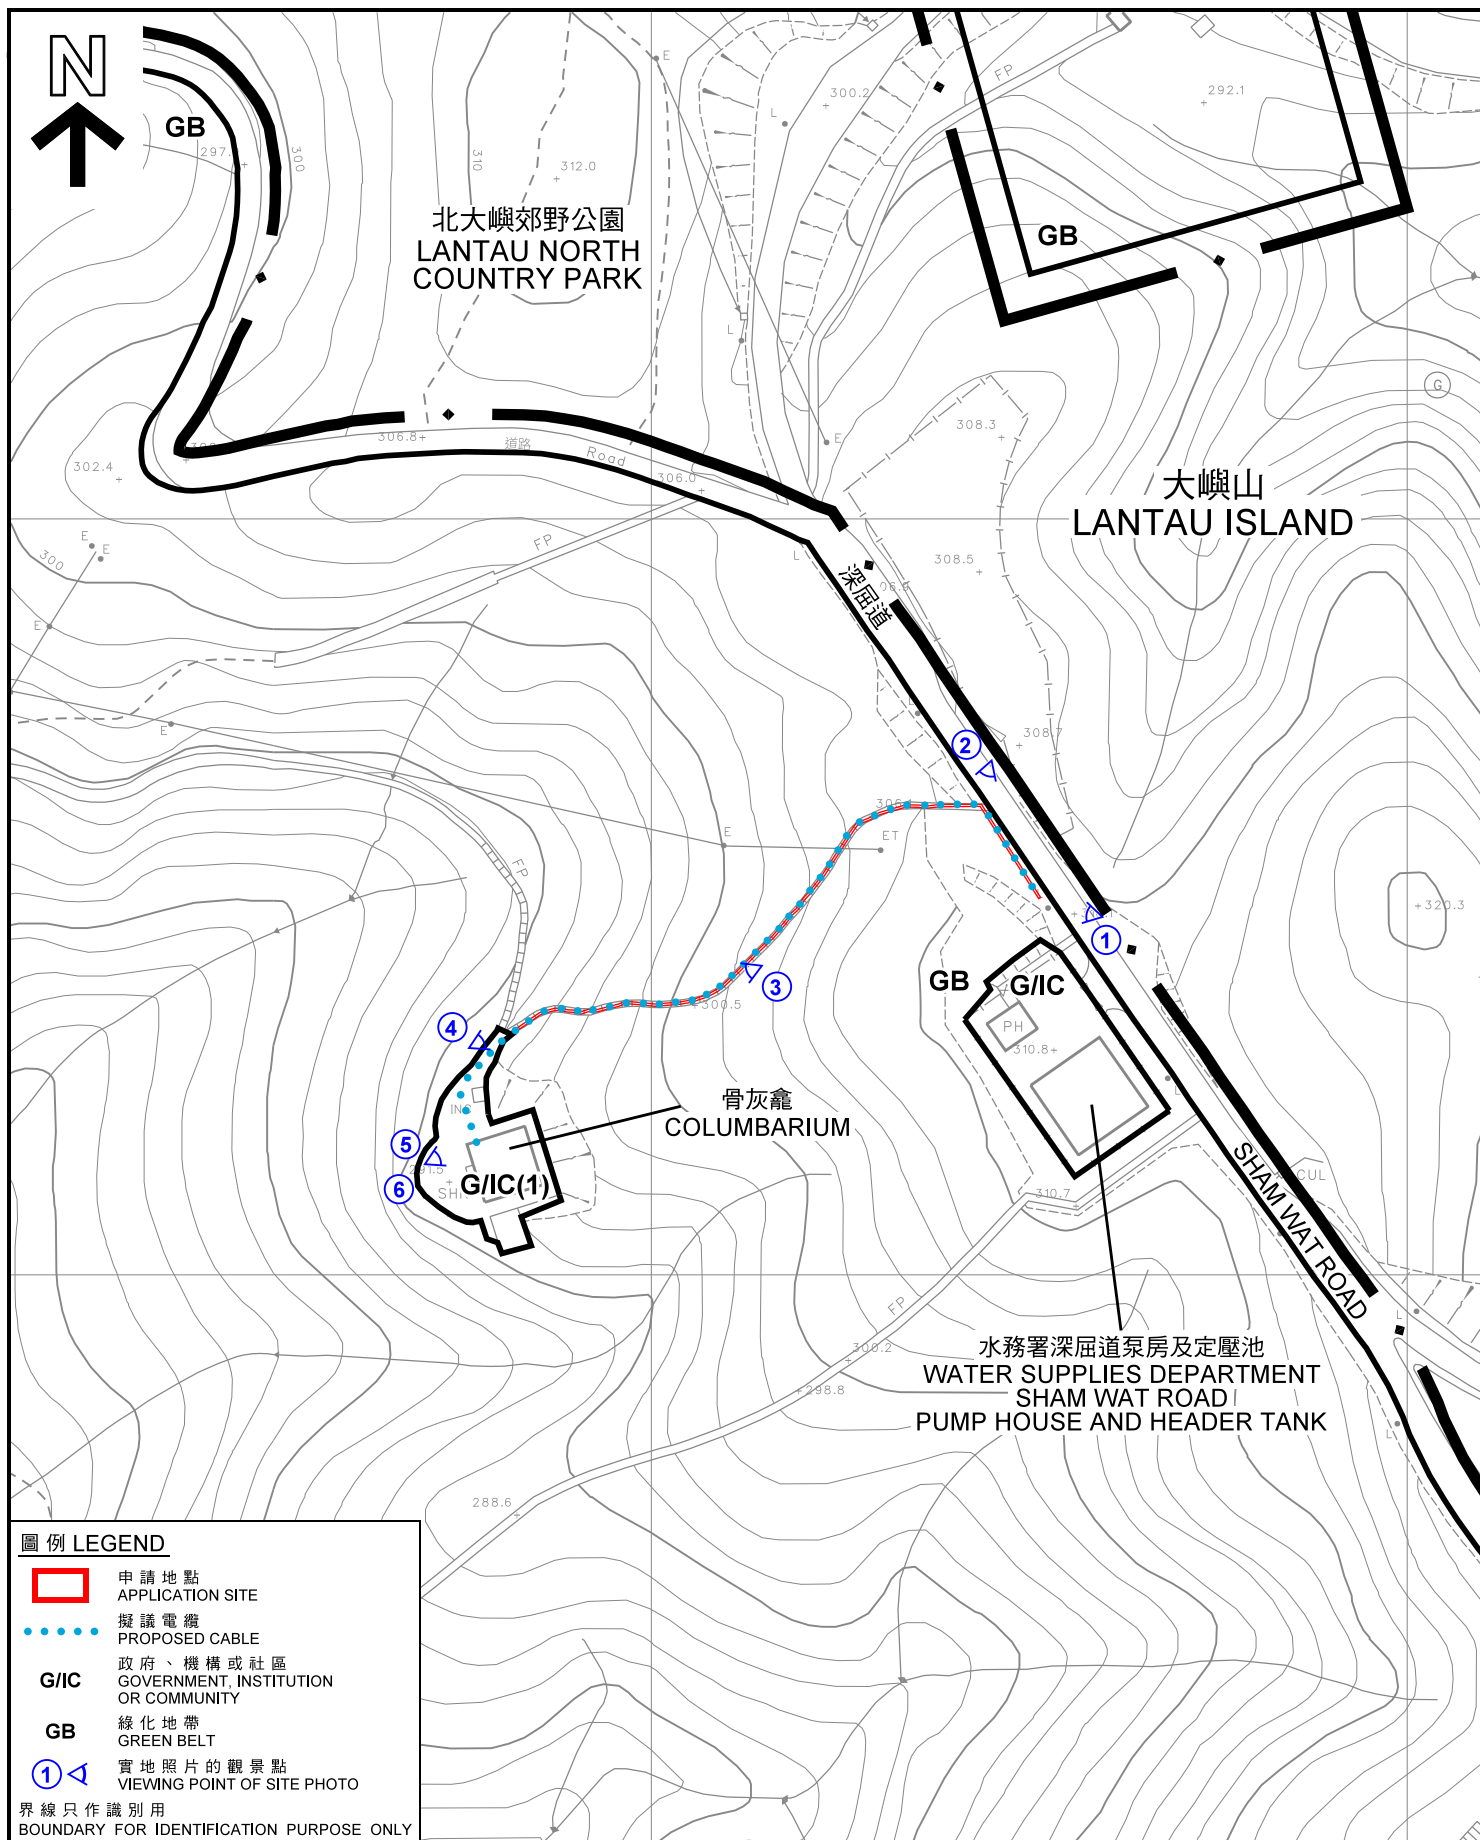

本摘要圖於2021年9月15日擬備， 所根據的資料為測量圖編號 9-SW-25C及25D EXTRACT PLAN PREPARED ON 15.9.2021 BASED ON SURVEY SHEETS No. 9-SW-25C & 25D	平面圖 SITE PLAN 擬議挖土及填土以作准許的公共事業設施管道（地底電纜） 大嶼山大澳鹿湖近深屈道的政府土地 PROPOSED EXCAVATION AND FILLING OF LAND FOR PERMITTED PUBLIC UTILITY PIPELINE (UNDERGROUND POWER CABLE) GOVERNMENT LAND NEAR SHAM WAT ROAD, LUK WU, TAI O, LANTAU SCALE 1:1 000 比例尺 米 20 0 20 40 米 METRES	規劃署 PLANNING DEPARTMENT 參考編號 REFERENCE No. A/I-LWKS/4 圖 PLAN A-2
---	---	---



大嶼山
LANTAU ISLAND

深屈道

骨灰龕
COLUMBARIUM

SHAM WAT ROAD

水務署深屈道泵房及定壓池
WATER SUPPLIES DEPARTMENT
SHAM WAT ROAD
PUMP HOUSE AND HEADER TANK

圖例 LEGEND

-  申請地點
APPLICATION SITE
-  擬議電纜
PROPOSED CABLE

界線 只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

本摘要圖於2021年9月15日擬備，
所根據的資料為地政總署於2021年1月9日
拍得的航攝照片編號E119250C

EXTRACT PLAN PREPARED ON 15.9.2021
BASED ON AERIAL PHOTO No. E119250C
TAKEN ON 9.1.2021
BY LANDS DEPARTMENT

航攝照片 AERIAL PHOTO

擬議挖土及填土以作准許的公共事業設施管道（地底電纜）
大嶼山大澳鹿湖近深屈道的政府土地
PROPOSED EXCAVATION AND FILLING OF LAND FOR
PERMITTED PUBLIC UTILITY PIPELINE (UNDERGROUND POWER CABLE)
GOVERNMENT LAND NEAR SHAM WAT ROAD,
LUK WU, TAI O, LANTAU

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.

A/I-LWKS/4

圖 PLAN
A-3


水務署深屈道泵房及定壓池
WATER SUPPLIES DEPARTMENT
SHAM WAT ROAD
PUMP HOUSE AND HEADER TANK

申請地點
APPLICATION SITE



水務署深屈道泵房及定壓池
WATER SUPPLIES DEPARTMENT
SHAM WAT ROAD
PUMP HOUSE AND HEADER TANK

申請地點
APPLICATION SITE

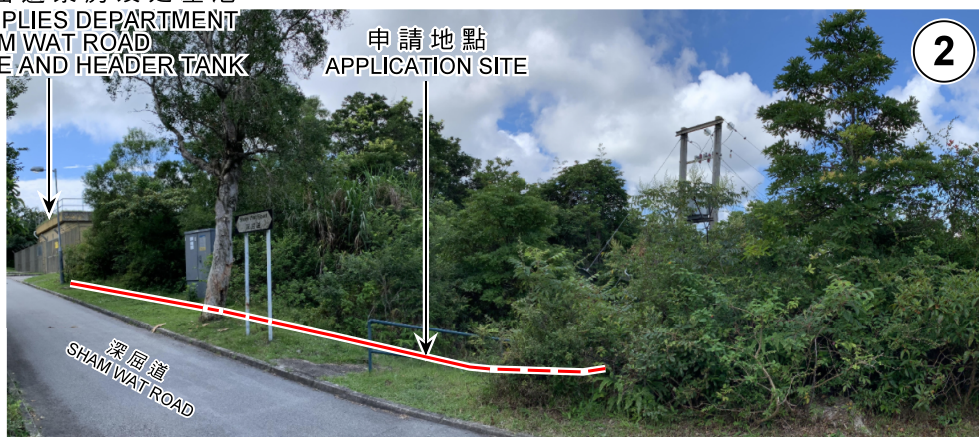

界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTOS

擬議挖土及填土以作准許的公共事業設施管道（地底電纜）
大嶼山大澳鹿湖近深屈道的政府土地
PROPOSED EXCAVATION AND FILLING OF LAND FOR
PERMITTED PUBLIC UTILITY PIPELINE (UNDERGROUND POWER CABLE)
GOVERNMENT LAND NEAR SHAM WAT ROAD,
LUK WU, TAI O, LANTAU

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/I-LWKS/4

圖 PLAN
A-4

本摘要圖於2021年9月14日擬備，
所根據的資料為
攝於2021年8月20日的實地照片
EXTRACT PLAN PREPARED ON 14.9.2021
BASED ON SITE PHOTOS
TAKEN ON 20.8.2021

申請地點
APPLICATION SITE

骨灰龕
COLUMBARIUM



骨灰龕
COLUMBARIUM



樂生助念蓮社四眾普同塔
LOK SANG LIN SHEA BUDDHIST TOWER

界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

本摘要圖於2021年9月17日擬備，
所根據的資料為
攝於2021年8月20日的實地照片
EXTRACT PLAN PREPARED ON 17.9.2021
BASED ON SITE PHOTOS
TAKEN ON 20.8.2021

實地照片 SITE PHOTOS

擬議挖土及填土以作准許的公共事業設施管道（地底電纜）
大嶼山大澳鹿湖近深屈道的政府土地
PROPOSED EXCAVATION AND FILLING OF LAND FOR
PERMITTED PUBLIC UTILITY PIPELINE (UNDERGROUND POWER CABLE)
GOVERNMENT LAND NEAR SHAM WAT ROAD,
LUK WU, TAI O, LANTAU

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/I-LWKS/4

圖 PLAN
A-5