


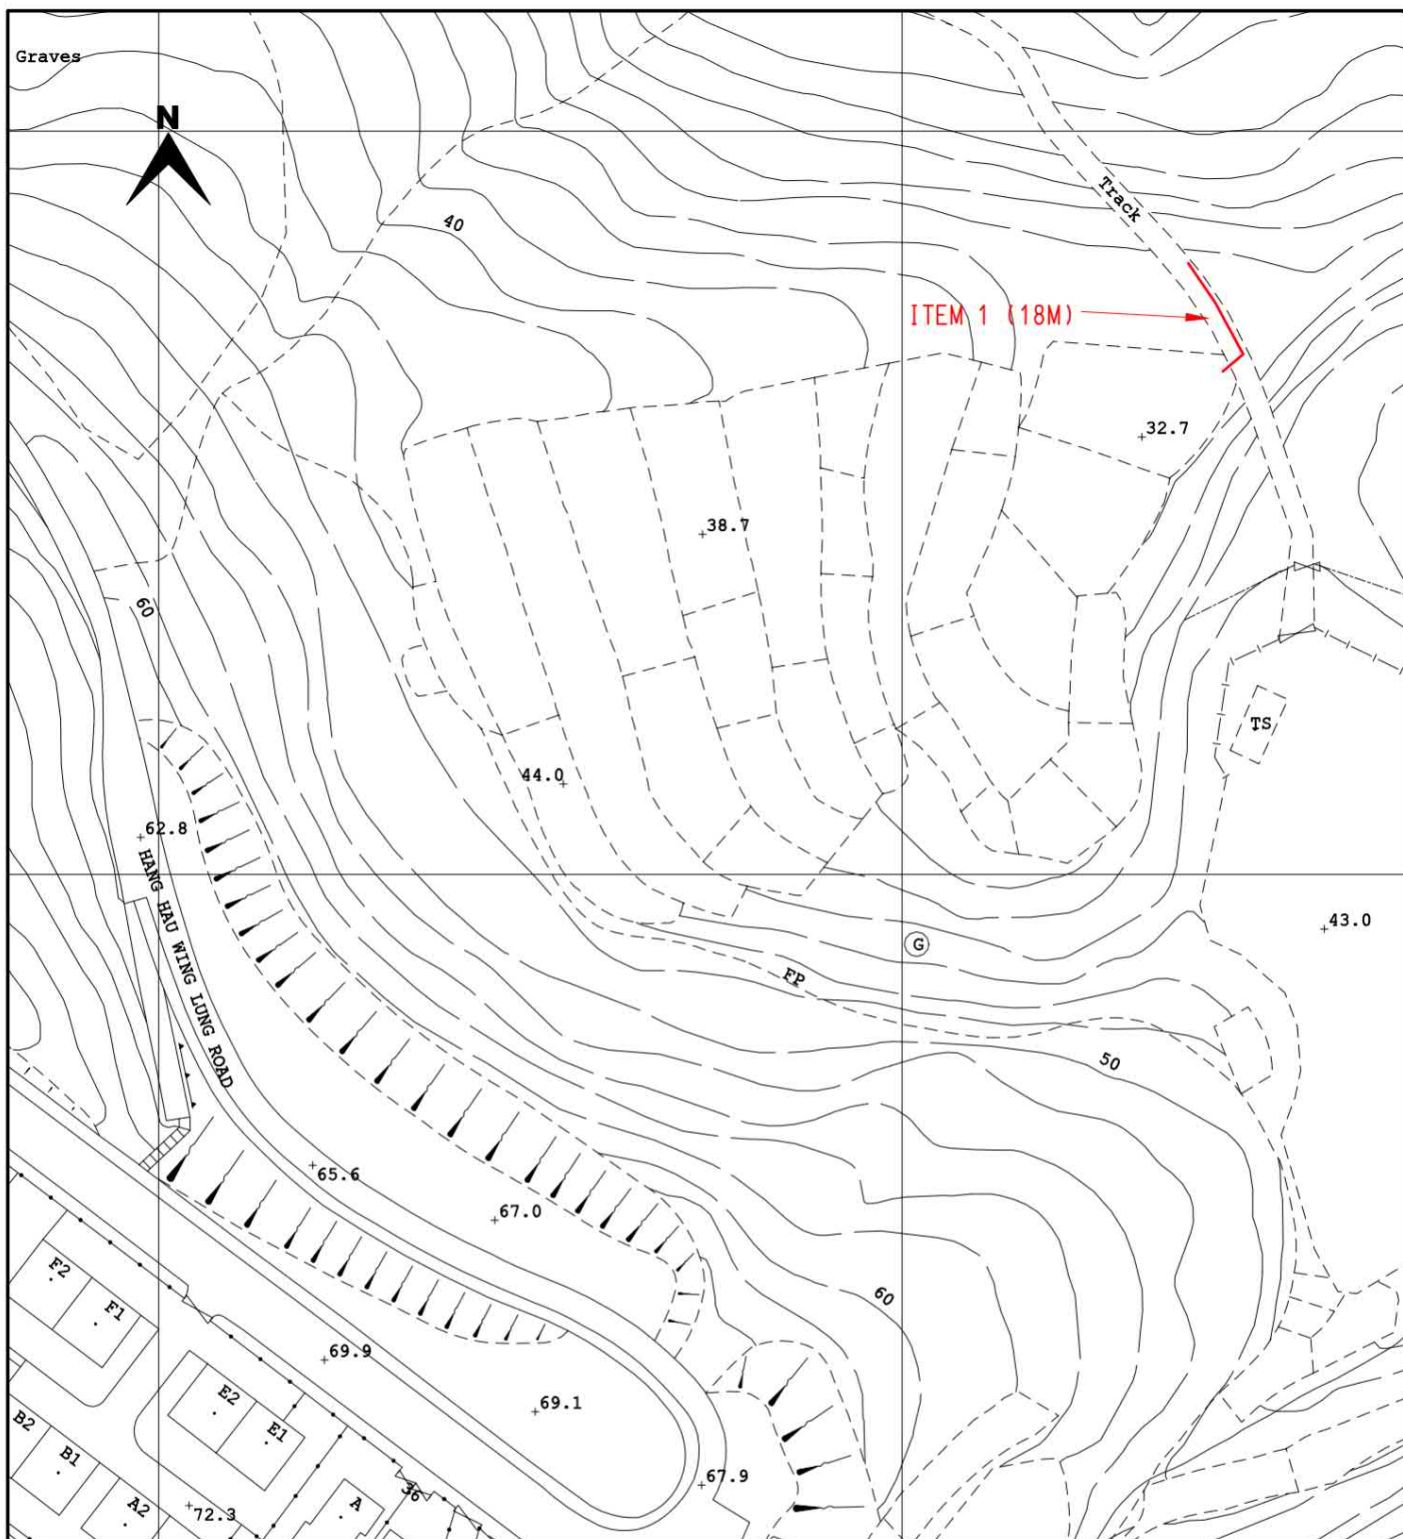

CLP 中電

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- (NO) --- PROPOSED TRENCH FOR LAYING DUCTS
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX
- x EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- x x x x x OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- ⬆ EXISTING POLE MOUNTED TRANSFORMER
- ⬆ PROPOSED POLE MOUNTED TRANSFORMER
- + PROPOSED STAY / STAY POLE
- ⊠ PROPOSED 5.0M(L) x 2.39M(W) x 3.0M(H) PACKAGE SUBSTATION

TITLE : LV CABLE LAYING
NEAR HANG HAU WING LUNG ROAD
NG FAI TIN
SAI KUNG

MAP NO : 12NW17B

DRAWN : H.Y. WONG

E/O NO :

CHECKED : C.H. CHUI

REGION : WE

O.C. : SK

DATE : 13-08-2020

PROJECT REF. : SK2017-0126

SCALE :


PLAN REF. : WESK2017-0126-04

Map data reproduced with permission of the Director of Lands. (C) Hong Kong


(資料來源 : 申請人於 15.10.2021 呈交的資料)
(Source : Applicant's Submission of 15.10.2021)

參考編號
REFERENCE No.
A/SK-CWBN/65

繪圖
DRAWING
A-1

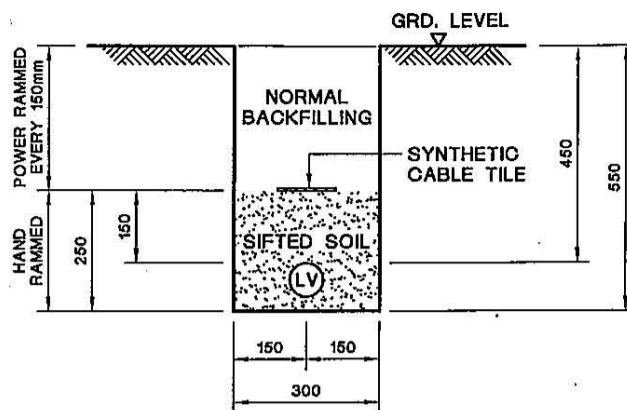

TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

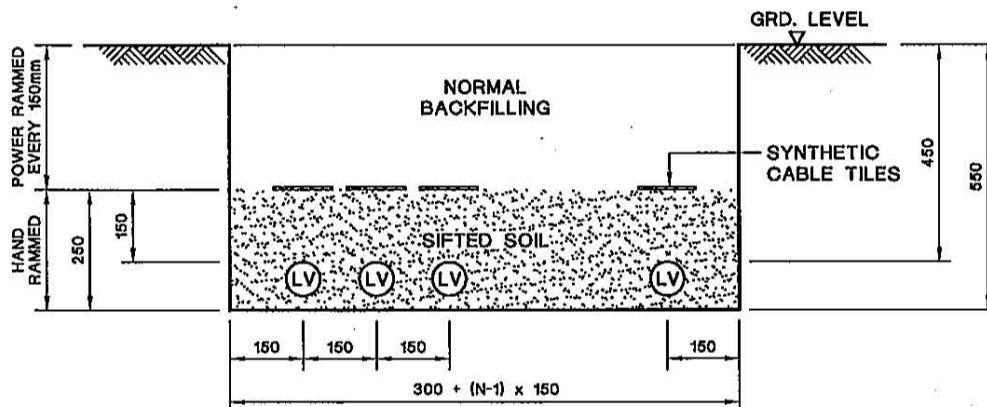

TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES

LEGEND :

- (LV) LV CABLE
N NUMBER OF CABLE CIRCUITS

NOTES:


1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.


C GENERAL REVISION		B GENERAL REVISION		A SYNTHETIC CABLE TILE SPECIFIED										
CLP 中電		REVS.	16-2-04	18-6-07	28-6-07									
		INITIAL	C.Y.P	W.B.LEE	Y.K.MAN	D	E	F	G	H	J	K	L	
DRAWN: S.C.T.		DATE: 15 Aug., 2003		TITLE : TYPICAL LV CABLE TRENCH										
CHECKED: K. K. LEUNG		APPROVED: W. B. LEE												
SCALE:		SHEET(S) IN SET: 1		PROJECT NO.					CONTRACT NO.					
ASSET MANAGEMENT				DRG. NO. T GEN 25500 DE 33000201 C A										

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

(資料來源：申請人於 15.10.2021 呈交的資料)
(Source : Applicant's Submission of 15.10.2021)

參考編號 REFERENCE No. A/SK-CWBN/65	繪圖 DRAWING A-2
---------------------------------------	----------------------

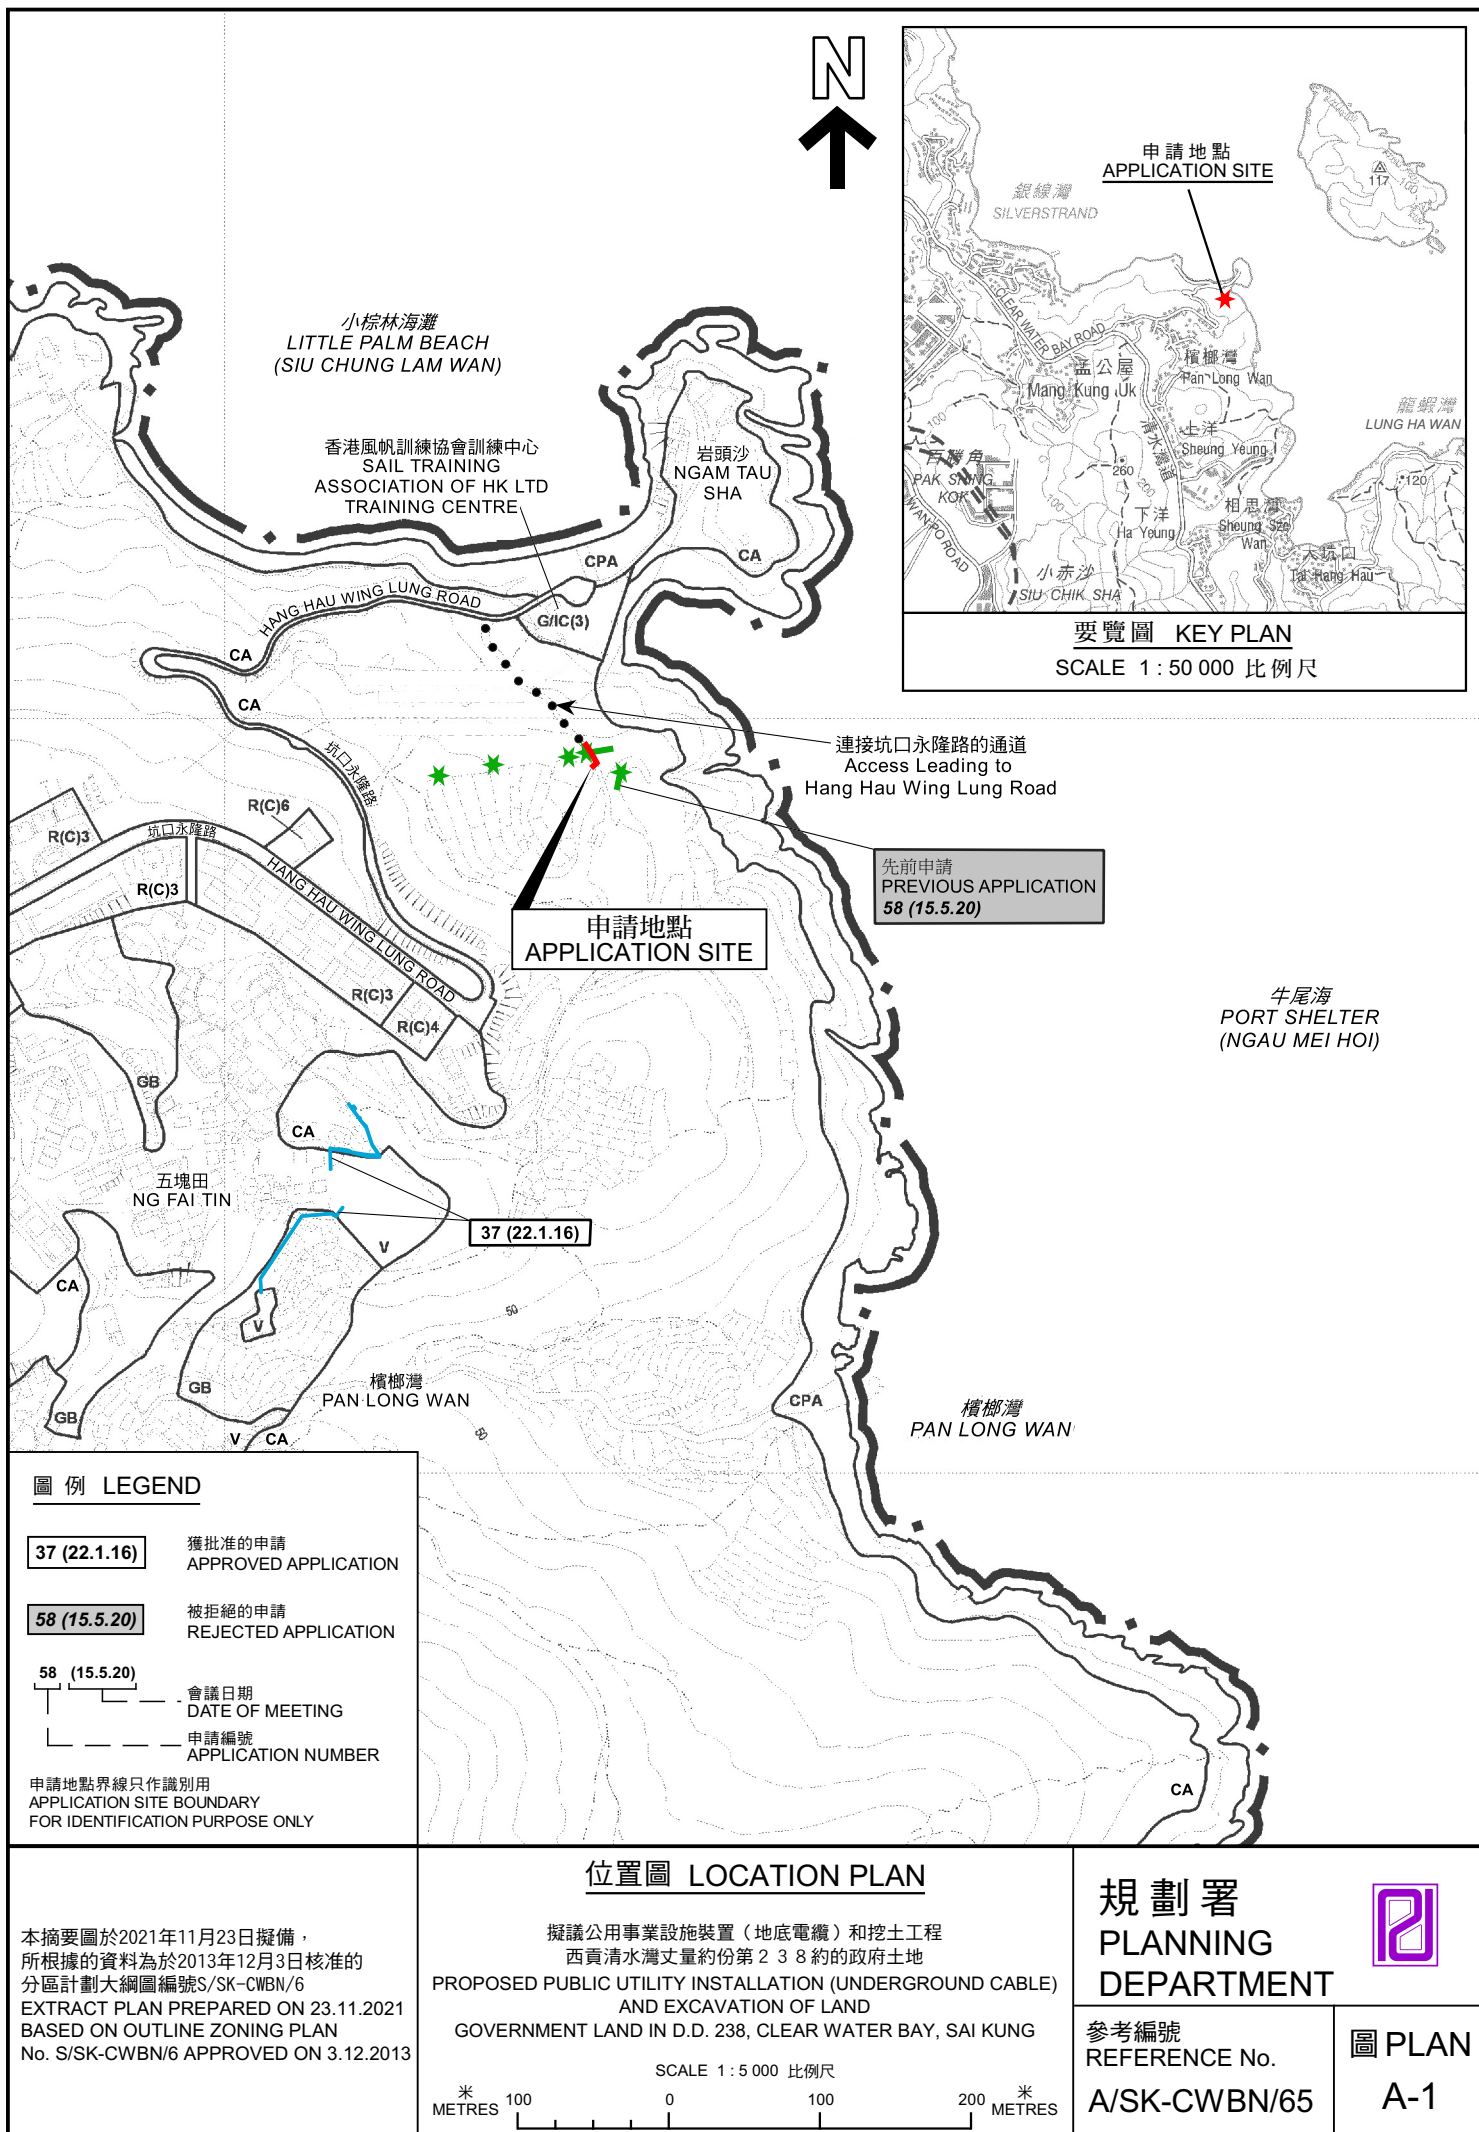

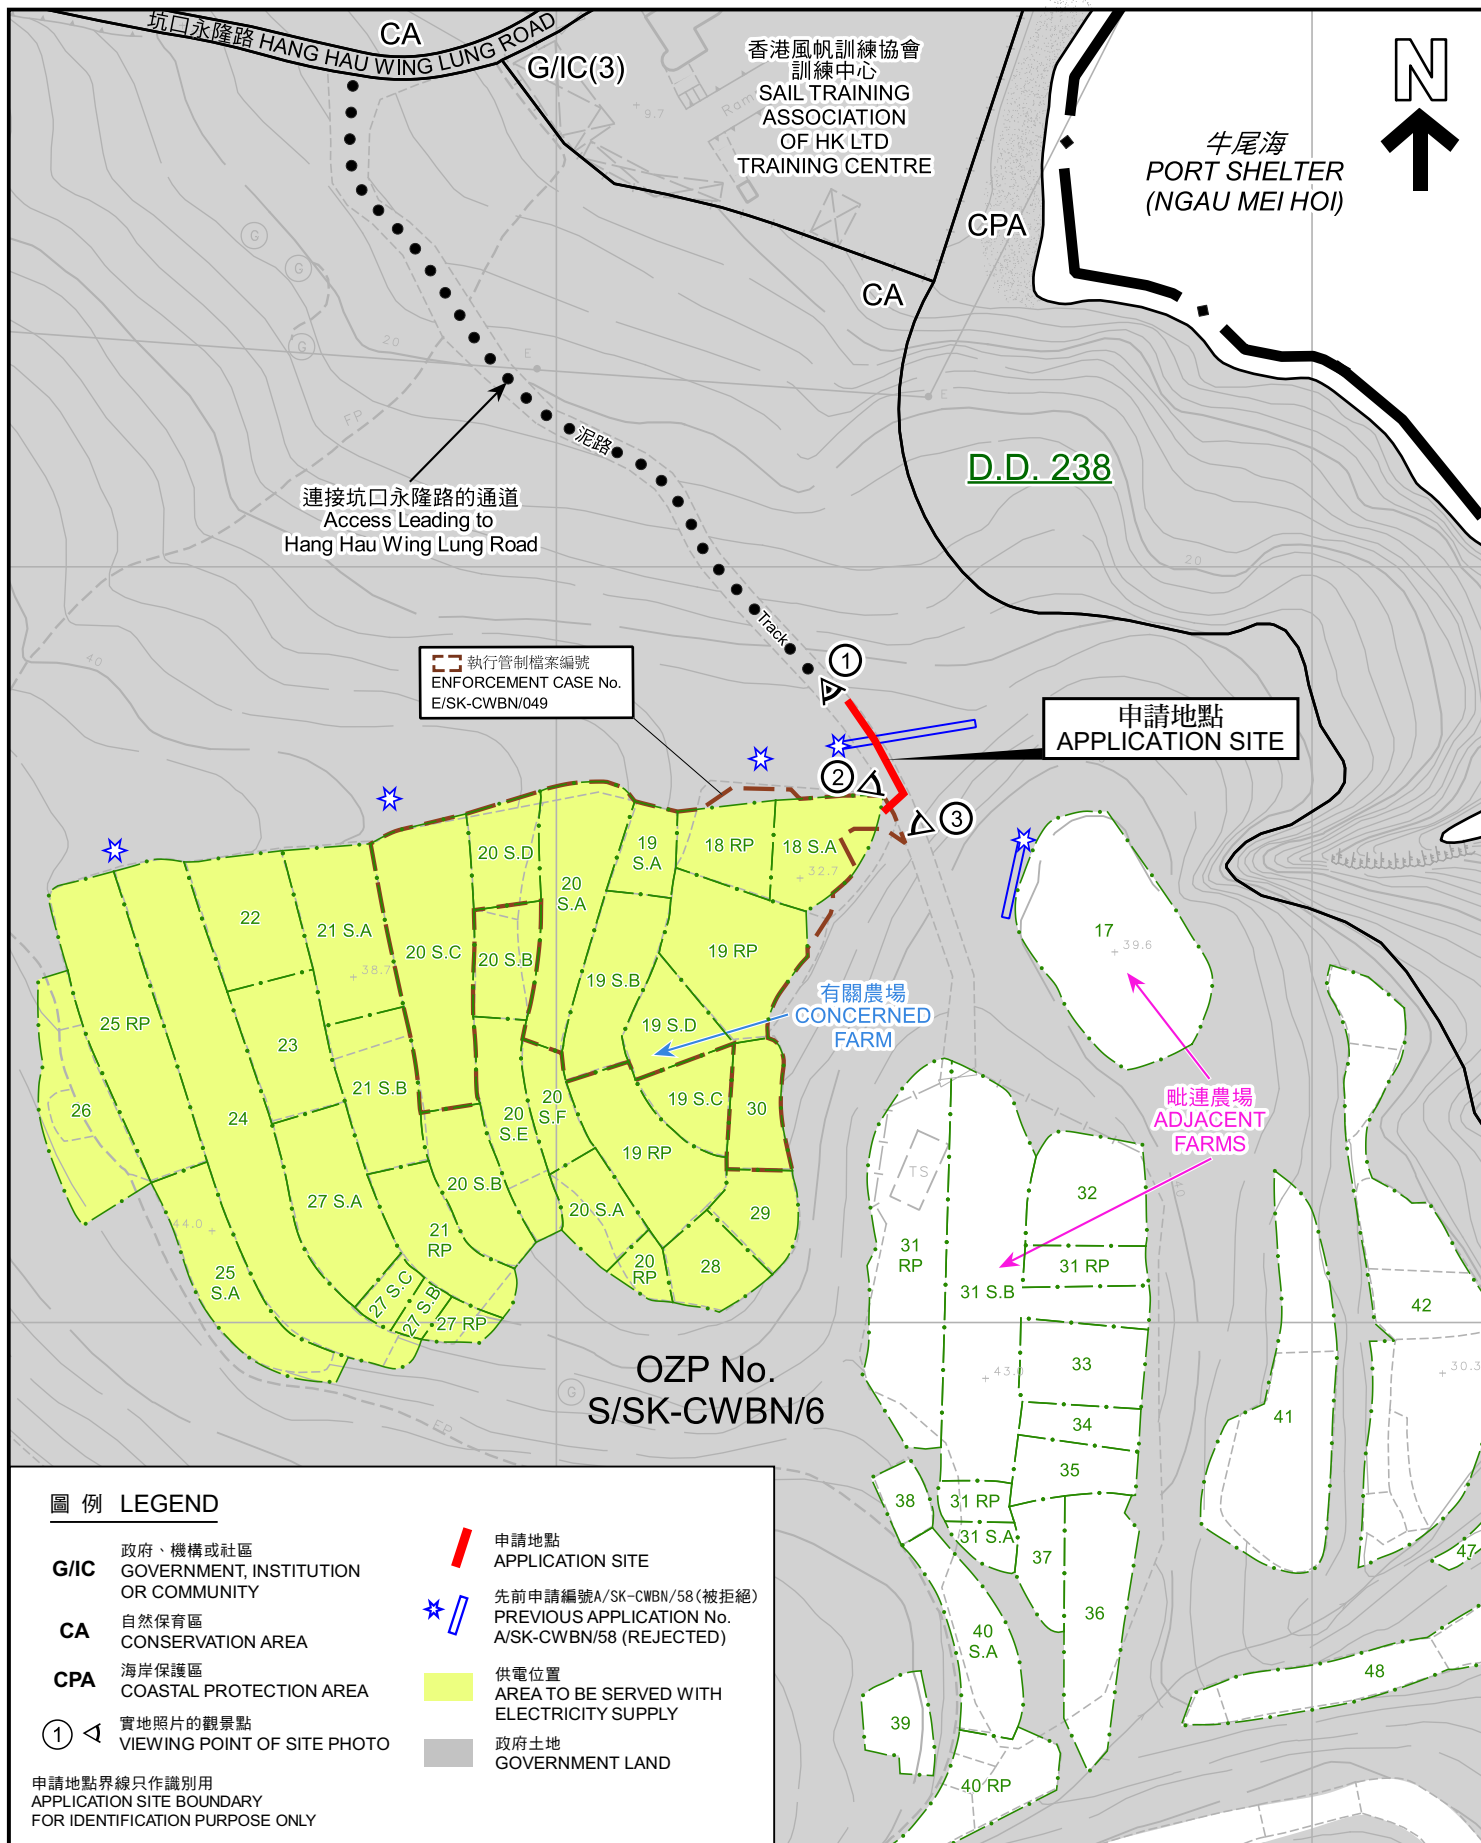

平面圖 SITE PLAN

擬議公用事業設施裝置(地底電纜)和挖土工程
西貢清水灣丈量約份第238約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION (UNDERGROUND CABLE)
AND EXCAVATION OF LAND
GOVERNMENT LAND IN D.D. 238, CLEAR WATER BAY, SAI KUNG

SCALE 1:1 000 比例尺

米 20 0 20 40 米
METRES

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-CWBN/65

圖 PLAN
A-2

本摘要圖於2021年11月23日擬備，所根據
的資料為測量圖編號12-NW-17B
EXTRACT PLAN PREPARED ON 23.11.2021
BASED ON SURVEY SHEET No. 12-NW-17B



小棕林海灘
LITTLE PALM BEACH
(SIU CHUNG LAM WAN)

岩頭沙
NGAM TAU SHA

坑口永隆路

HANG HAU WING LUNG ROAD

連接坑口永隆路的通道
Access Leading to
Hang Hau Wing Lung Road

香港風帆訓練協會
訓練中心
SAIL TRAINING
ASSOCIATION
OF HK LTD
TRAINING CENTRE

牛尾海
PORT SHELTER
(NGAU MEI HOI)

申請地點
APPLICATION SITE

愚園

毗連農場
ADJACENT FARMS

有關農場
CONCERNED FARM

HANG HAU WING LUNG ROAD

詠濤別墅
ISLAND VIRW

海濤別墅
THE CHALET

申請地點界線只作識別用
APPLICATION SITE BOUNDARY
FOR IDENTIFICATION PURPOSE ONLY

航攝照片 AERIAL PHOTO

擬議公用事業設施裝置（地底電纜）和挖土工程
西貢清水灣丈量約份第 2 3 8 約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION (UNDERGROUND
CABLE) AND EXCAVATION OF LAND
GOVERNMENT LAND IN D.D. 238, CLEAR WATER BAY, SAI KUNG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-CWBN/65

圖 PLAN
A-3

本摘要圖於2021年11月25日擬備，
所根據的資料為地政總署
於2020年2月20日拍得的
航攝照片編號E091114C
EXTRACT PLAN PREPARED ON 25.11.2021
BASED ON AERIAL PHOTO No. E091114C
TAKEN ON 20.2.2020
BY LANDS DEPARTMENT

1



2



3



申請地點界線只作識別用
APPLICATION SITE BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTO

本圖於2021年11月23日擬備，所根據的資料為攝於2021年10月22日的實地照片
PLAN PREPARED ON 23.11.2021
BASED ON SITE PHOTOS
TAKEN ON 22.10.2021

擬議公用事業設施裝置（地底電纜）和挖土工程
西貢清水灣丈量約份第238約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION (UNDERGROUND CABLE)
AND EXCAVATION OF LAND
GOVERNMENT LAND IN D.D. 238, CLEAR WATER BAY, SAI KUNG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-CWBN/65

圖 PLAN
A-4