


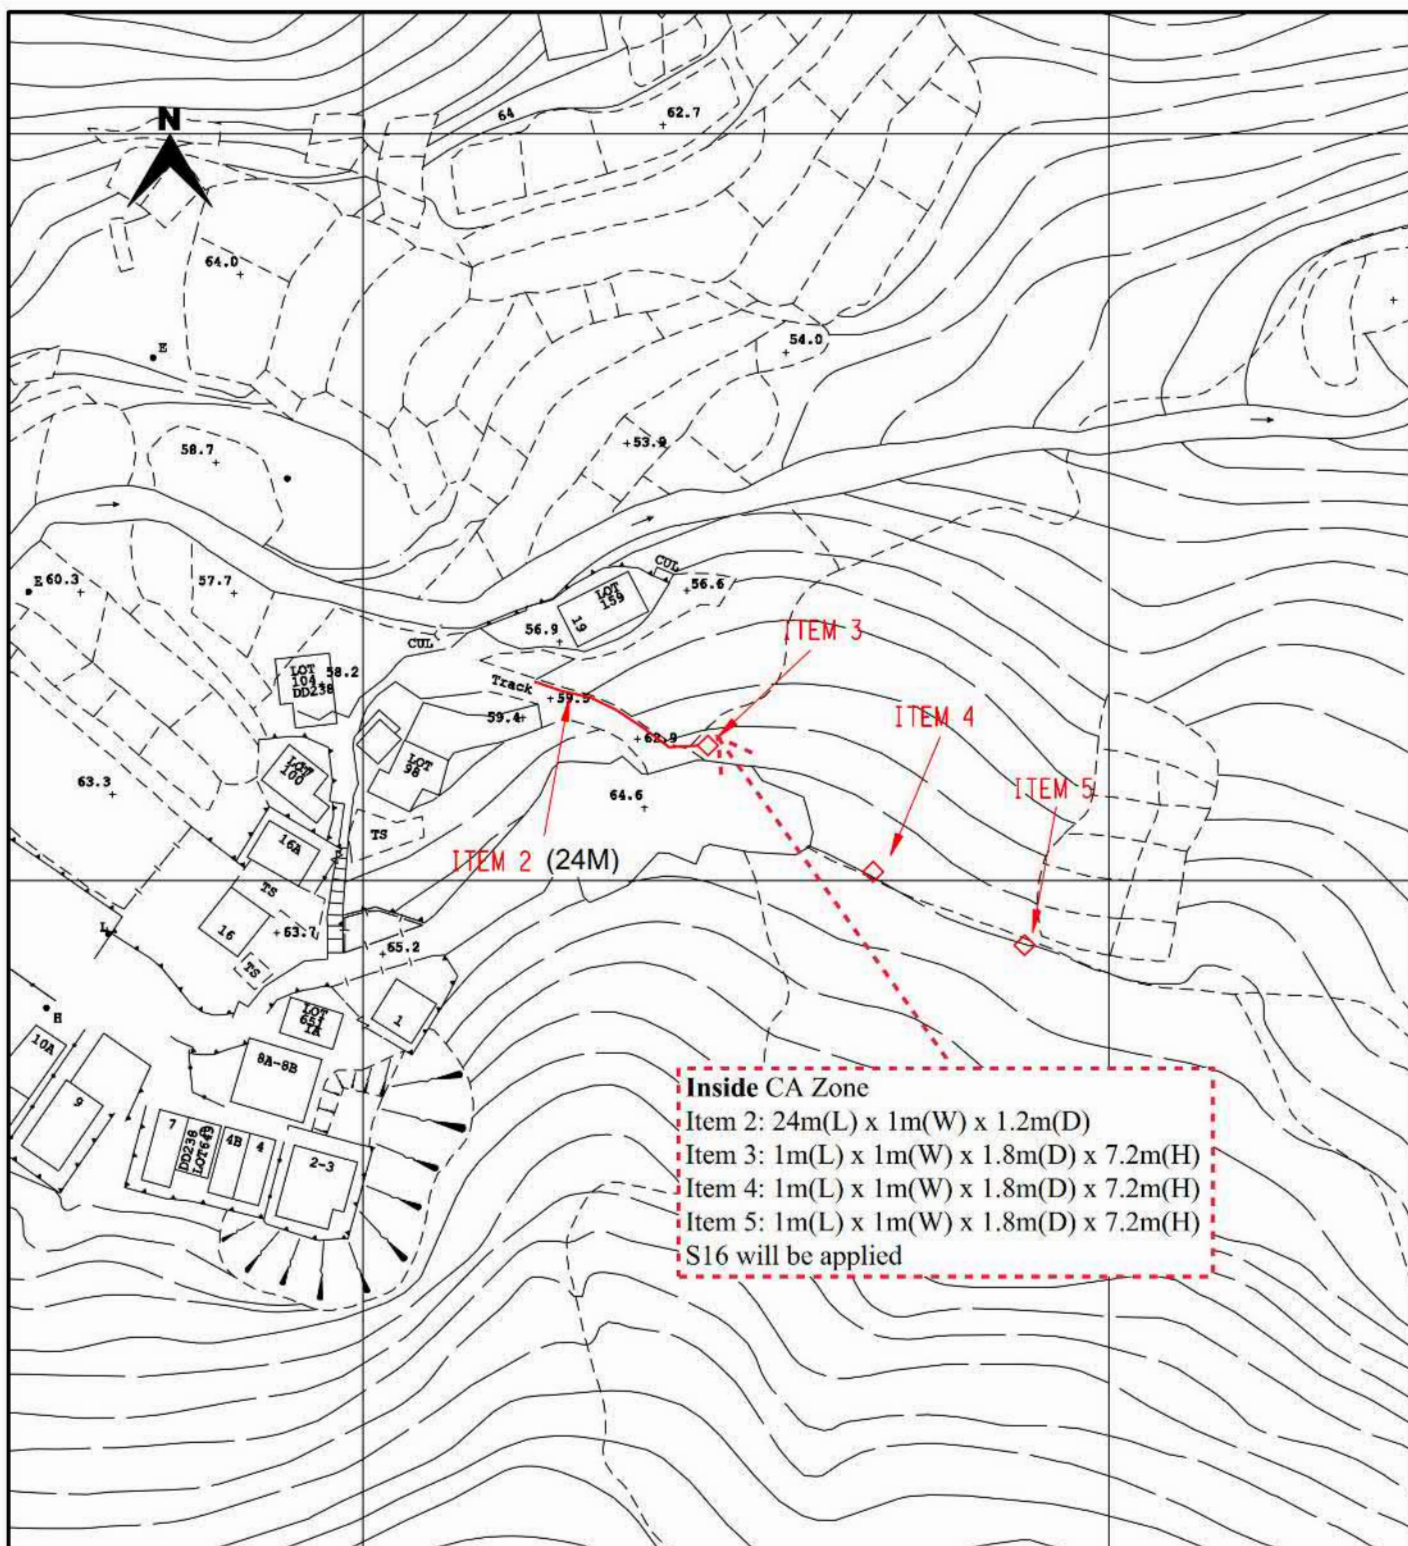

CLP 中電

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX
- x EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- x x x x x OVERHEAD LINE & POLE TO BE REMOVED
- ✂ PROPOSED TREE TRIMMING / CUTTING
- ⬆ EXISTING POLE MOUNTED TRANSFORMER
- ⬆ PROPOSED POLE MOUNTED TRANSFORMER
- + PROPOSED STAY / STAY POLE
- ⊠ PROPOSED 5.0M(L) x 2.39M(W) x 3.0M(H) PACKAGE SUBSTATION

TITLE : LV CABLE LAYING & POLE ERECTION
NEAR HOUSE NO.19
PAN LONG WAN
SAI KUNG

MAP NO : 12NW17D

DRAWN : H.Y. WONG

E/O NO :

CHECKED : C.H. CHUI

REGION : WE

O.C. : SK

DATE : 08-09-2021

PROJECT REF. : SK2021-0362

SCALE : 1:1000


PLAN REF. : WESK2021-0362-01

Map data reproduced with permission of the Director of Lands. (C) Hong Kong

(資料來源：申請人於 23.08.2023 呈交的資料)
(Source : Applicant's Submission of 23.08.2023)

參考編號
REFERENCE No.
A/SK-CWBN/75

繪圖
DRAWING
A-1

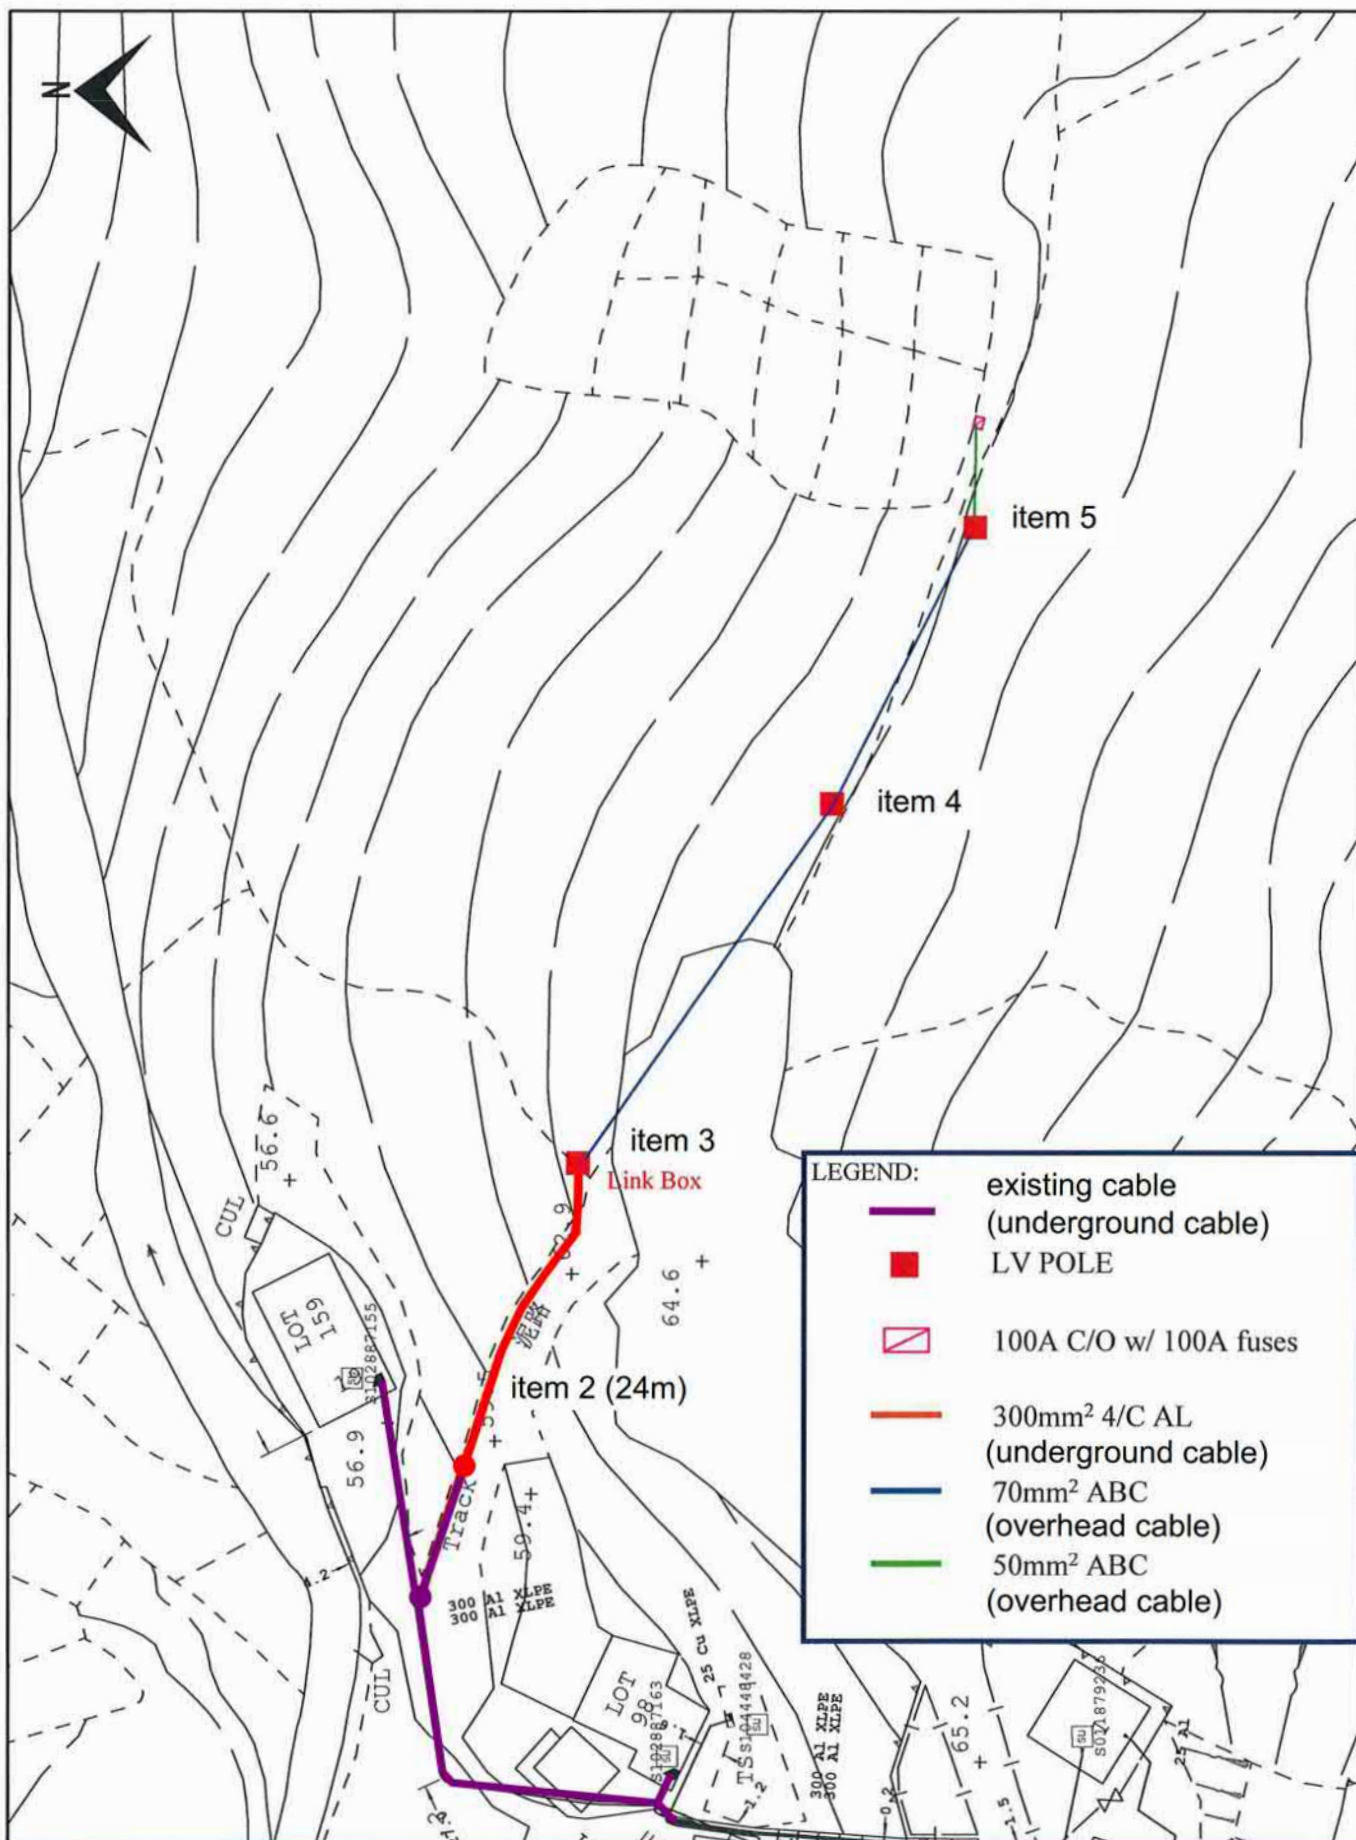

LEGEND:

- existing cable
(underground cable)
- LV POLE
- ◻ 100A C/O w/ 100A fuses
- 300mm² 4/C AL
(underground cable)
- 70mm² ABC
(overhead cable)
- 50mm² ABC
(overhead cable)

PROJECT:

NSLV-(FARM) DD238 LOT86 PAN LONG WAN

PROPOSED LV CIRCUIT DIAGRAM

DRG NO. SK-210362-4


Date: 27-07-2021

Map data reproduced with permission of the Director of Land, (c) Hong Kong.
Reproduction in any form must be approved by CLP Power.

(資料來源：申請人於 23.08.2023 呈交的資料)
(Source : Applicant's Submission of 23.08.2023)

參考編號
REFERENCE No.
A/SK-CWBN/75

繪圖
DRAWING
A-2

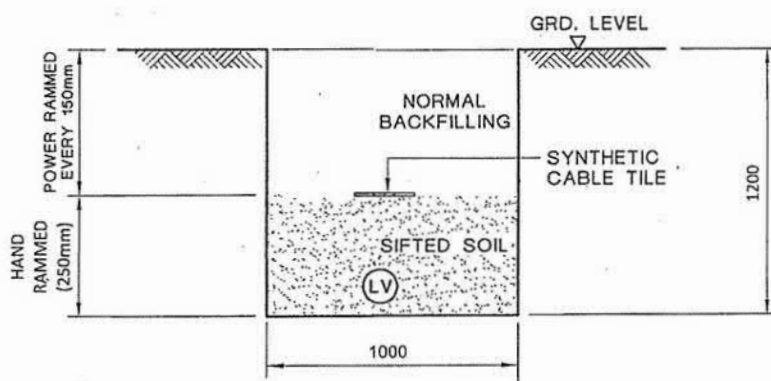

TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

LEGEND :

(LV) LV CABLE

NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.

C GENERAL REVISION		B GENERAL REVISION		A SYNTHETIC CABLE TILE SPECIFIED										
		REVS.	16-2-04	18-6-07	28-6-07									
			A	B	C	D	E	F	G	H	J	K	L	
		INITIAL	C.Y. IP	W.B. LEE	Y.K. MAN									
		TITLE :												
		TYPICAL LV CABLE TRENCH												
DRAWN: S.C.T.														
CHECKED: K. K. LEUNG		APPROVED: W. B. LEE												
SCALE:		SHEET(S) IN SET: 1												
		PROJECT NO.						CONTRACT NO.						
ASSET MANAGEMENT		DRG. NO. T GEN 25500 D E 33 0002 01 C A												


ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

(資料來源：申請人於 23.06.2023 呈交的資料)
(Source : Applicant's Submission of 23.06.2023)

參考編號 REFERENCE No. A/SK-CWBN/75	繪圖 DRAWING A-3
---------------------------------------	----------------------


NOMINAL POLE LENGTH

9m



VIEW A'

VIEW A'

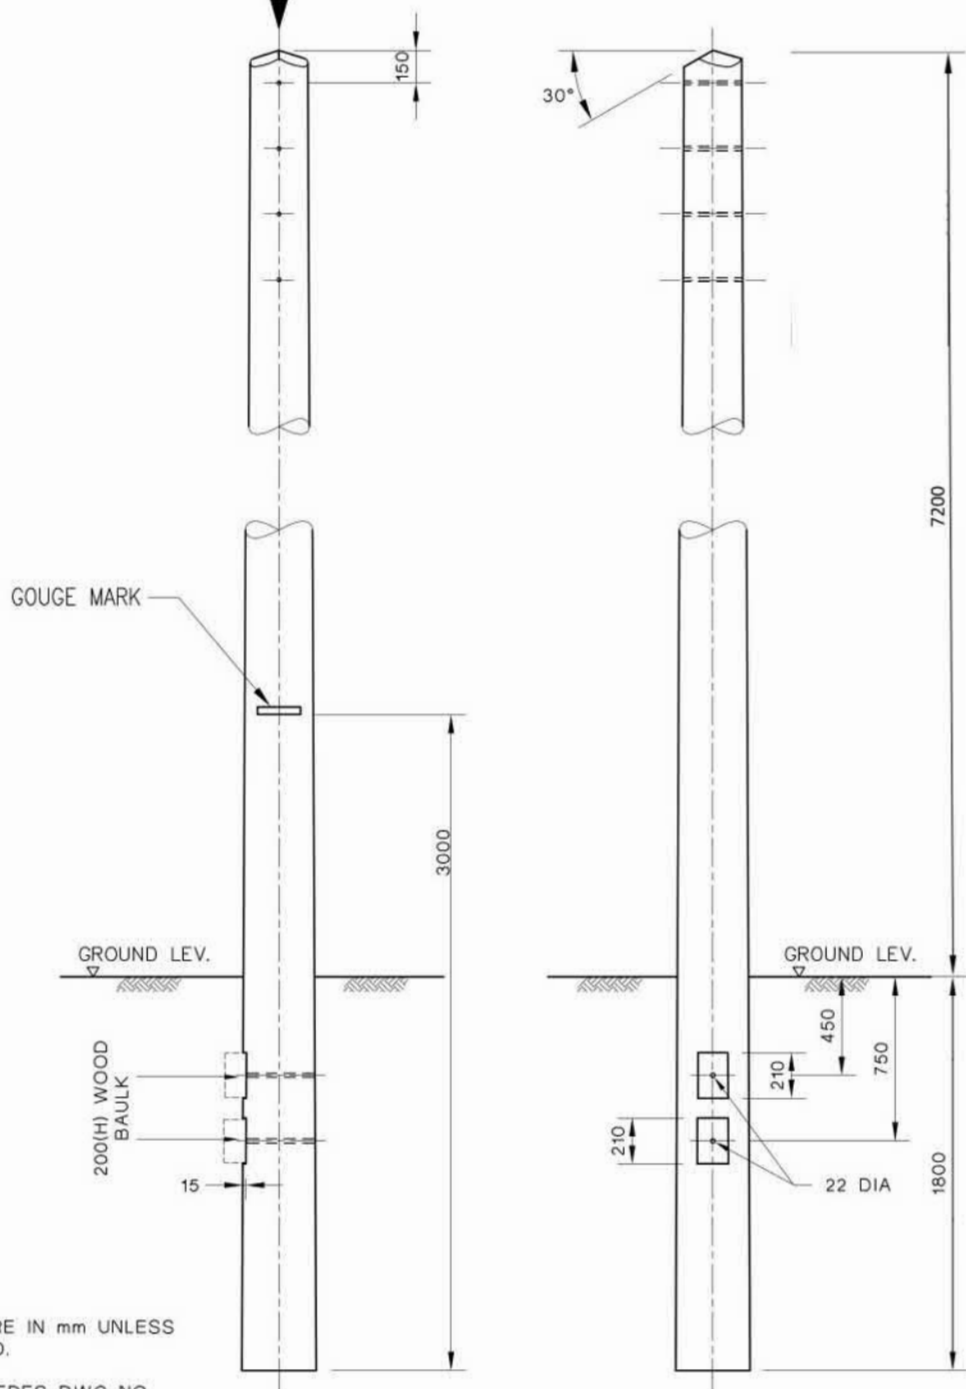

NOTE:
ALL DIMENSIONS ARE IN mm UNLESS
OTHERWISE STATED.

THIS DWG. SUPERSEDES DWG NO.
ESC/G/96-69

G GOUGE MARK UPDATED TO 3m

F ADDITIONAL BAULK, GOUGE MARK
MEASUREMENT INCREASED

CLP 中電

REVS.	28.10.02	28.1.03	8.10.04	30.09.15	05.08.16	13.03.17	01.06.17						
	A	B	C	D	E	F	G	H	J	K	L		
INITIAL	HCCHOW	HCCHOW	F.C.	SKLAU	KLCHAN	KLCHAN	KLCHAN						

TITLE :

LV OHL WOOD POLE

DRAWN: S.C.T.

CHECKED: Y.N.S

APPROVED:

SCALE: N.T.S.

SHEET(S) IN SET: 1

PROJECT NO.

CONTRACT NO.

ASSET MANAGEMENT

DRG. NO. T GEN 5 1 2 2 0 D E 3 3 0 0 2 4 0 1 G A


INFORMATION CLASS: PROPRIETARY

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER


(資料來源：申請人於 23.06.2023 呈交的資料)
(Source : Applicant's Submission of 23.06.2023)

參考編號
REFERENCE No.
A/SK-CWBN/75

繪圖
DRAWING
A-4

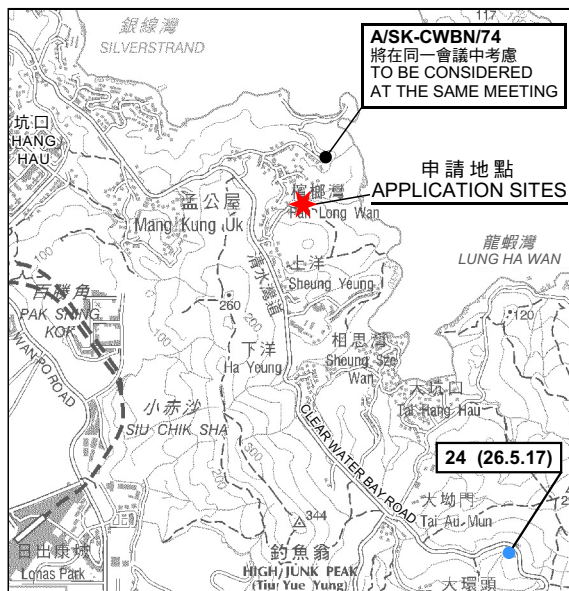

SCALE 1 : 50 000 比例尺

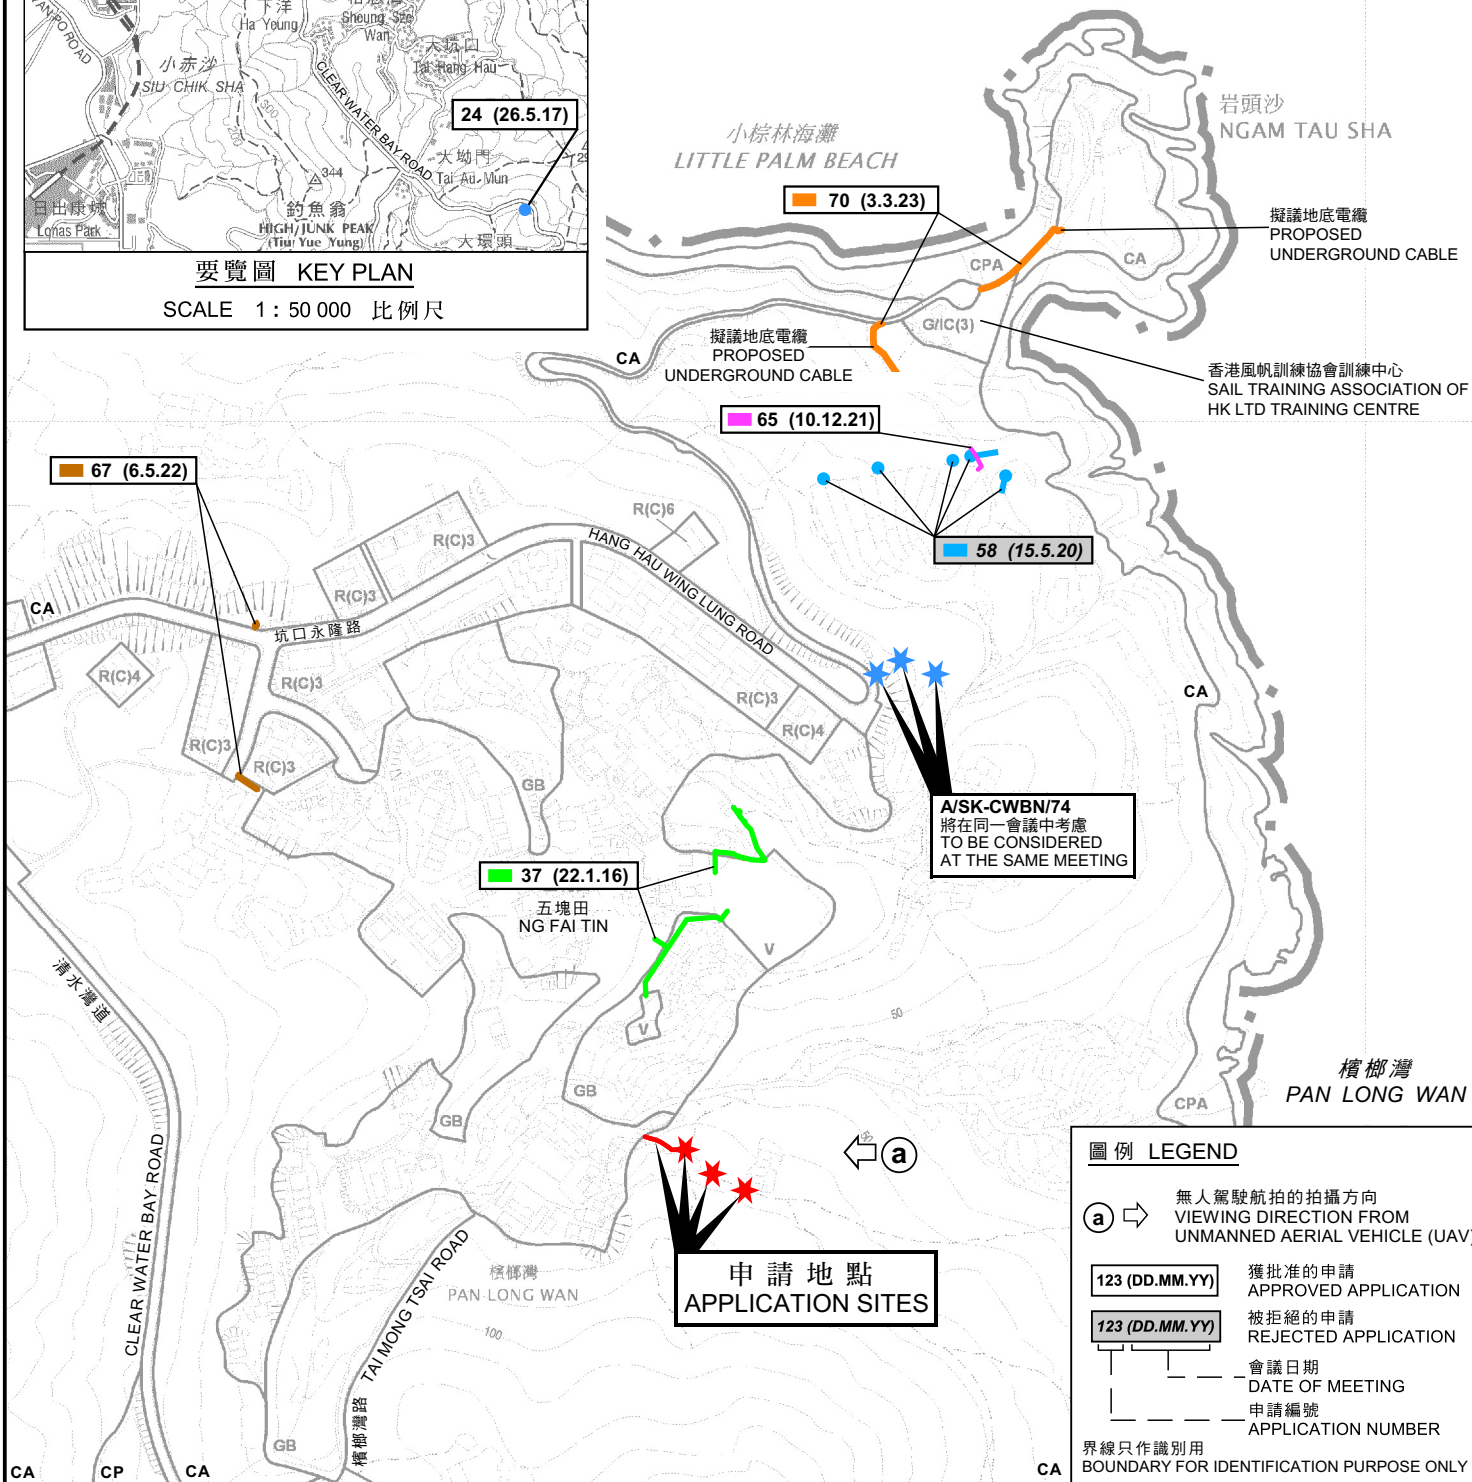

擬議公用事業設施裝置（電線桿和地底電纜）和相關的挖土工程
西貢清水灣櫚椰灣丈量約份第 2 3 8 約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(POLES AND UNDERGROUND CABLE) AND
ASSOCIATED EXCAVATION OF LAND
GOVERNMENT LAND IN D.D. 238,
PAN LONG WAN, CLEAR WATER BAY, SAI KUNG

SCALE 1 : 5 000 比例尺

SCALE 1:5 000 比例尺

100 0 100 200

METRES METRES



PLAN
A-1

本摘要圖於2023年9月26日擬備，
所根據的資料為於2013年12月3日
核准的分區計劃大綱圖編號S/SK-CWBN/6
EXTRACT PLAN PREPARED ON 26.9.2023
BASED ON OUTLINE ZONING PLAN No.
S/SK-CWBN/6 APPROVED ON 3.12.2013



圖例 LEGEND

★ 申請地點
APPLICATION SITES

界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

航攝照片 AERIAL PHOTO

擬議公用事業設施裝置（電線桿和地底電纜）和相關的挖土工程
西貢清水灣檳榔灣丈量約份第238約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(POLES AND UNDERGROUND CABLE) AND
ASSOCIATED EXCAVATION OF LAND
GOVERNMENT LAND IN D.D. 238,
PAN LONG WAN, CLEAR WATER BAY, SAI KUNG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-CWBN/75

圖 PLAN
A-3

本摘要圖於2023年9月26日擬備，所根據的資料為地政總署於2022年4月10日拍得的航攝照片編號 E164085C
EXTRACT PLAN PREPARED ON 26.9.2023
BASED ON AERIAL PHOTO No.
E164085C TAKEN ON 10.4.2022
BY LANDS DEPARTMENT

1



2



界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTOS

本圖於2023年9月29日擬備，所根據的資料為攝於2023年6月30日及2023年7月26日的實地照片
PLAN PREPARED ON 29.9.2023
BASED ON SITE PHOTOS
TAKEN ON 30.6.2023 & 26.7.2023

擬議公用事業設施裝置（電線桿和地底電纜）和相關的挖土工程
西貢清水灣檳榔灣丈量約份第238約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(POLES AND UNDERGROUND CABLE) AND
ASSOCIATED EXCAVATION OF LAND
GOVERNMENT LAND IN D.D. 238,
PAN LONG WAN, CLEAR WATER BAY, SAI KUNG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-CWBN/75

圖 PLAN
A-4a

3



a



界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTOS

擬議公用事業設施裝置（電線桿和地底電纜）和相關的挖土工程
西貢清水灣檳榔灣丈量約份第238約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(POLES AND UNDERGROUND CABLE) AND
ASSOCIATED EXCAVATION OF LAND
GOVERNMENT LAND IN D.D. 238,
PAN LONG WAN, CLEAR WATER BAY, SAI KUNG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SK-CWBN/75

圖 PLAN
A-4b

本圖於2023年10月6日擬備，所根據的資料為攝於2023年7月26日的實地照片及無人駕駛航拍照片
PLAN PREPARED ON 6.10.2023
BASED ON SITE PHOTO &
UNMANNED AERIAL VEHICLE (UAV)
PHOTO TAKEN ON 26.7.2023