


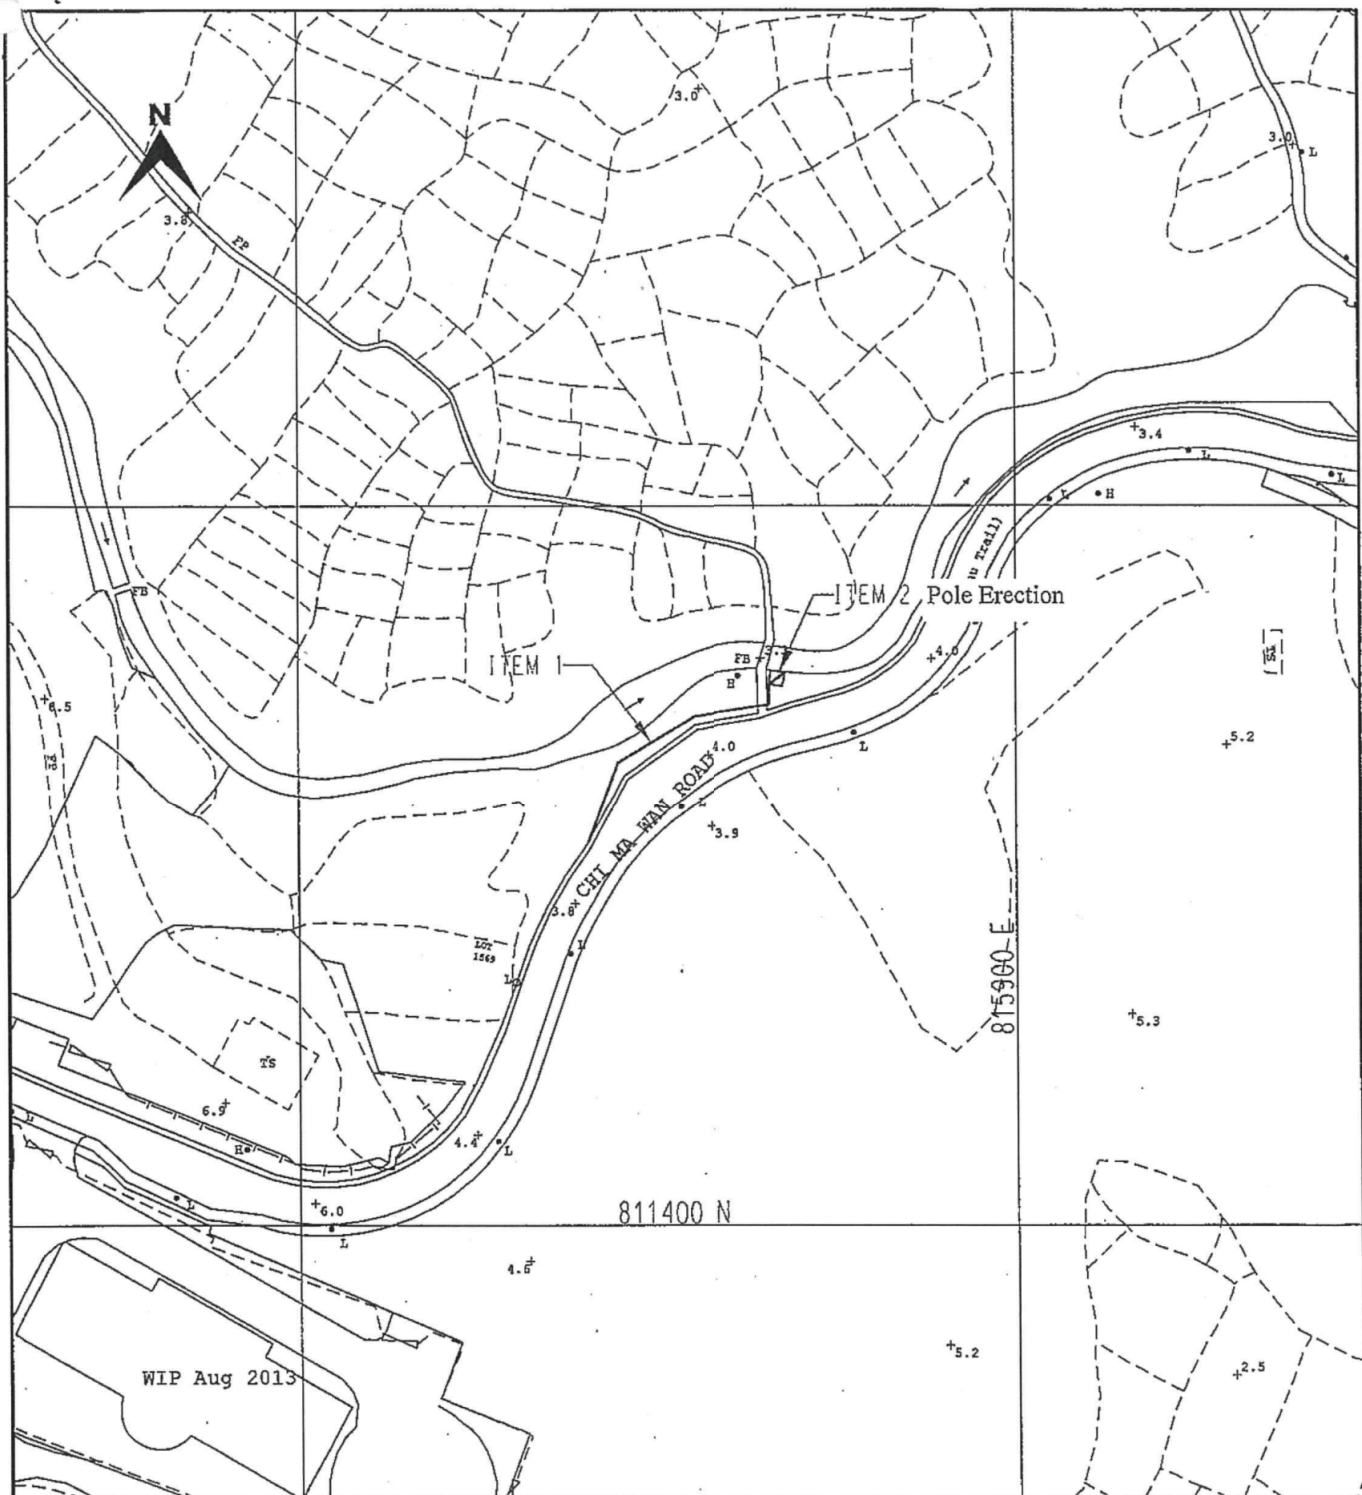

CLP 中電

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX
- EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- EXISTING POLE MOUNTED TRANSFORMER
- PROPOSED POLE MOUNTED TRANSFORMER
- PROPOSED STAY / STAY POLE
- PROPOSED 5.0M(L) x 2.39M(W) x 3.0M(H) PACKAGE SUBSTATION

TITLE : LV CABLE LAYING AND POLE ERECTION AT
GOVERNMENT LAND DD 316, LANTAU,
HAM TIN SAN TSUEN, PUI O, LANTAU ISLAND

MAP NO : 14NW01D, 14NW01B

DRAWN : KF CHEN

E/O NO :

CHECKED : PC NG

REGION : WE

O.C. : LT

DATE : 07-02-2018

PROJECT REF. : LT2018-0090

SCALE : 1:1000


PLAN REF. : WELT2018-0090-01

Map data reproduced with permission of the Director of Lands, (C) Hong Kong


(來源：申請人於2021年4月13日提交)
(SOURCE : SUBMITTED BY APPLICANT ON 13.4.2021)

參考編號
REFERENCE No.
A/SLC/169

繪圖
DRAWING
A-1

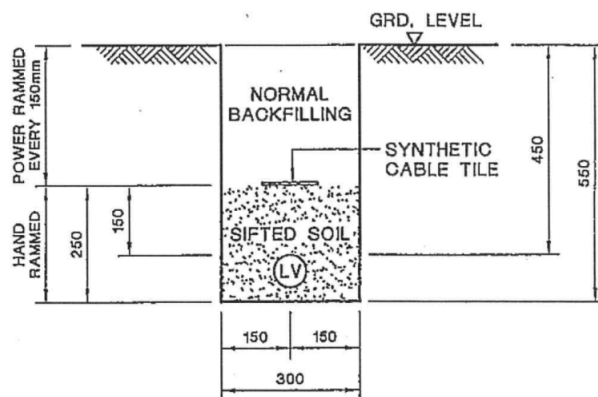

TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

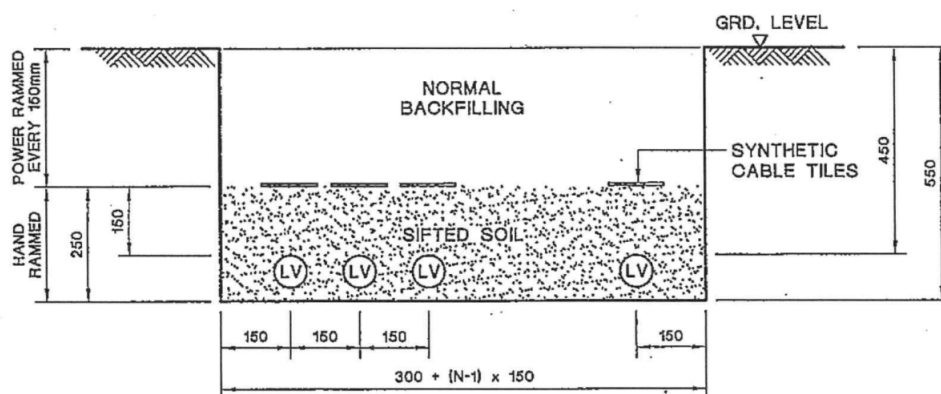

TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES

LEGEND :

- (LV) LV CABLE
N NUMBER OF CABLE CIRCUITS

NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm.

C GENERAL REVISION

B GENERAL REVISION

A SYNTHETIC CABLE TILE SPECIFIED

CLP 中電

REVS.	15-2-04	18-6-07	28-6-07										
INITIAL	A	B	O	D	E	F	G	H	J	K	L		

TITLE :

TYPICAL LV CABLE TRENCH

DRAWN: S.G.T. DATE: 15 Aug., 2003
CHECKED: K. K. LEUNG APPROVED: W. B. LEE

SCALE: 1:10 SHEET(S) IN SET: 1

PROJECT NO.

CONTRACT NO.

ASSET MANAGEMENT

DRG. NO. T GEN 25500 DE 33 0002 01 C A

ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

(來源：申請人於2021年4月13日提交)
(SOURCE : SUBMITTED BY APPLICANT ON 13.4.2021)


參考編號
REFERENCE No.
A/SLC/169

繪圖
DRAWING
A-2

電綫桿


現時使用的低壓木桿標準尺寸：

長度	9 米
桿頂的最小允許直徑	165 毫米
桿頂的最大允許直徑	210 毫米
距離桿底 1.5 米的最小允許直徑	250 毫米

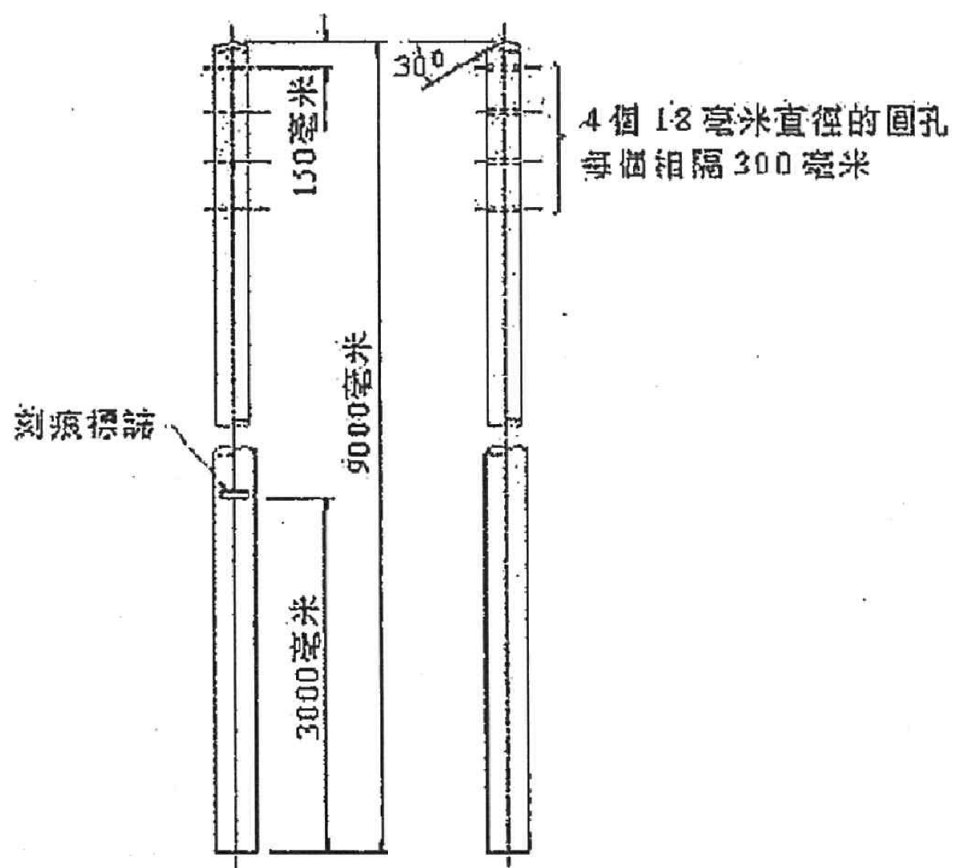

9 米長的低壓木杆

Tree Location Plan

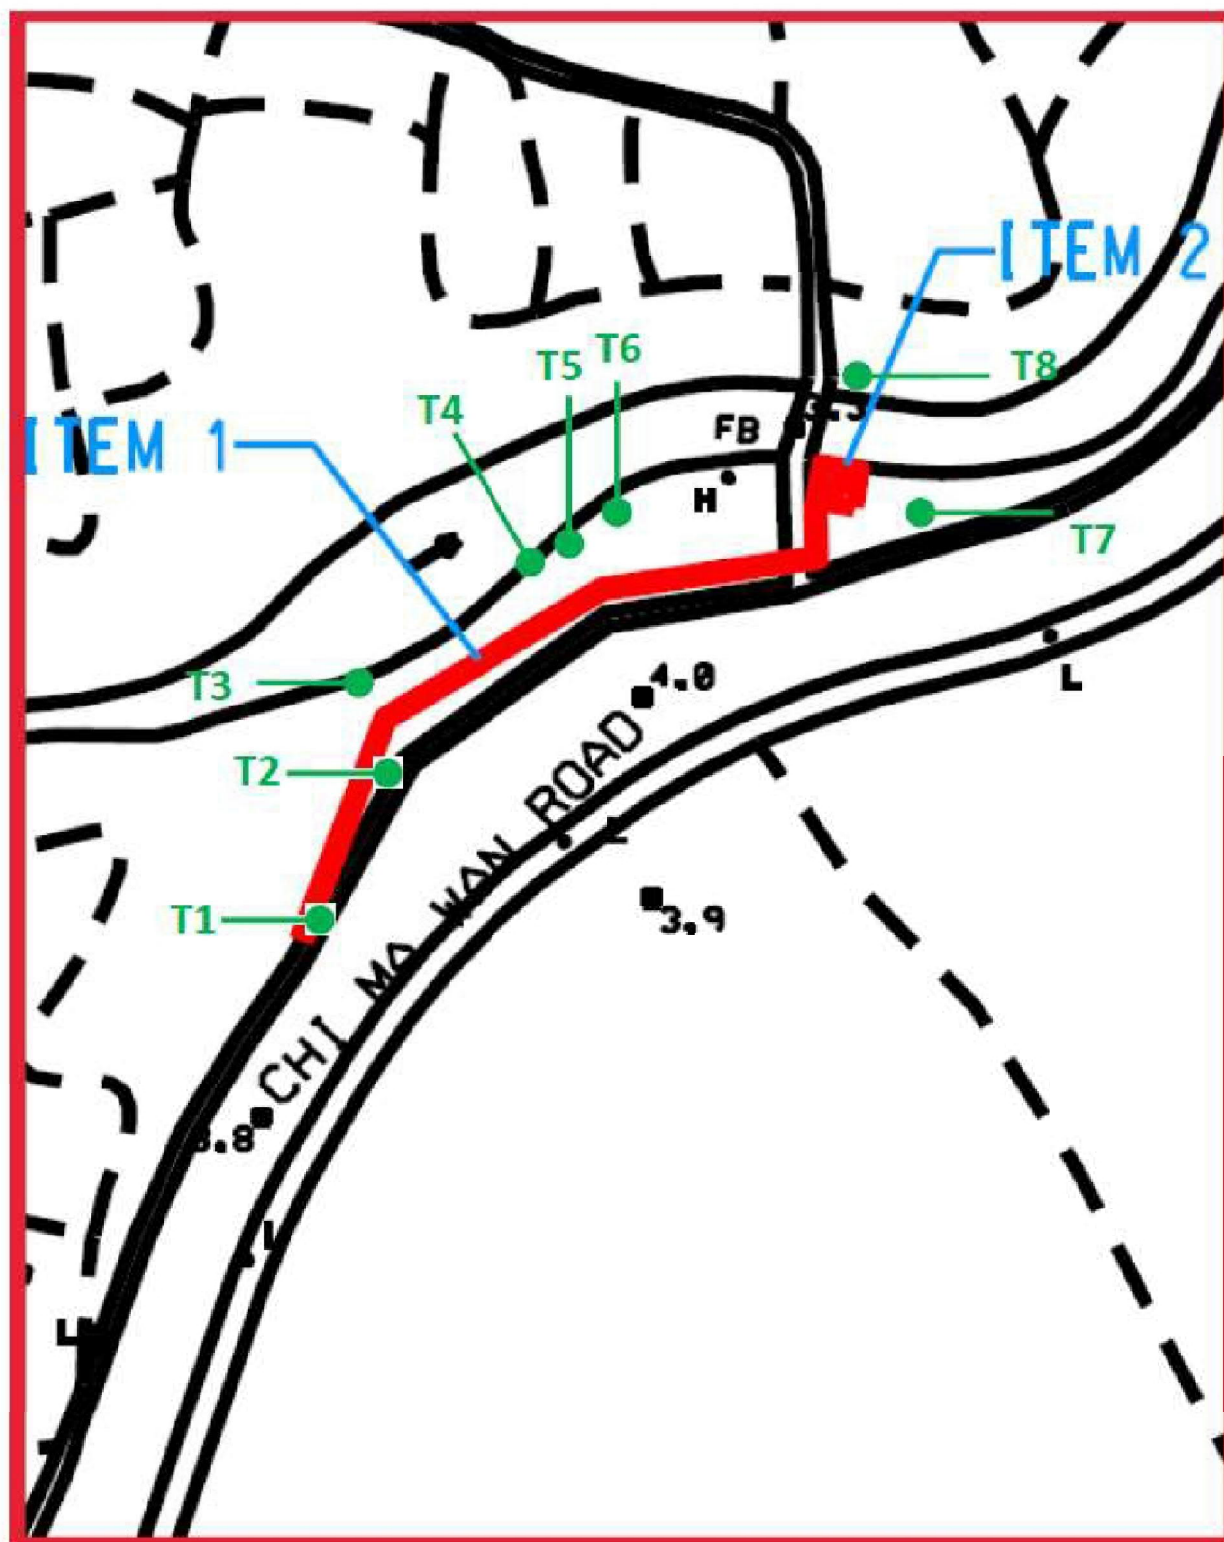


Project Title: LV Cable laying & Pole erection at Ham Tin San Tsuen, Lot 1409 Pui O, Lantau.

Location of tree ●

(來源：申請人於2021年4月13日提交)
(SOURCE : SUBMITTED BY APPLICANT ON 13.4.2021)

參考編號
REFERENCE No.
A/SLC/169

繪圖
DRAWING
A-4

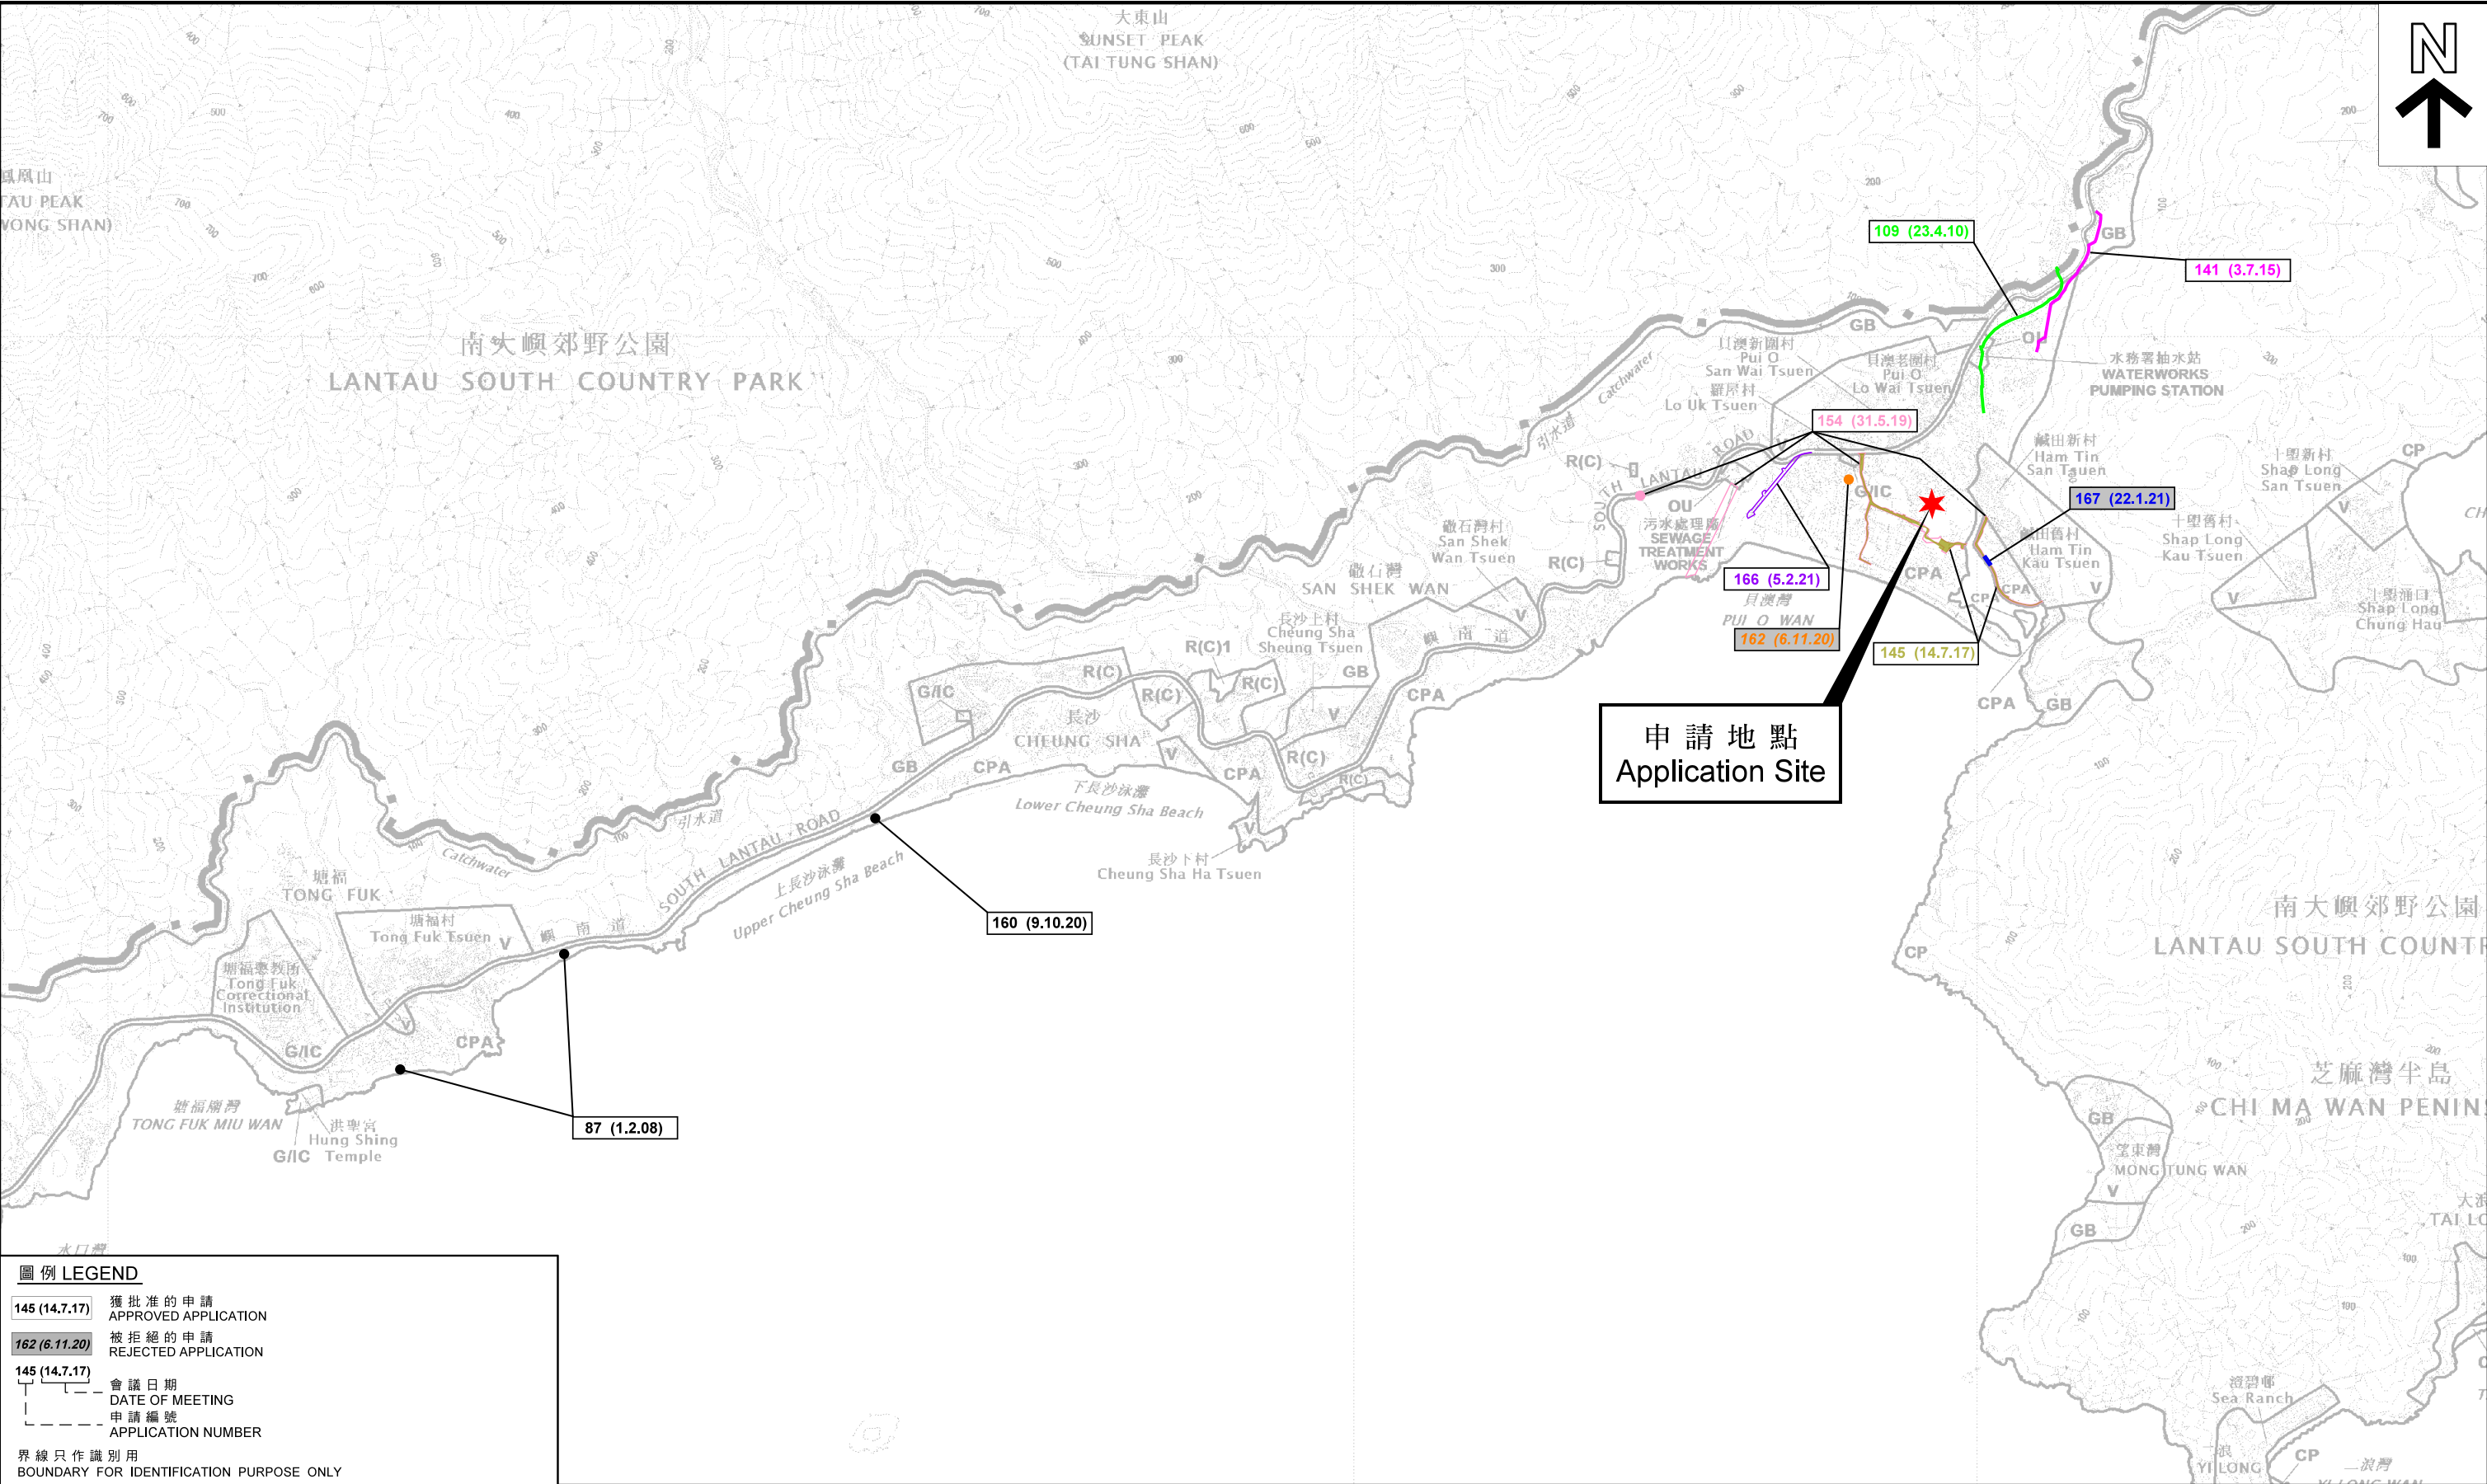

圖例 LEGEND

145 (14.7.17)	獲批准的申請 APPROVED APPLICATION
162 (6.11.20)	被拒絕的申請 REJECTED APPLICATION
145 (14.7.17)	會議日期 DATE OF MEETING
---	申請編號 APPLICATION NUMBER

界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

本摘要圖於2021年5月25日擬備，
所根據的資料為於2018年1月9日
核准的分區計劃大綱圖編號S/SLC/21
EXTRACT PLAN PREPARED ON 25.5.2021
BASED ON OUTLINE ZONING PLAN No.
S/SLC/21 APPROVED ON 9.1.2018

位置圖 LOCATION PLAN

擬議公用事業設施裝置（地底電纜和電線桿）和挖土及填土工程
大嶼山丈量約份第316L約芝麻灣道近鹹田新村的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(UNDERGROUND POWER CABLE AND POLE)
AND EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 316L,
CHI MA WAN ROAD NEAR HAM TIN SAN TSUEN, LANTAU
SCALE 1 : 20 000 比例尺

米
METRES

200 0 200 400 600 800 1 000 1 200 1 400 1 600 1 800 2 000

米
METRES


規劃署
PLANNING DEPARTMENT



參考編號
REFERENCE No.
A/SLC/169

圖 PLAN
A-1

(1) 2021年5月26日勘测的土地用途
Land uses shown on this plan are in accordance with land use survey conducted by the Planning Department on 26.5.2021

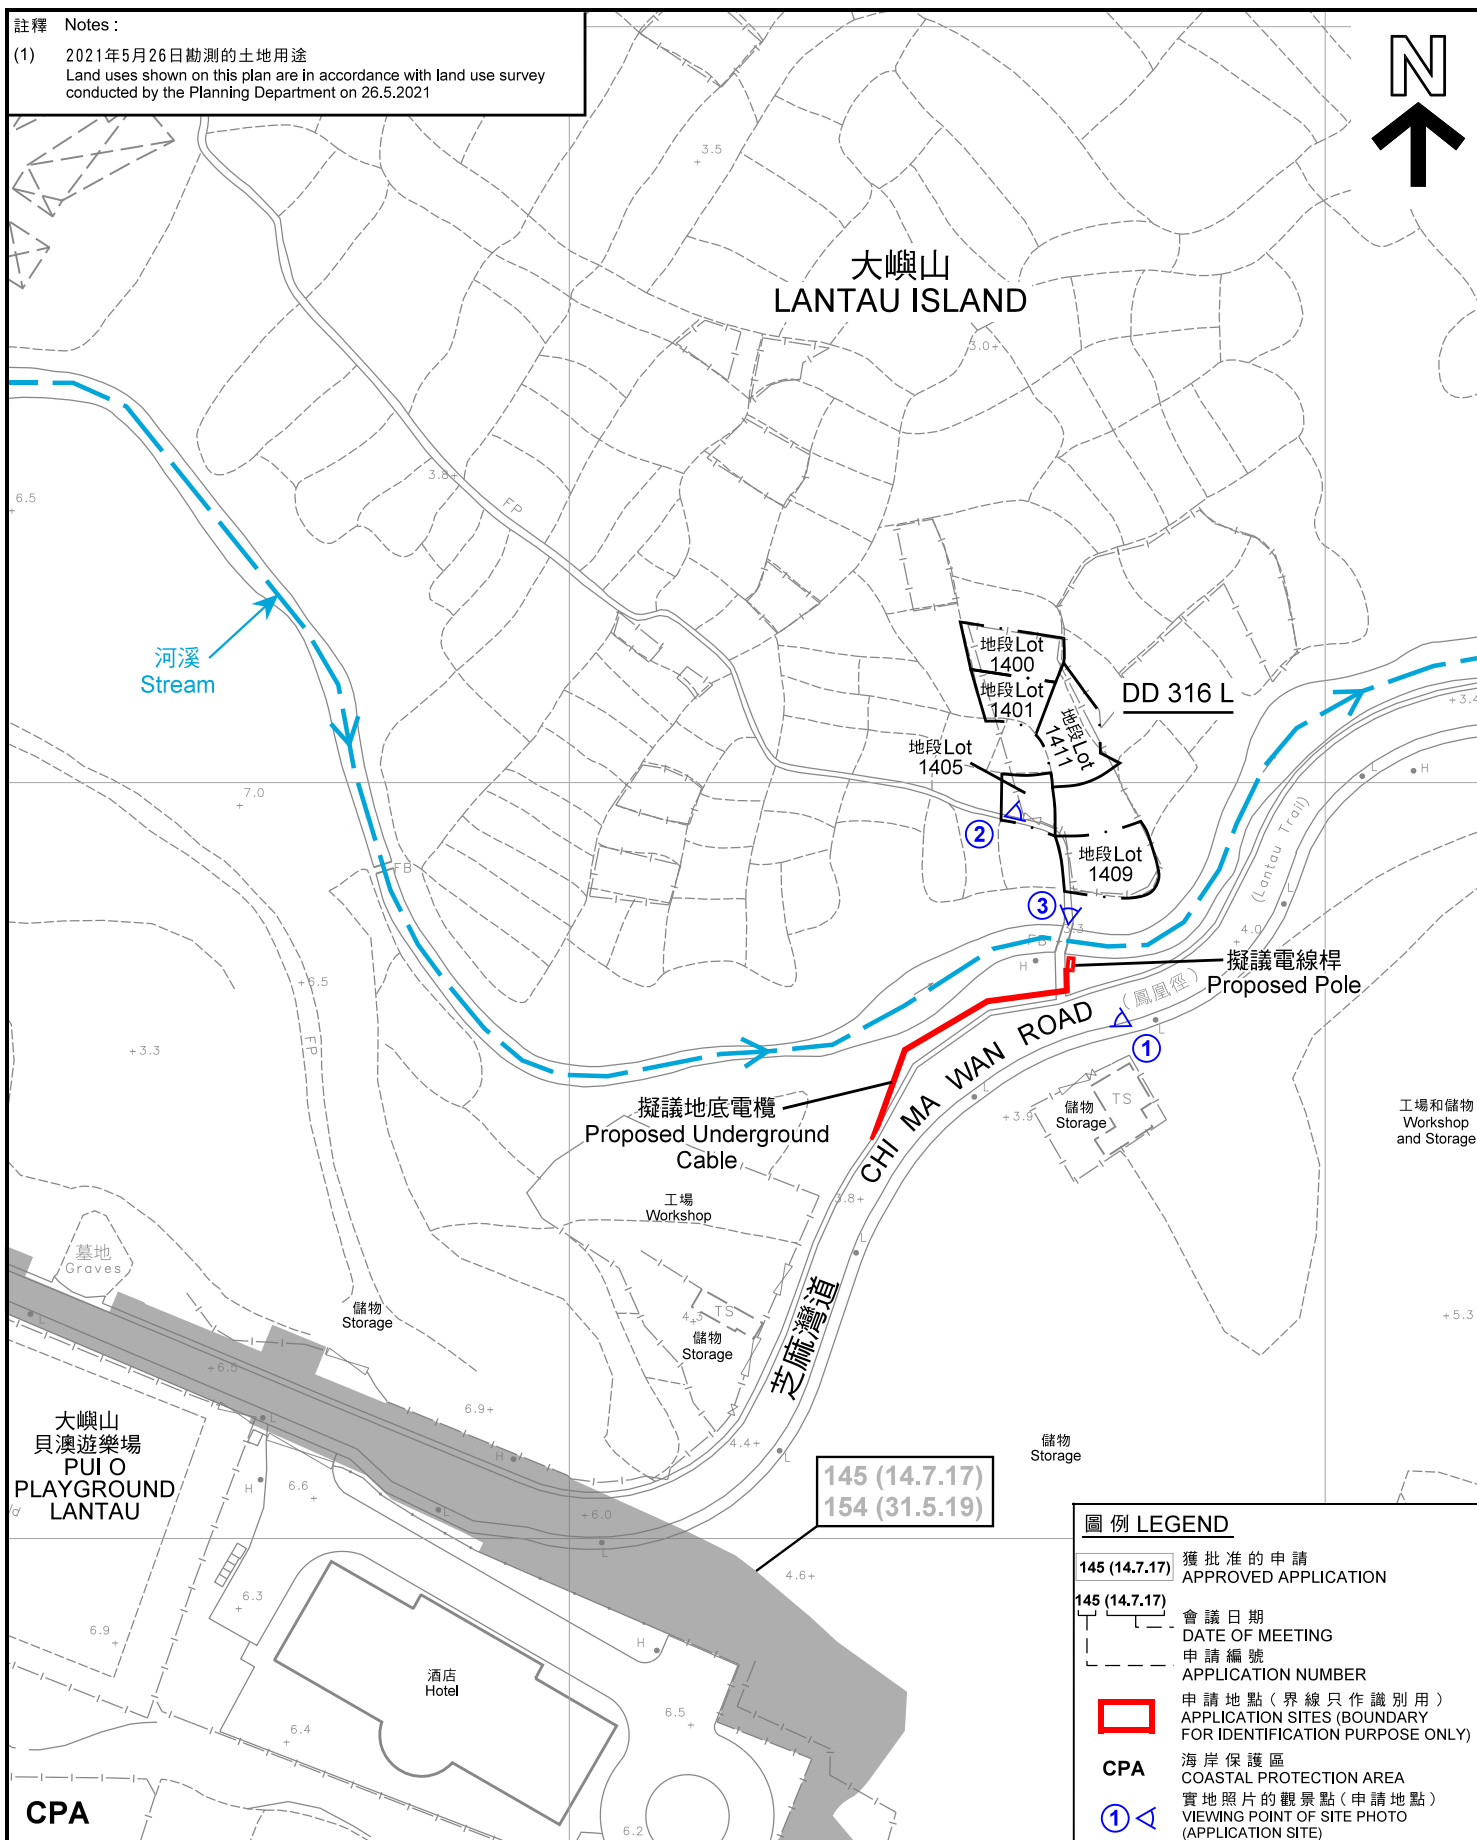

擬議公用事業設施裝置(地底電纜和電線桿)和挖土及填土工程
大嶼山丈量約份第3 1 6 L約芝麻灣道近鹹田新村的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(UNDERGROUND POWER CABLE AND POLE)
AND EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 316L,
CHI MA WAN ROAD NEAR HAM TIN SAN TSUEN, LANTAU

EXTRACT PLAN PREPARED ON 4.6.2021
BASED ON SURVEY SHEETS No.
14-NW-1A, 1B, 1C AND 1D

SCALE 1 : 1 000 比例尺

SCALE 1:1000 比例尺

米 20 0 20 40 米
METRES METRES

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SLC/169

PLAN
A-2



大嶼山
LANTAU ISLAND

DD 316 L

地段Lot
1400

地段Lot
1401

地段Lot
1401

地段Lot
1405

地段Lot
1409

CHI MA WAN ROAD

芝麻灣道

大嶼山
貝澳遊樂場
PUJO
PLAYGROUND
LANTAU

圖例 LEGEND



申請地點(界線只作識別用)
APPLICATION SITES (BOUNDARY
FOR IDENTIFICATION PURPOSE ONLY)

本摘要圖於2021年6月4日擬備，
所根據的資料為地政總署於2020年7月29日
拍得的航攝照片編號E102943C

EXTRACT PLAN PREPARED ON 4.6.2021
BASED ON AERIAL PHOTO No. E102943C
TAKEN ON 29.7.2020
BY LANDS DEPARTMENT

航攝照片 AERIAL PHOTO



擬議公用事業設施裝置(地底電纜和電線桿)和挖土及填土工程
大嶼山丈量約份第316L約芝麻灣道近鹹田新村的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(UNDERGROUND POWER CABLE AND POLE)
AND EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 316L,
CHI MA WAN ROAD NEAR HAM TIN SAN TSUEN, LANTAU

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SLC/169

圖 PLAN
A-3

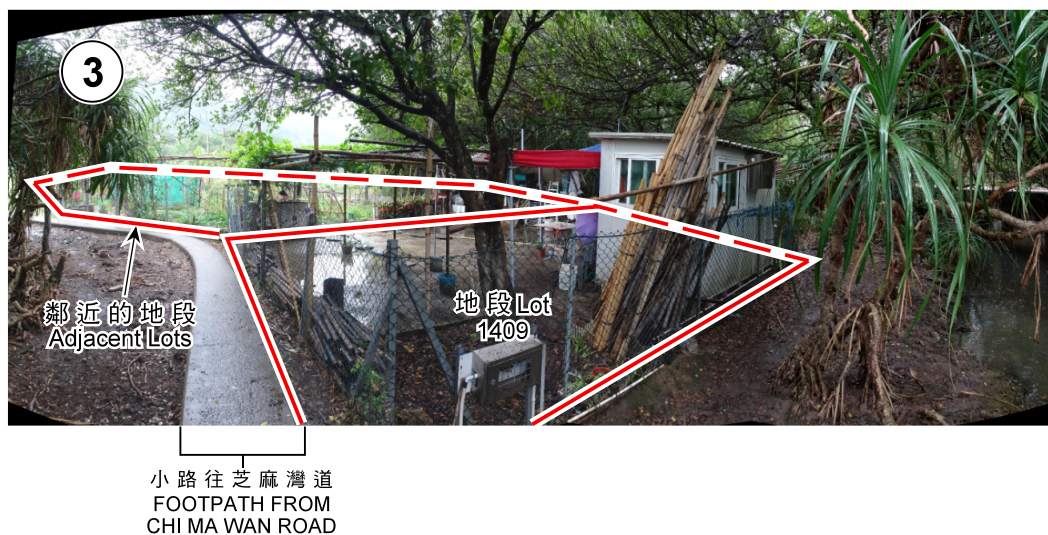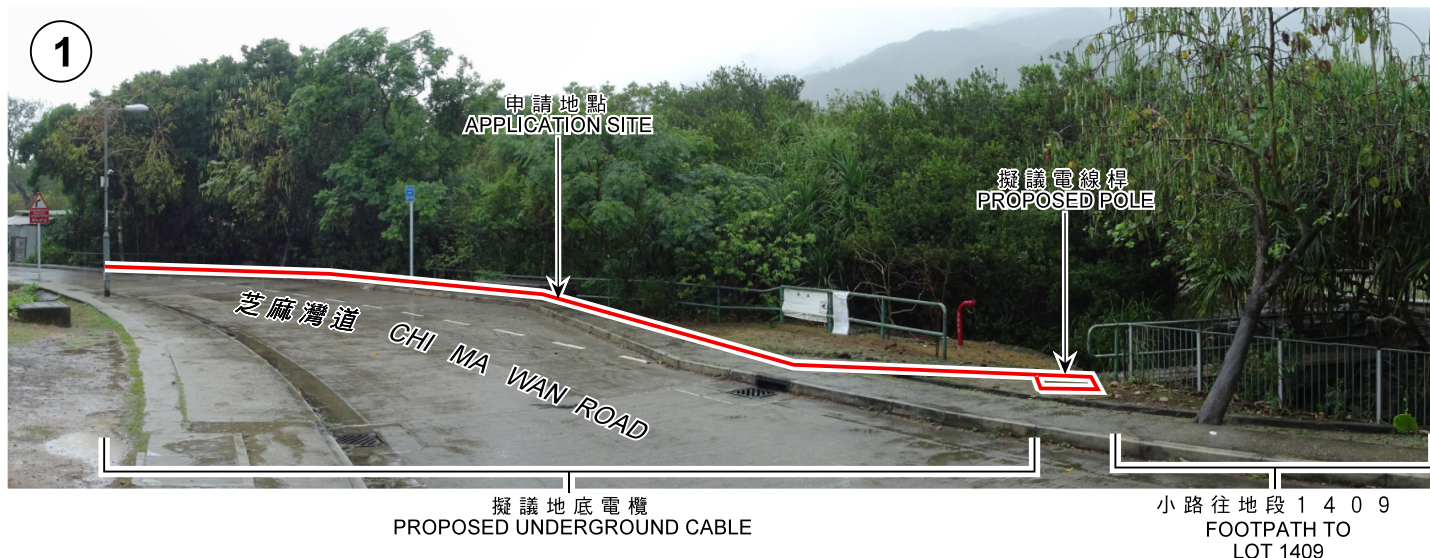

界線只作識別用
BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTOS

本摘要圖於2021年6月2日擬備，
所根據的資料為攝於
2021年4月27日的實地照片
PLAN PREPARED ON 2.6.2021
BASED ON SITE PHOTOS
TAKEN ON 27.4.2021

擬議公用事業設施裝置(地底電纜和電線桿)和挖土及填土工程
大嶼山丈量約份第 3 1 6 L 約芝麻灣道近鹹田新村的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(UNDERGROUND POWER CABLE AND POLE)
AND EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 316L,
CHI MA WAN ROAD NEAR HAM TIN SAN TSUEN, LANTAU

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/SLC/169

圖 PLAN
A-4