


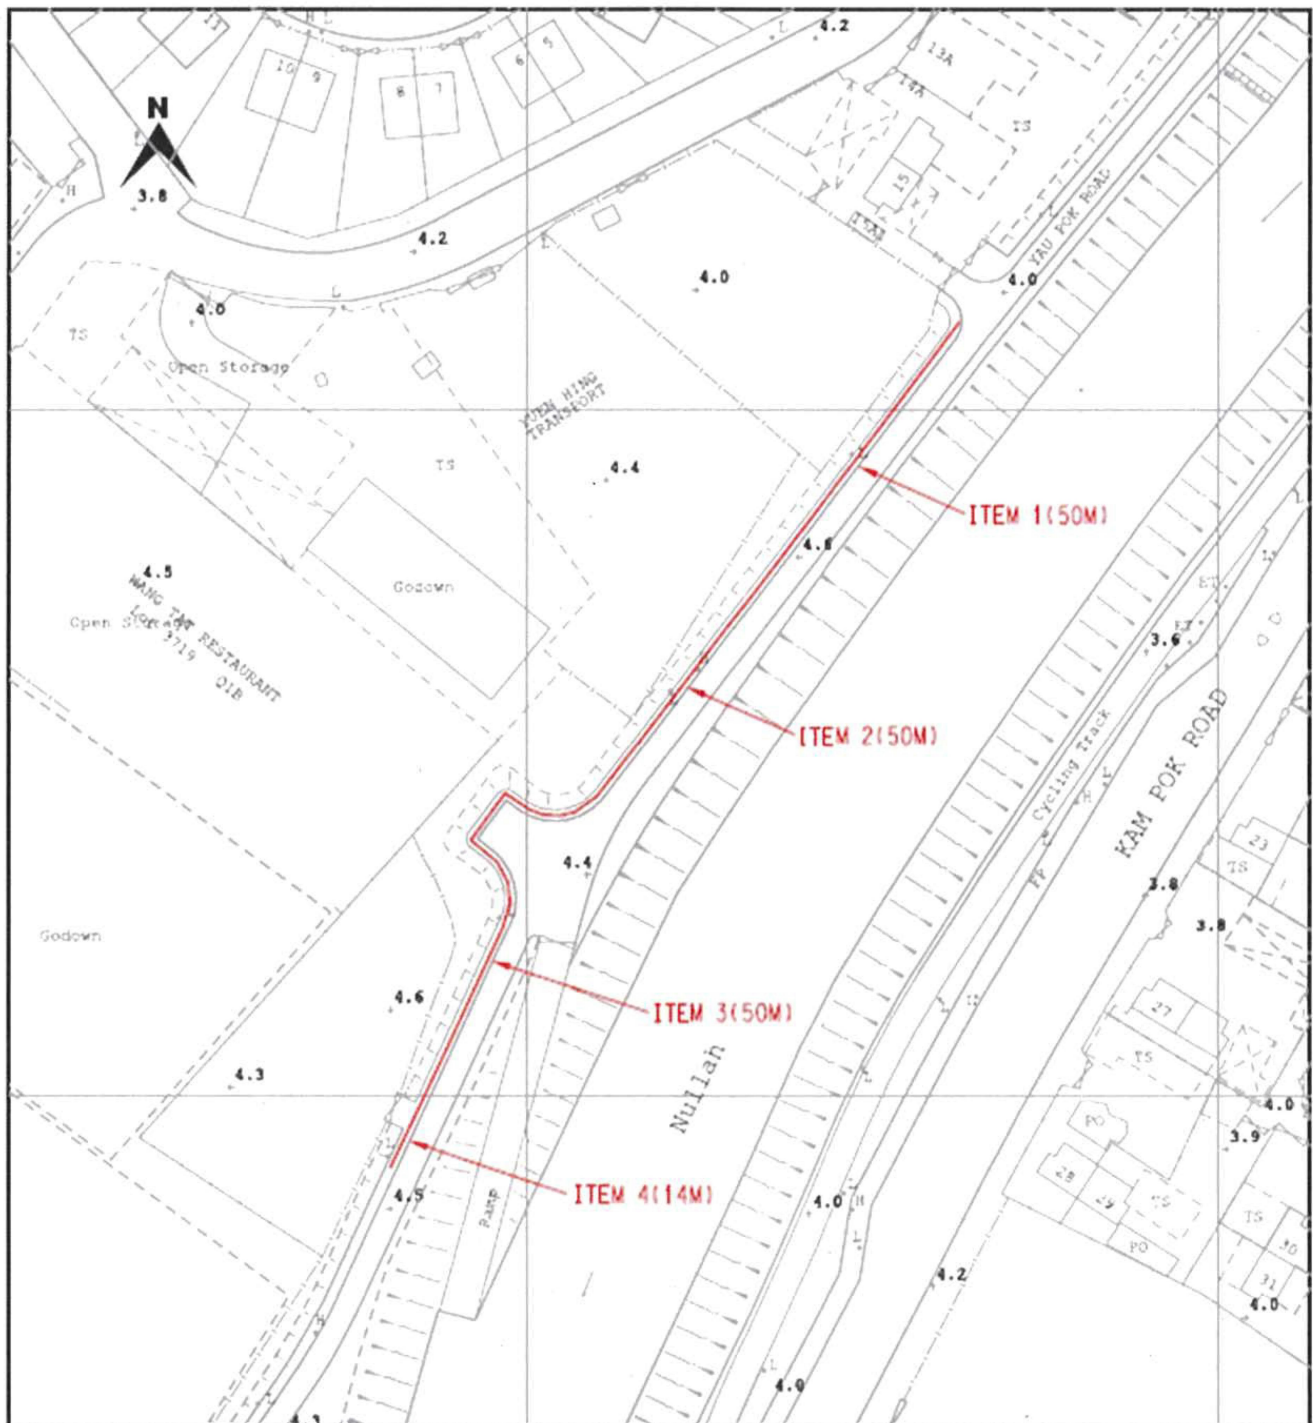

CLP 中電

TITLE : LV Cable Laying
At Yau Pok Road

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOUT BOX
- EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- EXISTING POLE MOUNTED TRANSFORMER
- PROPOSED POLE MOUNTED TRANSFORMER
- PROPOSED STAY / STAY POLE
- PROPOSED 3.6M(L) x 3.32M(W) x 2.7M(H) HV PILLAR

MAP NO : 02SE21A

DRAWN : BENSON

E/O NO :

CHECKED : S.W.TAM

REGION : NR

O.C. : YL

DATE : 24-11-2023

PROJECT REF. : YL2023-0665

SCALE : 1:1000

PLAN REF. : NRYL2023-0665-01


Map data reproduced with permission of the Director of Lands. © Hong Kong Information Classification: PROPRIETARY

Location Plan

(摘錄自申請人於 15.1.2024 呈交的申請書)
(Extract from Applicant's
Submission of 15.1.2024)

參考編號
REFERENCE No.
A/YL-NSW/322

繪圖
DRAWING
A - 1

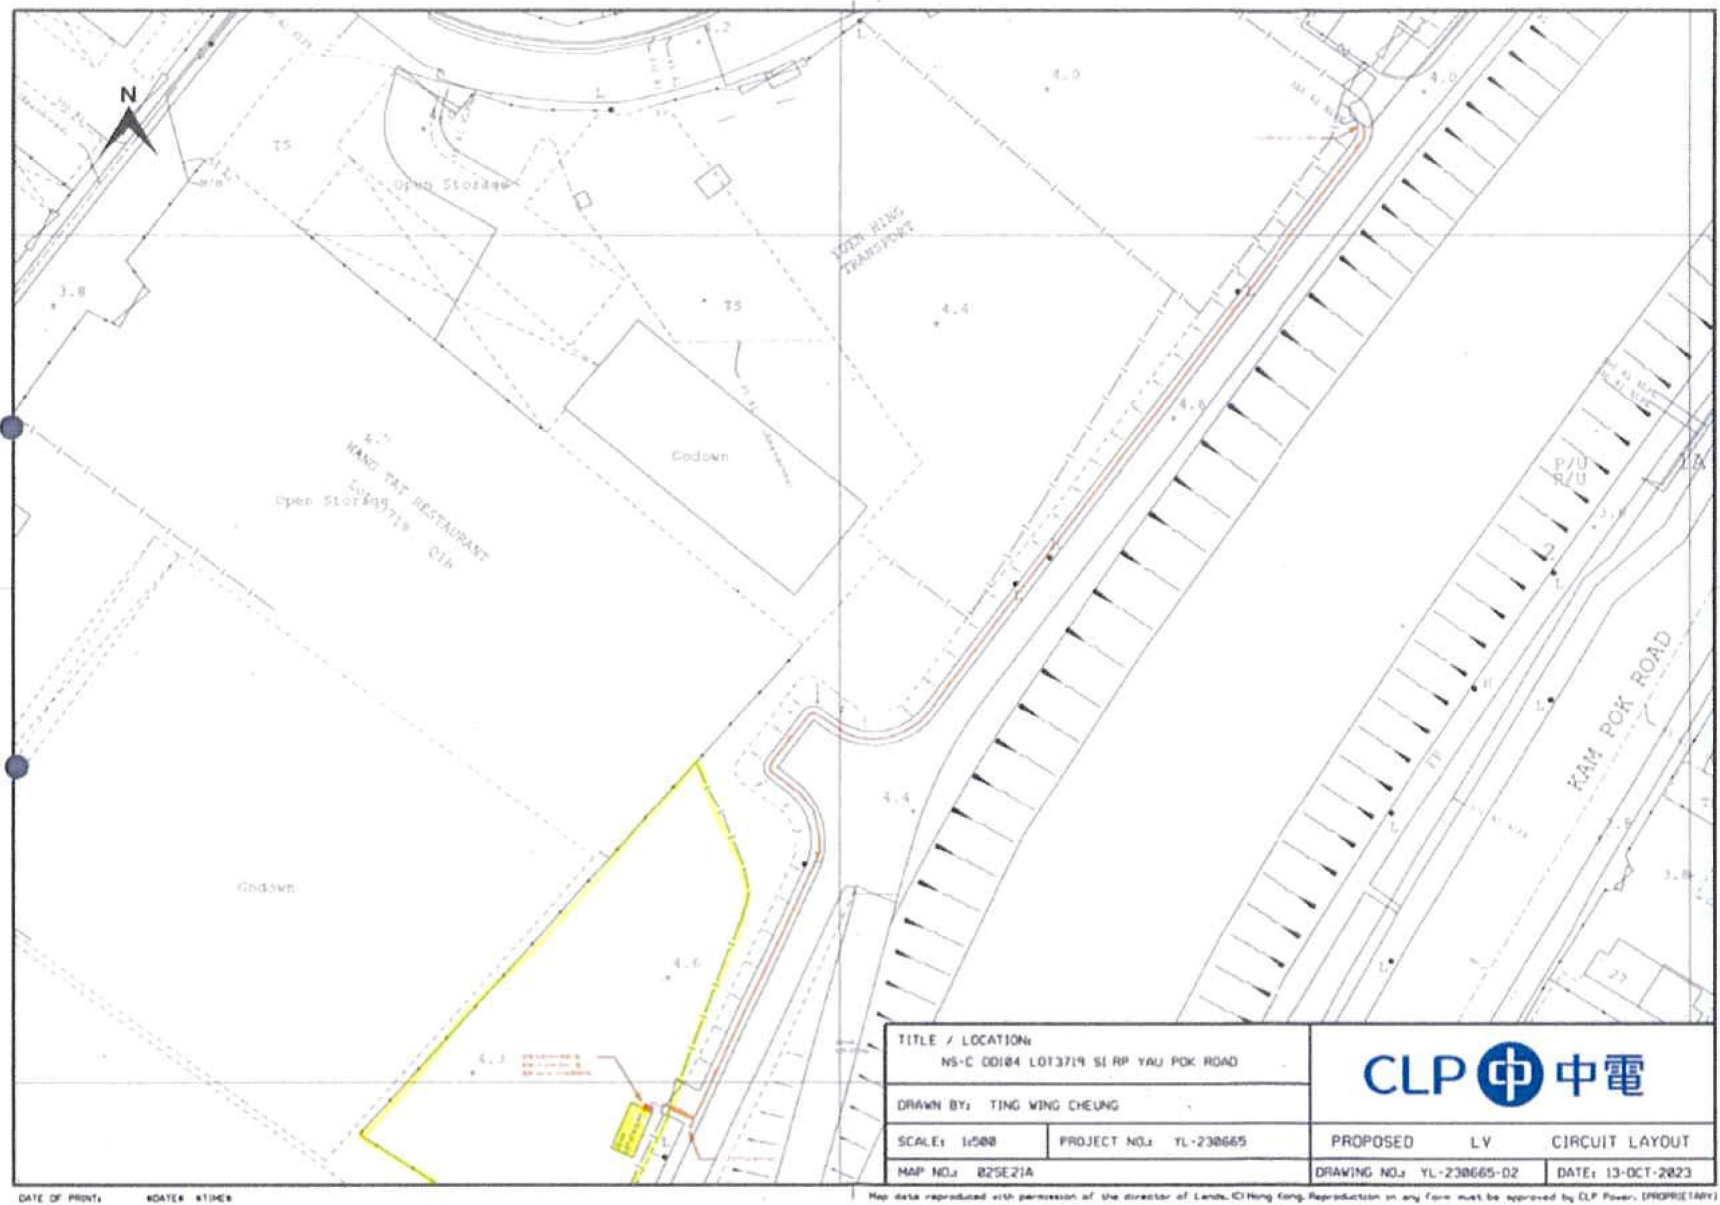


Layout Plan


(摘錄自申請人於 15.1.2024 呈交的申請書)
(Extract from Applicant's
Submission of 15.1.2024)

參考編號
REFERENCE No.
A/YL-NSW/322

繪圖
DRAWING
A - 2

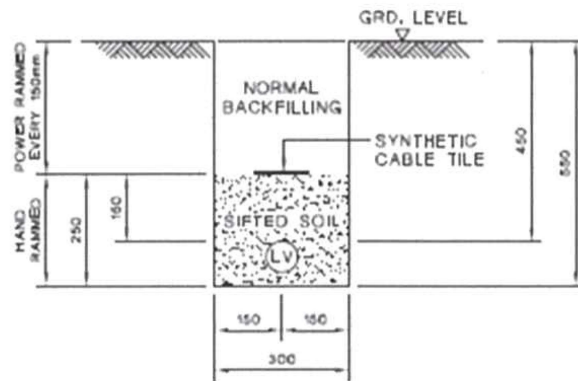

TYPICAL CABLE TRENCH FOR SINGLE LV CABLE

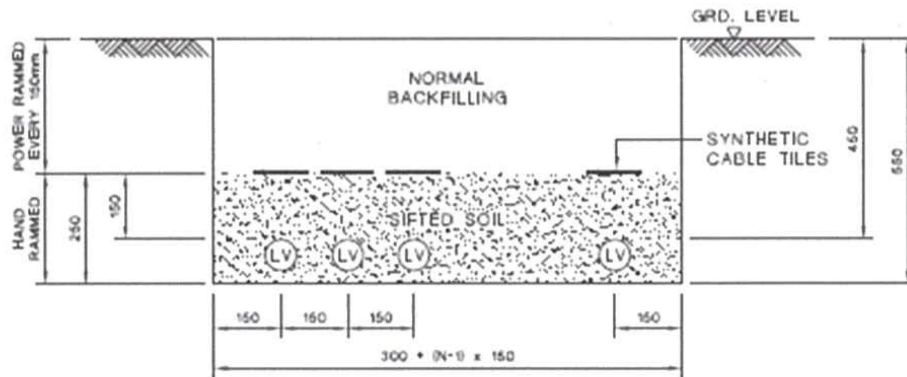

TYPICAL CABLE TRENCH FOR MULTIPLE LV CABLES

LEGEND :

- (LV) LV CABLE
N NUMBER OF CABLE CIRCUITS

NOTES:

- ALL SOIL BACKFILLING BENEATH CABLE TILES SHALL BE SIFTED THROUGH 12mm WIRE MESH.
- ALL DIMENSIONS ARE IN mm.

C GENERAL REVISION		B GENERAL REVISION		A SYNTHETIC CABLE TILE SPECIFIED											
CLP 中電 DRAWN: S.C.T. DATE: 15 Aug. 2003 CHECKED: K. K. LEUNG APPROVED: W. B. LEE SCALE: 1:10 SHEET(S) IN SET: 1		REVS.	15-2-04	15-6-07	28-6-07										
		INITIAL	C.Y.P.	W.B.LEE	Y.K.MAN										
		TITLE :													
		TYPICAL LV CABLE TRENCH													
PROJECT NO.		CONTRACT NO.													
ASSET MANAGEMENT		DRG. NO. T GEN 25500 D E33 0002 01 C A													


ALL RIGHTS RESERVED AND REPRODUCTION IN ANY FORM MUST BE APPROVED BY CLP POWER

Typical LV Cable Trench

(摘錄自申請人於 15.1.2024 呈交的申請書)
(Extract from Applicant's
Submission of 15.1.2024)

參考編號
REFERENCE No.
A/YL-NSW/322

繪圖
DRAWING
A - 3

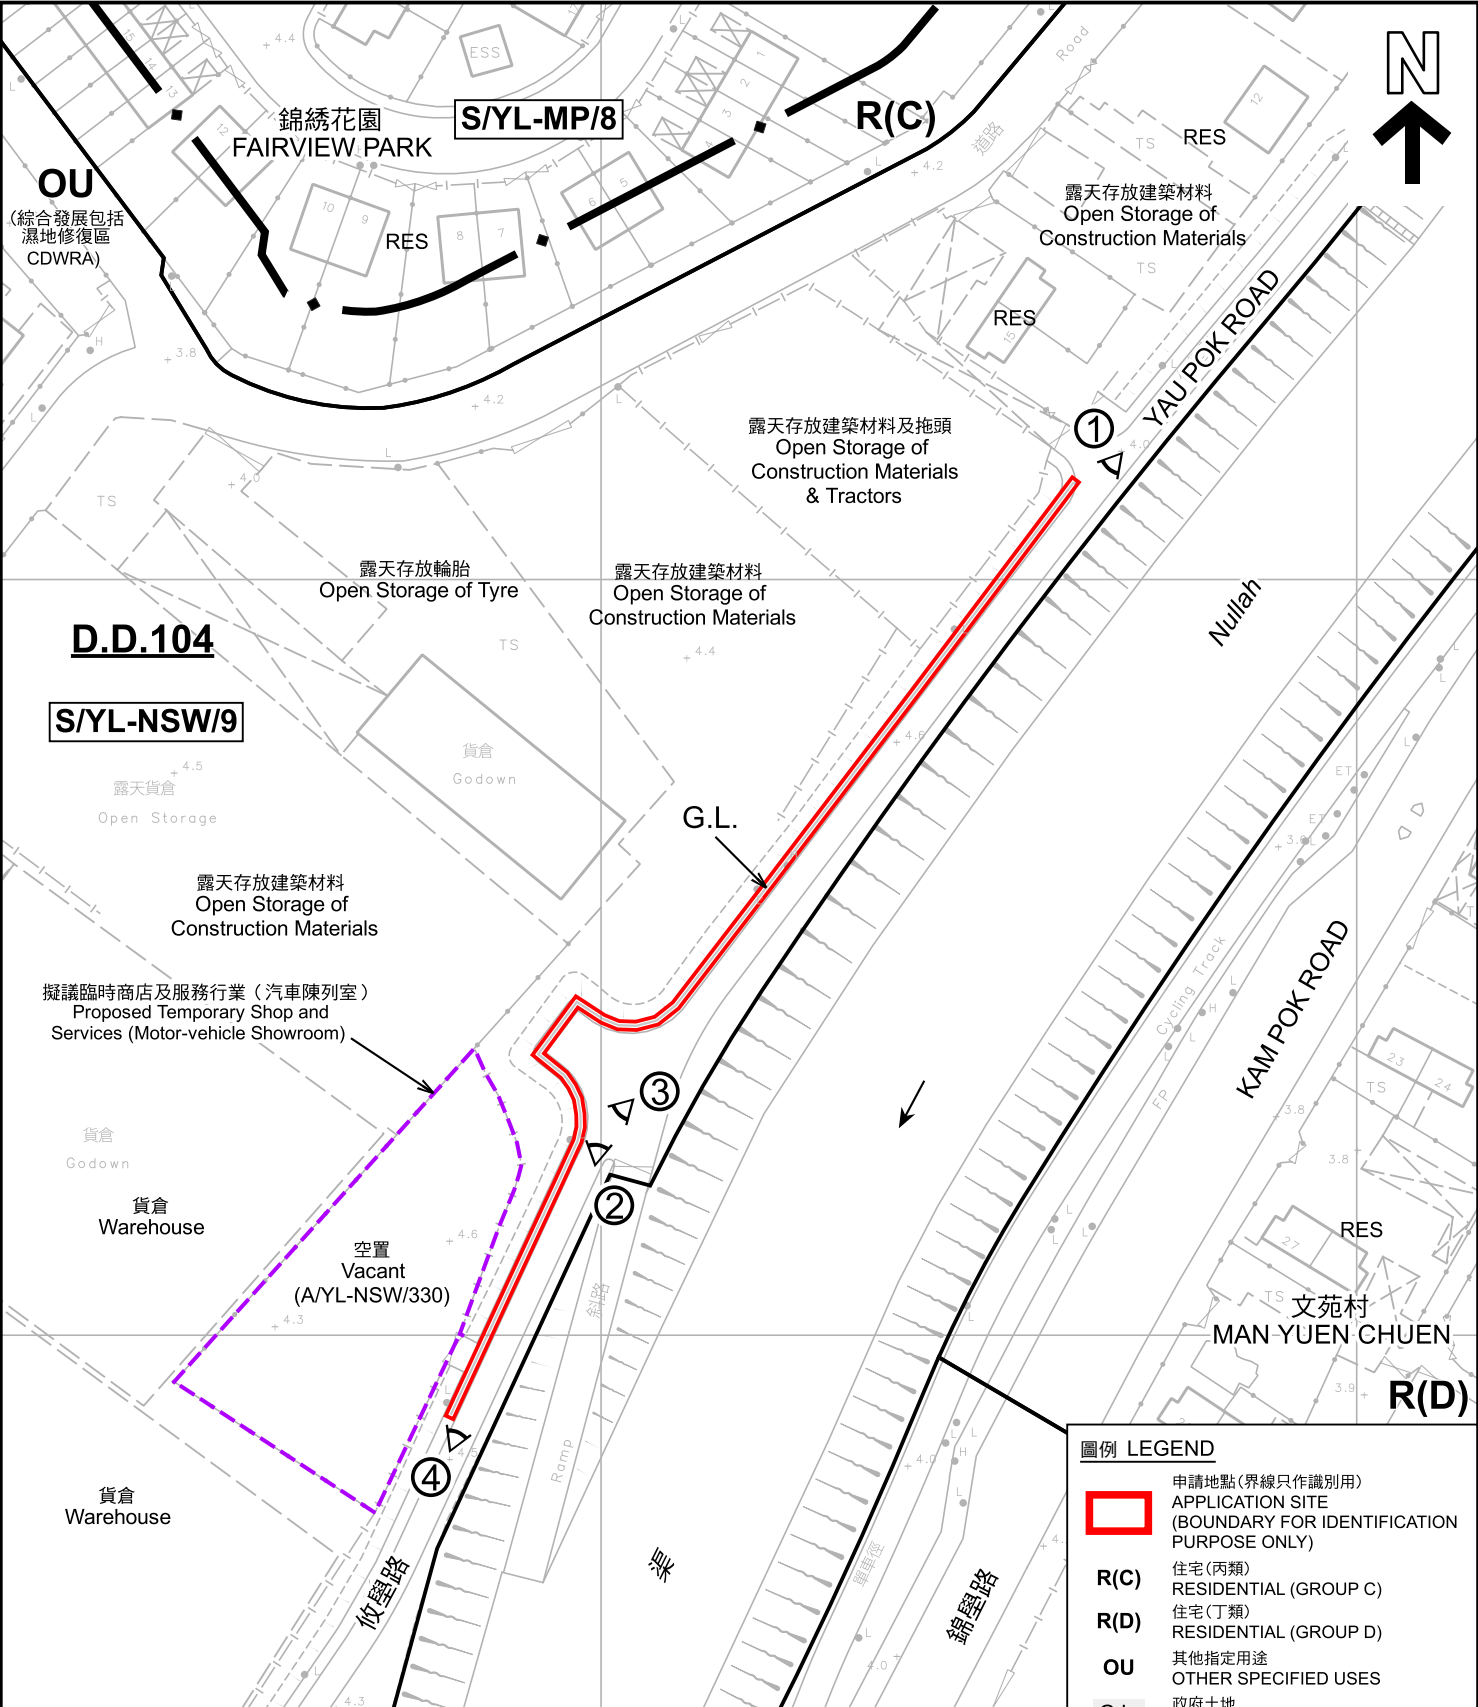

註釋 Notes :
2024年6月9日勘測的土地用途
Land uses shown on this plan are in accordance with the land use survey conducted by the Planning Department on 9.6.2024

圖例 LEGEND

申請地點(界線只作識別用)

APPLICATION SITE

(BOUNDARY FOR IDENTIFICATION

PURPOSE ONLY)

R(C)

住宅(丙類)

RESIDENTIAL (GROUP C)

R(D)

住宅(丁類)

RESIDENTIAL (GROUP D)

OU

其他指定用途

OTHER SPECIFIED USES

G.L.

政府土地

GOVERNMENT LAND

RES

住用構築物

RESIDENTIAL STRUCTURES

①

實地照片的觀景點

VIEWING POINT OF SITE PHOTO

本摘要圖於2024年9月19日擬備，
所根據的資料為測量圖編號2-SE-21A
EXTRACT PLAN PREPARED ON
19.9.2024 BASED ON SURVEY SHEET
No. 2-SE-21A

平面圖 SITE PLAN

擬議公用事業設施裝置(低壓地底電纜)和相關挖土及填土工程
元朗南生圍丈量約份第104約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(LOW VOLTAGE UNDERGROUND CABLE)
AND ASSOCIATED EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 104, NAM SANG WAI, YUEN LONG

SCALE 1:1 000 比例尺

米 METRES

20 0 20 40

米 METRES

規劃署
PLANNING
DEPARTMENT

參考編號
REFERENCE No.
A/YL-NSW/322

圖 PLAN


A-2



10

PLAN
A-3

1

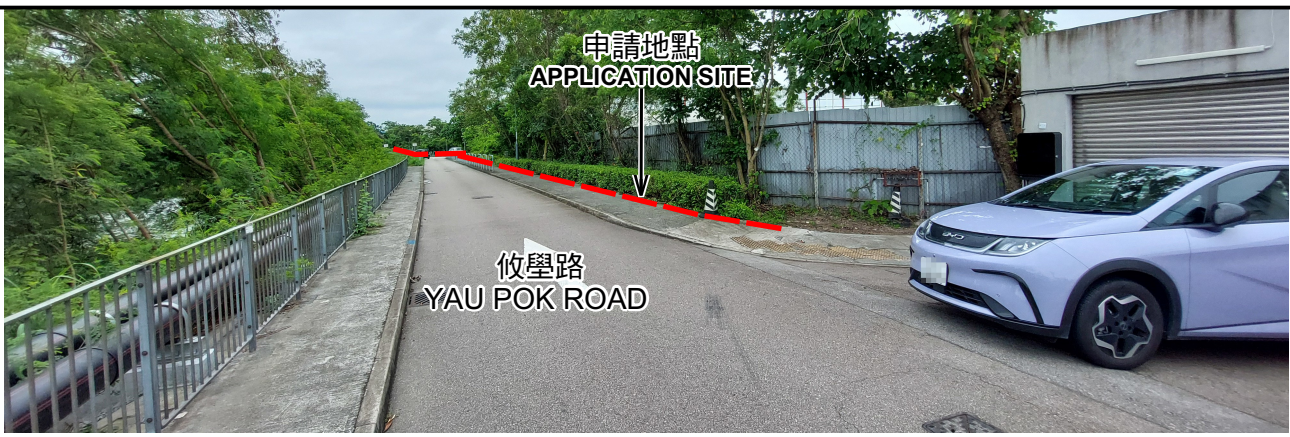


2



3



4

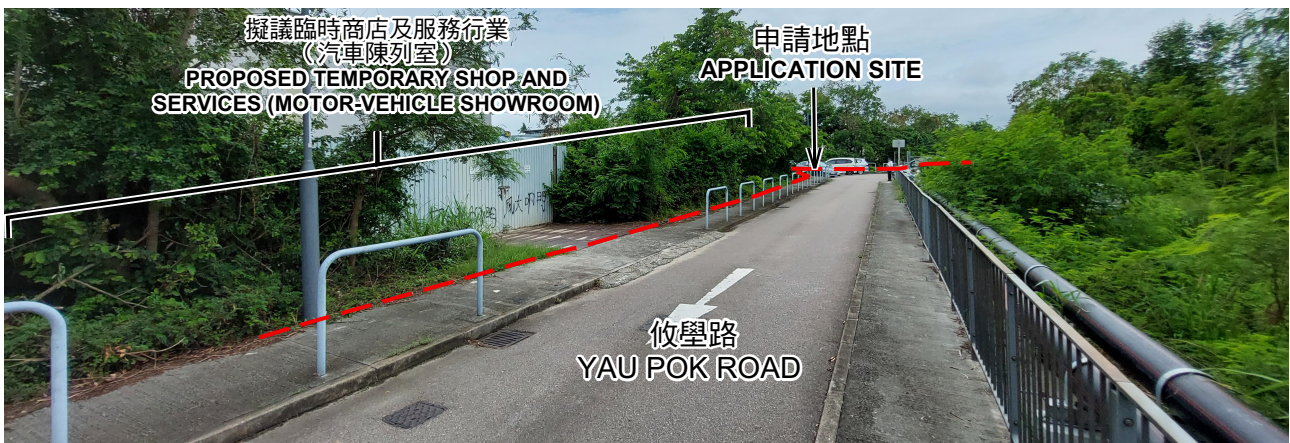

申請地點界線只作識別用 APPLICATION SITE BOUNDARY FOR IDENTIFICATION PURPOSE ONLY

實地照片 SITE PHOTOS

本圖於2024年9月19日擬備，所根據的資料為攝於2024年6月5日的實地照片
PLAN PREPARED ON 19.9.2024
BASED ON SITE PHOTOS
TAKEN ON 5.6.2024

擬議公用事業設施裝置（低壓地底電纜）和相關挖土及填土工程
元朗南生圍丈量約份第104約的政府土地
PROPOSED PUBLIC UTILITY INSTALLATION
(LOW VOLTAGE UNDERGROUND CABLE)
AND ASSOCIATED EXCAVATION AND FILLING OF LAND
GOVERNMENT LAND IN D.D. 104, NAM SANG WAI, YUEN LONG

規劃署
PLANNING
DEPARTMENT



參考編號
REFERENCE No.
A/YL-NSW/322

圖 PLAN
A-4